

Ten Year Power Plant Site Plan 2020 – 2029



FPL®



**Gulf
Power**®

(This page is intentionally left blank.)



FPL[®]



**Gulf
Power**[®]

Ten Year Power Plant Site Plan

2020-2029

Submitted To:

***Florida Public
Service Commission***

April 2020

(This page is intentionally left blank.)

Table of Contents

List of Figures, Tables, and Maps	iv
List of Schedules	vi
Overview of the Document	1
List of Abbreviations Used in Forms	3
Executive Summary	5
Chapter I. Description of Existing Resources	17
I.A. FPL System:	19
I.A.1. Description of Existing Resources	19
I.A.2. FPL - Owned Resources	19
I.A.3. FPL - Capacity and Energy Power Purchases	23
I.A.4. FPL - Demand Side Management (DSM).....	27
I.B. Gulf System:	30
I.B.1. Description of Existing Resources	30
I.B.2. Gulf - Owned Resources	30
I.B.3. Gulf - Capacity and Energy Power Purchases	34
I.B.4. Gulf - Demand Side Management (DSM)	38
Chapter II. Forecast of Electric Power Demand	41
II.A. Overview of the Load Forecasting Process	43
II.B. Customer Forecasts	44
II.C. Energy Sales Forecasts	45
II.D. Net Energy for Load (NEL)	51
II.E. System Peak Forecasts	52
II.F. Hourly Load Forecast	56
II.G. Uncertainty.....	56
II.H. DSM.....	57
Chapter III. Projection of Incremental Resource Additions	73
III.A. FPL's Resource Planning	75
III.B. Projected Incremental Resource Changes in the Resource Plan	85
III.C. Discussion of the Resource Plan and Issues Impacting Resource Planning Work	86
III.D. Demand Side Management (DSM)	93
III.E. Transmission Plan.....	98
III.F. Renewable Resources and Storage Technology	124
III.G. Fuel Mix and Fuel Price Forecasts.....	136
Chapter IV. Environmental and Land Use Information	223
IV.A. Protection of the Environment	225
IV.B. Environmental Organization Contributions	226

IV.C. Environmental Communication and Facilitation	227
IV.D. Environmental Policy	227
IV.E. Environmental Management	229
IV.F. Environmental Assurance Program	229
IV.G. Preferred and Potential Sites	230
IV.G.1. Preferred Sites	230
1. Preferred Site # 1 - Hibiscus Solar Energy Center, Palm Beach County.....	232
2. Preferred Site # 2 - Okeechobee Solar Energy Center, Okeechobee County	233
3. Preferred Site # 3 - Southfork Solar Energy Center, Manatee County.....	234
4. Preferred Site # 4 - Echo River Solar Energy Center, Suwannee County	235
5. Preferred Site # 5 - Lakeside Solar Energy Center, Okeechobee County.....	236
6. Preferred Site # 6 - Trailside Solar Energy Center, St. Johns County.....	237
7. Preferred Site # 7 - Union Springs Solar Energy Center, Union County	238
8. Preferred Site # 8 - Magnolia Springs Solar Energy Center, Clay County.....	239
9. Preferred Site # 9 - Egret Solar Energy Center, Baker County	240
10. Preferred Site # 10 - Nassau Solar Energy Center, Nassau County	241
11. Preferred Site # 11 - Pelican Solar Energy Center, St. Lucie County	242
12. Preferred Site # 12 - Palm Bay Solar Energy Center, Brevard County.....	243
13. Preferred Site # 13 - Discovery Solar Energy Center, Brevard County.....	244
14. Preferred Site # 14 - Orange Blossom Solar Energy Center, Indian River County	245
15. Preferred Site # 15 - Sabal Palm Solar Energy Center, Palm Beach County	246
16. Preferred Site # 16 - Fort Drum Solar Energy Center, Okeechobee County	247
17. Preferred Site # 17 - Rodeo Solar Energy Center, DeSoto County	248
18. Preferred Site # 18 - Willow Solar Energy Center, Manatee County.....	249
19. Preferred Site # 19 - Manatee Energy Storage Center, Manatee County	250
20. Preferred Site # 20 - Sunshine Gateway Energy Storage Center, Columbia County.....	251
21. Preferred Site # 21 - Echo River Energy Storage Center, Suwannee County.....	252
22. Preferred Site # 22 - Dania Beach Clean Energy Center Unit 7, Broward County	253
23. Preferred Site # 23 - Turkey Point Unit 6&7, Miami-Dade County.....	254
24. Preferred Site # 24 - Blue Springs Solar Energy Center, Jackson County	255

25. Preferred Site # 25 - Chautauqua Solar Energy Center, Walton County.....	256
26. Preferred Site # 26 – Crist Unit 8, Escambia County.....	257
IV.G.2 Potential Sites	258
27. FPL Area Potential Site # 1 - Elder Branch	259
28. FPL Area Potential Site # 2 - Everglades.....	260
29. FPL Area Potential Site # 3 - Ghost Orchid.....	261
30. FPL Area Potential Site # 4 - Sawgrass	262
31. FPL Area Potential Site # 5 - Sundew	263
32. FPL Area Potential Site # 6 - White Tail.....	264
33. Gulf Area Potential Site # 1 - Calhoun County.....	265
34. Gulf Area Potential Site # 2 - Calhoun County.....	266
35. Gulf Area Potential Site # 3 - Escambia County	267
36. Gulf Area Potential Site # 4 - Gadsden County.....	268
37. Gulf Area Potential Site # 5 - Jackson County.....	269
38. Gulf Area Potential Site # 6 - Okaloosa County.....	270
39. Gulf Area Potential Site # 7 - Santa Rosa County	271
Environmental and Land Use Information: Supplemental Information	272
Chapter V. Other Planning Assumptions & Information	415

List of Figures, Tables, and Maps

Table ES-1	Projected Capacity & Firm Purchase Power Additions and Changes	16
Figure I.A.2.1	FPL’s Generating Resources by Location (as of December 31, 2019)	20
Table I.A.2.1	FPL’s Capacity Resources by Unit Type (as of December 31, 2019)	21
Figure I.A.2.2	FPL Bulk Transmission System	22
Table I.A.3.1	FPL’s Purchased Power Resources by Contract (as of December 31, 2019).....	24
Table I.A.3.2	FPL’s Firm Purchased Power Summer MW	25
Table I.A.3.3	FPL’s Firm Purchased Power Winter MW.....	26
Figure I.B.2.1	Gulf Power Generating Resources by Location (as of December 31, 2019).....	31
Table I.B.2.1	Gulf Power Capacity Resources by Unit Type (as of December 31, 2019) ..	32
Figure I.B.2.2	Gulf Power Bulk Transmission System	33
Table I.B.3.1	Gulf Power Purchased Power Resources by Contract (as of December 31, 2019).....	35
Table I.B.3.2	Gulf Power Firm Purchased Power Summer MW	36
Table I.B.3.3	Gulf Power Firm Purchased Power Winter MW	37
Figure III.A.1	Overview of IRP Process: Fundamental Steps	76
Table III.E.1	List of Proposed Power Lines	98
Table III.F.1	List of FPL- & Gulf-Owned Solar Facilities Through April 2020	128
Table III.F.2	List of FPL Battery Storage Facilities	135
Table IV.C.1	2019 FPL Environmental Outreach Activities	227
Table IV.G.1	List of FPL & Gulf Preferred Sites	231
Table IV.G.2	List of FPL & Gulf Potential Sites	258
	Relationship of Regional Hydrogeologic Units to Major Stratigraphic Units.....	273
	Florida Regions Map.....	274
	Preferred Site # 1 – Hibiscus Solar Energy Center Maps.....	275
	Preferred Site # 2 – Okeechobee Solar Energy Center Maps	279
	Preferred Site # 3 – Southfork Solar Energy Center Maps.....	283
	Preferred Site # 4 – Echo River Solar Energy Center Maps.....	287

Preferred Site # 5 – Lakeside Solar Energy Center Maps	291
Preferred Site # 6 – Trailside Solar Energy Center Maps	295
Preferred Site # 7 – Union Springs Solar Energy Center Maps	299
Preferred Site # 8 – Magnolia Springs Solar Energy Center Maps.....	303
Preferred Site # 9 – Egret Solar Energy Center Maps	307
Preferred Site # 10 – Nassau Solar Energy Center Maps.....	311
Preferred Site # 11 – Pelican Solar Energy Center Maps	315
Preferred Site # 12 – Palm Bay Solar Energy Center Maps	319
Preferred Site # 13 – Discovery Solar Energy Center Maps	323
Preferred Site # 14 – Orange Blossom Solar Energy Center Maps.....	327
Preferred Site # 15 – Sabal Palm Solar Energy Center Maps	331
Preferred Site # 16 – Fort Drum Solar Energy Center Maps	335
Preferred Site # 17 – Rodeo Solar Energy Center Maps	339
Preferred Site # 18 – Willow Solar Energy Center Maps	343
Preferred Site # 19 – Manatee Energy Storage Center Maps.....	347
Preferred Site # 20 – Sunshine Gateway Energy Storage Center Maps	351
Preferred Site # 21 – Echo River Energy Storage Center Maps	355
Preferred Site # 22 – Dania Beach Clean Energy Center Unit 7 Maps	359
Preferred Site # 23 – Turkey Point Units 6&7 Maps.....	363
Preferred Site # 24 – Blue Springs Solar Energy Center Maps	367
Preferred Site # 25 – Chautauqua Solar Energy Center Maps.....	371
Preferred Site # 26 – Crist Unit 8 Maps	375
FPL Area Potential Site # 1 – Elder Branch Solar Energy Center Maps	379
FPL Area Potential Site # 2 – Everglades Solar Energy Center Maps	382
FPL Area Potential Site # 3 – Ghost Orchid Solar Energy Center Maps.....	385
FPL Area Potential Site # 4 – Sawgrass Solar Energy Center Maps.....	388
FPL Area Potential Site # 5 – Sundew Solar Energy Center Maps.....	391
FPL Area Potential Site # 6 – White Tail Solar Energy Center Maps.....	394
Gulf Area Potential Site # 1 & 2 – Calhoun County Maps	397
Gulf Area Potential Site # 3 – Escambia County Maps.....	400
Gulf Area Potential Site # 4 – Gadsden County Maps	403
Gulf Area Potential Site # 5 – Jackson County Maps	406
Gulf Area Potential Site # 6 – Okaloosa County Maps	409
Gulf Area Potential Site # 7 – Santa Rosa County Maps.....	412

List of Schedules

Schedule 1	FPL Existing Generating Facilities as of December 31, 2019	28
Schedule 1	Gulf Power Existing Generating Facilities as of December 31, 2019	39
Schedule 2.1	FPL and Gulf History of Energy Consumption & Number of Customers by Customer Class	59
Schedule 2.1	Forecast of Energy Consumption & Number of Customers by Customer Class	60
Schedule 2.2	FPL and Gulf History of Energy Consumption & Number of Customers by Customer Class (Continued)	61
Schedule 2.2	Forecast of Energy Consumption & Number of Customers by Customer Class (Continued)	62
Schedule 2.3	FPL and Gulf History of Energy Consumption & Number of Customers by Customer Class (Continued)	63
Schedule 2.3	Forecast of Energy Consumption & Number of Customers by Customer Class (Continued)	64
Schedule 3.1	FPL and Gulf History of Summer Peak Demand (MW)	65
Schedule 3.1	Forecast of Summer Peak Demand (MW)	66
Schedule 3.2	FPL and Gulf History of Winter Peak Demand (MW)	67
Schedule 3.2	Forecast of Winter Peak Demand (MW)	68
Schedule 3.3	FPL and Gulf History of Annual Net Energy for Load (GWh)	69
Schedule 3.3	Forecast of Annual Net Energy for Load (GWh)	70
Schedule 4	FPL Previous Year Actual and Two-Year Forecast of Total Peak Demand and Net Energy for Load (NEL) by Month	71
Schedule 4	Gulf Previous Year Actual and Two-Year Forecast of Total Peak Demand and Net Energy for Load (NEL) by Month	72
Schedule 5	Actual Fuel Requirements	147
Schedule 5	Forecasted Fuel Requirements	148
Schedule 6.1	Actual Energy Sources	149
Schedule 6.2	Actual Energy Sources % by Fuel Type	150
Schedule 6.1	Forecasted Energy Sources	151
Schedule 6.2	Forecasted Energy Sources % by Fuel Type	152

Schedule 7.1	Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak	153
Schedule 7.2	Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak	154
Schedule 8	Planned and Prospective Generating Facility Additions and Changes : FPL	155
Schedule 8	Planned and Prospective Generating Facility Additions and Changes : Gulf	157
Schedule 9	Status Report and Specifications of Proposed Generating Facilities	158
Schedule 10	Status Report and Specifications of Proposed Transmission Lines	193
Schedule 11.1	FPL Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type Actuals for the Year 2019... ..	218
Schedule 11.1	Gulf Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type Actuals for the Year 2019... ..	219
Schedule 11.2	FPL Existing Non-Firm Self-Service Renewable Generation Facilities Actuals for the Year 2019	220
Schedule 11.2	Gulf Existing Non-Firm Self-Service Renewable Generation Facilities Actuals for the Year 2019	221

(This page is intentionally left blank.)

Overview of the Document

Chapter 186, Florida Statutes, requires that each electric utility in the State of Florida with a minimum existing generating capacity of 250 megawatts (MW) must annually submit a Ten Year Power Plant Site Plan (Site Plan). This Site Plan should include an estimate of the utility's future electric power generating needs, a projection of how these estimated generating needs could be met, and disclosure of information pertaining to the utility's Preferred and Potential power plant sites. The information contained in this Site Plan is compiled and presented in accordance with Rules 25-22.070, 25-22.071, and 25-22.072, Florida Administrative Code (F.A.C.).

Site Plans are long-term planning documents and should be viewed in this context. A Site Plan contains uncertain forecasts and tentative planning information. Forecasts evolve, and all planning information is subject to change, at the discretion of the utility. Much of the data submitted is preliminary in nature and is presented in a general manner. Specific and detailed data will be submitted as part of the Florida site certification process, or through other proceedings and filings, at the appropriate time.

This Site Plan document addresses both Florida Power & Light Company (FPL) and Gulf Power Company (Gulf). NextEra Energy, the parent company of FPL, acquired Gulf in January 2019. As a result, resource planning for both FPL and Gulf are now performed by FPL's resource planning group. The information presented in this Site Plan is based on integrated resource planning (IRP) analyses that were carried out in 2019 and that were on-going in the first Quarter of 2020. The forecasted information presented in this plan addresses the years 2020 through 2029.

This document is organized in the following manner:

Chapter I – Description of Existing Resources

This chapter provides an overview of FPL's and Gulf's current generating facilities. Also included is information on other FPL and Gulf resources including purchased power, demand side management (DSM), and FPL's and Gulf's transmission system.

Chapter II – Forecast of Electric Power Demand

The load forecasting methodology utilized for both FPL and Gulf, and the resulting forecast of seasonal peaks and annual energy usage, are presented in Chapter II. Included in this discussion is the projected significant impact of federal and state energy-efficiency codes and standards.

Chapter III – Projection of Incremental Resource Additions

This chapter discusses the integrated resource planning (IRP) process and presents currently projected resource additions in both the FPL and Gulf areas. This chapter also discusses a number of factors or issues that either have changed, or may change, the resource plan presented in this Site Plan. Furthermore, this chapter also discusses previous and planned DSM efforts, the projected significant impact of state/federal energy-efficiency codes and standards, previous and planned renewable energy efforts, projected transmission additions, and the fuel cost forecasting processes.

Chapter IV – Environmental and Land Use Information

This chapter discusses environmental information as well as Preferred and Potential Site locations for additional electric generation facilities in both FPL and Gulf areas.

Chapter V – Other Planning Assumptions and Information

This chapter addresses twelve (12) “discussion items” which pertain to additional information that is included in a Site Plan filing.

**List of Abbreviations
Used in Forms**

Reference	Abbreviation	Definition
Unit Type	BS	Battery Storage
	CC	Combined Cycle
	CT	Combustion Turbine
	GT	Gas Turbine
	PV	Photovoltaic
	ST	Steam Unit (Fossil or Nuclear)
Fuel Type	BIT	Bituminous Coal
	FO2	#1, #2 or Kerosene Oil (Distillate)
	FO6	#4,#5,#6 Oil (Heavy)
	NG	Natural Gas
	No	None
	NUC	Uranium
	Pet	Petroleum Coke
	Solar	Solar Energy
	SUB	Sub Bituminous Coal
	ULSD	Ultra - Low Sulfur Distillate
Fuel Transportation	No	None
	PL	Pipeline
	RR	Railroad
	TK	Truck
	WA	Water
Unit/Site Status	L	Regulatory approval pending. Not under construction
	OP	Operating Unit
	OT	Other
	P	Planned Unit
	RT	Retired
	T	Regulatory approval received but not under construction
	U	Under construction, less than or equal to 50% Complete
	V	Under construction, more than 50% Complete
Other	ESP	Electrostatic Precipitators
	K Factor	The K factor for the capital costs of a given unit is the cumulative present value of revenue requirements (CPVRR) divided by the total installed cost
	ST	Solar Together
	SoBRA	Solar Rate Base Adjustment

(This page is intentionally left blank.)

Executive Summary

This Ten-Year Site Plan (Site Plan) document addresses the projected electric power generating resource additions and retirements for the years 2020 through 2029 for both Florida Power & Light Company (FPL) and Gulf Power Company (Gulf).

On January 1, 2019, Gulf became a subsidiary of NextEra Energy, Inc. which also owns FPL. Prior to this transaction, resource planning analyses for Gulf were performed by Southern Company Services. Among other things, such planning was based on Gulf remaining a part of the Southern Company system. Starting in January 2019, these planning services have been, and will continue to be, performed for both companies by FPL's resource planning group.

NextEra Energy's plan is to integrate FPL and Gulf into a single electric operating system effective on January 1, 2022 after the completion of a new 161 kV transmission line (the North Florida Resiliency Connection line) that will enhance the electrical connection between the two systems. This enhanced connection will benefit customers in both systems by better enabling the siting of clean, reliable, low cost generation, and the transmission of energy from those facilities, to all customers. Consequently, the resource planning work during 2019 and early 2020 that is discussed in this Site Plan has largely focused on developing a resource plan for the single integrated system. However, because this Site Plan addresses two years (2020 and 2021) prior to the scheduled electrical integration of the two systems, a number of schedules and tables will show information for the separate systems for those two years. All information presented for the years 2022 through 2029 is for the single integrated system.¹

This 2020 Site Plan presents the current plans to augment and enhance the electric generation capability of FPL and Gulf as part of efforts to cleanly, reliably, and cost-effectively meet projected incremental resource needs for 2020 through 2029. FPL already has one of the cleanest emission profiles of any electric utility in the U.S. In 2019, FPL delivered approximately 98% of its energy from a combination of low-emission natural gas, zero-emission nuclear, and zero-emission solar. With the resource additions presented in this Site Plan (which include solar additions consistent with FPL's announced plan to add more than 30 million solar panels by 2030), plus the planned retirement of FPL's ownership portion of a large coal-fueled generating unit, the emission profile of FPL's fleet of generating units is projected to become even cleaner.

¹ In this document, the separate companies will be referred to as FPL and Gulf for the years 2020 and 2021, and the single operating system will be referred to as FPL for the years 2022 through 2029. Likewise, the term "system" is generally used to discuss the separate FPL and Gulf systems for the years 2020 and 2021, and the term "area" is generally used to discuss the FPL and Gulf geographic areas for the years 2022 through 2029.

Although Gulf receives energy from several power purchase agreements that are either solar- or wind-based, the emission profile for Gulf's generation fleet is currently not as good as FPL's. However, this Site Plan describes a number of planned changes regarding generating units in the Gulf area that will significantly improve its emission profile. These planned changes include, but are not limited to, the addition of new solar facilities, enhancing the generation capability of an existing large gas-fueled combined cycle (CC) unit, the conversion of two generating units from coal-fueled to natural gas-fueled, and the retirement of Gulf's ownership portion of two other coal-fueled generating units.

As a result, after accounting for these planned changes to generating units in both FPL's and Gulf's areas, the clean energy percentage for the larger integrated FPL and Gulf utility system is projected to climb to approximately 99% by the end of the 10-year reporting period of this Site Plan.

Furthermore, there is a projected significant increase in the percentage of energy that will be delivered from zero-emission energy sources (solar, wind, and nuclear) over this 10-year reporting period. This is due to a projected significant increased contribution from zero-emission solar over these 10 years while the projected contributions from zero-emission wind and nuclear are projected to remain essentially unchanged.

In 2019, the percentage of the total energy delivered to all customers from both FPL and Gulf that was from zero-emission sources was approximately 22%. By 2029, the last year of the 10-year reporting period addressed in this document, the percentage of the total energy delivered to all customers for the single integrated system from zero-emission sources, including new solar facilities that are associated with FPL's Solar Together program², is projected to increase to approximately 37% which represents a 68% increase from 2019. This increase in the percentage of energy that is projected to be delivered by zero-emission sources is significant for a utility system of this size, especially when considering that the total amount of energy projected to be delivered to customers in 2029 will have also increased. The projections of energy by fuel/generation type are presented in Schedules 6.1 and 6.2 in Chapter III.

By design, the primary focus of this document is on projected supply side additions; *i.e.*, electric generation capability and the sites for these additions. The supply side additions discussed herein are resources projected to be needed after accounting for FPL's and Gulf's demand side management (DSM) resource capabilities and additions. In 2019, the Florida Public Service Commission (FPSC) established DSM Goals for the years 2020 through 2024 for a number of Florida utilities, including FPL and Gulf. Throughout this document, the analysis results discussed are based on an assumption that both companies will meet their respective DSM Goals in regard to Summer MW reduction, Winter MW

² In the Solar Together community solar program, participating customers share in the costs and benefits of a dedicated FPL Solar Together PV facility and are entitled, upon their request, to have the environmental attributes associated with their participation retired by FPL on their behalf.

reduction, and annual energy (MWh) reduction through the end of 2024. In addition, further DSM reductions for the years 2025 through 2029 are assumed. DSM is discussed in more detail in Chapters I, II, and III.

Additionally, load forecasts for both FPL and Gulf account for a very large amount of energy efficiency that results from federal and state energy-efficiency codes and standards. The projected impacts of these energy-efficiency codes and standards are discussed later in this summary and in Chapters II and III.

The projected resources, including resource additions and retirements, are summarized in Section I below. In addition, there are a number of factors that either have influenced, or may influence, ongoing resource planning efforts. These factors could result in different resources being added in the future than those presented in this docket. These factors are discussed below in Section II. Additional information regarding the topics is presented in Chapter III.

I. Summary of Projected Resources:

A summary of the projected resources, including resource additions and retirements, in both the FPL and Gulf areas is presented below. This discussion is presented in terms of the various types of resource options (solar, etc.) in the resource plan.

Solar:

At the end of 2019, FPL had a total of approximately 1,228 MW³ of total solar generation on its system. All of this solar is from FPL-owned solar facilities. Of this total, approximately 1,153 MW is from photovoltaic (PV) facilities and 75 MW are from a solar thermal facility. Also, at the end of 2019, Gulf had a total of 120 MW of solar that is delivered from three PV sites under three power purchase agreements (PPAs).

On November 18, 2019, the FPSC approved (Order No. PSC-2019-0484-FOF-EI) four additional PV facilities for FPL under the SoBRA (Solar Base Rate Adjustment) provision from the 2016 FPL Settlement Agreement (Order No. PSC-2016-0560-AS-EI). Each of these four PV facilities will be 74.5 MW and are scheduled to be in commercial operation in 2020.

This resource plan projects a significant increase in solar (PV) resources during the 10-year reporting period. Approximately 8,860 MW of additional PV generation is projected to be added in the 2020

³ Each reference to PV capacity in this Site Plan reflects the nameplate rating, AC, unless noted otherwise.

through 2029 time period with approximately 7,300 MW sited in FPL's area and approximately 1,560 MW sited in Gulf's area. These additional PV facilities are projected to be 74.5 MW each. Approximately 1,500 MW of the 7,300 MW of PV projected to be sited in FPL's area is projected to come from FPL's new Solar Together program which was approved by the FPSC on March 3, 2020.

When combining these projected solar additions with the approximately 1,150 MW of solar PV already installed on FPL's system at the end of 2019, the projected total of solar PV for the single integrated utility by the end of 2029 is slightly more than 10,000 MW. This planned solar implementation schedule is consistent with FPL's January 2019 announcement of its "30-by-30" plan in which FPL stated an objective to install more than 30 million solar panels on FPL's system by the year 2030.

This amount of cumulative solar is based on current projections that these solar additions will be cost-effective for FPL's customers. FPL's resource planning work in 2020 and beyond will continue to analyze the projected system economics of solar.⁴

Battery Storage:

In FPL's 2019 Site Plan, the projection was for approximately 469 MW of battery storage to be added in late 2021 with the majority of this battery storage capability projected to be installed in Manatee County as part of the plan to retire the two Manatee steam generating units. These 469 MW of battery storage are also included in this 2020 Site Plan. It is now projected that 409 MW of battery storage will be sited at Manatee as part of this plant retirement effort by late 2021. This battery storage facility will be charged by solar energy from an existing nearby PV facility. The remaining 60 MW of battery storage will be divided into two 30 MW battery storage facilities that will be installed at two different locations in FPL's service area in late 2021. Both of these battery storage facilities will also be charged by existing solar facilities. In addition, the resource plan presented in this Site Plan projects an additional approximately 700 MW of battery storage facilities by 2029 with all of these storage facilities currently projected to be sited in Gulf's area.

FPL continues to analyze other opportunities to utilize battery storage systems, including combining battery storage with new or existing PV facilities. FPL is also evaluating a number of other battery storage applications to gauge the potential for such applications to be beneficial for FPL's customers

⁴ System economics of future solar and natural gas-fueled generation will depend upon a number of factors other than future PV costs, including, but not necessarily limited to: natural gas costs, environmental compliance costs, potential technology improvements regarding cost and/or efficiency of both solar and natural gas-fueled generation, and potential system impacts of increasing amounts of solar.

if/when projected cost declines occur. Some of these potential applications are being examined through FPL's 50 MW Battery Storage Pilot Project that is discussed in Chapter III.

Modernization of Non-Renewable Generation:

For a number of years, FPL has undertaken a program to modernize its non-renewable generating units based on cost-effectiveness. These efforts have substantially improved system fuel efficiency and increased capacity while also reducing system air emission rates (including greenhouse gas emission rates) and reducing fuel and other costs for FPL's customers. The plan is to continue this program in both FPL and Gulf areas to further improve the efficiency and capabilities of the fossil-fueled generation fleet in 2020 and beyond through three principal initiatives: (i) retirement of existing generating units that are no longer economic to operate, (ii) enhancements to existing generating units, and (iii) addition of cost-effective new gas-fired generation as appropriate. These three modernization efforts are separately described below.

(i) Retirement of Existing Generating Units That Are No Longer Economic to Operate:

In its 2019 Site Plan, FPL discussed plans to retire two additional steam generating units (Manatee Units 1 & 2) and two older CC units (Lauderdale Units 4 & 5). Similar to two recently retired units at the Martin plant site, each of the Manatee units is approximately 800 MW and the units have become relatively inefficient compared to current generation technology. As a result, FPL's 2019 Site Plan projected that these units would be retired in late 2021. As previously mentioned, a 409 MW battery storage facility will be installed in Manatee County by late 2021 to partially offset the loss of generation in the Manatee area from the retirement of Manatee Units 1 & 2.

The retirement of the Lauderdale Units 4 & 5 has occurred, and these retirements are part of the modernization of FPL's existing Lauderdale power plant site. These two older CC units were each 442 MW units (for a total capacity of approximately 884 MW) that resulted from a repowering project approximately 25 years ago – but which contained certain now-outdated plant components, including the steam turbine, that dated back to the 1950s. These two units will be replaced with a new, modern CC unit that is discussed below. The FPSC voted unanimously to approve this modernization on March 1, 2018. (FPSC Order No. PSC-2018-0150-FOF-EI issued March 19, 2018). The FPSC based its approval on projections of significant economic savings for FPL's customers; enhanced reliability for both the FPL system and the Southeastern Florida region (Miami-Dade and Broward counties) of FPL's service territory; reduced use of natural gas system-wide; and reduced system emissions of sulfur dioxide (SO₂), nitrogen oxides (NO_x), and carbon dioxide (CO₂). The Governor and Cabinet, serving as the Power Plant Siting Board, issued a Final Order approving certification of the project on December

13, 2018. Subsequently, the former Fort Lauderdale Units 4 & 5 were retired, and the dismantlement of those facilities has been completed. Construction of the new CC unit, named the Dania Beach Clean Energy Center Unit 7 (Dania Beach), is underway.

The current resource plan presented in this Site Plan continues to account for the retirements of the Manatee units and the new CC unit at the Lauderdale site. In addition, the current resource plan projects the planned early retirements of four coal-fueled generating units. First, the 330 MW power purchase agreement with Indiantown Cogen L.P. is projected to end, along with the retirement of the associated coal-fueled generating unit, in the 4th Quarter of 2020. Second, the retirement of FPL's ownership portion (approximately 76%) of the coal-fueled Scherer Unit 4 unit in Georgia is planned by January 2022. FPL's ownership portion of this unit is approximately 630 MW. Additionally, an early retirement of Gulf's ownership portion (50%) of two coal-fueled steam units by January 2024 is also planned. These units, Daniels Units 1 & 2, are located in the Mississippi Power service territory and Gulf's ownership portion of the two units totals approximately 510 MW.

(ii) Enhancements to Existing Generating Units:

In its 2019 Site Plan, FPL discussed plans to upgrade the combustion turbine (CT) components in a number of FPL's existing CC units. That upgrade effort is still included in the resource plan presented in this Site Plan. An additional multi-year upgrade effort is also now planned. These additional upgrades are projected to be completed in 2026 and will address CC units in both FPL's and Gulf's areas. The upgrades are projected to result in a total increased Summer capacity of approximately 600 MW as well as improved heat rates for each upgraded CC unit. Information regarding the specific units, timing, and magnitude of these upgrades is presented in Schedule 8 in Chapter III.

Two significant enhancements to existing generating units in the Gulf area are also included in the resource plan presented in this Site Plan. The first of those is the conversion of Crist Units 6 & 7 from coal-fueled to natural gas-fueled. This conversion effort is already underway and is scheduled to be completed before the end of 2020. This enhancement will result in both lower cost energy generated by the units and in significant fixed cost savings for Gulf area customers. The second enhancement is a pair of capacity upgrades to the Lansing Smith Unit 3. The installation phase of the first upgrade of this existing CC unit was completed in 2019 which will be followed by testing and tuning in the Spring of 2020. This upgrade is projected to increase the firm capacity of the unit by more than 80 MW. A second upgrade of the unit is planned for 2024 which is projected to increase unit capacity by another approximately 59 MW. Both upgrades in this second enhancement will also result in cost savings for Gulf area customers through both the deferral of future capacity needs and by increased output of lower cost natural gas-fueled energy production.

(iii) Addition of Cost-Effective Natural Gas-Fueled Generation:

In its 2019 Site Plan, FPL's resource plan projected the addition of three new CC units with one each being added in 2019, 2022, and 2026. Gulf's 2019 Site Plan projected the addition of a single new CC unit in 2024.

The first of the three FPL projected CC units was the Okeechobee Clean Energy Center unit which became operational on FPL's system in 2019. This new CC unit supplies approximately 1,778 MW of firm capacity that can be delivered around the clock. The second of these is the previously mentioned Dania Beach CC unit that will come in-service in 2022. This unit is a key component of the modernization of FPL's existing Lauderdale power plant site as discussed above. The third CC projected in FPL's 2019 Site Plan was a new CC unit being added in 2026 at an as-yet-to-be-determined site. Gulf's 2019 Site Plan projected a single new CC unit to be added at its Escambia site in 2024.

The resource plan presented in this 2020 Site Plan continues to show the new Dania Beach CC unit coming in-service in 2022. However, neither the other CC unit previously projected in FPL's area for 2026, nor the Escambia CC unit in Gulf's area previously projected for 2024, remain in the current resource plan. However, four new CT units at the existing Crist plant site in Gulf's area are now part of the resource plan. These new CT units are being added based on system economics and for purposes of ensuring adequate fast-start operating reserves in Gulf's area.

Nuclear energy:

Nuclear energy remains an important factor in FPL's resource planning. Since June 2009, FPL has worked to secure from the federal Nuclear Regulatory Commission (NRC) Combined Operating Licenses (COL) for two future nuclear units, Turkey Point Units 6 & 7, that would be sited at FPL's Turkey Point site (the location of two existing nuclear generating units). In April 2018, FPL received NRC approval for these two COLs. These licenses remain valid for approximately 20 years. At this time, FPL has paused regarding a decision whether to seek FPSC approval to move forward with construction of the new nuclear units. FPL intends to incorporate into that decision the construction experience of the nuclear units currently under construction by Georgia Power at its Vogtle site and similar units being developed in China. As a result, and similar to the case with FPL's 2019 Site Plan, the earliest possible in-service dates for Turkey Point 6 & 7 are beyond the 10-year time period addressed in this 2020 Site Plan.

In addition, on January 30, 2018, FPL applied to the NRC for Subsequent License Renewal (SLR) for FPL's existing Turkey Point Units 3 & 4. The previous license terms for these two existing nuclear units extended into the years 2032 and 2033, respectively. The SLR requested approval to extend the operating licenses by 20 years to 2052 and 2053, respectively. The NRC granted approval for the SLR in December 2019. Consequently, FPL's resource plans include the continued operation of Turkey Point Units 3 & 4 out in time to those new license termination dates.

For these reasons, this Site Plan continues to present the Turkey Point location as a Preferred Site for nuclear generation as indicated in Chapter III.

II. Other Factors That Have Influenced, or Could Further Influence, the Current Resource Plan:

There are a number of factors that have influenced, or which may influence, the resource plan presented in this 2020 Site Plan. Six such factors are summarized below and are presented in no particular order. These factors and/or their potential influences on the resource plan presented in this Site Plan are further discussed in Chapters II and III.

Factor # 1: The critical need to maintain a balance between load and generating capacity in Southeastern Florida (Miami-Dade and Broward counties). This balance has both reliability and economic implications for FPL's system and customers and it is a key reason that FPL sought and obtained an affirmative need determination decision from the FPSC for the Lauderdale modernization described above.

Factor # 2: The desire to maintain/enhance fuel diversity in the FPL system while considering system economics. Diversity is sought in terms of the types of fuel that FPL utilizes and how these fuels are transported to the locations of FPL's generation units. These fuel diversity objectives are considered in light of economic impacts to FPL's customers. For example, FPL is cost-effectively adding significant amounts of PV generation throughout the 10-year reporting period of this document. These PV additions enhance fuel diversity. At the same time, FPL is retiring coal generation and older, fuel-inefficient oil- or gas-fueled generation because these generating units are no longer cost-effective for FPL's customers. In addition, FPL also seeks to further enhance the efficiency with which it uses natural gas to generate electricity.

Factor # 3: The need to maintain an appropriate balance of DSM and supply resources from the perspectives of both system reliability and operations. FPL addresses this through the use of a 10% generation-only reserve margin (GRM) reliability criterion to complement its other two reliability criteria:

a 20% total reserve margin criterion for Summer and Winter, and an annual 0.1 day/year loss-of-load-probability (LOLP) criterion. Together, these three criteria allow FPL to address this specific concern regarding system reliability and operations in a comprehensive manner.

Factor # 4: The significant impact of federal and state energy-efficiency codes and standards. The incremental impacts of these energy-efficiency codes and standards, from a beginning year 2020 starting point through the year 2029, are projected to have significant impacts by reducing forecasted Summer and Winter peak loads, and by reducing annual net energy for load (NEL), in both the FPL and Gulf areas. In addition, energy-efficiency codes and standards significantly reduce the potential for cost-effective energy efficiency that might otherwise have been obtained through utility DSM programs. The projected impacts of these energy efficiency codes and standards are discussed in more detail in Chapter II.

Factor # 5: The trends of decreasing costs for fuel, decreasing costs for new generating units, and increasing fuel efficiency of new generating units. There are a number of factors that drive utility system costs. Three of the most important of these are: (i) forecasted natural gas costs, (ii) projected costs for new generating units, and (iii) the efficiency with which generating units convert fuel into electricity. When comparing FPL's forecasts of these factors over at least the last 5 years, the trends for each of these factors is in a direction that results in lower system costs for FPL's customers. For example, when comparing FPL's 2015 forecasted cost for natural gas for the year 2020 with the current (2020) forecasted cost for 2020, there has been more than a 55% decrease in natural gas costs. An even greater reduction in CO₂ compliance costs for 2020 occurred between the 2015 and current forecast. In addition, in regard to the fuel efficiency of FPL's generating units, the amount of natural gas (measured in mmBTU of natural gas needed to produce a kWh of electricity) declined from 7,376 in 2015 to approximately 6,752 today. This improvement in fuel efficiency is truly significant, especially when considering the approximately 20,000 MW of gas-fueled generation on FPL's system.

These trends of steadily lowering of key components of utility system costs are very beneficial to a utility's customers because they help to lower electric rates.⁵

Factor # 6: Projected changes in CO₂ regulation and associated compliance costs. Since 2007, FPL has evaluated potential carbon dioxide (CO₂) regulation and/or legislation and has included projected compliance costs for CO₂ emissions in its resource planning work. However, there always has been an unavoidable level of uncertainty regarding the timing and magnitude of the cost impacts of the potential regulation/legislation. The forecast of potential CO₂ compliance costs that FPL used in its 2019 resource

⁵ However, because the potential benefits of utility DSM programs are based on DSM's ability to avoid certain system costs, the trend of steadily decreasing utility system costs automatically results in a significant lowering of the cost-effectiveness of utility DSM programs.

planning work was lower than forecasts that had been used in prior years. In 2020, the forecasted compliance costs are somewhat higher than projected in 2019, but remain lower than projections from a decade before. Projected lower compliance costs are due to a number of factors projected for the Southeastern region of the U.S., including Florida. These factors include at least the following: lower forecasted growth rates in electricity usage; lower forecasted costs of natural gas; retirements of existing coal units; and increasing implementation of renewable energy sources including solar.

Each of these factors will continue to be examined by FPL's resource planning group in its ongoing resource planning work in 2020 and future years.

III. A Summary of Projected Resource Changes for FPL and Gulf:

The resource plan presented in this 2020 Site Plan was developed based on considerations of projected system reliability, projected system economics, and other factors such as those discussed immediately above. Major changes in resources currently projected as part of this resource plan for the years 2020 through 2029 for both FPL and Gulf are summarized in Table ES-1. The changes are presented in terms of Summer firm capacity values.

Although this particular table does not specifically identify the impacts of projected DSM on resource needs and the resource plan, the projected DSM additions reflected in the resource plan presented in Table ES-1, and throughout this Site Plan, are consistent with the 2020 through 2024 DSM Goals set for FPL and Gulf (Order No. PSC-2019-0509-FOF-EG) in 2019 by the FPSC. The specific impacts of those DSM Goals through 2024, and of projected additional DSM impacts for 2025 through 2029, are shown in Schedules 3.1, 3.2, and 3.3.

A summary of some of the larger resource additions/retirements for both systems/areas include, but are not necessarily limited to, those listed below (in approximate chronological order):

For FPL's system/area:

- New solar (PV) additions from 2020 through 2029 of approximately 7,300 MW;
- Capacity upgrades at a number of FPL's existing CC units through 2026;
- Retirement of FPL's ownership portion (approximately 630 MW) of the Scherer 4 coal unit by January 2022;
- A 409 MW battery storage facility at the Manatee plant site, plus two 30 MW battery storage facilities at different sites, by the beginning of 2022; and,
- The modernization of the existing Lauderdale power plant site in mid-2022 with the new DBEC CC Unit 7.

For Gulf's system/area:

- New solar (PV) additions from 2020 through 2024 of approximately 1,560 MW;
- Capacity upgrades (two) of the existing Lansing Smith Unit 3 CC, with installation for the first upgrade completed in 2019 with testing and tuning in the Spring of 2020, then a planned second upgrade in 2024;
- Conversion from coal-fueled to natural gas-fueled of Crist Units 6 & 7 in 2020;
- A new FPL-to-Gulf transmission line by the beginning of 2022 enabling a bidirectional transfer capability between the two areas of 850 MW;
- Four new CTs at the Crist plant site by the beginning of 2022
- Expiration (as per the contract) of 885 MW from the Shell PPA in May, 2023;
- The retirement of Gulf's ownership portion of the coal-fueled Daniels Units 1 & 2 by the beginning of 2024; and,
- A total of approximately 700 MW of battery storage in 2028 and 2029.

It is noted that no final decisions are needed at this time, nor have such decisions yet been made, regarding some of the resource additions shown in this 2020 Site Plan. This is particularly relevant to resource additions shown for years increasingly further out in time in the 2020 through 2029 time period. Consequently, those resource additions are more prone to future change.

Table ES-1: Projected Capacity & Firm Purchase Power Additions and Changes:

Year ^{1/}	Projected Capacity & Firm Purchase Power Changes	FPL Summer MW (Approx.)	Gulf Summer MW (Approx.)	Date	Summer Reserve Margin ^{2/}
FPL					
2020	Solar PV ^{3/} (All solar facilities in-service January of 2020)	248		First Quarter 2020	
	SoBRA PV ^{3/}	165		Second Quarter 2020	
	Sanford 4	147		Second Quarter 2020	
	Total of MW changes to Summer firm capacity:	560			21.2%
2021	West County 3	21		Third Quarter 2020	
	Turkey Point 4	20		Fourth Quarter 2020	
	Solar PV ^{3/}	539		First Quarter 2021	
	Solar Degradation ^{4/}	(3)			
	Total of MW changes to Summer firm capacity:	577			21.6%
Gulf					
2020	Solar PV ^{3/} (Solar facility in-service April 1 st of 2020)		41	Fourth Quarter 2020	
	Total of MW changes to Summer firm capacity:		41		39.5%
2021					
	Total of MW changes to Summer firm capacity:		0		38.1%
Integrated FPL and Gulf					
2022	Manatee 1 and 2 Retirement	(1,618)		Fourth Quarter 2021	
	Scherer 4 Retirement	(634)		Fourth Quarter 2021	
	Manatee Energy Storage	409		Fourth Quarter 2021	
	Sunshine Gateway Energy Storage	30		Fourth Quarter 2021	
	Echo River Energy Storage	30		Fourth Quarter 2021	
	4X0 Crist CT's		938	Fourth Quarter 2021	
	Blue Springs PV ^{3/}		37	Fourth Quarter 2021	
	Chautauqua PV ^{3/}		37	Fourth Quarter 2021	
	Solar PV ^{3/}		224	First Quarter 2022	
	Fort Myers 2 Upgrade	40		Second Quarter 2022	
	Dania Beach Clean Energy Center Unit 7	1,163		Second Quarter 2022	
	Solar Degradation ^{4/}	(5)			
	Total of MW changes to Summer firm capacity:	(585)	1,237		26.1%
2023	Martin 8 Upgrade	40		Second Quarter 2022	
	Manatee 3 Upgrade	79		Fourth Quarter 2022	
	Solar PV ^{3/}		209	First Quarter 2023	
	Fort Myers 2 Upgrade	79		Second Quarter 2023	
	Solar Degradation ^{4/}	(6)			
	Total of MW changes to Summer firm capacity:	192	209		22.8%
2024	Lansing Smith 3 Upgrade		59	Fourth Quarter 2023	
	Daniel 1 and 2 Retirement		(502)	First Quarter 2024	
	Turkey Point 5 Upgrade	79		First Quarter 2024	
	Okeechobee Energy Center	58		First Quarter 2024	
	Solar PV ^{3/}		209	First Quarter 2024	
	Solar Degradation ^{4/}	(6)			
	Total of MW changes to Summer firm capacity:	131	(234)		20.8%
2025	Pea Ridge 1, 2 and 3 Retirement		(12)	Second Quarter 2024	
	Crist 4 Retirement		(75)	Fourth Quarter 2024	
	Solar PV ^{3/}	264		First Quarter 2025	
	Sanford 4 Upgrade	78		Second Quarter 2025	
	Sanford 5 Upgrade	78		Second Quarter 2025	
	Solar Degradation ^{4/}	(7)			
	Total of MW changes to Summer firm capacity:	413	(87)		20.5%
2026	Martin 8 Upgrade	40		Second Quarter 2025	
	Sanford 4 Upgrade	26		Second Quarter 2025	
	Sanford 5 Upgrade	26		Second Quarter 2025	
	Solar PV ^{3/}	422		First Quarter 2026	
	Solar Degradation ^{4/}	(8)			
	Total of MW changes to Summer firm capacity:	506			20.6%
2027	Crist 5 Retirement		(75)	Fourth Quarter 2026	
	Solar PV ^{3/}	422		First Quarter 2027	
	Solar Degradation ^{4/}	(9)			
	Total of MW changes to Summer firm capacity:	413	(75)		20.3%
2028	Lansing Smith A Retirement Energy Storage		(32)	Fourth Quarter 2027	
	Solar PV ^{3/}	252	200	First Quarter 2028	
	Solar Degradation ^{4/}	(11)		First Quarter 2028	
	Total of MW changes to Summer firm capacity:	241	168		20.0%
2029	Energy Storage		500	First Quarter 2029	
	Solar PV ^{3/}	194		First Quarter 2029	
	Solar Degradation ^{4/}	(11)			
	Total of MW changes to Summer firm capacity:	183	500		20.0%

^{1/} Year shown reflects when the MW change begins to be accounted for in Summer reserve margin calculations.

^{2/} Winter Reserve Margins are typically higher than Summer Reserve Margins. Winter Reserve Margins are shown on Schedule 7.2 in Chapter III.

^{3/} MW values shown for the PV facilities represent the summer firm capacity assumptions for the PV facilities.

^{4/} An annual 0.3% degradation for PV output is assumed for both FPL and Gulf Solar. Total degradation is shown solely in the FPL column.

CHAPTER I

Description of Existing Resources

(This page is intentionally left blank.)

I. Description of Existing Resources

I.A. FPL System:

I.A.1 Description of Existing Resources

FPL's service area contains approximately 27,650 square miles and has a population of approximately ten million people. FPL served an average of 5,061,525 customer accounts in 35 counties during 2019. These customers were served by a variety of resources including: FPL-owned fossil-fuel, renewable (solar), and nuclear generating units; non-utility owned generation; demand side management (DSM); and interchange/purchased power.

I.A.2 FPL - Owned Resources

As of December 31, 2019, FPL owned electric generating resources located at 29 sites distributed geographically throughout its service territory, plus one site in Georgia (partial FPL ownership of one unit). These generating facilities consisted of: four nuclear units, one coal unit (the aforementioned partially owned unit), 15 combined-cycle (CC) units, two fossil steam units, four gas turbines (GTs), nine simple-cycle combustion turbines (CTs), and 17 solar photovoltaic (PV) facilities.⁶ The locations of the 52 generating units that were in commercial operation on December 31, 2019 are shown on Figure I.A.2.1 and in Table I.A.2.1.

FPL's bulk transmission system, including both overhead and underground lines, is comprised of 7,278 circuit miles of transmission lines. Integration of the generation, transmission, and distribution systems is achieved through FPL's 661 substations in Florida.

The existing FPL system, including generating plants, major transmission stations, and transmission lines, is shown on Figure I.A.2.2.

⁶ FPL also has one 75 MW solar thermal facility at its Martin plant site. This facility does not generate electricity as the other units mentioned above do. Instead, it produces steam that reduces the use of fossil fuel to produce steam for electricity generation.

FPL Generating Resources by Location

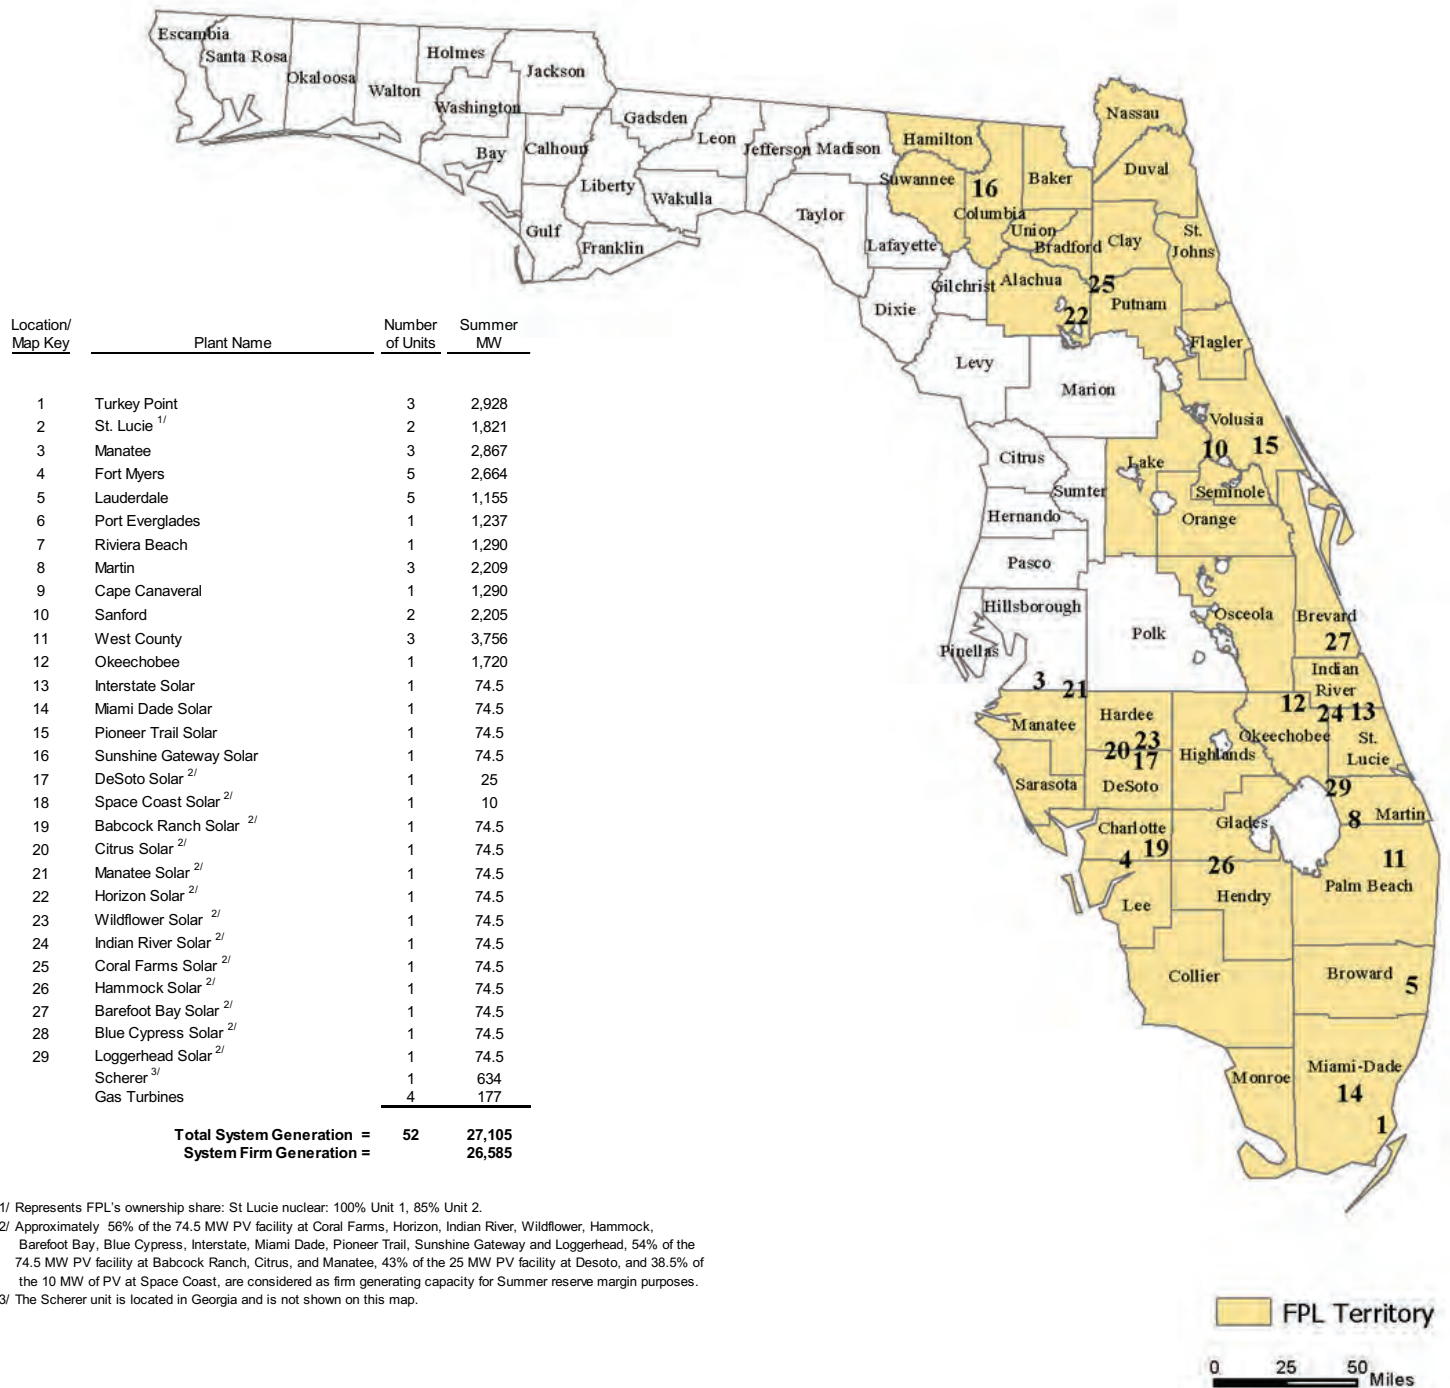


Figure I.A.2.1: FPL's Generating Resources by Location (as of December 31, 2019)

Table I.A.2.1: FPL's Capacity Resources by Unit Type (as of December 31, 2019)

<u>Unit Type/ Plant Name</u>	<u>Location</u>	<u>Number of Units</u>	<u>Fuel</u>	<u>Summer MW</u>
<u>Nuclear</u>				
St. Lucie ^{1/}	Hutchinson Island, FL	2	Nuclear	1,821
Turkey Point	Florida City, FL	2	Nuclear	1,658
Total Nuclear:		4		3,479
<u>Coal Steam</u>				
Scherer	Monroe County, Ga	1	Coal	634
Total Coal Steam:		1		634
<u>Combined-Cycle</u>				
Fort Myers	Fort Myers, FL	1	Gas	1,812
Manatee	Manatee County, FL	1	Gas	1,249
Martin	Indiantown, FL	2	Gas	974
Sanford	Lake Monroe, FL	2	Gas	2,205
Cape Canaveral	Cocoa, FL	1	Gas/Oil	1,290
Martin	Indiantown, FL	1	Gas/Oil	1,235
Okeechobee	Okeechobee, FL	1	Gas/Oil	1,720
Port Everglades	City of Hollywood, FL	1	Gas/Oil	1,237
Riviera Beach	City of Riviera Beach, FL	1	Gas/Oil	1,290
Turkey Point	Florida City, FL	1	Gas/Oil	1,270
West County	Palm Beach County, FL	3	Gas/Oil	3,756
Total Combined Cycle:		15		18,038
<u>Gas/Oil Steam</u>				
Manatee	Manatee County, FL	2	Gas/Oil	1,618
Total Oil/Gas Steam:		2		1,618
<u>Gas Turbines(GT)</u>				
Fort Myers (GT)	Fort Myers, FL	2	Oil	108
Lauderdale (GT)	Dania, FL	2	Gas/Oil	69
Total Gas Turbines/Diesels:		4		177
<u>Combustion Turbines</u>				
Lauderdale	Dania, FL	5	Gas/Oil	1,155
Fort Myers	Fort Myers, FL	4	Gas/Oil	852
Total Combustion Turbines:		9		2,007
<u>PV</u> ^{2/}				
DeSoto Solar	DeSoto County, FL	1	Solar Energy	25
Babcock Ranch Solar	Charlotte County, FL	1	Solar Energy	74.5
Citrus Solar	DeSoto County, FL	1	Solar Energy	74.5
Manatee Solar	Manatee County, FL	1	Solar Energy	74.5
Space Coast Solar	Brevard County, FL	1	Solar Energy	10
Interstate Solar	St. Lucie County, FL	1	Solar Energy	74.5
Miami Dade Solar	Dade County, FL	1	Solar Energy	74.5
Pioneer Trail Solar	Volusia County, FL	1	Solar Energy	74.5
Sunshine Gateway Solar	Columbia County, FL	1	Solar Energy	74.5
Horizon Solar	Putnam and Alachua Counties, FL	1	Solar Energy	74.5
Wildflower Solar	Desoto County, FL	1	Solar Energy	74.5
Indian River Solar	Indian River County, FL	1	Solar Energy	74.5
Coral Farms Solar	Putnam County, FL	1	Solar Energy	74.5
Hammock Solar	Hendry County, FL	1	Solar Energy	74.5
Barefoot Bay Solar	Brevard County, FL	1	Solar Energy	74.5
Blue Cypress Solar	Indian River County, FL	1	Solar Energy	74.5
Loggerhead Solar	St. Lucie County, FL	1	Solar Energy	74.5
Total PV:		17		1,153
Total System Generation as of December 31, 2019 =		52		27,105
System Firm Generation as of December 31, 2019 =				26,585

1/ Total capability of St. Lucie 1 is 981/1,003 MW. FPL's share of St. Lucie 2 is 840/860. FPL's ownership share of St. Lucie Units 1 and 2 is 100% and 85%, respectively.

2/ Approximately 56% of the 74.5 MW PV facility at Coral Farms, Horizon, Indian River, Wildflower, Hammock, Barefoot Bay, Blue Cypress, Interstate, Miami Dade, Pioneer Trail, Sunshine Gateway and Loggerhead, 54% of the 74.5 MW PV facility at Babcock Ranch, Citrus, and Manatee, 43% of the 25 MW PV facility at Desoto, and 38.5% of the 10 MW of PV at Space Coast, are considered as firm generating capacity for Summer reserve margin purposes.

FPL Bulk Transmission System

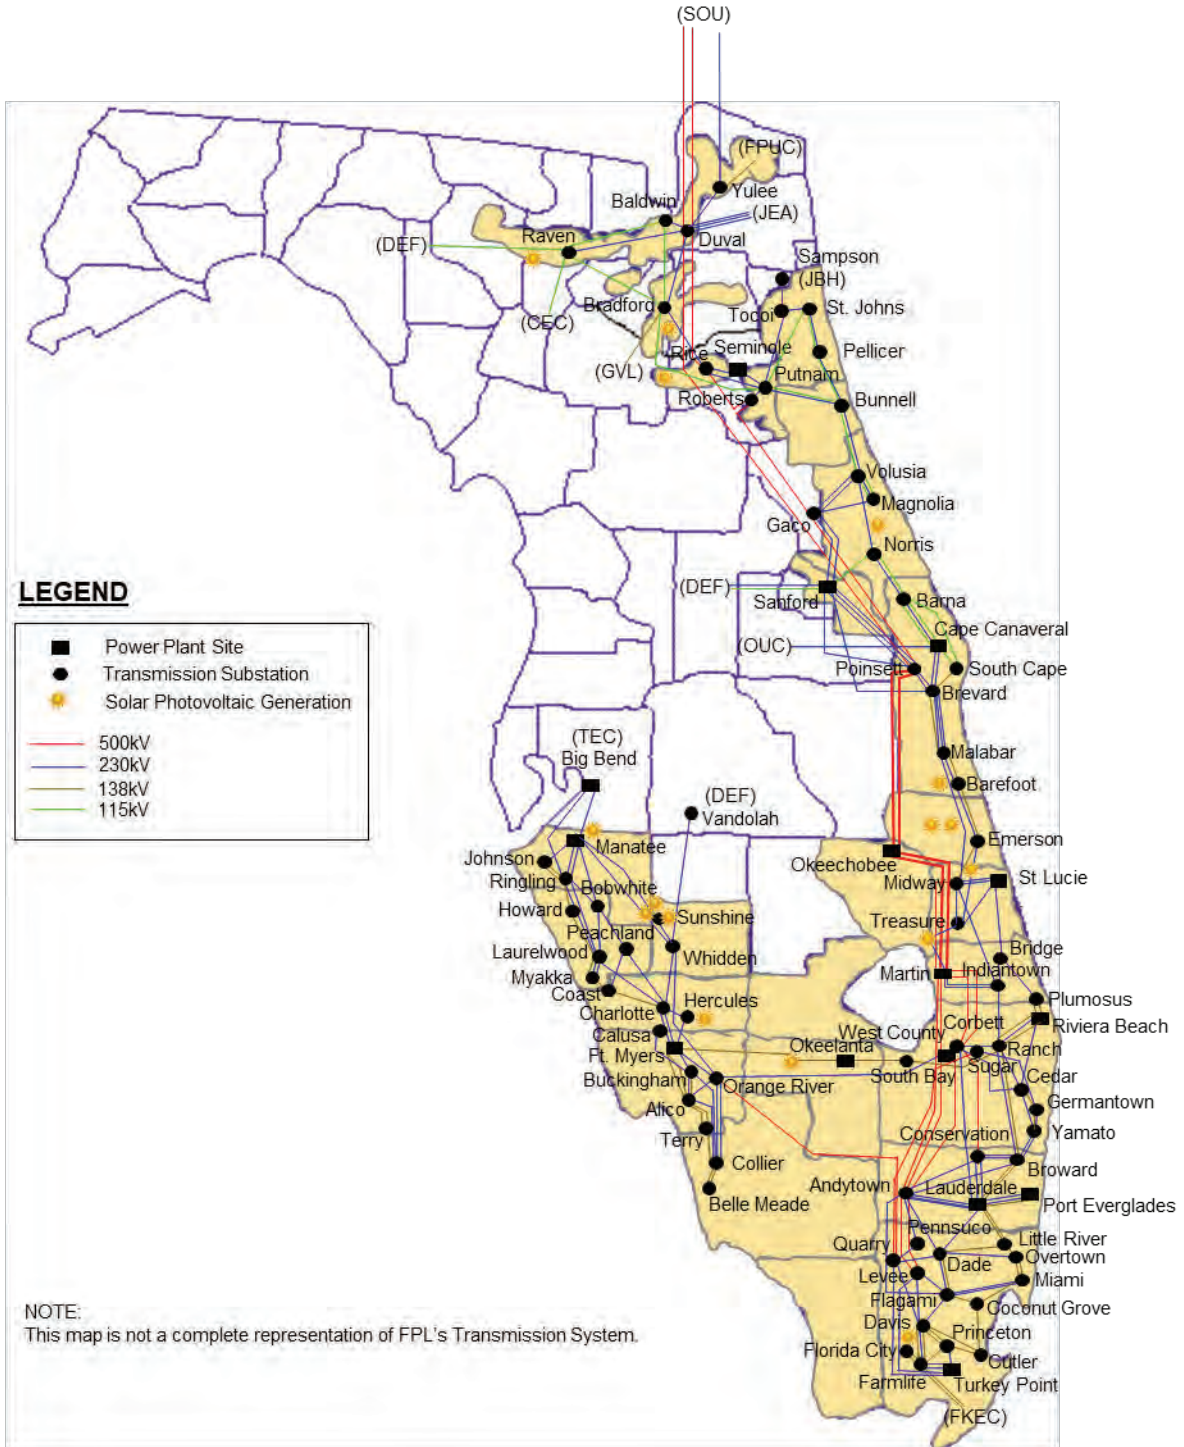


Figure I.A.2.2: FPL Bulk Transmission System

I.A.3 FPL - Capacity and Energy Power Purchases

Firm Capacity: Purchases from Qualifying Facilities (QF)

Firm capacity power purchases remain part of FPL's resource mix. A cogeneration facility is one that simultaneously produces electrical and thermal energy, with the thermal energy (*e.g.*, steam) used for industrial, commercial, or cooling and heating purposes. A small power production facility is one that does not exceed 80 MW (unless it is exempted from this size limitation by the Solar, Wind, Waste, and Geothermal Power Production Incentives Act of 1990) and uses solar, wind, waste, geothermal, or other renewable resources as its primary energy source.

FPL currently has four contracts with qualifying facilities (*e.g.*, cogeneration/small power production facilities) to purchase firm capacity and energy during the 10-year reporting period of this Site Plan. The 2019 actual and 2020-2029 projected contributions from these facilities are shown in Table I.A.3.1, Table I.A.3.2, and Table I.A.3.3. As discussed in prior FPL Site Plans, the FPSC approved (Order No. PSC-16-0506-FOF-EI) FPL's acquisition of the rights to the 330 MW Indiantown Cogen LP (ICL) unit and the associated power purchase agreement (PPA). FPL currently projects that it will cancel this PPA by the end of the 4th Quarter of 2020 because the agreement is no longer cost-effective for FPL's customers.

Firm Capacity: Purchases from Utilities

FPL currently has a PPA with Orlando Utilities Commission. Information regarding this PPA is shown in Table I.A.3.2 and Table I.A.3.3.

Firm Capacity: Other Purchases

FPL has two other firm capacity purchase contracts with the Palm Beach Solid Waste Authority. Table I.A.3.2 and I.A.3.3 present the Summer and Winter MW, respectively, resulting from these contracts under the category heading of Other Purchases.

Non-Firm (As Available) Energy Purchases

FPL purchases non-firm (as-available) energy from a number of cogeneration and small power production facilities. The lower half of Table I.A.3.1 shows the amount of energy purchased in 2019 from these facilities.

Table I.A.3.1: FPL's Purchased Power Resources by Contract (as of December 31, 2019)

Firm Capacity Purchases (MW)	Location (City or County)	Fuel	Summer MW
<u>I. Purchase from QF's: Cogeneration/Small Power Production Facilities</u>			
Indiantown Cogen LP	Martin	Coal (Cogen)	330
Broward South	Broward	Solid Waste	4
		Total:	334
<u>II. Purchases from Utilities & IPP</u>			
Palm Beach SWA - extension	Palm Beach	Solid Waste	40
Palm Beach SWA - New Unit	Palm Beach	Solid Waste	70
OUC/FMPA	Orange	Gas	100
		Total:	210
Total Net Firm Generating Capability:			544

Non-Firm Energy Purchases (MWH)			Energy (MWH) Delivered to FPL in 2019
Project	County	Fuel	
Miami Dade Resource Recovery ^{1/}	Dade	Solid Waste	55,702
Broward South ^{1/}	Broward	Solid Waste	48,779
Lee County Solid Waste ^{1/}	Lee	Solid Waste	45,916
Brevard County ^{1/}	Brevard	Solid Waste	38,226
Okeelanta (known as Florida Crystals and New Hope Power Partners) ^{1/}	Palm Beach	Bagasse/Wood	36,052
Waste Management - Collier County Landfill ^{1/}	Collier	Landfill Gas	25,527
Landfill Energy Systems (Aria Energy) ^{1/}	Seminole	Landfill Gas	15,058
Tropicana	Manatee	Natural Gas	6,056
Georgia Pacific	Putnam	Paper by-product	4,437
Landfill Energy Systems (Aria Energy) ^{1/}	Sarasota	Landfill Gas	2,062
Waste Management Renewable Energy ^{1/}	Broward	Landfill Gas	1,520
Fortistar - Port Charlotte ^{1/}	Charlotte	Landfill Gas	361
Customer Owned PV & Wind	Various	PV/Wind	72,084

^{1/} These Non-Firm Energy Purchases are renewable and are reflected on Schedule 11.1, row 9, column 6.

Table I.A.3.2: FPL's Firm Purchased Power Summer MW

Summary of FPL's Firm Capacity Purchases: Summer MW (for August of Year Shown)

I. Purchases from QF's

Cogeneration Small Power Production Facilities ^{1/}	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
Broward South	01/01/93	12/31/26	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	0	0
Broward South	01/01/95	12/31/26	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	0	0
Broward South	01/01/97	12/31/26	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0	0
Indiantown Cogen L.P.	12/22/95	4th Qtr/2020	330	0	0	0	0	0	0	0	0	0
QF Purchases Subtotal:			334	4	4	4	4	4	4	4	0	0

II. Purchases from Utilities

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
OUC	10/01/18	12/31/20	100	0	0	0	0	0	0	0	0	0
Utility Purchases Subtotal:			100	0	0	0	0	0	0	0	0	0

Total of QF and Utility Purchases =	434	4	4	4	4	4	4	4	4	4	0	0
--	------------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------

III. Other Purchases

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
Palm Beach SWA - Extension ^{2/}	01/01/12	04/01/34	40	40	40	40	40	40	40	40	40	40
Palm Beach SWA - Additional	01/01/15	04/01/34	70	70	70	70	70	70	70	70	70	70
Other Purchases Subtotal:			110	110	110	110	110	110	110	110	110	110

Total "Non-QF" Purchases =	210	110	110	110	110	110	110	110	110	110	110	110
-----------------------------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

Summer Firm Capacity Purchases Total MW:	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
	544	114	114	114	114	114	114	114	110	110

1/ The Indiantown Cogen L.P. PPA is projected to end, and the generating unit to be retired, in 4th Quarter 2020.

2/ When the second unit came into commercial service at the Palm Beach SWA, neither unit met the standards to be a small power producer, and it then became accounted for under "Other Purchases"

Table I.A.3.3: FPL's Firm Purchased Power Winter MW

Summary of FPL's Firm Capacity Purchases: Winter MW (for January of Year Shown)

I. Purchases from QF's

Cogeneration Small Power Production Facilities ^{1/}	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
Broward South	01/01/93	12/31/26	1.4	1.4	1.4	1.4	1.4	1.4	1.4	0	0	0
Broward South	01/01/95	12/31/26	1.5	1.5	1.5	1.5	1.5	1.5	1.5	0	0	0
Broward South	01/01/97	12/31/26	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0	0	0
Indiantown Cogen L.P.	12/22/95	4th Qtr/2020	330	0	0	0	0	0	0	0	0	0
QF Purchases Subtotal:			334	4	4	4	4	4	4	0	0	0

II. Purchases from Utilities

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
OUC	10/01/18	12/31/20	70	0	0	0	0	0	0	0	0	0
Utility Purchases Subtotal:			70	0	0	0	0	0	0	0	0	0

Total of QF and Utility Purchases =	404	4	4	4	4	4	4	4	4	0	0	0
--	------------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------

III. Other Purchases

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
Palm Beach SWA - Extension ^{2/}	01/01/12	04/01/34	40	40	40	40	40	40	40	40	40	40
Palm Beach SWA - Additional	01/01/15	04/01/34	70	70	70	70	70	70	70	70	70	70
Other Purchases Subtotal:			110	110	110	110	110	110	110	110	110	110

Total "Non-QF" Purchases =	180	110	110	110	110	110	110	110	110	110	110	110
-----------------------------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

Winter Firm Capacity Purchases Total MW:	514	114	114	114	114	114	114	114	114	110	110	110
---	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

1/ The Indiantown Cogen L.P. PPA is projected to end, and the generating unit to be retired, in 4th Quarter 2020.

2/ When the second unit came into commercial service at the Palm Beach SWA, neither unit met the standards to be a small power producer, and it then became accounted for under "Other Purchases"

I.A.4 FPL - Demand Side Management (DSM)

FPL has continually explored and implemented cost-effective DSM programs since 1978, and it has consistently been among the leading utilities nationally in achieving substantial DSM efficiencies. These programs include a number of innovative conservation/energy efficiency and load management initiatives. Importantly, FPL's DSM efforts through 2019 have resulted in a cumulative Summer peak reduction of 4,870 MW at the generator and an estimated cumulative energy savings of 89,166 Gigawatt-Hour (GWh) at the generator. After accounting for the 20% total reserve margin requirements, FPL's highly effective DSM efforts through 2019 have eliminated the need to construct the equivalent of approximately fifteen (15) new 400 MW generating units. Also, it is important to note that FPL has achieved these significant DSM accomplishments while minimizing the DSM-based impact on electric rates for all of its customers.

In 2019, the Florida Public Service Commission (FPSC) set DSM Goals for the years 2020 through 2024 for FPL and the other Florida utilities subject to the Florida Energy Efficiency and Conservation Act (FEECA). For these 5 years, these Goals are identical to the Goals set by the FPSC in 2014 for the years 2020 through 2024. In February 2020, FPL filed for FPSC approval its DSM Plan with which it intends to meet the DSM Goals. In this Site Plan, FPL assumes that the annual reduction values for Summer MW, Winter MW, and energy (MWh) set forth in the DSM Goals order (Order No. PSC-2019-0509-FOF-EG) will be met as shown in various schedules presented in this Site Plan. For the years 2025 through 2029, for which the FPSC did not establish Goals, FPL has assumed that DSM will be implemented to achieve the DSM levels that FPL proposed in its 2019 DSM Goals filing because this level of annual DSM was projected to be cost-effective.

Schedule 1

FPL Existing Generating Facilities
As of December 31, 2019

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Plant Name	Unit No.	Location	Unit Type	Fuel Pri.	Fuel Alt.	Fuel Transport. Pri.	Fuel Transport. Alt.	Fuel Days Use	Commercial In-Service Month/Year	Actual/Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capacity ^{1/} Winter MW	Summer MW
Babcock Ranch Solar ^{2/}		Charlotte County											
		29,31,32/41S/26E : 5,6/42S/26E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Barefoot Solar ^{2/}		Brevard County											
		15,16/30S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Blue Cypress Solar ^{2/}		Indian River County											
		16,21/33S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Cape Canaveral		Brevard County											
		19/23S/36E	CC	NG	FO2	PL	TK	Unknown	Apr-13	Unknown	1,295,400	1,393	1,290
	3										1,295,400	1,393	1,290
Citrus Solar ^{2/}		DeSoto County											
		26,27,34,35,36/36S/25E : 1,2/37S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Coral Farms Solar ^{2/}		Putnam County											
		27,28,33,34/8S/24E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
DeSoto Solar ^{2/}		DeSoto County											
		27,28/36S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Oct-09	Unknown	22,500	25	25
	1										22,500	25	25
Fort Myers		Lee County											
		35/43S/25E	CC	NG	No	PL	No	Unknown	Jun-02	Unknown	2,796,198	2,750	2,772
	2										1,836,798	1,787	1,812
	3		CT	NG	FO2	TK	TK	Unknown	Jun-03	Unknown	835,380	840	852
	1, 9		GT	FO2	No	WA	No	Unknown	May-74	Unknown	124,020	123	108
Hammock Solar ^{2/}		Hendry County											
		33,34/43S/30E : 3,4,9,10/44S/30E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Horizon Solar ^{2/}		Alachua County											
		25,35,36/9S/22E : 30, 31/9S/23E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Indian River Solar ^{2/}		Indian River County											
		30,31/33S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Interstate Solar ^{2/}		St. Lucie County											
		28,29,33/34S/39E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-19	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Lauderdale		Broward County											
		30/50S/42E	CT	NG	FO2	PL	TK	Unknown	Dec-16	Unknown	1,215,956	1,184	1,224
	6										1,147,500	1,110	1,155
	3, 5		GT	NG	FO2	PL	TK	Unknown	Aug-70	Unknown	68,456	74	69
Loggerhead Solar ^{2/}		St. Lucie County											
		21,28,33/37S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
	1										74,500	74.5	74.5
Manatee Solar ^{2/}		Manatee County											
		1,12,13,24/33S/19E : 6,7,18,19/33S/20E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	6,130,464	74.5	74.5
	1										74,500	74.5	74.5
Manatee		Manatee County											
		18/33S/20E	ST	NG	FO6	PL	WA	Unknown	Oct-76	4th Qtr/2021	863,300	819	809
	1										863,300	819	809
	2		ST	NG	FO6	PL	WA	Unknown	Dec-77	4th Qtr/2021	863,300	819	809
	3		CC	NG	No	PL	No	Unknown	Jun-05	Unknown	1,301,382	1,265	1,249

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ Approximately 56% of the 74.5 MW PV facility at Coral Farms, Horizon, Indian River, Interstate, Hammock, Barefoot Bay, Blue Cypress, and Loggerhead, 54% of the 74.5 MW PV Facility at Babcock Ranch, Citrus, and Manatee and 43% of the 25 MW PV facility at Desoto is considered as firm generating capacity for Summer reserve margin purposes and 0% is considered as firm capacity for Winter reserve margin purposes.

Schedule 1

FPL Existing Generating Facilities
As of December 31, 2019

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Plant Name	Unit No.	Location	Unit Type	Fuel Pri.	Fuel Alt.	Fuel Transport Pri.	Fuel Alt.	Fuel Days Use	Commercial In-Service Month/Year	Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capacity ^{1/}	
												Winter MW	Summer MW
Martin		Martin County 30/39S/38E											
	3		CC	NG	No	PL	No	Unknown	Feb-94	Unknown	2,525,382	2,337	2,209
	4		CC	NG	No	PL	No	Unknown	Apr-94	Unknown	612,000	533	487
	8 ^{4/}		CC	NG	FO2	PL	TK	Unknown	Jun-05	Unknown	612,000	533	487
											1,301,382	1,271	1,235
Miami Dade Solar ^{3/}		Dade County 13,24/55S/38E											
	1		PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
Okeechobee		Okeechobee 2/33S/35E											
	1		CC	NG	FO2	PL	TK	Unknown	Mar-19	Unknown	1,886,150	1,672	1,720
											1,886,150	1,672	1,720
Pioneer Trail Solar ^{3/}		Volusia County 16,20,21,28,29,32/17S/32E											
	1		PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
Port Everglades		City of Hollywood 23/50S/42E											
	5		CC	NG	FO2	PL	TK	Unknown	Apr-16	Unknown	1,412,700	1,338	1,237
											1,412,700	1,338	1,237
Riviera Beach		City of Riviera Beach 33/42S/43E											
	5		CC	NG	FO2	PL	TK	Unknown	Apr-14	Unknown	1,295,400	1,393	1,290
											1,295,400	1,393	1,290
Sanford		Volusia County 16/19S/30E											
	4		CC	NG	No	PL	No	Unknown	Oct-03	Unknown	2,531,464	2,335	2,205
	5		CC	NG	No	PL	No	Unknown	Jun-02	Unknown	1,265,732	1,147	1,029
											1,265,732	1,188	1,176
Scherer ^{2/}		Monroe, GA											
	4		ST	SUB	No	RR	No	Unknown	Jul-89	4th Q 2021	680,368	635	634
											680,368	635	634
Space Coast Solar ^{3/}		Brevard County 13/23S/36E											
	1		PV	Solar	Solar	N/A	N/A	Unknown	Apr-10	Unknown	10,000	10	10
St. Lucie ^{5/}		St. Lucie County 16/36S/41E											
	1		ST	Nuc	No	TK	No	Unknown	May-76	Unknown	1,999,128	1,863	1,821
	2		ST	Nuc	No	TK	No	Unknown	Jun-83	Unknown	1,080,000	1,003	981
											919,128	860	840
Sunshine Gateway Solar ^{3/}		Columbia County 25,26,35,36/2S/15E : 31/2S/16E											
	1		PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5
											74,500	74.5	74.5
Turkey Point		Miami Dade County 27/57S/40E											
	3		ST	Nuc	No	TK	No	Unknown	Nov-72	Unknown	3,055,782	3,018	2,928
	4		ST	Nuc	No	TK	No	Unknown	Jun-73	Unknown	877,200	859	837
	5		CC	NG	FO2	PL	TK	Unknown	May-07	Unknown	877,200	848	821
											1,301,382	1,311	1,270
West County		Palm Beach County 29/43S/40E											
	1		CC	NG	FO2	PL	TK	Unknown	Aug-09	Unknown	4,100,400	4,087	3,756
	2		CC	NG	FO2	PL	TK	Unknown	Nov-09	Unknown	1,366,800	1,369	1,259
	3		CC	NG	FO2	PL	TK	Unknown	May-11	Unknown	1,366,800	1,369	1,259
											1,366,800	1,349	1,238
Wildflower Solar ^{3/}		Desoto County 25,26,35,36/36S/25E											
	1		PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5
											74,500	74.5	74.5
Total System Generating Capacity as of December 31, 2019 ^{6/} =											28,061	27,105	
System Firm Generating Capacity as of December 31, 2019 ^{7/} =											26,908	26,585	

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These ratings relate to FPL's 76.36% share of Plant Scherer Unit 4 operated by Georgia Power, and represent FPL's 73.923% ownership share available at point of interchange.

3/ Approximately 56% of the 74.5 MW PV facility at Miami Dade, Pioneer Trail, Sunshine Gateway and Wildflower, 38.5% of the 10 MW PV facility at Space Coast is considered as firm generating capacity for Summer reserve margin purposes and 0% is considered as firm capacity for Winter reserve margin purposes.

4/ Martin Unit 8 is also partially fueled by a 75 MW solar thermal facility that supplies steam when adequate sunlight is available, thus reducing fossil fuel use.

5/ Total capability of St. Lucie 1 is 981/1,003 MW. FPL's share of St. Lucie 2 is 840/860. FPL's ownership share of St. Lucie Units 1 and 2 is 100% and 85%, respectively, as shown above. FPL's share of the deliverable capacity from each unit is approx. 92.5% and exclude the Orlando Utilities Commission (OUC) and Florida Municipal Power Agency (FMPA) combined portion of approximately 7.448% per unit.

6/ The Total System Generating Capacity value shown includes FPL-owned firm and non-firm generating capacity.

7/ The System Firm Generating Capacity value shown includes only firm generating capacity.

I.B. Gulf System:

I.B.1 Description of Existing Resources

Gulf's service area contains approximately 7,550 square miles and has a population of approximately one million people. Gulf Power served an average of 468,282 customer accounts in 8 counties during 2019. These customers were served by a variety of resources including: Gulf Power-owned fossil-fuel, renewable (solar and wind), other non-utility owned generation; demand side management (DSM); and interchange/purchased power.

I.B.2 Gulf - Owned Resources

As of December 31, 2019, Gulf owned electric generating resources located at five sites distributed geographically throughout its service territory, plus one site in Georgia (partial Gulf ownership of one unit). These generating facilities consisted of: seven coal units, one combined-cycle (CC) unit, four simple-cycle combustion turbines (CTs), and two landfill gas (LFG) facilities. The locations of the 14 generating units that were in commercial operation on December 31, 2019 are shown on Figure I.B.2.1 and in Table I.B.2.1.

Gulf's bulk transmission system, including both overhead and underground lines, is comprised of 1,672 circuit miles of transmission lines. Integration of the generation, transmission, and distribution systems is achieved through Gulf's 132 substations in Florida.

The existing Gulf system, including generating plants, major transmission stations, and transmission lines, is shown on Figure I.B.2.2.

Gulf Power Generating Resources by Location


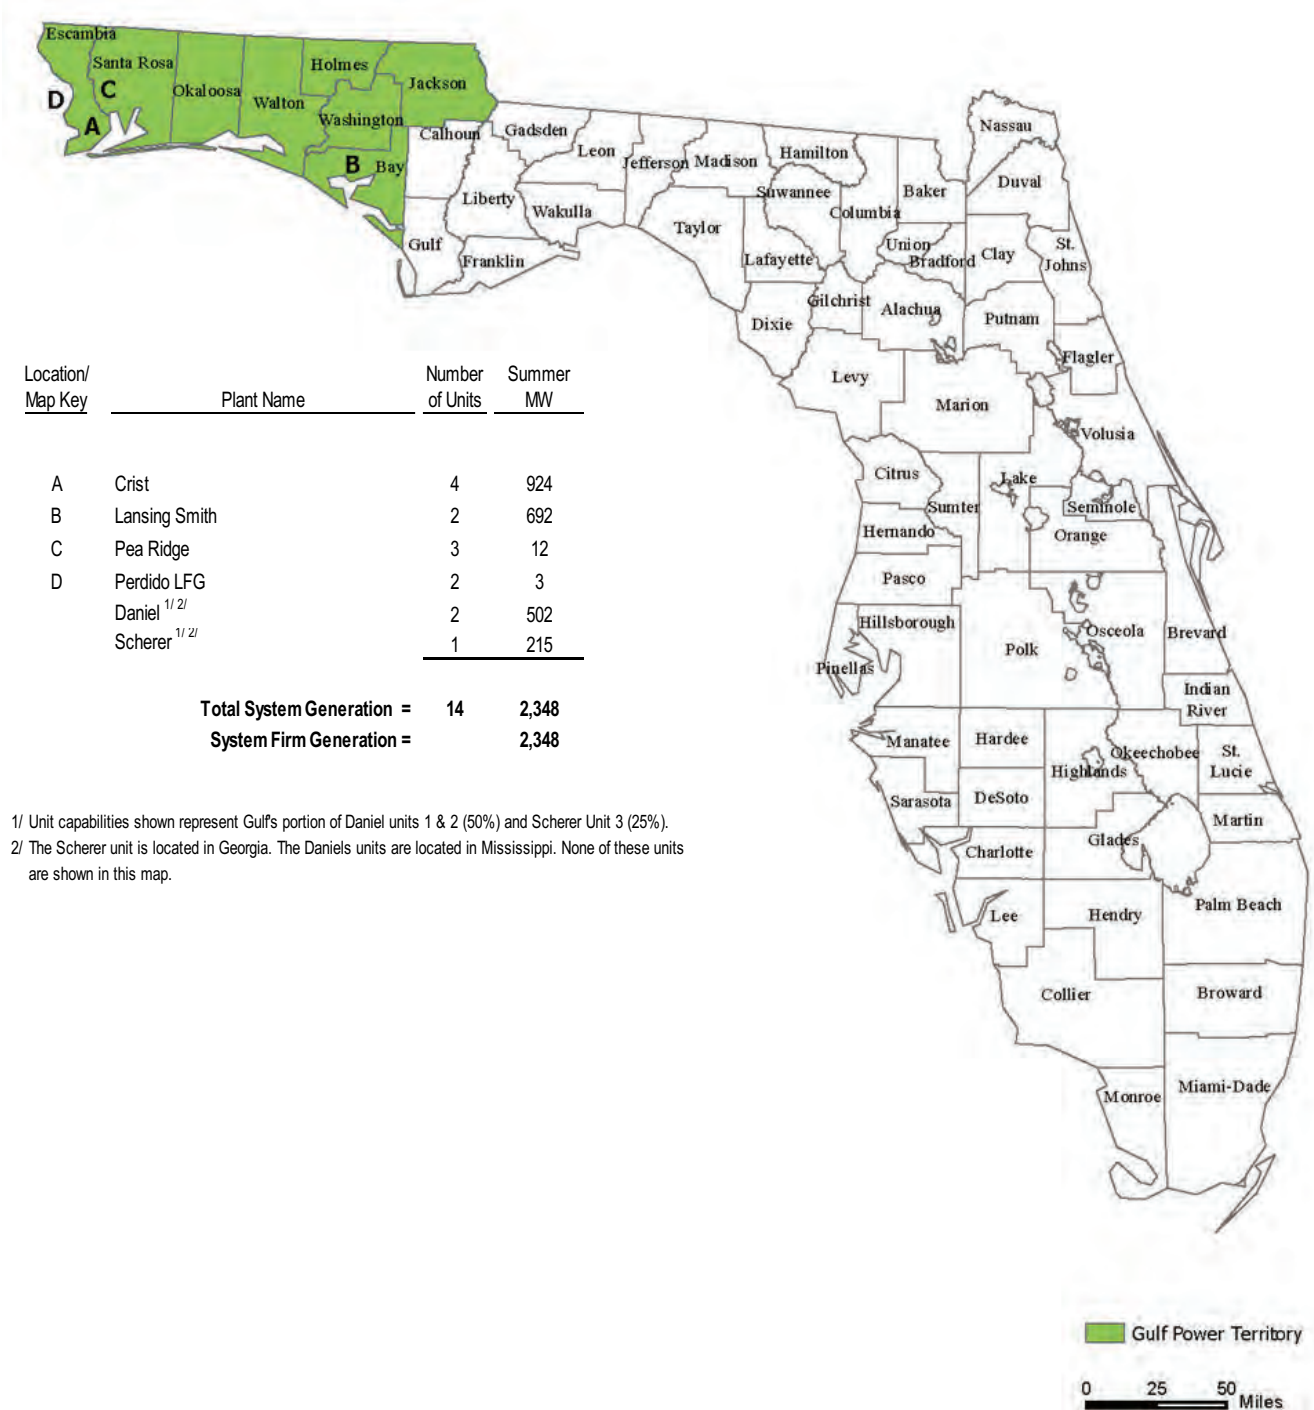


Figure I.B.2.1: Gulf Power Generating Resources by Location (as of December 31, 2019)

Table I.B.2.1: Gulf Power Capacity Resources by Unit Type (as of December 31, 2019)

<u>Unit Type/ Plant Name</u>	<u>Location</u>	<u>Number of Units</u>	<u>Fuel</u>	<u>Summer MW</u>
<u>Coal Steam</u>				
Crist	Escambia County	4	Coal	924
Daniel	Jackson County, MS	2	Coal	502
Scherer	Monroe County, Ga	1	Coal	215
Total Coal Steam:		7		1,641
<u>Combined-Cycle</u>				
Lansing Smith	Bay County	1	Gas	660
Total Combined Cycle:		1		660
<u>Combustion Turbines</u>				
Pea Ridge	Santa Rosa County	3	Gas	12
Lansing Smith	Bay County	1	Oil	32
Total Combustion Turbines:		4		44
<u>Land Fill Gas</u>				
Perdido LFG	Escambia County	2	LFG	3
Total LFG:		2		3
Total System Generation as of December 31, 2019 =		14		2,348
System Firm Generation as of December 31, 2019 =				2,348

Gulf Power Bulk Transmission System

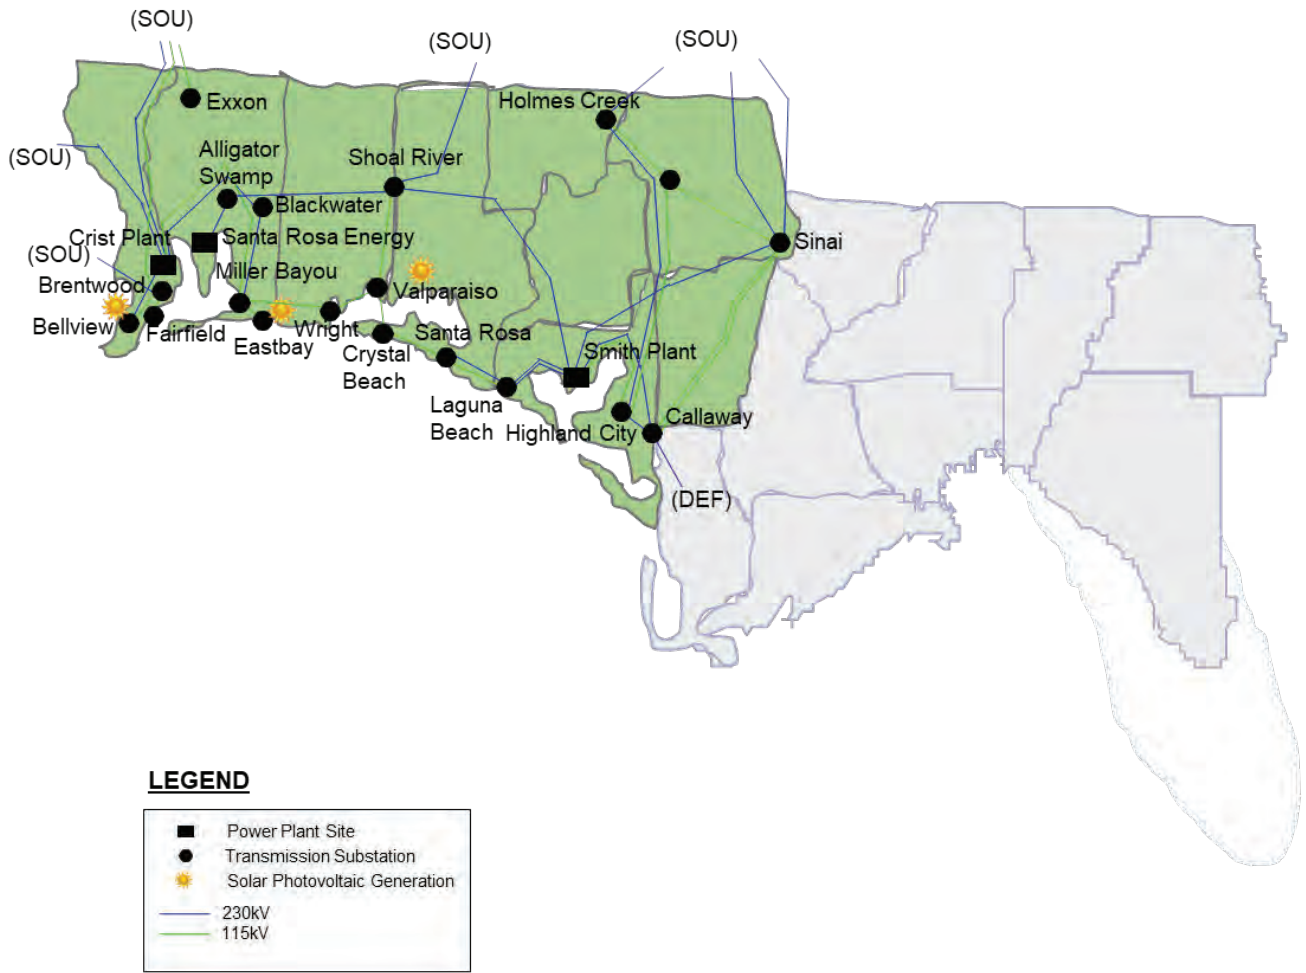

NOTE:
This map is not a complete representation of GULF's Transmission System.

Figure I.B.2.2: Gulf Power Bulk Transmission System

I.B.3 Gulf - Capacity and Energy Power Purchases

Firm Capacity: Purchases from Qualifying Facilities (QF)

Gulf currently has no contracts with qualifying facilities (e.g., cogeneration/small power production facilities) to purchase firm capacity and energy during the 10-year reporting period of this Site Plan.

Firm Capacity: Purchases from Utilities

Gulf currently has no PPAs with other utilities.

Firm Capacity: Other Purchases

Gulf has three firm capacity purchase contracts; two with Morgan Stanley Capital Group's Kingfisher I and Kingfisher II wind projects, and one with Shell Energy North America's Tenaska project. The 2019 actual and 2020-2029 projected contributions from these facilities are shown in Table I.B.3.1, I.B.3.2 and I.B.3.3.

Non-Firm (As Available) Energy Purchases

Gulf purchases non-firm (as-available) energy from a number of cogeneration and small power production facilities. The lower half of Table I.B.3.1 shows the amount of energy purchased in 2019 from these facilities.

Table I.B.3.1: Gulf Power Purchased Power Resources by Contract (as of December 31, 2019)

Firm Capacity Purchases (MW)	Location (City or County)	Fuel	Summer MW
<u>I. Purchase from QF's: Cogeneration/Small Power Production Facilities</u>			
		Total:	-
<u>II. Purchases from Utilities & IPP</u>			
MSCG - Kingfisher I 1/	Oklahoma	Wind	53
MSCG - Kingfisher II 1/	Oklahoma	Wind	28
SENA - (Shell)	Alabama	Gas	885
		Total:	966
Total Net Firm Generating Capability:			966

<u>Non-Firm Energy Purchases (MWH)</u>			Energy (MWH) Delivered to FPL in 2019
Project	County	Fuel	
International Paper Company Units 1&2 1/	Escambia	Biomass	1,084
Ascend - Solutia Units 1-4	Escambia	Gas	198,163
Gulf Coast Solar Center I	Okaloosa	Sun	59,090
Gulf Coast Solar Center II	Santa Rosa	Sun	78,571
Gulf Coast Solar Center III	Escambia	Sun	94,741
Customer Owned PV & Wind	Various	PV/Wind	6,821

1/ These Non-Firm Energy Purchases are renewable and are reflected on Schedule 11.1, row 9, column 6.

Table I.B.3.2: Gulf Power Firm Purchased Power Summer MW

Summary of Gulf Power Firm Capacity Purchases: Summer MW (for August of Year Shown)

I. Purchases from QF's

Cogeneration Small Power Production Facilities	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
None	-	-	-	-	-	-	-	-	-	-	-	-
QF Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

II. Purchases from Utilities

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
None	-	-	-	-	-	-	-	-	-	-	-	-
Utility Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

Total of QF and Utility Purchases =	0	0	0	0	0	0	0	0	0	0	0	0
--	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------

III. Other Purchases

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
MSCG - Kingfisher I	01/01/17	12/31/35	53	53	53	53	53	53	53	53	53	53
MSCG - Kingfisher II	01/01/17	12/31/35	28	28	28	28	28	28	28	28	28	28
SENA - (Shell)	06/01/14	05/24/23	885	885	885	0	0	0	0	0	0	0
Gulf Solar PPAs ^{1/}	11/17/14	11/17/40	34	34	34	34	34	34	34	34	34	34
Other Purchases Subtotal:			1,000	1,000	1,000	115	115	115	115	115	115	115

Total "Non-QF" Purchases =	1,000	1,000	1,000	115	115	115	115	115	115	115	115	115
-----------------------------------	--------------	--------------	--------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

Summer Firm Capacity Purchases Total MW:	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
	1,000	1,000	1,000	115	115	115	115	115	115	115

1/ These PPAs are non-firm, energy-only contracts due to the unscheduled, intermittent nature of solar resources. For resource planning purposes, a portion of the nameplate rating of the solar facilities has been, and continues to, provide, on average, a non-zero value at the system Summer peak hour.

Table I.B.3.3: Gulf Power Firm Purchased Power Winter MW

Summary of Gulf Power Firm Capacity Purchases: Winter MW (for January of Year Shown)

I. Purchases from QF's

Cogeneration Small Power Production Facilities	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
None	-	-	-	-	-	-	-	-	-	-	-	-
QF Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

II. Purchases from Utilities

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
None	-	-	-	-	-	-	-	-	-	-	-	-
Utility Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

Total of QF and Utility Purchases =	0	0	0	0	0	0	0	0	0	0	0	0
--	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------	----------

III. Other Purchases

	Contract Start Date	Contract End Date	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
MSCG - Kingfisher I	01/01/17	12/31/35	71	71	71	71	71	71	71	71	71	71
MSCG - Kingfisher II	01/01/17	12/31/35	38	38	38	38	38	38	38	38	38	38
SENA - (Shell)	06/01/14	05/24/23	885	885	885	0	0	0	0	0	0	0
Gulf Solar PPAs ^{1/}	11/17/14	11/17/40	0	0	0	0	0	0	0	0	0	0
Other Purchases Subtotal:			994	994	994	109	109	109	109	109	109	109

Total "Non-QF" Purchases =	994	994	994	109	109	109	109	109	109	109	109	109
-----------------------------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

Winter Firm Capacity Purchases Total MW:	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
	994	994	994	109	109	109	109	109	109	109

1/ These PPAs are non-firm, energy-only contracts due to the unscheduled, intermittent nature of solar resources. For resource planning purposes, a portion of the nameplate rating of the solar facilities has been, and continues to, provide, on average, a zero value at the system Winter peak hour.

I.B.4 Gulf - Demand Side Management (DSM)

Gulf has continually explored and implemented cost-effective DSM programs since 1981. These programs include a number of innovative conservation/energy efficiency initiatives. Importantly, Gulf's DSM efforts through 2019 have resulted in a cumulative Summer peak reduction of more than 500 MW at the generator and an estimated cumulative energy savings of approximately 1,079 Gigawatt-Hour (GWh) at the generator. After accounting for Gulf's current 16.25% total reserve margin requirements, Gulf's highly effective DSM efforts through 2019 have eliminated the need to construct the equivalent of approximately six (6) new 100 MW generating units. Also, it is important to note that Gulf has achieved these significant DSM accomplishments while minimizing the DSM-based impact on electric rates for all of its customers.

In 2019, the Florida Public Service Commission (FPSC) set DSM Goals for the years 2020 through 2024 for Gulf and the other Florida utilities subject to the Florida Energy Efficiency and Conservation Act (FEECA). These Goals are identical to the Goals set by the FPSC in 2014 for the years 2020 through 2024. In February 2020, Gulf filed for FPSC approval its DSM Plan with which it intends to meet the DSM Goals. In this Site Plan, Gulf assumes that the annual reduction values for Summer MW, Winter MW, and energy (MWh) set forth in the DSM Goals order (Order No. PSC-2019-0509-FOF-EG) will be met as shown in various schedules presented in this Site Plan. For the years 2025 through 2029, for which the FPSC did not establish Goals, it is assumed that DSM will be implemented to achieve the Goals Gulf proposed in its 2019 DSM Goals filing because this level of annual DSM was projected to be cost-effective.

Schedule 1

Gulf Power Existing Generating Facilities
As of December 31, 2019

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Plant Name	Unit No.	Location	Unit Type	Fuel Pri.	Fuel Alt.	Fuel Transport.		Fuel Days Use	Commercial In-Service Month/Year	Actual/Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capacity ^{1/}	
						Pri.	Alt.					Winter MW	Summer MW
Crist		Escambia County 25/1N/30W									<u>1,135,250</u>	<u>924</u>	<u>924</u>
	4		FS	C	NG	WA	PL	1	Jul-59	4th Q 2024	93,750	75	75
	5		FS	C	NG	WA	PL	1	Jun-61	4th Q 2026	93,750	75	75
	6		FS	C	NG	WA	PL	1	May-70	Unknown	369,750	299	299
Daniel ⁽¹⁾		Jackson County, MS 42/5S/6W									<u>548,250</u>	<u>502</u>	<u>502</u>
	1		FS	C	--	RR	--	--	Sep-77	1st Q 2024	274,125	251	251
Lansing Smith	2		FS	C	--	RR	--	--	Jun-81	1st Q 2024	274,125	251	251
		Bay County 36/2S/15W									<u>697,950</u>	<u>686</u>	<u>692</u>
A	3		CC	NG	--	PL	--	--	Apr-02	Unknown	656,100	646	660
			CT	LO	--	TK	--	--	May-71	4th Q 2027	41,850	40	32
Pea Ridge		Santa Rosa County 15/1N/29W									<u>14,250</u>	<u>15</u>	<u>12</u>
	1		CT	NG	--	PL	--	--	May-98	2nd Q 2025	4,750	5	4
	2		CT	NG	--	PL	--	--	May-98	2nd Q 2025	4,750	5	4
Perdido LFG	3		CT	NG	--	PL	--	--	May-98	2nd Q 2025	4,750	5	4
		Escambia County									<u>3,200</u>	<u>3</u>	<u>3</u>
1			IC	LFG	--	PL	--	--	Oct-10	4th Q 2029	1,600	1.5	1.5
	2		IC	LFG	--	PL	--	--	Oct-10	4th Q 2029	1,600	1.5	1.5
Scherer ⁽¹⁾		Monroe County, GA									<u>222,750</u>	<u>215</u>	<u>215</u>
	3		FS	C	--	RR	--	--	Jan-87	Unknown	222,750	215	215
Total System Generating Capacity as of December 31, 2019 ^{6/} =												2,345	2,348
System Firm Generating Capacity as of December 31, 2019 ^{7/} =												2,345	2,348

^{1/} Unit capabilities shown represent Gulf's portion of Daniel units 1 & 2 (50%) and Scherer Unit 3 (25%).

(This page is intentionally left blank.)

CHAPTER II

Forecast of Electric Power Demand

(This page is intentionally left blank.)

II. Forecast of Electric Power Demand

II.A. Overview of the Load Forecasting Process

On January 1, 2019, Gulf Power became a subsidiary of NextEra Energy, the parent company of FPL. The load forecasting teams from FPL and Gulf were consolidated into one load forecasting team, which developed the forecasts of customers, sales, net energy for load (NEL), and peak demands presented in this Site Plan. Modifications were made to the standalone methodologies that were formerly applied to FPL and/or Gulf. The result is that consistent forecasting methodologies are now being applied to both the FPL and Gulf areas. These modifications are detailed later in this chapter. However, at the time this 2020 Site Plan is filed, the forecasting methodologies used to provide the load forecast information presented in this document are evolving as work to integrate the two companies is ongoing. The load forecasting team will evaluate and implement appropriate enhancements to the forecasting methodologies for upcoming forecasts.

As previously discussed, FPL and Gulf plan to integrate the two systems into a single electric system, effective 1/1/2022. In this document, the load forecasts for FPL and Gulf will be presented separately for the years 2020 and 2021. For 2022 through 2029, the load forecast for the single integrated utility will be presented. That electrically integrated system will be referred to in this document as FPL. This forecast will reflect the growth of the new integrated system, including reduced peak demand from load diversity.

FPL and Gulf typically develop long-term forecasts of customers, energy sales, and peak loads on an annual basis for each of their systems. This was done again in order to develop load forecasts for the single integrated system. Gulf's new long-term forecasts were developed in the 3rd Quarter of 2019 and FPL's new long-term forecasts were developed in the 4th Quarter of 2019⁷. The forecasts for FPL and Gulf then were combined to arrive at the forecasts for the single integrated system for the years 2022 and beyond. These new load forecasts are utilized throughout this 2020 Site Plan and are key inputs to the models used to develop the integrated resource plan presented in this document.

The following pages describe how the forecasts of customers, energy sales, and peak loads were developed first separately for FPL and Gulf, and then combined into a single set of forecasts for the integrated system. Consistent with past forecasts, the drivers for both the FPL

⁷ At the time the forecasts presented in this TYSP were developed, Gulf was obligated as member of the Southern Company pool to provide updated NEL and peak demand forecasts to Southern Company Services for their planning process. The difference in the timing of the planning processes resulted in Gulf's forecast being completed prior to FPL's forecast.

and Gulf forecasts include population and household growth, economic conditions, electricity prices, weather, and energy-efficiency codes and standards. Additionally, these forecasts are 50% probability (P50) forecasts. This means there is a 50% probability that actual load will be on either side of forecasted load.

The projections for population growth, household growth, and other economic variables are obtained from IHS Markit, a leading economic forecasting firm. Using statistical models, these inputs are quantified in terms of their impact on the future demand for electricity.

Weather is a key factor that affects energy sales and peak demand. The weather variables for use in FPL's and Gulf's forecasting models are as follows:

1. The residential and commercial energy models incorporate heating degree hours and/or cooling degree hours. The threshold temperatures differ based on how each customer group responds to temperatures.
2. The Summer peak demand models incorporate maximum temperatures on the peak Summer day while the Winter peak demand models incorporate minimum temperatures on the peak Winter day. Additional details are provided later in this chapter.

FPL's weather variables are based on a composite hourly temperature using temperatures from weather stations across FPL's service area: Miami, Ft. Myers, Daytona Beach, and West Palm Beach. The temperatures for each weather station are weighted based on the energy sales associated with that region. The resulting composite temperatures are then used to derive FPL's cooling degree hours and heating degree hours used in the energy models and the peak day temperatures used in the Summer and Winter peak demand models.

Gulf's weather variables are based on the hourly temperatures from the Pensacola weather station. The Pensacola hourly temperatures are then used to derive Gulf's cooling degree hours and heating degree hours used in the energy models and the peak day temperatures used in the Summer and Winter peak demand models. The eight counties in Gulf's service area typically experience similar weather patterns and previous experience has shown that the use of multiple weather stations does not result in significant differences in the reported weather. The Pensacola weather station is used due to the availability of consistent historical data.

II.B. Customer Forecasts

FPL's customer forecasts are developed by class as the factors driving customer growth vary by class. Residential customer growth is driven by population, commercial customer growth is

driven by employment and recent trends, and industrial customer growth is driven by housing starts and recent trends. Projections of population, employment, and housing starts are from IHS Markit. Total customer growth is projected to grow at an average annual rate of 1.0% during the years 2020 and 2021. The primary driver of customer growth is population.

Gulf's customer forecasts are also developed by class. Residential customer growth for 2020 and 2021 are based on projections prepared by Gulf's field marketing managers and growth for years 2022 and beyond are based on household growth projection from IHS Markit. Commercial customer growth for 2020 is based on projections prepared by Gulf's field marketing manager and commercial customer growth for years 2021 and beyond is based on residential customer growth. Industrial customer growth is driven by recent trends. Total customer growth is projected to grow at an average annual rate of 1.63% during the years 2020 and 2021. The primary driver of customer growth is population growth.

The customer forecasts for the integrated system for 2022-on is the sum of the class-level customer forecasts for FPL and Gulf, which represent 91.5% and 8.5% of the combined 2022 customers, respectively. Total customer growth is projected to grow at an average annual rate of 0.9% during the forecast period. The primary driver of customer growth is projected increase in population.

II.C. Energy Sales Forecasts

Energy sales forecasts for both FPL and Gulf were developed for the major revenue classes, wholesale energy sales, and losses. Energy adjustments, such as electric vehicles and private solar, were calculated and applied to the class-level energy sales forecasts. These forecasts were then aggregated up to arrive at the NEL forecast for each company (a bottom-up approach). Econometric models were developed using the statistical software package MetrixND.

The FPL energy sales forecast presented in this TYSP for the years 2020 and 2021 was developed using a bottom-up approach whereas prior FPL forecasts were developed using a top-down approach in which the forecast began with the NEL forecast and class-level forecasts were then adjusted to match the NEL forecast. FPL's adoption of the same bottom-up approach that has been used by Gulf has several potential benefits. This approach ensures a consistent energy sales forecasting methodology is being used for both utility systems. In addition, the bottom-up approach has the potential for enhancing both the ability to perform forecast variance analyses as actual load data becomes available and for enhancing the ability to capture different growth rates between revenue classes.

1. Residential Sales

FPL's residential energy sales forecast was developed using an econometric model. Residential energy sales, expressed as monthly use per customer by billing day, are a function of cooling degree hours, heating degree hours, real per capita income, the four month moving average of real electricity price increases over time, energy savings from changes to energy efficiency codes and standards, monthly binary terms, and an autoregressive term. The forecasted energy use per customer per billing day was then multiplied by the projected number of residential customers and projected billing days by month to arrive at the residential billed energy sales. The billed energy sales were then adjusted for unbilled energy to arrive at the calendar month delivered energy sales forecast.

Gulf's residential energy sales forecast was also developed using an econometric model. Monthly use per customer per billing day was estimated based on historical data, normal weather, price of electricity, energy savings from changes to energy efficiency codes and standards, monthly binary terms, and an autoregressive term. The model output was then multiplied by the projected number of residential customers and projected billing days by month to expand to the total residential class.

The methodology described above for Gulf was used for the entire forecast horizon whereas prior forecasts applied this methodology only for the short-term. Growth rates from the LoadMAP-R electric utility end-use model were then used to extend the short-term residential sales forecast into the long-term forecast horizon. Gulf's adoption of the long-term model results for the entire forecast horizon ensures both FPL and Gulf are employing enhanced energy sales forecasting methodologies.

Both FPL's and Gulf's residential energy sales forecasts were adjusted to reflect the anticipated impact of continued adoption of electric vehicles. FPL's residential energy sales forecast was also adjusted to reflect the impact of private solar.

The residential energy sales forecast for the integrated system for the year 2022-on is the sum of the residential sales forecasts for FPL and Gulf, which represent, respectively, 91.5% and 8.5% of the combined 2022 residential sales. Residential energy sales are projected to grow at an average annual rate of 0.9% during the forecast period.

2. Commercial Sales

Econometric models were also used to develop a commercial sales forecast for FPL. The commercial class is forecast using one model for lighting accounts and three separate

models based on customer size: small accounts (less than 20 kW of demand), medium accounts (21 kW to 499 kW of demand), and large accounts (demand of 500 kW or higher). Except for the commercial lighting accounts model, the commercial sales models utilize the following variables: cooling degree hours, employment, and the four month moving average of real electricity price increases. Monthly binary terms were utilized in the large and medium models; and an autoregressive term was utilized in the medium and small models. The model outputs were then multiplied by the projected number of commercial customers associated with each respective model and the projected billing days by month to arrive at the billed energy sales. The billed energy sales were then adjusted for unbilled energy to arrive at the calendar month delivered energy sales forecast. The commercial lighting accounts model is based on historical sale trends and input from FPL's lighting group regarding the impact of LEDs. These forecasts are then added together to arrive at the total commercial sales forecast.

Econometric models were also used to develop a commercial non-lighting sales forecast for Gulf. The commercial non-lighting sales is forecast using two separate models which are based on customer size: small accounts (less than 25 kW of demand) and large accounts (all other commercial rate schedules excluding lighting rates). The models utilize the following variables: cooling degree hours, heating degree hours, twelve month moving average of real electricity prices, energy savings from changes to energy efficiency codes and standards, monthly binary terms, and an autoregressive term. The model outputs were then multiplied by the projected number of commercial customers associated with each respective model and the projected billing days by month to arrive at the billed energy sales. The billed energy sales were then adjusted for unbilled energy to arrive at the calendar month delivered energy sales forecast. The commercial lighting sales were developed using historical growth rates and input from Gulf's lighting team to gain insight into future trends.

The methodology described above for Gulf's forecast was used for the entire forecast horizon while prior forecasts employed this methodology only for the short-term forecast. Growth rates from the LoadMAP-C electric utility end-use model are then used to extend the short-term commercial sales forecast into the long-term forecast horizon. Gulf's adoption of the long-term results for the entire forecast horizon ensures both FPL and Gulf are employing enhanced energy sales forecasting methodologies.

FPL's commercial energy sales forecast was adjusted to reflect the impact of private solar and the incremental load projected to be added for the forecast period from FPL's economic development riders.

The commercial energy sales forecast for the integrated system for the years 2022-on is the sum of the commercial sales forecasts for FPL and Gulf, which represent, respectively, 93.0% and 7.0% of the combined 2022 commercial sales. Commercial energy sales are projected to grow at an average annual rate of 0.4% during the forecast period.

3. Industrial Sales

Forecasts developed for FPL's industrial class sales consists of one model for lighting accounts and three separate models based on customer size: small accounts (less than 20 kW of demand), medium accounts (21 kW to 499 kW of demand), and large accounts (demands of 500 kW or higher). The small industrial sales model utilizes cooling degree hours, an autoregressive term, and a lagged variable. The medium, large, and lighting accounts forecasts utilize exponential smoothing models. The small, medium, large, and lighting accounts forecasts were then added together to arrive at the total industrial sales forecast.

Forecasts for Gulf's industrial class sales used a combination of surveys of major industrial customers and historical average use per customer. Gulf's largest industrial customers were interviewed by Gulf's industrial account representatives to identify expected future load changes. The forecast of sales to the remaining smaller industrial customers was developed by rate code using historical average use per customer, which was multiplied by the projected number of customers to arrive at energy sales. The forecasts for the largest industrial customers and the remaining smaller industrial customers were added together to arrive at the total industrial sales forecast.

FPL's Industrial energy sales were adjusted for forecasted Commercial/Industrial Service Rider (CISR) sales for new or retained customer loads of 2 MW or greater and meet the criteria outlined in FPL's Rate Schedule: CISR-1.

The industrial energy sales forecast for the integrated system for the years 2022-on is the sum of the industrial sales forecasts for FPL and Gulf, which represent, respectively, 65.9% and 34.1% of the combined 2022 industrial sales. Industrial energy sales are projected to remain mostly flat during the forecast period, only growing at an average annual rate of 0.2%.

4. Railroad and Railway Sales and Street and Highway Sales

FPL's Railroad and Railway class consists solely of Miami-Dade County's Metrorail system. The projections for railroad and railways sales are based on a historical moving average.

FPL develops the forecast for Street and Highway sales by first developing a trended use-per-customer value, then multiplying this value by the number of forecasted customers.

Gulf's street and highway class consists of outdoor lighting accounts for governmental entities and municipal services benefit units (MSBU). An MSBU is a non-ad valorem assessment district established for funding improvements, such as street lighting, in a specific geographic area. The projections for street and highway sales are based on historical growth rates and inputs from Gulf's lighting team to gain insight into future trends.

5. Other Public Authority Sales

This class is applicable only to FPL and consists of a sports field rate schedule (which is closed to new customers) and one government account. The forecast for this class is based on its historical usage characteristics.

6. Total Sales to Ultimate Customer

The sales forecasts by revenue class for FPL and Gulf are each summed to produce their respective total sales forecasts.

7. Sales for Resale

Sales for resale (wholesale) customers are comprised of sales to municipalities and/or electric co-operatives. These customers differ from jurisdictional customers in that they are not the ultimate users of the electricity. Instead, they resell this electricity to their own customers.

The load forecast for FPL includes wholesale loads served under full and partial-requirements contracts that provide other utilities all, or a portion of, their load requirements at a level of service equivalent to FPL's own native load customers. There are currently nine customers in this class: Florida Keys Electric Cooperative, Lee County Electric Cooperative, New Smyrna Beach, Wauchula, Homestead, Quincy, Moore Haven, Florida Public Utilities Company, and Seminole Electric Cooperative.⁸

⁸ FPL continues to evaluate the possibility of serving the electrical loads of other entities at the time this Site Plan was being prepared. Because these possibilities are still being evaluated, the load forecast presented in this Site Plan does not include these potential loads.

The load forecast for Gulf also includes a full-requirements wholesale contract that provide another utility all of their load requirement at a level of service equivalent to Gulf's own native load customers. There is currently one customer in this class: Florida Public Utilities Company.

Since May 2011, FPL has provided service to the Florida Keys Electric Cooperative under a long-term, full-requirements contract. The sales to Florida Keys Electric Cooperative are based on customer-supplied information and historical coincidence factors.

FPL sales to Lee County began in 2010. Lee County has a contract with FPL for the full-requirements of their load that is projected to continue through 2033, with an option to extend the contract through 2053. Forecasted NEL for Lee County is based on customer-supplied information and historical usage trends.

FPL sales to New Smyrna Beach began in February 2014. The contract is projected to continue through December 2021. Under a second contract, additional sales to New Smyrna Beach began in July 2017 and are also projected to continue through December 2021. Under a third contract, sales to New Smyrna again increased beginning in January 2019 and these are also projected to continue through December 2021

FPL's sales to Wauchula began in October 2011. The contract is projected to continue through December 2023.

FPL sales to Homestead began in August 2015. The contract is projected to continue through December 2026. Under a separate contract, additional sales to Homestead began in January 2020 and are also projected to continue through December 2026.

FPL sales to Quincy began in January 2016. The contract is projected to continue through December 2023.

FPL sales to Moore Haven began in July 2016. The contract is projected to continue through December 2025.

FPL sales to Florida Public Utilities Company began in January 2018. The contract is projected to continue through December 2026.

FPL sales to Seminole Electric Cooperative are based on delivery of 200 MW that began in June 2014 and is projected to continue through May 2021.

Gulf Power sales to Florida Public Utilities Company is projected to continue through December 2026.

II.D. Net Energy for Load (NEL)

The NEL forecast for both FPL and Gulf are the sums of the retail energy, wholesale energy, and losses. Through the use of the energy efficiency variable, the retail energy sales forecast includes the impacts from major energy efficiency codes and standards, including those associated with the 2005 National Energy Policy Act, the 2007 Energy Independence and Security Act, and savings resulting from the use of compact fluorescent bulbs (CFLs) and LEDs. The estimated impact from these codes and standards includes engineering estimates and any resulting behavioral changes. The impact of these savings began in 2005 and, from that year, their cumulative impact on NEL for the integrated system is projected to be a reduction of 6,028 GWh by 2029. This represents an approximately 4.2% reduction in what the forecasted NEL for 2029 would have been absent these codes and standards. From the end of 2019, the incremental reduction through 2029 is expected to be 2,482 GWh. The estimated impacts from codes and standards are based on the energy efficiency variables in the respective energy models. Previously, FPL's NEL forecast was based on a top-down approach using a single model for NEL which included an energy efficiency variable. The result of this approach assigned energy efficiency savings to all FPL customer classes.

FPL's current NEL forecast, however, is based on a bottoms-up approach using separate models for each class. The result of this approach found that the energy efficiency variables were not statistically significant⁹ for the commercial customer model, and as such, the impact associated with energy efficiency on FPL's commercial sales cannot be quantified separately using the current models. While this energy efficiency impact cannot be separately quantified using the current models, this should not be interpreted as though energy efficiency is not impacting commercial customers nor that the NEL forecast is not accounting for this impact. What it means is that this impact for the commercial class is being captured in another variable within the model. However, as a result, it appears that there is a decline in the explicitly quantified energy efficiency impact on total NEL through 2029 compared to the results presented in the 2019 Site Plan. As previously mentioned, FPL routinely evaluates its

⁹ The efficiency variable was highly correlated with the price term, and the resulting multicollinearity issue resulted in the variable exhibiting a high p-value. Variables with a high p-value are not statistically significant to the model.

methodologies and models for potential refinements and one area for possible refinement is in regard to separately quantifying the impact of energy efficiency codes and standards for commercial class customers.

FPL makes an adjustment for the impact of incremental private solar projected to be added during the forecast period. The impact of private solar on the NEL forecast for the integrated system is projected to be a reduction of approximately 1,311 GWh by 2029. FPL and Gulf also adjust for the additional load projected to be added due to the incremental adoption of new plug-in electric vehicles. This results in an increase on the integrated system of approximately 1,686 GWh by 2029. The forecast is also adjusted for the incremental load projected to be added to FPL's system from FPL's economic development riders forecast. This incremental load is projected to be approximately 252 GWh by 2029.

II.E. System Peak Forecasts

The rate of absolute growth in peak load for both FPL and Gulf has been a function of the size of the customer base, weather, projected economic conditions, and energy-efficiency codes and standards. The peak forecast models capture these behavioral relationships. In addition, the peak forecast for FPL also reflects changes in load expected from private solar, the expected number of plug-in electric vehicles, FPL's economic development riders, and wholesale requirements contracts. With respect to the peak forecast for Gulf, the projected impacts of private solar and electric vehicles are believed to be relatively small. However, the ability to better incorporate projected impacts of private solar and EVs in Gulf's area is another aspect of the current forecasting methodologies for which the load forecasting team will evaluate for additional refinements in upcoming forecasts.

The monthly peak load for the integrated system from 2022-on is the highest hourly demand from the forecasted system hourly load forecast, which was developed by summing the forecasted system hourly loads for FPL and Gulf. The integrated system peak load forecast reflects the growth in peak load for FPL and Gulf along with the peak demand savings associated with load diversity.

As separate systems, FPL and Gulf peak at different hours and this difference is due to load diversity. The load diversity is primarily due to their respective loads being located in different time zones and the benefit of load diversity is that the combined system peak demand is lower than the sum of the standalone FPL and Gulf peaks demands. By 2029, the load diversity results

in a projected reduction to the integrated system peaks of 103 MW in the Summer and 190 MW in the Winter. This represents savings for customers.

The savings from energy-efficiency codes and standards incorporated into the peak forecast include the impacts from the 2005 National Energy Policy Act, the 2007 Energy Independence and Security Act, and the use of CFLs and LEDs. The impact from these energy-efficiency standards began in 2005, and their cumulative reduction, from that year, on the integrated Summer peak is projected to reach approximately 5,732 MW by 2029. This reduction includes engineering estimates and any resulting behavioral changes.

The cumulative 2029 impact from these energy-efficiency codes and standards is projected to effectively reduce the integrated system's Summer peak for that year by approximately 19%. From the end of 2019, the projected incremental impact on the Summer peak from these energy-efficiency codes and standards is a reduction of approximately 1,848 MW through 2029.

The peak forecast for FPL was also adjusted for the additional load estimated from private solar, plug-in electric vehicles, and FPL's economic development riders. The impact from plug-in electric vehicles is projected to be an increase on the integrated system of approximately 582 MW in the Summer and 291 MW in the Winter by the end of 2029. The impact on the integrated system from FPL's economic development riders is projected to be an increase of approximately 29 MW in the Summer peak and 61 MW in the Winter peak. The incremental impact of private solar on the integrated system is an expected decrease of approximately 327 MW in the Summer and a negligible reduction in the Winter by the end of 2029.

The forecasting methodology for Summer, Winter, and monthly system peaks is discussed below.

The forecasted values for FPL's and Gulf's Summer and Winter peak loads for the years 2020 through 2021 are presented separately at the end of this chapter in Schedules 3.1 and 3.2, and in Chapter III in Schedules 7.1 and 7.2. For the years 2022 through 2029, only forecasted values for the integrated system are presented on these schedules.

1. System Summer Peak

The Summer peak forecast for FPL is developed using an econometric model based on the Summer peak contribution per customer. The variables included in the model are Florida real per capita income, cooling degree hours two days prior to the peak day, the maximum temperature on the day of the peak, a variable for energy efficiency codes and standards,

binary variables years 2005 and 2019, and autoregressive terms. The model output is multiplied by the total number of customers to arrive at the projected Summer peak demand. This product is then adjusted to account for the expected changes in loads resulting from private solar, plug-in electric vehicles, FPL's economic development riders, and wholesale requirements contracts to derive FPL's system Summer peak.

The Summer peak forecast for Gulf is developed using an econometric model based on the Summer peak contribution per customer. The variables included in the model are the maximum temperature on the day of the peak, a variable for energy efficiency codes and standards, employment-weighted real per capita income, and an autoregressive term. The model output is multiplied by the total number of customers to arrive at the projected Summer peak demand.

Summer peak forecasts presented in Gulf's prior Site Plans were developed using the Peak Demand Model (PDM) which spread the energy projections using historical load shapes to develop forecasted hourly load shapes and the monthly forecast peak demand was the single highest hour in each month. Adoption of the econometric modeling approach for Summer peak forecast ensures FPL and Gulf are employing enhanced peak demand forecasting methodologies.

The Summer peak demand forecast for the integrated system for 2022-on is the highest hourly demand during the Summer months from the integrated system hourly forecast, which was developed by summing the forecasted system hourly loads for FPL and Gulf. This approach ensures the Summer peak demand forecast for the integrated system reflects the growth in Summer peak load for FPL and Gulf along with the Summer peak demand savings associated with load diversity. The Summer peak demand for the integrated system is projected to occur in August.

2. System Winter Peak

The Winter peak forecast for FPL is developed using an econometric model based on the Winter peak contribution per customer. The variables included in the model are employment-weighted real per capita income, the minimum temperature on the peak day, a weather-related variable capturing cold buildup, a binary variable for year 2008, and a trend variable. The model output is multiplied by the total number of customers to arrive at the projected Winter peak demand. The projection is then adjusted for the expected changes in loads resulting from private solar, plug-in electric vehicles, FPL's economic development riders, and wholesale requirement contracts.

The Winter peak forecast for Gulf was developed using an econometric model based on the Winter peak contribution per customer. The variables included in the model are the minimum temperature on the peak day, a variable for energy efficiency codes and standards, and autoregressive terms. The model output is then multiplied by the total number of customers to arrive at the projected Winter peak demand.

The Winter peak forecasts presented in prior Gulf Site Plans were developed using the PDM model. Adoption of the econometric modeling approach for Winter peak forecast ensures FPL and Gulf are employing enhanced peak demand forecasting methodologies.

The Winter peak demand forecast for the integrated system is the highest hourly demand during the Winter months from the integrated system hourly forecast. This approach ensures the integrated Winter peak demand forecast reflects the growth in the Winter peak load for FPL and Gulf along with the Winter peak demand savings associated with load diversity. The Winter peak demand for the integrated system is projected to occur in January.

3. Monthly Peak Forecasts

The forecasting process for FPL's monthly peaks begins with two assumptions. First, the forecasted annual Summer peak is assumed to occur in the month of August, which historically has accounted for more annual Summer peaks than any other month. Second, the forecasted annual Winter peak is assumed to occur in the month of January, which historically has accounted for more annual Winter peaks than any other month. Then the remaining monthly peaks are forecasted based on the historical relationship between the monthly peaks and the annual Summer peak.

The forecasting process for Gulf's monthly peaks begins with two assumptions. First, the forecasted annual Summer peak is assumed to occur in the month of July, which historically has accounted for more annual Summer peaks than any other month. Second, the forecasted annual Winter peak is assumed to occur in the month of January, which historically has accounted for more annual Winter peaks than any other month. Then the remaining monthly peaks are forecasted based on the historical relationship between the monthly peaks and the annual Summer peak.

Monthly peak forecasts presented in prior Gulf Site Plans were developed using the PDM model. Gulf's adoption of FPL's monthly peak demand forecast process ensures FPL and Gulf are employing enhanced monthly peak demand forecasting methodologies.

The monthly peak demand forecast for the integrated system for 2022-on is the highest hourly demand by month from the integrated system hourly forecast. This approach ensures the integrated monthly peak demand forecast reflects the growth in monthly peaks for FPL and Gulf along with the monthly peak demand savings associated with load diversity.

II.F. Hourly Load Forecast

Forecasted values for system hourly load on the FPL system for the period 2020 through 2029 were developed using a system load forecasting program named MetrixLT. This model uses years of historical FPL hourly system load data to develop load shapes. The model generates a projection of hourly load values based on these load shapes and the forecast of FPL's monthly peaks and energy.

Forecasted values for system hourly load on the Gulf system for the period 2020 to 2029 were also developed using MetrixLT, which uses historical Gulf hourly system load data to develop load shapes. The model generates a projection of hourly load values based on these load shapes and the forecast of Gulf's monthly peaks and energies.

The forecasted values for system hourly load on the integrated system for 2022-on were the summation of the FPL and Gulf hourly load for the period. The Gulf system hourly load was adjusted from Central to Eastern time zone to be consistent with FPL's system hourly load.

II.G. Uncertainty

Uncertainty is inherent in the load forecasting process. This uncertainty can result from a number of factors, including unexpected changes in consumer behavior, structural shifts in the economy, and fluctuating weather conditions. Large weather fluctuations, in particular, can result in significant deviations between actual and forecasted peak demands. The load forecast is based on average expected or normal weather conditions. An extreme 90% probability (P90) cold weather event can add an additional 3,000 MW or more to the Winter peak, and an extreme P90 hot weather event can add an additional 750 MW to the Summer peak.

In order to address uncertainty in the forecast of aggregate peak demand and NEL, the assumptions underlying the forecasts are first evaluated. Then a series of steps are taken to evaluate the input variables, including comparing projections from different sources, identifying outliers in the series, and assessing the series' consistency with past forecasts. Additional factors that may affect the input variables are reviewed as needed.

Uncertainty is also addressed in the modeling process. Econometric models generally are used to forecast peak demands and energies. During the modeling process, relevant statistics such as (goodness of fit, F-statistic, P-values, mean absolute deviation (MAD), mean absolute percentage error (MAPE), etc.) are scrutinized to ensure the models adequately explain historical variation. Once a forecast is developed, it is compared with past forecasts. Deviations from past forecasts are examined in light of changes in input assumptions to ensure that the drivers underlying the forecast are thoroughly understood. Finally, forecasts of aggregate peak demand and NEL are compared with the actual values as they become available. An ongoing process of variance analyses is performed. To the extent the variance analyses identify large unexplained deviations between the forecast and actual values, revisions to the econometric model may be considered. Finally, the forecasting group regularly engages with forecasting professionals from other electric utilities to share best practices and changes to existing processes may be considered.

The inherent uncertainty in load forecasting is addressed in different ways in regard to the overall resource planning and operational planning work. With respect to resource planning work, the utilization of a 20% total reserve margin (TRM) criterion, a Loss-of-Load-Probability (LOLP) criterion of 0.1, and a 10% generation-only reserve margin (GRM) criterion are designed to maintain reliable electric service for customers in light of forecasting and other uncertainties. In addition, banded forecasts of the projected Summer peak and NEL may be produced based on an analyses of past forecasting variances. A banded forecast for the projected Summer and Winter peak days may also be developed based on historical weather variations. These bands are then used to develop similar bands for the monthly peaks. A P80 monthly peak forecast is typically provided to FPL's System Operations group for operational planning purposes.

II.H. DSM

FPL and Gulf assume that the effects of its DSM energy-efficiency programs through August 2019 are embedded in the actual usage data for forecasting purposes. In addition, the utilities account for the following projected DSM MW and MWh impacts as "line item reductions" to the forecasts as part of the IRP process: 1) the impacts of incremental energy efficiency that the utilities have implemented in the September 2019 through December 2019 time period (*i.e.*, after the 2019 Summer peak has occurred), 2) projected impacts from incremental energy efficiency that FPL plans to implement in 2020 through 2024 in response to the DSM Goals that were set for each utility by the FPSC in the 4th Quarter of 2019 for the 2020 – 2024 time period, 3) the inclusion of additional currently projected cost-effective DSM for the years 2025 through 2029, and 4) the cumulative and projected incremental impacts of FPL's load management

programs through 2029. After making these adjustments to the load forecasted load values, the resulting “firm” load forecast as shown in Chapter III in Schedules 7.1 and 7.2., is then used in the IRP work.

**Schedule 2.1: FPL
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Population	Members per Household	Rural & Residential			Commercial		
			GWh	Average No. of Customers	Average kWh Consumption Per Customer	GWh	Average No. of Customers	Average kWh Consumption Per Customer
2010	8,851,966	2.21	56,343	4,004,366	14,070	44,544	503,529	88,464
2011	8,979,403	2.23	54,642	4,026,760	13,570	45,052	508,005	88,685
2012	9,096,135	2.24	53,434	4,052,174	13,187	45,220	511,887	88,340
2013	9,219,688	2.25	53,930	4,097,172	13,163	45,341	516,500	87,786
2014	9,357,139	2.24	55,202	4,169,028	13,241	45,684	525,591	86,919
2015	9,517,833	2.25	58,846	4,227,425	13,920	47,369	532,731	88,916
2016	9,687,433	2.26	58,687	4,284,159	13,699	47,355	540,356	87,637
2017	9,824,821	2.26	58,188	4,338,224	13,413	47,151	547,908	86,056
2018	10,004,467	2.28	59,096	4,391,832	13,456	47,394	553,562	85,616
2019	10,119,121	2.26	60,325	4,479,356	13,467	48,078	565,622	85,000

Historical Values (2010 - 2019):

Col. (2) represents population only in the area served by FPL.

Col. (4) and Col. (7) represent actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (5) and Col. (8) represent the annual average of the twelve monthly values.

**Schedule 2.1: Gulf
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Population	Members per Household	Rural & Residential			Commercial		
			GWh	Average No. of Customers	Average kWh Consumption Per Customer	GWh	Average No. of Customers	Average kWh Consumption Per Customer
2010	873,320	2.32	5,651	375,847	15,036	3,997	53,349	74,912
2011	882,950	2.33	5,305	378,157	14,028	3,911	53,409	73,235
2012	898,710	2.37	5,054	379,897	13,303	3,859	53,706	71,846
2013	911,720	2.38	5,089	382,599	13,301	3,810	54,261	70,215
2014	923,520	2.39	5,362	386,765	13,865	3,838	54,749	70,104
2015	936,420	2.39	5,365	391,465	13,705	3,898	55,234	70,566
2016	949,240	2.39	5,358	396,408	13,515	3,869	55,876	69,236
2017	962,790	2.40	5,229	401,793	13,015	3,814	56,428	67,583
2018	977,810	2.40	5,519	406,949	13,563	3,829	56,892	67,298
2019	990,370	2.43	5,520	407,436	13,548	3,775	56,590	66,710

Historical Values (2010 - 2019):

Col. (2) includes the Pensacola, Crestview, and Panama City MSAs, which are generally representative of the area served by Gulf.

Col. (4) and Col. (7) represent actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (5) and Col. (8) represent the annual average of the twelve monthly values.

**Schedule 2.1
Forecast of Energy Consumption
And Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Population	Members per Household	Rural & Residential			Commercial		
			GWh	Average No. of Customers	Average kWh Consumption Per Customer	GWh	Average No. of Customers	Average kWh Consumption Per Customer
FPL								
2020	10,227,063	2.26	59,382	4,527,529	13,116	48,037	572,459	83,914
2021	10,335,192	2.26	59,814	4,568,149	13,094	48,469	579,245	83,677
Gulf								
2020	1,000,760	2.42	5,405	414,018	13,029	3,646	57,318	63,564
2021	1,010,360	2.40	5,433	421,341	12,852	3,629	57,932	62,563
Integrated FPL and Gulf								
2022	11,465,461	2.28	65,314	5,036,516	12,963	52,262	644,416	81,100
2023	11,586,120	2.28	65,784	5,084,160	12,932	52,440	650,778	80,581
2024	11,708,833	2.28	66,480	5,129,346	12,952	52,735	656,117	80,374
2025	11,832,535	2.29	66,969	5,173,248	12,937	52,937	660,837	80,107
2026	11,956,071	2.29	67,586	5,217,662	12,945	53,177	665,392	79,918
2027	12,080,045	2.30	68,285	5,261,200	12,971	53,433	669,923	79,760
2028	12,204,016	2.30	69,176	5,303,021	13,037	53,783	674,471	79,741
2029	12,328,021	2.31	69,845	5,344,810	13,060	53,871	679,110	79,326

Projected Values (2020 - 2029):

Col. (2) represents population in the areas served by FPL and Gulf separately for 2020 and 2021, and by the single integrated system for 2022 - 2029

Col. (4) and Col. (7) represent forecasted energy sales that do not include the impact of incremental conservation. These values are at the meter.

Col. (5) and Col. (8) represent the annual average of the twelve monthly values.

**Schedule 2.2: FPL
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
Year	Industrial			Railroads & Railways	Street & Highway Lighting	Sales to Public Authorities	Sales to Ultimate Consumers
	<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>
2010	3,130	8,910	351,318	81	431	28	104,557
2011	3,086	8,691	355,104	82	437	27	103,327
2012	3,024	8,743	345,871	81	441	25	102,226
2013	2,956	9,541	309,772	88	442	28	102,784
2014	2,941	10,415	282,398	91	446	24	104,389
2015	3,042	11,318	268,799	92	448	23	109,820
2016	3,059	11,770	259,853	92	447	23	109,663
2017	2,961	11,654	254,103	83	446	41	108,871
2018	3,013	11,601	259,728	80	447	23	110,053
2019	2,994	11,799	253,759	82	428	23	111,929

Historical Values (2010 - 2019):

Col. (16) represents actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (11) represents the annual average of the twelve monthly values.

Col. (16) = Schedule 2.1 Col. (4) + Schedule 2.1 Col. (7) + Col. (10) + Col. (13) + Col. (14) + Col. (15).

**Schedule 2.2: Gulf
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
Year	Industrial			Railroads & Railways	Street & Highway Lighting	Sales to Public Authorities	Sales to Ultimate Consumers
	<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>
2010	1,686	275	6,133,961	0	26	0	11,359
2011	1,799	273	6,586,591	0	25	0	11,040
2012	1,725	267	6,453,071	0	25	0	10,663
2013	1,700	258	6,581,320	0	21	0	10,620
2014	1,849	258	7,165,343	0	25	0	11,075
2015	1,798	249	7,235,499	0	25	0	11,086
2016	1,830	247	7,402,625	0	25	0	11,082
2017	1,740	255	6,815,486	0	26	0	10,809
2018	1,757	253	6,931,497	0	28	0	11,132
2019	1,756	250	7,026,958	0	28	0	11,079

Historical Values (2010 - 2019):

Col. (16) represents actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (11) represents the annual average of the twelve monthly values.

Col. (16) = Schedule 2.1 Col. (4) + Schedule 2.1 Col. (7) + Col. (10) + Col. (13) + Col. (14) + Col. (15).

**Schedule 2.2
Forecast of Energy Consumption
And Number of Customers by Customer Class**

(1)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
Year	Industrial		Average kWh Consumption Per Customer	Railroads & Railways GWh	Street & Highway Lighting GWh	Sales to Public Authorities GWh	Sales to Ultimate Consumers GWh
	GWh	Average No. of Customers					
FPL							
2020	3,071	12,244	250,838	80	401	20	110,993
2021	3,152	12,722	247,739	80	399	20	111,934
Gulf							
2020	1,738	251	6,923,042	0	28	0	10,816
2021	1,663	251	6,624,257	0	28	0	10,752
Integrated FPL and Gulf							
2022	4,874	13,270	367,281	80	417	20	122,968
2023	4,875	13,414	363,429	80	420	20	123,619
2024	4,875	13,469	361,955	80	429	20	124,619
2025	4,876	13,559	359,611	80	450	20	125,333
2026	4,877	13,648	357,302	80	456	20	126,195
2027	4,876	13,640	357,499	80	462	20	127,156
2028	4,876	13,589	358,814	80	462	20	128,398
2029	4,876	13,570	359,309	80	462	20	129,154

Projected Values (2020 - 2029):

Col. (10) and Col.(15) represent forecasted energy sales that do not include the impact of incremental conservation. These values are at the meter.

Col. (11) represents the annual average of the twelve monthly values.

Col. (16) = Schedule 2.1 Col. (4) + Schedule 2.1 Col. (7) + Col. (10) + Col. (13) + Col. (14) + Col. (15).

**Schedule 2.3: FPL
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(17)	(18)	(19)	(20)	(21)
<u>Year</u>	<u>Sales for Resale GWh</u>	<u>Utility Use & Losses GWh</u>	<u>Net Energy For Load GWh</u>	<u>Average No. of Other Customers</u>	<u>Total Average Number of Customers</u>
2010	2,049	7,870	114,475	3,523	4,520,328
2011	2,176	6,950	112,454	3,596	4,547,051
2012	2,237	6,403	110,866	3,645	4,576,449
2013	2,158	6,713	111,655	3,722	4,626,934
2014	5,375	6,204	115,968	3,795	4,708,829
2015	6,610	6,326	122,756	3,907	4,775,382
2016	6,623	5,334	121,619	3,994	4,840,279
2017	6,406	5,468	120,745	4,100	4,901,886
2018	6,790	5,604	122,447	4,334	4,961,330
2019	7,315	5,924	125,168	4,749	5,061,525

Historical Values (2010 - 2019):

Col. (19) represents actual energy sales including the impacts of existing conservation.

Col. (19) = Schedule 2.2 Col. (16) + Col. (17) + Col. (18). Historical NEL includes the impacts of existing conservation and agrees to Col. (5) on schedule 3.3. Historical GWh, prior to 2011, are based on a fiscal year beginning 12/29 and ending 12/28. The 2011 value is based on 12/29/10 to 12/31/11. The 2012-2019 values are based on calendar year.

Col. (20) represents the annual average of the twelve monthly values.

Col. (21) = Schedule 2.1 Col. (5) + Schedule 2.1 Col. (8) + Schedule 2.2 Col. (11) + Col. (20).

**Schedule 2.3: Gulf
History of Energy Consumption
And Number of Customers by Customer Class**

(1)	(17)	(18)	(19)	(20)	(21)
<u>Year</u>	<u>Sales for Resale GWh</u>	<u>Utility Use & Losses GWh</u>	<u>Net Energy For Load GWh</u>	<u>Average No. of Other Customers</u>	<u>Total Average Number of Customers</u>
2010	409	750	12,518	559	430,030
2011	382	663	12,086	564	432,403
2012	339	597	11,598	572	434,441
2013	330	602	11,552	579	437,698
2014	332	629	12,037	598	442,370
2015	330	580	11,996	610	447,557
2016	331	618	12,030	609	453,140
2017	318	588	11,715	574	459,050
2018	302	623	12,057	589	464,682
2019	257	407	11,742	608	464,884

Historical Values (2010 - 2019):

Col. (19) represents actual energy sales including the impacts of existing conservation.

Col. (19) = Schedule 2.2 Col. (16) + Col. (17) + Col. (18). Historical NEL includes the impacts of existing conservation and agrees to Col. (5) on schedule 3.3.

Col. (20) represents the annual average of the twelve monthly values.

Col. (21) = Schedule 2.1 Col. (5) + Schedule 2.1 Col. (8) + Schedule 2.2 Col. (11) + Col. (20).

**Schedule 2.3
Forecast of Energy Consumption
And Number of Customers by Customer Class**

(1)	(17)	(18)	(19)	(20)	(21)
<u>Year</u>	<u>Sales for Resale GWh</u>	<u>Utility Use & Losses GWh</u>	<u>Net Energy For Load GWh</u>	<u>Average No. of Other Customers</u>	<u>Total Average Number of Customers</u>
FPL					
2020	6,283	5,797	123,073	5,100	5,117,332
2021	5,788	5,412	123,134	5,458	5,165,574
Gulf					
2020	298	601	11,715	603	472,190
2021	293	597	11,643	606	480,130
Integrated FPL and Gulf					
2022	5,717	6,115	134,800	6,419	5,700,622
2023	5,793	6,189	135,600	6,783	5,755,134
2024	5,871	6,271	136,761	7,141	5,806,073
2025	5,948	6,260	137,540	7,499	5,855,142
2026	6,028	6,318	138,541	7,858	5,904,561
2027	5,955	6,363	139,474	8,215	5,952,978
2028	6,040	6,437	140,874	8,572	5,999,654
2029	6,125	6,472	141,751	8,931	6,046,421

Projected Values (2020 - 2029):

Col. (19) represents forecasted energy sales that do not include the impact of incremental conservation and agrees to Col. (2) on Schedule 3.3.

Col. (19) = Schedule 2.2 Col. (16) + Col. (17) + Col. (18).

Col. (20) represents the annual average of the twelve monthly values.

Col. (21) = Schedule 2.1 Col. (5) + Schedule 2.1 Col. (8)
+ Schedule 2.2 Col. (11) + Col. (20).

**Schedule 3.1: FPL
History of Summer Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2010	22,256	419	21,837	0	990	1,181	815	758	20,451
2011	21,619	427	21,192	0	1,000	1,281	821	781	19,798
2012	21,440	431	21,009	0	1,013	1,351	833	810	19,594
2013	21,576	396	21,180	0	1,025	1,417	833	839	19,718
2014	22,935	1,155	21,780	0	1,010	1,494	843	866	21,082
2015	22,959	1,303	21,656	0	878	1,523	826	873	21,255
2016	23,858	1,367	22,491	0	882	1,548	836	888	22,140
2017	23,373	1,393	21,980	0	910	1,560	825	903	21,639
2018	23,217	1,338	21,879	0	866	1,571	866	916	21,485
2019	24,241	1,292	22,949	0	852	1,579	879	926	22,510

Historical Values (2010 - 2019):

Col. (2) and Col. (3) are actual values for historical Summer peaks. As such, they incorporate the effects of conservation (Col. 7 & Col. 9) and may incorporate the effects of load control if load control was operated on these peak days. Col. (2) represents the actual Net Firm Demand.

Col. (5) through Col. (9) represent actual DSM capabilities and represent annual (12-month) values.

Col.(6) values for 2015-on reflect a hardware communications issue identified in 2015 that was subsequently resolved. A number of participating customers did not respond to FPL's efforts to reach them or refused access to correct the equipment problem at their home. As a result, these customers were removed from the program.

Col. (10) represents a hypothetical "Net Firm Demand" as if the load control values had definitely been exercised on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col.(6) + Col. (8).

**Schedule 3.1: Gulf
History of Summer Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2010	2,525	88	2,437	0	0	178	0	192	2,525
2011	2,535	89	2,446	0	0	186	0	198	2,535
2012	2,351	76	2,275	0	0	206	0	212	2,351
2013	2,362	74	2,288	0	0	229	0	220	2,362
2014	2,437	75	2,362	0	0	243	0	224	2,437
2015	2,495	78	2,417	0	0	256	0	231	2,495
2016	2,508	76	2,432	0	0	261	0	231	2,508
2017	2,434	74	2,360	0	0	266	0	232	2,434
2018	2,491	80	2,411	0	0	268	0	233	2,491
2019	2,472	75	2,397	0	0	269	0	233	2,472

Historical Values (2010 - 2019):

Col. (2) and Col. (3) are actual values for historical Summer peaks and include the effects of conservation (Col. 7 & Col. 9).

Col. (4) represents "Retail Demand" and is derived by the formula: Col. (2) - Col. (3).

Col. (10) is derived by the formula Col. (10) = Col. (2) - Col. (6) - Col. (8).

**Schedule 3.1
Forecast of Summer Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
August of Year	Total	Wholesale	Retail	Interruptible	Res. Load Management*	Residential Conservation	C/I Load Management*	C/I Conservation	Net Firm Demand
FPL									
2020	24,624	1,540	23,084	0	856	11	907	11	22,838
2021	24,720	1,367	23,353	0	865	23	918	27	22,887
Gulf									
2020	2,464	64	2,399	0	0	5	0	1	2,458
2021	2,496	64	2,432	0	0	12	0	2	2,481
Integrated FPL and Gulf									
2022	27,220	1,384	25,836	0	873	55	928	47	25,317
2023	27,564	1,406	26,158	0	882	76	939	65	25,602
2024	27,953	1,399	26,554	0	894	98	949	84	25,927
2025	28,349	1,405	26,944	0	915	105	960	92	26,278
2026	28,775	1,425	27,350	0	939	105	971	92	26,668
2027	29,143	1,357	27,786	0	963	105	982	92	27,001
2028	29,592	1,376	28,216	0	987	105	993	92	27,415
2029	30,195	1,396	28,799	0	1,012	105	1,004	92	27,983

Projected Values (2020 - 2029):

Col. (2) - Col. (4) represent forecasted peak and do not include incremental conservation, cumulative load management, or incremental load management.

Col. (5) through Col. (9) represent incremental and cumulative load management, and incremental conservation. All values are projected August values.

Col. (8) represents FPL's Business On Call, CDR, CILC, and curtailable programs/rates.

Col. (10) represents a "Net Firm Demand" which accounts for all of the incremental conservation and assumes all of the load control is implemented on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col. (5) - Col. (6) - Col. (7) - Col. (8) - Col. (9).

* Res. Load Management and C/I Load Management include Lee County and FKEC whose loads are served by FPL.

**Schedule 3.2: FPL
History of Winter Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Firm Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2010	24,346	500	23,846	0	895	687	721	291	22,730
2011	21,126	383	20,743	0	903	717	723	303	19,501
2012	17,934	382	17,552	0	856	755	722	314	16,356
2013	15,931	348	15,583	0	843	781	567	326	14,521
2014	17,500	890	16,610	0	828	805	590	337	16,083
2015	19,718	1,329	18,389	0	822	835	551	346	18,345
2016	17,031	1,087	15,944	0	742	858	570	352	15,719
2017	17,172	1,098	16,074	0	759	861	577	364	15,836
2018	19,109	1,262	17,847	0	750	864	588	369	17,771
2019	16,795	1,432	15,363	0	706	867	613	379	15,476

Historical Values (2010 - 2019):

Col. (2) and Col. (3) are actual values for historical Winter peaks. As such, they incorporate the effects of conservation (Col. 7 & Col. 9) and may incorporate the effects of load control if load control was operated on these peak days. Col. (2) represents the actual Net Firm Demand. For year 2011, the actual winter peak occurred in December of 2010.

Col. (5) through Col. (9) represent actual DSM capabilities and represent annual (12-month) values.

Col.(6) values for 2015-on reflect a hardware communications issue identified in 2015 that was subsequently resolved. A number of participating customers did not respond to FPL's efforts to reach them or refused access to correct the equipment problem at their home. As a result, these customers were removed from the program.

Col. (10) represents a hypothetical "Net Firm Demand" as if the load control values had definitely been exercised on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col.(6) + Col. (8).

**Schedule 3.2: Gulf
History of Winter Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Firm Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2010	2,553	99	2,454	0	0	289	0	154	2,553
2011	2,495	89	2,406	0	0	297	0	157	2,495
2012	2,139	70	2,069	0	0	317	0	165	2,139
2013	1,766	90	1,676	0	0	341	0	169	1,766
2014	2,694	85	2,609	0	0	356	0	172	2,694
2015	2,492	74	2,418	0	0	369	0	176	2,492
2016	2,043	80	1,963	0	0	374	0	176	2,043
2017	2,211	89	2,122	0	0	377	0	177	2,211
2018	2,809	70	2,739	0	0	379	0	178	2,809
2019	2,066	66	2,000	0	0	381	0	178	2,066

Historical Values (2010 - 2019):

Col. (2) and Col. (3) are actual values for historical Winter peaks and include the effects of conservation (Col. 7 & Col. 9).

Col. (4) represents "Retail Demand" and is derived by the formula: Col. (2) - Col. (3).

Col. (10) is derived by the formula Col. (10) = Col. (2) - Col. (6) - Col. (8).

**Schedule 3.2
Forecast of Winter Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
January of Year	Total	Firm Wholesale	Retail	Interruptible	Res. Load Management*	Residential Conservation	C/I Load Management*	C/I Conservation	Net Firm Demand
FPL									
2020	19,959	1,230	18,729	0	712	3	634	10	18,599
2021	20,250	1,248	19,002	0	721	5	640	20	18,863
Gulf									
2020	2,256	69	2,187	0	0	0	0	0	2,256
2021	2,293	68	2,225	0	0	4	0	1	2,287
Integrated FPL and Gulf									
2022	22,369	1,068	21,301	0	733	16	647	33	20,939
2023	22,617	1,108	21,509	0	746	24	653	46	21,149
2024	22,861	1,139	21,722	0	758	32	659	58	21,353
2025	23,103	1,140	21,963	0	778	40	666	70	21,548
2026	23,388	1,172	22,216	0	804	40	671	70	21,803
2027	23,608	1,118	22,490	0	829	40	676	70	21,992
2028	23,941	1,155	22,786	0	855	40	681	70	22,294
2029	24,293	1,181	23,112	0	880	40	686	70	22,616

Projected Values (2020 - 2029):

Col. (2) - Col. (4) represent forecasted peak and do not include incremental conservation, cumulative load management, or incremental load management.

Col. (5) through Col. (9) represent incremental and cumulative load management, and incremental conservation. All values are projected January values.

Col. (8) represents FPL's Business On Call, CDR, CILC, and curtailable programs/rates.

Col. (10) represents a "Net Firm Demand" which accounts for all of the incremental conservation and assumes all of the load control is implemented on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col. (5) - Col. (6) - Col. (7) - Col. (8) - Col. (9).

* Res. Load Management and C/I Load Management include Lee County and FKEC whose loads are served by FPL.

Schedule 3.3: FPL
History of Annual Net Energy for Load (GWh)
(All values are "at the generator" values except for Col (8))

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Net Energy For Load without DSM GWh</u>	<u>Residential Conservation GWh</u>	<u>C/I Conservation GWh</u>	<u>Actual Net Energy For Load GWh</u>	<u>Sales for Resale GWh</u>	<u>Utility Use & Losses GWh</u>	<u>Actual Total Retail Sales (GWh)</u>	<u>Load Factor(%)</u>
2010	119,220	2,487	2,259	114,475	2,049	7,870	104,557	53.7%
2011	117,460	2,683	2,324	112,454	2,176	6,950	103,327	59.4%
2012	116,083	2,823	2,394	110,866	2,237	6,403	102,226	58.9%
2013	117,087	2,962	2,469	111,655	2,158	6,713	102,784	59.1%
2014	121,621	3,125	2,529	115,968	5,375	6,204	104,389	57.7%
2015	128,555	3,232	2,568	122,756	6,610	6,326	109,820	61.0%
2016	127,481	3,254	2,608	121,619	6,623	5,334	109,663	58.0%
2017	126,680	3,278	2,655	120,747	6,406	5,470	108,871	59.0%
2018	128,465	3,300	2,718	122,447	6,790	5,604	110,053	60.2%
2019	131,241	3,322	2,751	125,168	7,315	5,924	111,929	58.9%

Historical Values (2010 - 2019):

Col. (2) represents derived NEL not including conservation using the formula: Col. (2) = Col. (3) + Col. (4) + Col. (5)

Col. (3) & Col. (4) are annual (12-month) DSM values and represent total GWh reductions experienced each year.

Col. (8) is the Total Retail Sales calculated using the formula: Col. (8) = Col. (5) - Col. (6) - Col. (7). These values are at the meter.

Col. (9) is calculated using Col. (5) from this page and the greater of Col. (2) from Schedules 3.1 and 3.2 using the formula:
 Col. (9) = ((Col. (5)*1000) / ((Col. (2) * 8760)). Adjustments are made for leap years.

Schedule 3.3: Gulf
History of Annual Net Energy for Load (GWh)
(All values are "at the generator" values except for Col (8))

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Net Energy For Load without DSM GWh</u>	<u>Residential Conservation GWh</u>	<u>C/I Conservation GWh</u>	<u>Actual Net Energy For Load GWh</u>	<u>Sales for Resale GWh</u>	<u>Utility Use & Losses GWh</u>	<u>Total Retail Energy Sales (GWh)</u>	<u>Load Factor(%)</u>
2010	13,256	388	350	12,518	409	750	11,359	56.0%
2011	12,864	417	361	12,086	382	663	11,040	54.4%
2012	12,453	482	374	11,598	339	597	10,663	56.2%
2013	12,502	551	399	11,552	330	602	10,620	55.8%
2014	13,048	595	416	12,037	332	629	11,075	51.0%
2015	13,056	630	430	11,996	330	580	11,086	54.9%
2016	13,097	637	430	12,030	331	618	11,082	54.6%
2017	12,789	642	432	11,715	318	588	10,809	54.9%
2018	13,138	647	435	12,057	302	623	11,132	49.0%
2019	12,828	650	436	11,742	257	407	11,079	54.2%

Historical Values (2010 - 2019):

Col. (2) represents derived NEL not including conservation using the formula: Col. (2) = Col. (3) + Col. (4) + Col. (5)

Col. (3) & Col. (4) are annual (12-month) DSM values and represent total GWh reductions experienced each year.

Col. (8) is the Total Retail Sales calculated using the formula: Col. (8) = Col. (5) - Col. (6) - Col. (7). These values are at the meter.

Col. (9) is calculated using Col. (5) from this page and the greater of Col. (2) from Schedules 3.1 and 3.2 using the formula:
 Col. (9) = ((Col. (5)*1000) / ((Col. (2) * 8760)). Adjustments are made for leap years.

Schedule 3.3
Forecast of Annual Net Energy for Load (GWh)
 (All values are "at the generator" values except for Col (8))

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Forecasted Net Energy For Load without DSM GWh	Residential Conservation GWh	C/I Conservation GWh	Net Energy For Load Adjusted for DSM GWh	Sales for Resale GWh	Utility Use & Losses GWh	Forecasted Total Billed Retail Energy Sales w/o DSM GWh	Load Factor(%)
FPL								
2020	123,073	30	35	123,007	6,283	5,538	111,252	56.9%
2021	123,134	56	65	123,013	5,788	5,538	111,808	56.8%
Gulf								
2020	11,715	10	3	11,702	298	601	10,816	54.1%
2021	11,643	18	5	11,620	293	597	10,752	53.2%
Integrated FPL and Gulf								
2022	134,800	108	103	134,588	5,717	6,133	122,949	56.4%
2023	135,600	144	138	135,318	5,793	6,167	123,640	56.0%
2024	136,761	181	175	136,405	5,871	6,217	124,673	55.6%
2025	137,540	181	175	137,184	5,948	6,252	125,340	55.2%
2026	138,541	181	175	138,185	6,028	6,297	126,216	54.8%
2027	139,474	181	175	139,118	5,955	6,339	127,180	54.5%
2028	140,874	181	175	140,518	6,040	6,402	128,432	54.1%
2029	141,751	181	175	141,395	6,125	6,442	129,184	53.5%

Projected Values (2020 - 2029):

Col. (2) represents Forecasted NEL and does not include incremental conservation.

Col. (3) & Col. (4) are forecasted values representing reduction on sales from incremental conservation

Col. (5) is forecasted NEL adjusted for incremental conservation.

Col. (8) is Total Retail Sales. The values are calculated using the formula: Col. (8) = Col. (2) - Col. (6) - Col. (7). These values are at the meter.

Col. (9) is calculated using Col. (5) from this page and Col. (10) from Schedule 3.1 using the formula:
 Col. (9) = ((Col. (5)*1000) / ((Col. (2) * 8760)). Adjustments are made for leap years.

Schedule 4: FPL
Previous Year Actual and Two-Year Forecast of
Total Peak Demand and Net Energy for Load (NEL) by Month

(1)	(2)	(3)	(4)	(5)	(6)	(7)
	2019 ACTUAL		2020 FORECAST		2021 FORECAST	
Month	Total Peak Demand MW	NEL GWh	Total Peak Demand MW	NEL GWh	Total Peak Demand MW	NEL GWh
JAN	16,795	8,672	19,959	8,890	20,250	8,861
FEB	18,660	8,353	19,005	8,311	19,233	8,124
MAR	18,963	9,159	18,900	9,155	19,127	9,254
APR	20,106	9,899	20,255	9,522	20,499	9,598
MAY	22,580	11,417	22,150	10,879	22,416	10,987
JUN	24,241	11,775	23,700	11,437	23,792	11,428
JUL	23,583	12,481	24,190	12,312	24,284	12,274
AUG	22,861	12,145	24,624	12,402	24,720	12,425
SEP	23,653	11,803	23,652	11,439	23,745	11,430
OCT	21,776	11,633	22,210	10,732	22,296	10,711
NOV	19,855	9,001	19,601	8,962	19,678	8,978
DEC	17,249	8,830	18,737	9,030	18,810	9,064
Annual Values:		125,168		123,073		123,134

Col. (3) annual value shown is consistent with the value shown in Col.(5) of Schedule 3.3.

Cols. (4) through (7) do not include the impacts of cumulative load management, incremental utility conservation, or incremental load management.

Schedule 4: Gulf
Previous Year Actual and Two-Year Forecast of
Total Peak Demand and Net Energy for Load (NEL) by Month

(1)	(2)	(3)	(4)	(5)	(6)	(7)
	2019 ACTUAL		2020 FORECAST		2021 FORECAST	
	Total Peak Demand	NEL	Total Peak Demand	NEL	Total Peak Demand	NEL
<u>Month</u>	<u>MW</u>	<u>GWh</u>	<u>MW</u>	<u>GWh</u>	<u>MW</u>	<u>GWh</u>
JAN	2,066	941	2,256	967	2,293	950
FEB	1,564	725	1,955	837	1,980	809
MAR	1,885	817	1,726	800	1,749	796
APR	1,734	808	1,733	809	1,756	801
MAY	2,260	1,087	2,137	991	2,165	986
JUN	2,444	1,210	2,359	1,146	2,389	1,146
JUL	2,426	1,291	2,464	1,254	2,496	1,254
AUG	2,374	1,187	2,411	1,240	2,442	1,239
SEP	2,472	1,163	2,265	1,078	2,294	1,076
OCT	2,284	959	1,997	909	2,023	906
NOV	1,951	730	1,710	794	1,732	792
DEC	1,862	825	1,894	889	1,919	888
Annual Values:		11,742		11,715		11,643

Col. (3) annual value shown is consistent with the value shown in Col.(5) of Schedule 3.3.

Cols. (4) through (7) do not include the impacts of incremental conservation.

CHAPTER III

Projection of Incremental Resource Additions

(This page is intentionally left blank.)

III. Projection of Incremental Resource Additions

III.A. FPL's Resource Planning:

FPL utilizes its well-established, integrated resource planning (IRP) process, in whole or in part as dictated by analysis needs, to determine: (i) the magnitude and timing of needed resources, and (ii) the type of resources that should be added. This section describes FPL's basic IRP process which was used during 2019 and early 2020 to develop the resource plan for FPL's and Gulf's areas that is presented in this 2020 Site Plan. It also discusses some of the key assumptions, in addition to a new load forecast discussed in the previous chapter, which were used in developing this resource plan.

Four Fundamental Steps of FPL's Resource Planning:

The four fundamental steps of FPL's resource planning process are:

Step 1: Determine the magnitude and timing of FPL's new resource needs;

Step 2: Identify which resource options and resource plans can meet the determined magnitude and timing of projected resource needs (e.g., identify competing options and resource plans);

Step 3: Evaluate the competing options and resource plans in regard to system economics and non-economic factors; and,

Step 4: Select a resource plan and commit, as needed, to near-term options.

Figure III.A.1 graphically outlines the 4 steps.

Step 1: Determine the Magnitude and Timing of New Resource Needs:

The first of the four resource planning steps is essentially a determination of the amount and timing of megawatts (MW) of load reduction, new capacity additions, or a combination of both, which are needed to maintain and/or enhance system reliability. This step is often referred to as a reliability assessment for the utility system.

This analysis typically starts with an updated load forecast. Several databases are also updated in this first fundamental step, not only with the new information regarding forecasted loads, but also with other information that is used throughout other aspects of FPL's resource planning process. Examples of this new information include but are not limited to: delivered fuel price projections, current financial and economic assumptions, current power plant capability and operating assumptions, and current demand side management (DSM) demand and energy reduction assumptions.

FPL's process also includes key sets of projections regarding three specific types of resources: (1) generating unit capacity changes, (2) firm capacity power purchase agreements (PPAs), and (3) DSM implementation.

Key Assumptions Regarding the Three Types of Resources:

The first set of assumptions, generating unit capacity changes, is based on current projections of new generating capacity additions and planned retirements of existing generating units. In this 2020 Site Plan, there are five (5) types of projected generation capacity changes through the 10-year reporting time frame of this document. These changes are listed below in general chronological order:

1) Additional Solar Energy Facilities:

In this 2020 Site Plan, the resource plan projects the addition of approximately 8,860 MW of new solar PV generation during the 2020 through 2029 time period. Of that total addition, approximately 7,300 MW are projected to be in FPL's area and approximately 1,560 MW are projected to be in Gulf's area. These PV additions are consistent with FPL's "30-by-30" announcement in January 2019 which detailed FPL's plans to add 30 million solar PV panels cost-effectively by the year 2030. These projected solar additions for 2020 through 2029, when combined with solar additions made prior to 2020, will result in a total of approximately 10,000 MW of total installed solar by the end of 2029.

2) Additional Battery Storage:

FPL's 2019 Site Plan showed the planned addition of approximately 469 MW of battery storage in late 2021 with the majority of that storage capacity being sited in Manatee County as partial replacement for the generating capacity that will be decreased by the retirement of Manatee Units 1 & 2 (as discussed below). The current resource plan presented in this 2020 Site Plan continues to show these 469 MW of battery storage by the end of 2021. The current plan is to site 409 MW of battery storage in Manatee County and two 30 MW battery storage facilities at different sites. In addition, this resource plan projects another 700 MW of battery storage facilities by the end of 2029 with these facilities being sited in Gulf's area.

3) Retirement of Existing Generating Units:

As discussed in FPL's 2019 Site Plan, FPL plans to retire its Manatee Units 1 and 2 in late 2021. These units are older steam generating units of approximately 800 MW each that have been in operation for more than 40 years. The units are relatively inefficient units in regard to their ability to convert fuel into electricity. As a result, they are projected to no longer be cost-effective to operate for FPL's customers.

In this 2020 Site Plan, these two Manatee units are still projected to be retired in late 2021. In addition, FPL's ownership portion (approximately 630 MW) of the Scherer 4 coal-fueled unit in Georgia is planned to be retired by year-end 2021/beginning of 2022. Furthermore, Gulf's ownership portion of Daniels Units 1 & 2 is now projected to be retired by January of 2024. The Daniels units are coal-fueled units located in Mississippi Power's service territory. Gulf's ownership portion of those two units is approximately 510 MW.

4) Enhancements of Existing Generating Units:

FPL's 2019 Site Plan discussed a plan to upgrade CT components in a number of its CC units, and these upgrades are again reflected in the 2020 Site Plan. In addition, the 2020 Site Plan projects another capacity upgrade effort for existing CC units in both FPL's and Gulf's areas. These additional upgrades are projected to be completed in 2026 and to result in increased Summer capacity of approximately 600 MW, plus improved heat rates for each host CC unit. The results of all of the upgrades are included in the information presented in Schedule 8 in this chapter.

Two significant enhancements to existing generating units in the Gulf area are also included in the resource plan presented in this Site Plan. The first of those is the

conversion of Crist Units 6 & 7 from coal-fueled to natural gas-fueled. This conversion effort is already underway and is scheduled to be completed in September of 2020. This enhancement will result in both lower cost energy generated by the units, and in significant fixed cost savings, particularly for Gulf area customers. The second enhancement is a pair of capacity upgrades of the Lansing Smith Unit 3. The installation phase of the first upgrade of this existing CC unit was completed in 2019 which will be followed by testing and tuning in the Spring of 2020. This upgrade is projected to increase the firm capacity of the unit by more than 80 MW. A second upgrade of the unit is planned for 2024 which is projected to increase unit capacity by approximately another 59 MW. Both upgrades in this second enhancement will also result in cost savings for customers through both the deferral of future capacity needs and by increased output of lower cost natural gas-fueled energy production.

5) Addition of Cost-Effective Natural Gas-Fueled Generation:

In its 2019 Site Plan, FPL's resource plan projected the addition of three new CC units with one each being added in 2019, 2022, and 2026. Gulf's 2019 Site Plan projected the addition of a single new CC unit in 2024.

The first of the FPL projected CC units in last year's Site Plan was the Okeechobee Clean Energy Center unit which became operational on FPL's system in 2019. This new CC unit supplies approximately 1,778 MW of firm capacity that can be delivered around the clock. The second of these is the Dania Beach Clean Energy Center Unit 7 that will come in-service in 2022. This unit is a key component of the modernization of FPL's existing Lauderdale power plant site. The third CC projected in FPL's 2019 Site Plan was a new CC unit being added in 2026 at a yet-to-be-determined site. Gulf's 2019 Site Plan projected a single new CC unit to be added at the Escambia site in 2024.

The resource plan presented in this 2020 Site Plan continues to show the new Dania Beach CC unit coming in-service in 2022. However, neither the other CC unit previously projected in FPL's area for 2026, nor the Escambia CC unit in Gulf's area previously projected for 2024, remain in the current resource plan. However, four new combustion turbine (CT) units at the Crist plant site in Gulf's area are now part of the resource plan. These new CT units are being added based on system economics and for purposes of ensuring adequate fast-start operating reserves in Gulf's area.

The second set of assumptions involves other firm capacity power purchase agreements (PPAs). These assumptions are generally consistent with those presented in FPL's 2019 Site Plan and Gulf's 2019 Site Plan.

In regard to FPL's area, the most significant firm capacity PPA is with Indiantown Cogeneration LP (ICL). On January 5, 2017, with mutual consent of the parties involved and FPSC approval (in Order PSC-16-0506-FOF-EI), FPL acquired the equity interests in this coal-based PPA with ICL. This approval included both the PPA and the underlying asset (*i.e.*, the generating unit) from which FPL received firm capacity and energy. The plan is to terminate this PPA by the end of the 4th Quarter of 2020 upon retirement of the senior debt in the project. In addition, the coal-fueled generating unit upon which the PPA was based will also be retired.

In regard to Gulf's area, the most significant firm capacity PPA is the Shell PPA with which Gulf receives 885 MW of firm capacity and energy from a CC unit in Alabama. That PPA is scheduled to terminate in May of 2023. At the time this document is being prepared, Alabama Power is seeking approval from the Alabama Public Service Commission to acquire this generating unit.

The remaining projected firm capacity purchases for both areas are from a combination of utility and independent power producers. Details for these other purchases, including the annual total capacity values, are presented in Chapter I in Tables I.A.3.2, I.A.3.3, I.B.3.2, and I.B.3.3. These purchased firm capacity amounts were incorporated in the resource planning work that led to the resource plan presented in this document.

The third set of assumptions involves a projection of the amount of incremental DSM that FPL and Gulf anticipate implementing annually over the ten-year reporting period of 2020 through 2029 for this Site Plan. In the 4th Quarter of 2019, the Florida Public Service Commission (FPSC) set DSM Goals for FPL, Gulf, and other Florida utilities that addressed the years 2020 through 2024. The annual amounts of Summer MW reduction, Winter MW reduction, and energy (MWh) reduction for the FPL and Gulf areas detailed in the FPSC's DSM Goal's order (Order No. PSC-2019-0509-FOF-EG) through 2024 are accounted for in the resource plan presented in this Site Plan. For the years 2025 through 2029, the annual DSM levels proposed in the DSM Goals docket separately by FPL and Gulf – because they were projected to be cost-effective - are also accounted for in the resource plan presented in this Site Plan. Those annual amounts are shown in Schedules 3.1, 3.2, and 3.3 in Chapter II.

The Three Reliability Criteria Used to Determine FPL's Projected Resource Needs:

FPL's resource planning process applies these key assumptions, plus the other updated information described above, in the first fundamental step: determining the magnitude and timing of future resource needs. This determination is accomplished through system reliability analyses. Until 2014, FPL's reliability analyses were based on dual planning criteria, including a minimum peak-period total reserve margin (TRM) of 20% (FPL applies this criterion to both Summer and Winter peaks) and a maximum loss-of-load probability (LOLP) of 0.1 day per year. Both criteria are commonly used throughout the utility industry. Beginning in 2014, FPL began utilizing a third reliability criterion: a 10% generation-only reserve margin (GRM).

Until the acquisition of Gulf by NextEra Energy in January 2019, the reliability criteria used for Gulf was determined by analyses of the entire Southern Company system of which Gulf was a part. It is projected that Southern Company will continue to operate Gulf's generating units as part of its system until the new North Florida Resiliency Connection transmission line is in-service by the end of 2021. At that time, FPL will begin to operate Gulf's generating units as well as FPL's units as part of a single, integrated electrical system. In addition, the generation-based reliability of the Gulf area will be evaluated, and the area planned, using FPL's current three reliability criteria described above.

These reliability criteria utilize two basic types of methodologies: deterministic and probabilistic. The calculation of excess firm capacity at the annual system peaks (reserve margin) is a common method, and this relatively simple deterministic calculation can be performed on a spreadsheet. It provides an indication of the adequacy of a generating system's capacity resources compared to its load during peak periods. However, deterministic methods do not take into account probabilistic-related elements, such as the impact of individual unit failures. For example, two 50 MW units that can be counted on to run 90% of the time are more valuable in regard to utility system reliability than is one 100 MW unit that also can be counted on to run 90% of the time. Probabilistic methods can also account for the value of being part of an interconnected system with access to multiple capacity sources.

For this reason, probabilistic methodologies have been used to provide an additional perspective on the reliability of a generating system, and a number of them are used to perform system reliability analyses. Among the most widely used is loss-of-load probability (LOLP), which FPL's resource planning group utilizes. Simply stated, LOLP is an index of how well a generating system may be able to meet its firm demand (*i.e.*, a measure of how often load may exceed available resources). In contrast to reserve margin, the calculation of LOLP looks at the

daily peak demands for each year, while taking into consideration such probabilistic events as the unavailability of individual generators due to scheduled maintenance or forced outages.

LOLP is expressed in terms of the projected probability that a utility will be unable to meet its entire firm load at some point during a year. The probability of not being able to meet the firm load is calculated for each day of the year using the daily peak hourly load. These daily probabilities are then summed to develop an annual probability value. This annual probability value is commonly expressed as “the number of days per year” that the system firm load could not be met. The standard for LOLP used by FPL’s resource planning group, is a maximum of 0.1 day per year which is commonly accepted throughout the industry. This analysis requires a more complicated calculation methodology than the reserve margin analysis. LOLP analyses are typically carried out using computer software models, such as the Tie Line Assistance and Generation Reliability (TIGER) program used by FPL.

In 2010, FPL’s integrated resource planning work examined a then-projected fundamental change in FPL’s resource plans. This change was a significant shift in the mix of generation and DSM resources that could result in FPL becoming increasingly reliant on DSM resources, rather than generation resources, to maintain system reliability. As discussed in several subsequent FPL Site Plans, extensive analyses examined this shift from a system reliability perspective.

In these analyses, FPL developed a key new metric: a generation-only reserve margin (GRM). This GRM metric reflects reserves that would be provided only by actual generating resources. The GRM value is calculated by setting to zero all incremental energy efficiency (EE) and load management (LM), plus all existing LM, to derive another useful version of a reserve margin calculation. The resulting GRM value provides an indication of the respective roles that DSM and generation are projected to play each year as FPL maintains its 20% Summer and Winter total reserve margins (which account for both generation and DSM resources).

These analyses examined the two types of resources, DSM and Supply options, from both an operational and a resource planning perspective. Based on these analyses, FPL concluded that resource plans for its system with identical total reserve margins, but different GRM values, are not equal in regard to system reliability. A resource plan with a higher GRM value is projected to result in more MW being available to system operators on adverse peak load days, and in lower LOLP values, than a resource plan with a lower GRM value, even though both resource plans have an identical total reserve margin value. In other words, it matters what resources are used to meet a reserve margin criterion such as 20%. Therefore, in 2014 FPL implemented a minimum GRM criterion of 10% as a third reliability criterion in its resource planning process.

The 10% minimum Summer and Winter GRM criterion augments the other two reliability criteria that FPL's resource planning group uses: the 20% TRM criterion for Summer and Winter and the 0.1 day/year LOLP criterion. All three reliability criteria are useful to identify the timing and magnitude of the resource need because of the different perspectives the three criteria provide. In addition, the GRM criterion is particularly useful in providing direction regarding the mix of generation (combined cycle, solar, etc.) and DSM resources that should be added to maintain and enhance system reliability.

Step 2: Identify Resource Options and Plans That Can Meet the Determined Magnitude and Timing of Projected Resource Needs:

The initial activities associated with this second fundamental step of resource planning generally proceed concurrently with the activities associated with Step 1. During Step 2, preliminary economic screening analyses of new capacity options that are identical, or virtually identical, in certain key characteristics may be conducted to determine what type of new capacity option appears to be the most competitive on FPL's system. Preliminary analyses also can help identify capacity size (MW) values, projected construction/permitting schedules, and operating parameters and costs. Similarly, preliminary economic screening analyses of new DSM options and/or evaluation of existing DSM options are often conducted in this second fundamental IRP step.

FPL's resource planning group typically utilizes a production cost model, a Fixed Cost Spreadsheet, and/or an optimization model to perform the preliminary economic screening of generation resource options. For the preliminary economic screening analyses of DSM resource options, FPL typically uses its DSM CPF model, which is an FPL spreadsheet model utilizing the FPSC's approved methodology for performing preliminary economic screening of individual DSM measures and programs. A years-to-payback screening test based on a two-year payback criterion is also used in the preliminary economic screening of individual DSM measures and programs in order to minimize the probability of paying incentives to customers who would have implemented a DSM measure anyway without a utility incentive (*i.e.*, free riders). Then, as the focus of DSM analyses progresses from analysis of individual DSM measures to the development of DSM portfolios, FPL typically uses two additional models. One is a proprietary non-linear programming (NLP) model that is used to analyze the potential for lowering system peak loads through additional load management/demand response capability. The other model that is utilized is a proprietary linear programming (LP) model with which DSM portfolios are developed.

The next step is typically to “package” the individual new resource options, both Supply options and DSM portfolios, emerging from these preliminary economic screening analyses into different resource plans that are designed to meet the system reliability criteria. In other words, resource plans are created by combining individual resource options so that the timing and magnitude of projected new resource needs are met. The creation of these competing resource plans is typically carried out using spreadsheet and/or dynamic programming techniques.

At the conclusion of the second fundamental resource planning step, a number of different combinations of new resource options (*i.e.*, resource plans) of a magnitude and timing necessary to meet the projected resource needs are identified.

Step 3: Evaluate the Competing Options and Resource Plans in Regard to System Economics and Non-Economic Factors:

At the completion of fundamental Steps 1 and 2, the most viable new resource options have been identified, and these resource options have been combined into a number of resource plans that each meet the magnitude and timing of projected resource needs. The stage is set for evaluating these resource options and resource plans in system economic analyses that aim to account for all of the impacts to the utility system from the competing resource options/resource plans. FPL’s resource planning group typically utilizes the UPLAN production cost model and a Fixed Cost Spreadsheet, and/or the EGEAS or AURORA optimization models, to perform the system economic analyses of resource plans. Other spreadsheet models may also be used to further analyze the resource plans.

The basic economic analyses of the competing resource plans focus on total system economics. The standard basis for comparing the economics of competing resource plans is their relative impact on electricity rate levels, with the general objective of minimizing the projected levelized system average electric rate (*i.e.*, a Rate Impact Measure or RIM methodology). In analyses in which the DSM contribution has already been determined through the same IRP process and/or FPSC approval, and therefore the only competing options are new generating units and/or purchase options, comparisons of the impacts of competing resource plans on both electricity rates and system revenue requirements will yield identical outcomes in regard to the relative rankings of the resource options being evaluated. Consequently, the competing options and resource plans in such cases can be evaluated on a system cumulative present value revenue requirement (CPVRR) basis.

FPL's resource planning group also includes other factors in its evaluation of resource options and resource plans. Although these factors may have an economic component or impact, they are often discussed in quantitative but non-economic terms, such as percentages, tons, etc., rather than in terms of dollars. These factors are often referred to as "system concerns or factors," which include (but are not limited to) maintaining/enhancing fuel diversity and maintaining a regional balance between load and generating capacity, particularly in the Southeastern Florida region of FPL's area that consists of Miami-Dade and Broward counties. In conducting the evaluations needed to determine which resource options and resource plans are best for the utility system, the non-economic evaluations are conducted with an eye to whether the system concern is positively or negatively impacted by a given resource option or resource plan. These and other factors are discussed later in this chapter in section III.C.

Step 4: Finalizing the Current Resource Plan

The results of the previous three fundamental steps are typically used to develop a new or updated resource plan. The current resource plan presented in this 2020 Site Plan is summarized in the following section.

III.B. Projected Incremental Resource Changes in the Resource Plan

The projection of major changes in the current resource plan for the FPL and Gulf areas, including both utility-owned generation and PPAs, for the years 2020 through 2029 is summarized in Table ES-1 in the Executive Summary. The changes are presented in terms of Summer firm capacity values. Although this table does not specifically identify the impacts of projected DSM additions on projected resource needs and the resource plan, the projected DSM additions are consistent with the recent DSM Goals order regarding DSM Goals for both FPL and Gulf through the year 2024. In addition, projected cost-effective amounts of DSM for the years 2025 through 2029 are also assumed. Thus, DSM impacts are fully accounted for in the resource plan in this Site Plan.

A summary of some of the larger resource additions/retirements for both systems/areas include, but are not necessarily limited to, those listed below (in approximate chronological order):

For FPL's system/area:

- New solar (PV) additions from 2020 through 2029 of approximately 7,300 MW;
- Capacity upgrades at a number of FPL's existing CC units through 2026;
- Retirement of FPL's ownership portion (approximately 630 MW) of the Scherer 4 coal unit by January 2022;

- A 409 MW battery facility at the Manatee plant site, plus two 30 MW battery storage facilities at different sites, by the beginning of 2022; and,
- The modernization of the existing Lauderdale power plant site in mid-2022 with the new DBEC CC Unit 7.

For Gulf's system/area:

- New solar (PV) additions from 2020 through 2024 of approximately 1,560 MW;
- Capacity upgrades (two) of the existing Lansing Smith Unit 3 CC, with installation for the first upgrade completed in 2019 with testing and tuning in the Spring of 2020, then a planned second upgrade in 2024;
- Conversion from coal-fueled to natural gas-fueled at Crist Units 6 & 7 in 2020;
- A new transmission line between FPL and Gulf by the beginning of 2022 enabling a bidirectional transfer capability between the two areas of 850 MW;
- Four new CTs at the Crist plant site by the beginning of 2022;
- Expiration (as per the contract) of 855 MW from the Shell PPA in May, 2023;
- The retirement of Gulf's ownership portion of the coal-fueled Daniels Units 1 & 2 by the beginning of 2024; and,
- Approximately 700 MW of battery storage in 2028 and 2029.

FPL notes that, with the exception of certain of the resource additions and retirements listed above in the earlier years of the 2020 through 2029 time period addressed in this 2020 Site Plan, final decisions on other resource options shown in this Site Plan are not needed at this time, nor have yet been made. This is particularly relevant to resource additions shown for years increasingly further out in the 10-year reporting period. Consequently, those resource additions are more prone to future change.

III.C Discussion of the Resource Plan and Issues Impacting Resource Planning Work

In considering the resource plan presented in this Site Plan, it is useful to note that there are at least six (6) significant factors that either influenced the current resource plan or which may result in future changes. These factors are discussed below (in no particular order).

1. Maintaining a Balance Between Load and Generation in Southeastern Florida:

An imbalance exists between regionally installed generation and regional peak load in Southeastern Florida (Miami-Dade and Broward counties). As a result of that imbalance, a significant amount of energy required in the Southeastern Florida region during peak periods is provided by importing energy through the transmission system from generating

units located outside the region, operating less efficient generating units located in Southeastern Florida out of economic dispatch, or a combination of the two. FPL's prior planning work concluded that, as load inside the region grows, additional installed generating capacity and/or load reduction in this region, or additional installed transmission capacity capable of delivering more electricity from outside the region, would be required to address this imbalance.

Partly because of the lower transmission-related costs resulting from their location in or adjacent to Southeastern Florida, at least five relatively recent capacity additions (Turkey Point Unit 5, West County Energy Center Units 1, 2, & 3, and the modernization of the Port Everglades plant) were determined to be the most cost-effective options to meet FPL's then projected capacity needs. In addition, FPL has added increased capacity at its existing two nuclear units at Turkey Point as part of the nuclear capacity uprates project.

The balance between load and generation in the Southeastern Florida region was further enhanced by decisions to proceed with two other projects. First, the Corbett-Sugar-Quarry (CSQ) transmission line was added in mid-2019. This new line significantly increased FPL's ability to import capacity and energy into the region from generators located outside of the region. Second, the modernization of the existing Lauderdale plant site, which will result in an additional 279 MW of generation capacity in Southeastern Florida from the new DBEC Unit 7 in 2022, will significantly assist in maintaining and enhancing a balance between load and generation in this important region.

2. Maintaining/Enhancing System Fuel Diversity:

In 2019, FPL used natural gas to generate approximately 75% of the total electricity it delivered to its customers. By 2029, due largely to significant solar additions, the percentage of electricity generated by natural gas for the single integrated system is projected to decrease to approximately 62% based on the resource plan presented in this Site Plan. Due to this still significant reliance on natural gas, as well as evolving environmental regulations, opportunities to economically maintain and enhance fuel diversity are continually sought, both in regard to type of fuel and fuel delivery, with due consideration given to system economics.

In 2007, following express direction by the FPSC, FPL sought approval from the FPSC to add two new advanced technology coal units to its system in 2013 and 2014, respectively. However, these units were not approved. Since that time, coal units have ceased to be a viable generation option for a number of reasons which include: (i) environmental

regulations regarding coal units, (ii) increased availability of natural gas, (iii) much lower forecasted costs for natural gas, and (iv) increased economic competitiveness of solar and battery storage. Consequently, FPL does not believe that new advanced technology coal units are currently viable fuel diversity enhancement options in Florida at this time.

Therefore, FPL has focused on: (i) cost-effectively adding solar energy and nuclear energy generation to enhance fuel diversity, (ii) diversifying the sources of natural gas, (iii) diversifying the gas transportation paths used to deliver natural gas to FPL's generating units, and (iv) using natural gas more efficiently.

Solar Energy: Assuming that annual additions of PV will be cost-effective from 2020-on, this 2020 Site Plan projects that FPL will have a total of approximately 10,000 MW of PV generation by the end of 2029. Such a level of PV generation would represent about 33% of FPL's and Gulf's current total installed generation (MW). However, the impact of PV contribution in terms of actual energy produced (MWh) is smaller. Because solar energy can only be generated during daylight hours, and is impacted by clouds, rain, etc., PV has a relatively low capacity factor (approximately 26% to 30%) in the state of Florida. As a result, FPL's solar additions would be projected to supply approximately 16% of the total energy (MWh) delivered in 2029 in the two areas (as shown in Schedule 6.2 later in this chapter).¹⁰

Based on the resource plan presented in this 2020 Site Plan, it is projected that the cleanest energy sources -- low-emission natural gas, zero-emission nuclear, zero-emission wind, and zero-emission solar -- will provide approximately 99% of all energy produced in the single, merged system in 2029 with zero-emission nuclear, wind, and solar alone providing approximately 37% of all energy produced by the system in 2029.

Nuclear Energy: In 2008, the FPSC approved the need to increase capacity at FPL's four existing nuclear units and authorized the company to recover project-related expenditures that were approved as a result of annual nuclear cost recovery filings. FPL successfully completed this nuclear capacity uprate project. Approximately 520 MW of additional nuclear capacity was delivered by the project, which represents an increase of approximately 30% more incremental capacity than was originally forecasted when the project began. FPL's customers are benefitting from lower fuel costs and reduced system emissions provided by this additional nuclear capacity.

¹⁰ As a rule of thumb, each 500 MW of PV added will account for slightly less than 1% of total energy delivered on the single, integrated system.

In June 2009, FPL began work to obtain all of the licenses, permits, and approvals that are necessary to construct and operate two new nuclear units at its Turkey Point site in the future. These licenses, permits, and approvals will provide FPL with the opportunity to construct these nuclear units for as long as 20 years from the time the licenses and permits are granted, and then to operate the units for at least 40 years thereafter. The Combined Operating Licenses (COL) for the prospective new Turkey Point Units 6 & 7 were granted by the Nuclear Regulatory Commission (NRC) in April 2018. FPL has paused in its determination of whether to seek FPSC approval to move forward with construction of the new nuclear units. FPL intends to incorporate into any such assessment the construction experience of two nuclear units currently being constructed by Georgia Power at its Vogtle site, and similar units being developed in China. As a result, the earliest possible in-service dates for Turkey Point 6 & 7 are beyond the 2020 through 2029 time period addressed in this docket.

In addition, on January 30, 2018, FPL filed a request with the NRC for a Subsequent License Renewal (SLR) for FPL's existing Turkey Point nuclear Units 3 & 4. The SLR requested approval to extend the operating licenses for these two nuclear units by 20 years from the license expiration dates in 2032 and 2033, respectively. The NRC approved the SLR in December 2019. As a result, FPL assumes that these two nuclear units will continue operating into the early 2050s, providing firm capacity into the important load center of Miami-Dade and Broward Counties, as well as zero-emission baseload energy.

Nuclear capacity remains an important consideration in resource planning work, and this Site Plan continues to present the Turkey Point site as a Preferred Site for the new and/or continuing nuclear capacity and energy.

Natural gas sourcing and delivery: In 2013, the FPSC approved FPL's contracts to bring more natural gas into FPL's service territory through a third natural gas pipeline system into Florida. The process by the pipeline companies to obtain approval from the Federal Energy Regulatory Commission (FERC) for the new pipeline system, consisting of the Sabal Trail and Florida Southeast Connection pipelines, culminated in receiving a FERC certificate of approval on February 2, 2016. The new pipeline system has been constructed and is now in service. This pipeline is necessary to fuel the FPSC-approved Okeechobee CC unit. The new pipeline system utilizes an independent route that will result in a more reliable, economic, and diverse natural gas supply for FPL customers and the State of Florida.

Using natural gas more efficiently: FPL has sought ways to utilize natural gas more efficiently for a number of years. In 2008, FPL received approval from the FPSC to modernize the existing Cape Canaveral and Riviera Beach plant sites with new, highly efficient CC units, which replaced the former steam generating units on each of those sites. The Cape Canaveral modernization went into service in April 2013, and the Riviera Beach modernization entered service in April 2014. On April 9, 2012, FPL received FPSC approval to proceed with a similar modernization project at the Port Everglades site. That new generating unit went into service on April 1, 2016.

Similarly, the modernization of the Lauderdale site in 2022 will also enhance FPL's ability to utilize natural gas more efficiently. The modernization project has begun with the recent retirement of two older, relatively fuel-inefficient generating units, Lauderdale Units 4 & 5. In 2022, a new fuel-efficient CC unit will be added at the same site: DBEC Unit 7. Part of the decision to proceed with the modernization of the Lauderdale site was the projection that the total amount of natural gas that will be used on FPL's system will be reduced with the new CC unit compared to what the usage would have been if the two older units had continued to operate.

Addition of Gulf Assets: Gulf Power (Gulf) currently owns two generating plants in the Florida Panhandle. Plant Crist, located in Pensacola, currently runs on coal with limited access to natural gas. Plant Smith, located near Panama City, is a CC natural gas plant. Gulf has access to gas transportation capacity on the Gulf South Pipeline Company, LP (Gulf South) and the Florida Gas Transmission Company, LLC (FGT) pipelines to serve these plants. Gulf is completing uprates at Plant Smith's Unit 3 to increase the output of the unit. Gulf is currently in the process of converting Plant Crist Units 6 & 7 to allow utilization of natural gas which will be delivered via a new plant lateral connecting Plant Crist to the FGT pipeline. This conversion is projected to be completed in the Summer of 2020. Gulf will also be adding four new CTs at Plant Crist in late 2021 that will have the capability to burn either natural gas or ultra-low sulfur distillate (ULSD) fuel oil.

In the future, FPL's resource planning group will continue to identify and evaluate alternatives that may maintain or enhance system fuel diversity. In this regard, efforts are also being made to maintain the ability to utilize ULSD oil at existing units that have that capability. In addition, the new CTs that FPL installed at its existing Lauderdale and Fort Myers sites in 2016, which replaced older GT units that were retired, have the capability to burn either natural gas or ULSD fuel oil.

3. Maintaining a Balance Between Generation and DSM Resources for System Reliability:

As mentioned earlier in Section III. A, FPL utilizes a 10% Generation-Only Reserve Margin (GRM) to ensure that system reliability is not negatively affected by an overreliance on non-generation resources. This GRM reliability criterion was developed as a result of extensive analyses – which have been described in detail in prior FPL Site Plans – of FPL’s system from both resource planning and system operations perspectives. The potential for overreliance upon non-generating resources for system reliability remains an important resource planning issue for the FPL and Gulf areas and is one that will continue to be examined in ongoing resource planning work.

4. The Significant Impacts of Federal and State Energy-Efficiency Codes and Standards:

As discussed in Chapter II, the load forecasts for both the FPL and Gulf areas include projected impacts from federal and state energy-efficiency codes and standards. The magnitude of energy efficiency that is currently projected to be delivered to customers of the single, integrated system through these codes and standards is significant.

Current projections are that a cumulative Summer peak reduction impact of 5,732 MW, from these codes and standards beginning in 2005 (the year the National Energy Policy Act was enacted) and extending through 2029 (*i.e.*, the last year in the 2020 through 2029 reporting time period for this Site Plan), will occur compared to what the projected load would have been without the codes and standards. The projected incremental Summer MW impact from these codes and standards during the 2020 through 2029 reporting period of this Site Plan is the equivalent of an approximate 19% reduction compared to what the projected load would have been without the codes and standards. In regard to energy, the cumulative reduction attributed to the impact of the codes and standards from 2005 to 2029 is projected to reach 6,082 GWh since 2005. Included in this projection is a reduction of approximately 4% during the 2020 through 2029 reporting period. All of these projections show the significant impact of these energy-efficiency codes and standards.

In addition to lowering the load forecast from what it otherwise would have been, and thus serving to lower projected load and resource needs, this projection of efficiency from the codes and standards also affects resource planning in another way: it lowers the potential for utility DSM programs to cost-effectively deliver energy efficiency. This effect was taken into account by the FPSC when it set DSM Goals in 2014. This fact was also prominently

discussed in the 2019 DSM Goals docket in which DSM Goals were set for the years 2020 through 2024.

5. The trends of decreasing costs for fuel, decreasing costs for new generating units, and increasing fuel efficiency of new generating units:

There are a number of factors that drive FPL's system costs. Three of the most important of these are: (i) forecasted natural gas costs, (ii) projected costs for new generating units, and (iii) the efficiency with which FPL's generating units convert fuel into electricity. When comparing forecasts of these factors over at least the last 5 years, the trends for each of these factors is in a direction that results in lower system costs for FPL's customers. For example, when comparing the 2015 forecasted cost for natural gas for the year 2020 with the current (2020) forecasted cost for 2020, there has been more than a 55% decrease in natural gas costs. An even greater reduction in CO₂ compliance costs for 2020 occurred between the 2015 and current forecast. In addition, in regard to the fuel efficiency of FPL's generating units, the amount of natural gas (measured in mmBTU of natural gas needed to produce a kWh of electricity) declined from 7,376 in 2015 to approximately 6,752 today. This improvement in fuel efficiency is truly significant, especially when considering the approximately 20,000 MW of gas-fueled generation on FPL's system.

These trends of steadily lowering of key components of FPL's system costs are very beneficial to FPL's customers because they help to lower FPL's electric rates¹¹.

6. Projected changes in CO₂ regulation and associated compliance costs:

Since 2007, FPL has evaluated potential carbon dioxide (CO₂) regulation and/or legislation and has included projected compliance costs for CO₂ emissions in its resource planning work. However, there always has been an unavoidable level of uncertainty regarding the timing and magnitude of the cost impacts of the potential regulation/legislation. The forecast of potential CO₂ compliance costs that FPL used in its 2019 resource planning work is lower than forecasts that had been used in prior years. In 2020, the new forecast of compliance costs is higher than the 2019 forecast but remains relatively low by historical standards.

¹¹ However, because the potential benefits of utility demand-side management (DSM) programs are based on DSM's ability to avoid certain system costs, the trend of steadily decreasing FPL system costs automatically results in a significant lowering of the cost-effectiveness of utility DSM.

III.D Demand Side Management (DSM)

FPL has sought and implemented cost-effective DSM programs since 1978, and cost-effective DSM has been a key focus of FPL's resource planning work for more than 40 years. During that time, FPL's DSM programs have included many energy efficiency and load management programs and initiatives. Similarly, Gulf has also steadily pursued cost-effective DSM for decades.

DSM Goals were set for FPL, Gulf, and other Florida utilities in November 2019. As discussed in FPL's testimony in the 2019 DSM Goals filing that led to these Goals being set, there were several important market forces affecting the feasibility and cost-effectiveness of utility DSM programs. The first of these is the growing impact of federal and state energy-efficiency codes and standards. As discussed first in Chapter II, and earlier in Section III.C above, the projected incremental impacts of these energy-efficiency codes and standards during the 2020 through 2029 time period has significantly lowered FPL's projected load and resource needs. In addition, these energy-efficiency codes and standards significantly reduce the potential for cost-effective utility DSM programs.

The second market force discussed in FPL's DSM Goals Testimony is FPL's lower generating costs with which DSM must compete. There are several reasons for these lower generating costs. One of these is that, as fuel costs are lowered, the benefit that is realized by each kWh of energy reduced by DSM is also lowered. In other words, the benefit from DSM's kWh reductions has been reduced from what it had been when Florida previously established DSM Goals. For example, from 2015 to 2020, projected fuel costs in \$ per mmBTU for the year 2020 have decreased from \$5.15 to \$2.31, a percentage decrease of 55%. These lower forecasted natural gas costs are very beneficial for FPL's customers because they result in lower fuel costs and lower electric rates. At the same time, lower fuel costs also result in lower potential fuel savings benefits from the kWh reductions of DSM measures. These lowered benefit values result in DSM being less cost-effective than it was in the past.

Another reason for the lower generating costs and the resultant decline in the cost-effectiveness of utility DSM on the FPL system is the steadily increasing efficiency with which FPL generates electricity. FPL's generating system has steadily become more efficient in regard to its ability to generate electricity using less fossil fuel. For example, the FPL system is projected to use almost 30% less fossil fuel to generate a MWh in 2020 than it did in 2001. Again, this is very good for FPL's customers because it helps to significantly lower fuel costs and electric rates. However, the improvements in generating system efficiency affect DSM cost-effectiveness in much the

same way as lower forecasted fuel costs: both lower the fuel costs of energy delivered to FPL's customers. Therefore, the improvements in generating system efficiency further reduce the potential fuel savings benefits from the kWh reduction impacts of DSM, thus further lowering potential DSM benefits and DSM cost-effectiveness.

These market forces that result in lower fuel and new generation costs for utility customers, and lower avoided costs for utility DSM programs, was a topic that was prominently discussed when new DSM Goals for the years 2020 through 2024 were set for FPL, Gulf, and other Florida utilities by the FPSC in the 4th Quarter of 2019. Consideration of these market forces, and of the effects of energy-efficiency codes and standards, were undoubtedly factors helping lead the FPSC to decide to maintain the DSM Goals at the same levels that had been set five years earlier, and to resist efforts to greatly increase DSM Goals for the Florida utilities and their customers.

For resource planning purposes, the DSM Goals set for both FPL and Gulf through 2024 are accounted for in this Site Plan. In addition, the annual DSM levels proposed separately by FPL and Gulf for the years 2025 through 2029 in the DSM Goals docket are accounted for in this Site Plan because these annual levels of DSM were projected to be cost-effective.

In February 2020, FPL and Gulf submitted to the FPSC their respective DSM Plans with which they will strive to meet the DSM Goals for 2020 through 2024. A summary of the programs for both FPL and Gulf is provided below. The FPSC is expected to determine the suitability of the respective DSM Plans later in 2020.

DSM Programs and Research & Development Efforts In FPL's Proposed DSM Plan

1. Residential Home Energy Survey (HES)

This program educates customers on energy efficiency and encourages implementation of recommended practices and measures, even if these are not included in FPL's DSM programs. The HES is also used to identify potential candidates for other FPL DSM programs.

2. Residential Load Management (On Call)

This program allows FPL to turn off certain customer-selected appliances using FPL-installed equipment during periods of extreme demand, capacity shortages, system emergencies, or for system frequency regulation.

3. Residential Air Conditioning

This program encourages customers to install high-efficiency central air-conditioning systems.

4. Residential Ceiling Insulation

This program encourages customers to improve their home's thermal efficiency.

5. Residential New Construction (BuildSmart®)

This program encourages builders and developers to design and construct new homes to achieve BuildSmart® certification and move towards ENERGY STAR® qualifications.

6. Residential Low Income

This program assists low income customers through FPL-conducted Energy Retrofits and state Weatherization Assistance Provider (WAP) agencies.

7. Business Energy Evaluation (BEE)

This program educates customers on energy efficiency and encourages implementation of recommended practices and measures, even if these are not included in FPL's DSM programs. The BEE is also used to identify potential candidates for other FPL DSM programs.

8. Commercial/Industrial Demand Reduction (CDR)

This program allows FPL to control customer loads of 200 kW or greater during periods of extreme demand, capacity shortages, or system emergencies.

9. Commercial/Industrial Load Control (CILC)

This program allows FPL to control customer loads of 200 kW or greater during periods of extreme demand, capacity shortages or system emergencies. It was closed to new participants as of December 31, 2000.

10. Business On Call

This program allows FPL to turn off customers' direct expansion central electric air conditioning units using FPL-installed equipment during periods of extreme demand, capacity shortages, or system emergencies.

11. Business Heating, Ventilating and Air Conditioning (HVAC)

This program encourages customers to install high-efficiency HVAC systems.

12. Business Lighting

This program encourages customers to install high-efficiency lighting systems.

13. Business Custom Incentive (BCI)

This program encourages customers to install unique high-efficiency technologies not covered by other FPL DSM programs.

14. Conservation Research & Development (CRD) Project

This project consists of research studies designed to: identify new energy-efficient technologies; evaluate and quantify their impacts on energy, demand and customers; and, where appropriate and cost-effective, incorporate an emerging technology into a DSM program.

DSM Programs and Research & Development Efforts In Gulf's Proposed DSM Plan

1. Residential Energy Audit

This program educates customers on energy efficiency through energy conservation advice and information that encourages the implementation of efficiency measures and behaviors resulting in energy and utility bill savings. The Residential Energy Audit program is also used to identify potential candidates for other Gulf Power DSM programs.

2. *Energy Select*

This program is designed to provide the customer with a means of conveniently and automatically controlling and monitoring energy purchases in responses to prices that vary during the day and by season in relation to Gulf's cost of producing or purchasing energy. The *Energy Select* system includes field units utilizing a communication gateway, major appliance load control relays, and a programmable thermostat, all operating at the customer's home.

3. Community Energy Saver Program

This program is designed to assist low-income families with energy costs through the direct installation of conservation measures at no cost to them. The program also educates families on energy efficiency techniques and behavioral changes to help control their energy use and reduce their utility operating costs.

4. Residential Ceiling Insulation

This program encourages customers to improve their home's thermal efficiency.

5. Residential Heat Pump

This program encourages customers to install high-efficiency heat pump systems.

6. Residential Variable Speed Pool Pump

This program encourages customers to install high-efficiency variable speed pool pump systems.

7. Commercial/Industrial Energy Survey

This program educates customers on energy efficiency and encourages them to participate in applicable DSM programs and/or implement other recommended actions not included as part of Gulf Business programs.

8. Business Heating, Ventilating and Air Conditioning (HVAC)

This program encourages customers to install high-efficiency HVAC systems.

9. Commercial Curtable Load Program

This program allows Gulf to request curtailment of customer loads with a minimum commitment of 4,000 kW of Non-Firm Demand. The program will be closed to new participants when the total contracted Non-Firm Demand reaches 50 MW.

10. Commercial/Industrial Custom Incentive

This program is designed to establish the ability to offer advanced energy services and energy efficient end-user equipment (including comprehensive audits, design, and construction of energy conservation projects) not offered through other programs to Commercial or Industrial customers.

11. Conservation Demonstration & Development

The program is designed to serve as an umbrella program for the identification, evaluation, demonstration, data collection and development of new or emerging end-use technologies.

III.E Transmission Plan

The transmission plan will allow for the reliable delivery of the required capacity and energy to FPL's and Gulf's retail and wholesale customers. The following table presents the proposed future additions of 230 kV and above bulk transmission lines that must be certified under the Transmission Line Siting Act (TLSA) for the FPL and Gulf areas. There is one such line in FPL's area, but none in Gulf's area, for this 10-year reporting period.

Table III.E.1: List of Proposed Power Lines

(1) Line Ownership	(2) Terminals (To)	(3) Terminals (From)	(4) Line Length CKT. Miles	(5) Commercial In-Service Date (Mo/Yr)	(6) Nominal Voltage (KV)	(7) Capacity (MVA)
FPL	Levee ^{1/}	Midway	150	2030	500	2598

^{1/} Final order certifying the corridor was issued in April 1990. Construction of 138 miles is complete and in-service. Another phase of the project will utilize the remaining 12 mile section of the Levee-Midway corridor and will bring a second 500 kV line to feed Conservation 500/230 kV substation. The second Conservation 500 kV line is currently projected to be built no earlier than 2030 with the month in which the line would go into service unknown at this time.

In addition, there will be transmission facilities needed to connect several projected generation capacity additions to the system transmission grid in both the FPL and Gulf areas. These transmission facilities are described on the following pages. Other generation capacity additions, such as Dania Beach Clean Energy Center Unit 7 in mid-2022, will not require new transmission lines. Sites for longer term additions, such as projected PV additions for 2022-on, have not yet been definitely determined so no transmission analyses for these additions have been performed.

III.E.1 Transmission Facilities for the Hibiscus Solar Energy Center in Palm Beach County

The work required to connect the approximate 74.5 MW (nameplate, AC) Hibiscus Solar Energy Center in Palm Beach County in the 2nd Quarter of 2020 as part of the 2020 SoBRA PV additions is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Minto) on the project site approximately 1 mile west of FPL's Westlake substation on the Ranch-Corbett 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Minto 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Westlake-Corbett section of the Corbett-Ranch 230 kV line into Minto substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.2 Transmission Facilities for the Okeechobee Solar Energy Center in Okeechobee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Okeechobee Solar Energy Center in Okeechobee County in the 2nd Quarter of 2020 as part of the 2020 SoBRA PV additions is projected to be:

- I. **Substation:** None. Solar PV project to be connected to low-side of Okeechobee Clean Energy Center Combustion Turbine Generator Step-up transformer inside the existing plant, which is connected to Fort Drum 500 kV Substation.

- II. **Transmission:** None. Solar PV project to be connected to low-side of Okeechobee Clean Energy Center Combustion Turbine Generator Step-up transformer inside the existing plant, which is connected to Fort Drum 500 kV Substation.

III.E.3 Transmission Facilities for the Southfork Solar Energy Center in Manatee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Southfork Solar Energy Center in Manatee County in the 2nd Quarter of 2020 as part of the 2020 SoBRA PV additions is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (“Duette”) on the project site on the FPL Manatee-Keentown 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Duette 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Manatee-Keentown 230 kV line into Duette substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.4 Transmission Facilities for the Echo River Solar Energy Center in Suwannee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Echo River Solar Energy Center in Suwannee County in the 2nd Quarter of 2020 as part of the 2020 SoBRA PV additions is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 115 kV substation (Hogan) on the project site approximately 2.6 miles west of the FPL Wellborn substation on the Suwannee (Duke Energy Florida DEF) – Columbia (FPL) 115 kV line.
2. Add one 115/34.5 kV main step-up transformer (85 MVA) with a 115 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Hogan 115 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Wellborn-Live Oak section of the Suwannee (Duke Energy) – Columbia (FPL) 115 kV line into Hogan substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.5 Transmission Facilities for the Lakeside Solar Energy Center in Okeechobee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Lakeside Solar Energy Center in Okeechobee County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Nubbin) on the project site on the FPL Martin-Sherman 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Nubbin 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Martin-Sherman 230 kV line into Nubbin substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.6 Transmission Facilities for the Trailside Solar Energy Center in St. Johns County

The work required to connect the approximate 74.5 MW (nameplate, AC) Trailside Solar Energy Center in St. Johns County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 115 kV substation (Moccasin) on the project site on the FPL Elkton-St. Johns section of the Putnam-St. Johns 115 kV line.
2. Add one 115/34.5 kV main step-up transformer (85 MVA) with a 115 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Moccasin 115 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Elkton-St. Johns section of the Putnam-St. Johns 115 kV line into Moccasin substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.7 Transmission Facilities for the Union Springs Solar Energy Center in Union County

The work required to connect the approximate 74.5 MW (nameplate, AC) Union Springs Solar Energy Center in Union County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 115 kV substation (Plum) on the project site approximately 0.1 mile from the FPL Bradford-Lake Butler section of the Raven-Bradford 115 kV line.
2. Add one 115/34.5 kV main step-up transformer (85 MVA) with a 115 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Plum 115 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the FPL Bradford-Lake Butler section of the Raven-Bradford 115 kV line into Plum substation.
2. No additional upgrades are expected to be necessary at this time

III.E.8 Transmission Facilities for the Magnolia Springs Solar Energy Center in Clay County

The work required to connect the approximate 74.5 MW (nameplate, AC) Magnolia Springs Solar Energy Center in Clay County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Leno) on the project site approximately 0.1 mile from the Titanium-Green Cove Springs section of the Seminole Plant-Springbank 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Leno 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Titanium-Green Cove Springs section of the Seminole Plant-Springbank 230 kV line into Leno substation on the project site.
2. No additional upgrades are expected to be necessary at this time

III.E.9 Transmission Facilities for the Egret Solar Energy Center in Baker County

The work required to connect the approximate 74.5 MW (nameplate, AC) Egret Solar Energy Center in Baker County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Claude) on the project site approximately 2 miles from the FPL Duval-Raven 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Claude 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Duval-Raven 230 kV line into Claude substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.10 Transmission Facilities for the Nassau Solar Energy Center in Nassau County

The work required to connect the approximate 74.5 MW (nameplate, AC) Nassau Solar Energy Center in Nassau County in the 4th Quarter of 2020 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Crawford) on the project site on the FPL Duval-West Nassau (Georgia Transmission Company, "GTC") section of the Duval-Yulee 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Crawford 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Duval-West Nassau (GTC) section of the Duval-Yulee 230 kV line into Crawford substation (approximately 1 mile).
2. No additional upgrades are expected to be necessary at this time.

III.E.11 Transmission Facilities for the Pelican Solar Energy Center in St. Lucie County

The work required to connect the approximate 74.5 MW (nameplate, AC) Pelican Solar Energy Center in St. Lucie County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new 230 kV substation (Morrow) on the project site.
2. Add one 230 kV line switch at Morrow for string bus to Eldora substation
3. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
4. Construct 34.5 kV bus to connect the PV array to Morrow 230 kV Substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

II. Transmission:

1. Construct approximately 1.25 miles string bus from Eldora 230 kV to Morrow substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.12 Transmission Facilities for the Palm Bay Solar Energy Center in Brevard County

The work required to connect the approximate 74.5 MW (nameplate, AC) Palm Bay Solar Energy Center in Brevard County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Hayward) on the project site on the FPL Glendale-Hield section of the Midway-Malabar 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Hayward 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Glendale-Hield section of the Midway-Malabar 230 kV line into Hayward substation (approximately 2.5 miles).
2. No additional upgrades are expected to be necessary at this time.

III.E.13 Transmission Facilities for the Discovery Solar Energy Center in Brevard County

The work required to connect the approximate 74.5 MW (nameplate, AC) Discovery Solar Energy Center in Brevard County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 115 kV substation (Rocket) on the project site on the FPL C5-Barna 115 kV line.
2. Add one 115/34.5 kV main step-up transformer (85 MVA) with a 115 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to Rocket 115 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the C5-Barna 115 kV line into Rocket substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.14 Transmission Facilities for the Orange Blossom Solar Energy Center in Indian River County

The work required to connect the approximate 74.5 MW (nameplate, AC) Orange Blossom Solar Energy Center in Indian River County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new 230 kV substation (Finca) on the project site.
2. Add one 230 kV line switch at Finca bifurcating Eldora-Heritage 230 kV line approximately 1 mile from Eldora
3. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
4. Construct 34.5 kV bus to connect the PV array to Finca 230 kV Substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

II. Transmission:

1. Bifurcate Eldora-Heritage 230 kV line approximately 1 mile from Eldora at Finca substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.15 Transmission Facilities for the Sabal Palm Solar Energy Center in Palm Beach County

The work required to connect the approximate 74.5 MW (nameplate, AC) Sabal Palm Solar Energy Center in Palm Beach County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new 230 kV substation (Costa) on the project site.
2. Add one 230 kV line switch at Costa for string bus to Minto substation
3. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
4. Construct 34.5 kV bus to connect the PV array to Costa 230 kV Substation.
5. Add one 230 kV breaker to close ring bus at Minto substation
6. Add relays and other protective equipment.
7. Breaker replacements: None

II. Transmission:

1. Construct approximately 1.5 miles string bus from Minto 230 kV to Costa substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.16 Transmission Facilities for the Fort Drum Solar Energy Center in Okeechobee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Fort Drum Solar Energy Center in Okeechobee County in the 1st Quarter of 2021 is projected to be:

I. Substation:

None. Solar PV project to be connected to low-side of Okeechobee Clean Energy Center Combustion Turbine Generator Step-up transformer inside the existing plant, which is connected to Fort Drum 500 kV Substation.

II. Transmission:

None. Solar PV project to be connected to low-side of Okeechobee Clean Energy Center Combustion Turbine Generator Step-up transformer inside the existing plant, which is connected to Fort Drum 500 kV Substation.

III.E.17 Transmission Facilities for the Rodeo Solar Energy Center in DeSoto County

The work required to connect the approximate 74.5 MW (nameplate, AC) Rodeo Solar Energy Center in DeSoto County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new 230 kV substation (Karson) on the project site.
2. Add one 230 kV line switch at new substation to connect to Gleam substation (Cattle Ranch Solar Energy Center)
3. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
4. Construct 34.5 kV bus to connect the PV array to new 230 kV Substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

II. Transmission:

1. Connect new substation line switch via string bus to Gleam substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.18 Transmission Facilities for the Willow Solar Energy Center in Manatee County

The work required to connect the approximate 74.5 MW (nameplate, AC) Willow Solar Energy Center in Manatee County in the 1st Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new single bus, two (2) breaker 230 kV substation (Coachwhip) on the project site on the FPL Sunshine-Keentown 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
3. Construct 34.5 kV bus to connect the PV array to new Coachwhip 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

II. Transmission:

1. Loop the Sunshine-Keentown 230 kV line into new Coachwhip substation.
2. No additional upgrades are expected to be necessary at this time.

III.E.19 Transmission Facilities for Manatee Energy Storage Center in Manatee County

The approximately 409 MW battery storage addition that will be sited in Manatee County with a projected in-service date of late 2021 does not require any new offsite transmission lines.

III.E.20 Transmission Facilities for Sunshine Gateway Energy Storage addition in Columbia County

The 30 MW battery energy storage facility projected to be in-service in late 2021 that will be added to the existing Sunshine Gateway Solar Energy Center in Columbia County does not require any new offsite transmission lines¹².

¹² This battery storage facility is currently projected to be a 30 MW facility. However, on-going analyses may result in an increase to approximately 75 MW.

III.E.21 Transmission Facilities for Echo River Energy Storage addition in Suwannee County

The 30 MW battery energy storage facility projected to be in-service in late 2021 that will be added to the Echo River Solar Energy Center in Suwannee County does not require any new offsite transmission lines¹³.

¹³ This battery storage facility is currently projected to be a 30 MW facility. However, on-going analyses may result in an increase to approximately 75 MW.

III.E.22 Transmission Facilities for the Lauderdale Plant Modernization (Dania Beach Clean Energy Center Unit 7) in Broward County

The Lauderdale Modernization project (Dania Beach Clean Energy Center Unit 7) that is projected to be completed by mid-2022 does not require any new offsite transmission lines.

III.E.23 Transmission Facilities for the Blue Springs Solar Energy Center in Jackson County

The work required to connect the approximate 74.5 MW (nameplate, AC) Blue Springs Solar Energy Center in Jackson County in the 4th Quarter of 2021 is projected to be:

I. Substation:

- a. Construct a new single bus, two (2) breaker 115 kV substation (Americus) on the project site, approximately 2 miles from the Cypress – Chipola section of the Gulf Marianna – West Grand Ridge 115 kV line.
- b. Add one 115/34.5 kV main step-up transformer (85 MVA) with a 115 kV breaker to connect PV inverter array.
- c. Construct 34.5 kV bus to connect the PV array to Americus 115 kV Substation.
- d. Add relays and other protective equipment.
- e. Breaker replacements: None

II. Transmission:

- a. Loop the Cypress – Chipola section of the Gulf Marianna – West Grand Ridge 115 kV line into Americus substation.
- b. No additional upgrades are expected to be necessary at this time.

III.E.24 Transmission Facilities for the Chautauqua Solar Energy Center in Walton County

The work required to connect the approximate 74.5 MW (nameplate, AC) Chautauqua Solar Energy Center in Walton County in the 4th Quarter of 2021 is projected to be:

I. Substation:

1. Construct a new 230 kV substation (“Liddie”) on the project site.
2. Add two 230 kV line switches on the Shoal River – Samson 230kV line at Liddie Substation
3. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
4. Construct 34.5 kV bus to connect the PV array to Liddie 230 kV Substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

II. Transmission:

1. Interconnection (“Liddie”) Substation is on site. No Gen-Tie Required.
2. No additional upgrades are expected to be necessary at this time.

III.E.25 Transmission Facilities for the Crist Unit 8 Combustion Turbine Project in Escambia County

The work required to connect Crist Unit 8, which consists of four simple cycle combustion turbines (CT) in late 2021, to the Gulf system in Escambia County is projected to be:

I. Substation:

1. Construct a 230 kV switchyard (Conecuh) for the four (4) approximately 235 MW CTs on Crist Plant property. Switchyard will have five (5) bays with breaker-and-a-half configuration.
2. Install four (4) main step-up transformers (4 - 315 MVA), one for each CT.
3. Install thirteen (13) - 230 kV independent-pole breakers in the Conecuh switchyard.
4. Replace all Crist 230 kV breakers with independent-pole breakers.
5. Replace 230/115kV autotransformer transformer with a 500 MVA unit at Bellview substation.
6. Add relays and other protective equipment.

II. Transmission:

1. Loop existing Crist-Alligator Swamp #2-230kV and Crist-Bellview 230kV lines into new Conecuh switchyard.
2. Relocate line terminal for Crist-Barry 230kV line into Conecuh substation.
3. Upgrade Brentwood-Crist 230kV to 1930 Amps (768 MVA, ~7.6 miles).
4. Upgrade Conecuh-Crist #1 and #2-230kV lines to 2000 Amps (797 MVA, ~0.2 miles).
5. Upgrade Crist-Scenic Hills #1-115kV to 1800 Amps (359 MVA, ~2.9 miles).
6. Upgrade Eastgate-Scenic Hills 115kV to 1005 Amps (200 MVA, ~4.8 miles).
7. Upgrade Bellview-Conecuh 230kV to 1930 Amps (768 MVA, 8.9 miles).

III.F. Renewable Resources and Storage Technology

Overview:

Even though solar energy-based resource options were generally not economically competitive on FPL's and Gulf's system until the 2016 time frame, both companies have been actively involved in renewable energy resource research and development since the mid-1970s. These activities have been numerous and varied as described below.

FPL's and Gulf's Renewable Energy Efforts Through 2019:

FPL has been the leading Florida utility in examining ways to effectively utilize renewable energy technologies to serve its customers. Since 1976, FPL has been an industry leader in renewable energy research and development and in facilitating the implementation of various renewable energy technologies. FPL's and Gulf's renewable energy efforts through 2019 are briefly discussed in five categories of solar/renewable activities. Plans for new renewable energy facilities from 2020 through 2029 are then discussed in a separate section.

1) Early Research & Development Efforts:

In the late 1970s, FPL assisted the Florida Solar Energy Center (FSEC) in demonstrating the first residential PV system east of the Mississippi River. This PV installation at FSEC's Brevard County location was in operation for more than 15 years and provided valuable information about PV performance capabilities in Florida on both a daily and annual basis. In 1984, FPL installed a second PV system at its Flagami substation in Miami. This 10-kilowatt (kW) system operated for a number of years before it was removed to make room for substation expansion. In addition, FPL maintained a thin-film PV test facility at the FPL Martin Plant Site for a number of years to test new thin-film PV technologies.

Gulf has evaluated the potential for wind as a renewable energy resource in Northwest Florida through meteorological research along the coastal area. Gulf also participated in joint efforts with Southern Company research on various PV technology evaluations.

2) Demand Side & Customer Efforts:

In terms of utilizing renewable energy sources to meet its customers' needs, FPL initiated the first utility-sponsored conservation program in Florida designed to facilitate the implementation of solar technologies by its customers. FPL's Conservation Water Heating Program, first implemented in 1982, offered incentive payments to customers who chose

solar water heaters. Before the program ended (because it was no longer cost-effective), FPL paid incentives to approximately 48,000 customers who installed solar water heaters.

In the mid-1980s, FPL introduced another renewable energy program, FPL's Passive Home Program. This program was created to broadly disseminate information about passive solar building design techniques that are most applicable in Florida's climate. As part of this program, three Florida architectural firms created complete construction blueprints for six passive home designs with the assistance of the FSEC and FPL. These designs and blueprints were available to customers at a low cost. During its existence, the program received a U.S. Department of Energy award for innovation and also led to a revision of the Florida Model Energy Building Code which was the incorporation of one of the most significant passive design techniques highlighted in the program: radiant barrier insulation.

FPL has continued to analyze and promote PV utilization. These efforts have included PV research, such as the 1991 research project to evaluate the feasibility of using small PV systems to directly power residential swimming pool pumps. FPL's PV efforts also included educational efforts, such as FPL's Next Generation Solar Station Program. This initiative delivered teacher training and curriculum that was tied to the Sunshine Teacher Standards in Florida. The program provided teacher grants to promote and fund projects in the classrooms.

Gulf offered customers the opportunity to contribute to the development of solar PV beginning with the Solar for Schools program in the 1995 DSM Plan. This voluntary program ultimately developed multiple PV installations in schools across Northwest Florida and was used primarily for educational purposes. In 1999, Gulf offered customers an additional opportunity through an optional rate rider. The PV Rate Rider program was intended to give customers an opportunity to contribute towards the construction of a solar PV facility along with other customers across the Southern Company territory.

In 2008, Gulf received FPSC approval to offer an experimental solar water heating program. This program was intended to help customers overcome the high initial cost of adopting the solar thermal water heating technology. The program spanned three years and was absorbed into a larger portfolio of renewable program offerings in Gulf's 2010 DSM Plan.

In 2009, as part of its DSM Goals decision, the FPSC imposed a requirement for Florida's investor-owned utilities to spend up to a certain capped amount annually to facilitate demand-side solar water heater and PV applications. The annual spending caps for these

applications over the five-year period was approximately \$15.5 million per year for FPL and approximately \$576,000 per year for Gulf. In response to this direction, FPL received approval from the FPSC in 2011 to initiate a solar pilot portfolio consisting of three PV-based programs and three solar water heating-based programs, plus a Renewable Research and Demonstration project. Gulf received similar approval from the FPSC in 2011 to initiate a solar pilot portfolio consisting of two PV-based programs and two solar water heating-based programs. Analyses of the results by both FPL and Gulf from these pilot programs since their inception consistently showed that none of these pilot programs was cost-effective for customers using any of the three cost-effectiveness screening tests used by the State of Florida. As a result, consistent with the FPSC's December 2014 DSM Goals Order No. PSC-14-0696-FOF-EU, these pilot programs expired on December 31, 2015.

Gulf conducted market research in 2015 indicating customer interest in a renewable energy alternative to rooftop PV. After further research into innovative offerings across the industry, Gulf developed a subscription-based program model commonly known as community solar. Gulf received FPSC approval in 2016 for a Community Solar program intended to facilitate construction of a 1 MW facility in Northwest Florida once adequate subscriptions were secured. However, customer interest to-date has not been adequate to justify construction of the project.

In addition, FPL and Gulf assist customers interested in installing PV equipment at their facilities. Consistent with Florida Administrative Code Rule 25-6.065, Interconnection and Net Metering of Customer-Owned Renewable Generation, FPL works with customers to interconnect these customer-owned PV systems. Through December 2019, approximately 17,000 customer systems (predominantly residential) have been interconnected with FPL and approximately 2,200 customer systems (predominately residential) have been interconnected with Gulf. These values represent approximately 0.3% of FPL's total number of customers, and approximately 0.5% of Gulf's total number of customers, respectively.

3) Supply Side Efforts – Power Purchases:

FPL has facilitated a number of renewable energy projects (facilities which burn bagasse, waste wood, municipal waste, etc.) through power purchase agreements (PPAs). FPL purchases firm capacity and energy, and/or as-available energy, from these types of facilities. For example, FPL has a contract to receive firm capacity from the Solid Waste Authority of Palm Beach (SWA) through April 2034.

Gulf currently has three PPAs with solar facilities totaling approximately 120 MW. In addition, Gulf has two PPAs totaling approximately 81 MW based, at least in part, on receiving wind-produced firm amounts of hourly energy from out-of-state sources. Tables I.A.3.1, I.A.3.2, I.A.3.3, I.B.3.1, I.B.3.2, and I.B.3.3 in Chapter I provide information regarding both firm and non-firm capacity PPAs from renewable energy facilities in the two areas.

4) Supply Side Efforts – Utility Owned Facilities:

At the time this Site Plan is filed, FPL owns 24 universal solar generating facilities that are in commercial operation, and Gulf owns one universal solar generating facility (Blue Indigo) that is scheduled to go into commercial operation at about the time this 2020 Site Plan is to be filed (April 1, 2020). All but one of these facilities are PV facilities and together they represent approximately 1,675 MW of generation for FPL and 74.5 MW of generation for Gulf Power. The other facility is a 75 MW solar thermal facility. Each of these solar facilities is listed below in Table III.F.1.

Table III.F.1: List of FPL- & Gulf-Owned Solar Facilities Through April 2020

	Solar Energy Center	Project	County	Nameplate MW	Type	COD
FPL Area						
1	Desoto		Desoto	25	Tracking	Oct-09
2	Space Coast		Brevard	10	Fixed	Apr-10
3	Martin		Martin	75	Solar Thermal	Dec-10
4	Manatee		Manatee	74.5	Fixed	Dec-16
5	Citrus		DeSoto	74.5	Fixed	Dec-16
6	Babcock		Charlotte	74.5	Fixed	Dec-16
7	Horizon	SoBRA	Alachua / Putnam	74.5	Fixed	Jan-18
8	Coral Farms	SoBRA	Putnam	74.5	Fixed	Jan-18
9	Wildflower	SoBRA	DeSoto	74.5	Fixed	Jan-18
10	Indian River	SoBRA	Indian River	74.5	Fixed	Jan-18
11	Blue Cypress	SoBRA	Indian River	74.5	Fixed	Mar-18
12	Barefoot Bay	SoBRA	Brevard	74.5	Fixed	Mar-18
13	Hammock	SoBRA	Hammock	74.5	Fixed	Mar-18
14	Loggerhead	SoBRA	St. Lucie	74.5	Fixed	Mar-18
15	Miami-Dade	SoBRA	Miami-Dade	74.5	Fixed	Jan-19
16	Interstate	SoBRA	St. Lucie	74.5	Fixed	Jan-19
17	Sunshine Gateway	SoBRA	Columbia	74.5	Fixed	Jan-19
18	Pioneer Trail	SoBRA	Volusia	74.5	Fixed	Jan-19
19	Sweetbay	ST	Martin	74.5	Fixed	Jan-20
20	Northern Preserve	ST	Baker	74.5	Fixed	Jan-20
21	Cattle Ranch	ST	Desoto	74.5	Tracking	Jan-20
22	Twin Lakes	ST	Putnam	74.5	Tracking	Jan-20
23	Blue Heron	ST	Hendry	74.5	Fixed	Jan-20
24	Babcock Preserve	ST	Charlotte	74.5	Fixed	Jan-20
Gulf Power Area						
25	Blue Indigo		Jackson	74.5	Fixed	Apr-20
Totals						
FPL Area Total Nameplate MW =				1,675		
Gulf Power Area Total Nameplate MW =				74.5		
Total Nameplate MW =				1,749		

5) Ongoing Research & Development Efforts:

FPL has a “Living Lab” across several of its office locations and select customer sites to demonstrate FPL’s renewable energy commitment to employees and visitors. FPL currently has approximately 308 kW of PV as part of the Living Lab, including a 150 kW floating solar installation in Miami-Dade County. Through various Living Lab projects, FPL is able to evaluate multiple solar and storage technologies and applications for the purpose of developing a renewable business model resulting in the most cost-effective and reliable uses for FPL’s customers. FPL plans to continue to expand the Living Lab as new technologies come to market, including a plan to add 500 kW of linear generators in 2020.

FPL has also been in discussions with several private companies on multiple emerging technology initiatives, including ocean current, ocean thermal, hydrogen, fuel cell technology, biomass, biofuels, and energy storage.

In regard to PV's impact on the FPL system, FPL began in 2014 to develop a methodology to determine what firm capacity value at FPL's Summer and Winter peak hours would be appropriate to apply to existing, and potential PV facilities. The potential capacity contribution of PV facilities is dependent upon a number of factors including (but not necessarily limited to): site location, technology, design, and the total amount of solar that is operating on FPL's system. (Note that the Martin solar thermal facility is a "fuel-substitute" facility, not a facility that provides additional capacity and energy. The solar thermal facility displaces the use of fossil fuel to produce steam on the FPL system when the solar thermal facility is operating.)

Based on the results of its analyses using that methodology, firm capacity values are assigned to each new solar facility. These firm capacity values are described in terms of the percentage of the facility's nameplate (AC) rating that can be counted on as firm capacity at the Summer and Winter peak load hours. For example, two of FPL's earliest PV facilities, DeSoto and Space Coast, have been assigned firm capacity values of approximately 46% for DeSoto and 32% for Space Coast at FPL's Summer peak hour (that typically occurs in the 4 p.m. to 5 p.m. hour), but contribute no firm capacity during FPL's Winter peak hour (that typically occurs in the 7 a.m. to 8 a.m. hour). Similarly, each new solar facility is assigned a specific firm capacity value based on the factors described above.

Gulf partnered with EPRI in 2016 as a host site for the SHINES (Sustainable and Holistic Integration of Energy Storage and Solar PV) project. This ongoing project evaluates the potential for transformer-level battery storage to work in conjunction with rooftop solar to manage energy flow on the distribution system. Advanced forecasting technology interacts with the solar and battery control systems to optimize customer loads and charging/discharging of the battery storage to minimize grid disruption. Gulf also conducted research on residential Tesla Powerwall battery systems to evaluate both the potential to shift solar contribution to peak hours and to dispatch storage as a demand-response resource.

Renewable Energy, Battery Storage, and Electric Vehicle Projections for 2020 through 2029:

This section addresses efforts regarding renewable energy in both universal (utility-scale) solar and customer-focused (distributed) solar. In addition, efforts regarding battery storage are also addressed. These efforts and plans are summarized below.

1) Universal Solar:

In 2009, FPL constructed 110 MW of solar energy facilities including two PV facilities totaling 35 MW and one 75 MW solar thermal facility. From 2009 through 2017, the costs of solar equipment, especially PV equipment, declined significantly and universal (i.e., utility-scale) PV facilities at a number of sites became increasingly competitive economically with more conventional generation options. As a result, FPL added three new PV facilities of approximately 74.5 MW each near the end of 2016.

In the first quarter of 2018, eight additional PV facilities of 74.5 MW each, or 596 MW in total, also went into commercial operation. These eight PV facilities were added under the Solar Base Rate Adjustment (SoBRA) provision of the Commission's order approving the settlement agreement for FPL's last base rate case in 2016 (Order No. PSC-16-0560-AS-EI) and comprised the first two tranches of four facilities each. In 2019, four more 74.5 MW PV facilities, or approximately 298 MW, were added as SoBRA facilities. An additional four 74.5 MW PV facilities, or approximately 298 MW, are in the final phase of construction and will be placed into commercial operation in the 2nd Quarter of 2020. This will complete the addition of solar under the current Solar Base Rate Adjustment (SoBRA) mechanism that resulted from FPL's 2016 base rate settlement agreement.

In regard to Gulf's area, one new 74.5 MW utility-owned PV facility, Blue Indigo, will be placed into commercial operation in April of 2020. The decision to add this PV facility was made based on resource planning work performed in 2019.

In this 2020 Site Plan, the resource plan shows a significant amount of solar being added throughout the 10-year projection period (2020 through 2029) of this Site Plan. A total of approximately 10,000 MW of solar is projected by the end of the year 2029. This total value consists of approximately 9,925 MW of PV and 75 MW of solar thermal. Ongoing resource planning work will continue to analyze the projected system economics of solar and all other resource options. Information regarding the Preferred and Potential Sites for the projected solar additions, particularly in the near-term, is presented in Chapter IV.

2) Customer-Focused PV Pilot Programs:

FPL began implementation of two customer-focused PV pilot programs in 2015. The first is a voluntary, community-based, solar partnership pilot to install new solar-powered generating facilities. The program is at least partially funded by contributions from customers who volunteer to participate in the pilot and will not rely on subsidies from non-participating customers. The second program will implement approximately 5 MW of DG PV. The objective of this second program is to collect grid integration data for distributed generation (DG) PV and develop operational best practices for addressing potential problems that may be identified. A brief description of these pilot programs follows.

a) Voluntary, Community-Based Solar Partnership Pilot Program:

The Voluntary Solar Pilot Program, named FPL SolarNow, provides FPL customers with an additional and flexible opportunity to support development of solar power in Florida. The FPSC approved FPL's request for this three-year pilot program in Order No. PSC-14-0468-TRF-EI on August 29, 2014. The pilot program's tariff became effective in January 2015. The pilot was recently approved for a third extension of an additional year by the FPSC in Order No. PSC-2019-0544-TRF-EI on December 20, 2019 and the pilot program is now scheduled to end at the close of 2020.

This pilot program provides all customers the opportunity to support bringing solar projects into local communities by funding the construction of solar facilities in local public areas, such as parks, zoos, schools, and museums. Customers can participate in the program through voluntary contributions of \$9/month. As of the end of 2019, there were 48,897 participants enrolled in the Voluntary Solar Pilot Program. This program has installed 68 projects located in 64 different locations within the FPL service territory. These projects represent approximately 2,420 kW-DC of PV generation.

b) FPL SolarTogether, Shared Solar Program:

In March of 2019, FPL filed for FPSC approval of a community shared solar program. The program is named FPL SolarTogether. This voluntary program offers FPL customers the option to purchase capacity/energy from cost-effective, large-scale solar generation facilities. The proposed program will not require customers who participate to be bound to a long-term contract or subject to administrative fees or termination penalties. Under this program, participants' monthly electric bills would show both a subscription charge and a direct credit on their electric bills associated with the amount of solar-generated capacity purchased. This shared solar program will

leverage the economies of scale of universal solar to deliver long-term savings to both program participants and non-participants.

In March 2020, the FPSC approved the SolarTogether program (Order PSC-2020-0084-S-EI). The first phase of the program is projected to add approximately 1,490 MW of new solar facilities¹⁴.

c) C&I Solar Partnership Pilot Program:

This pilot program is conducted in partnership with interested commercial and industrial (C&I) customers over an approximate 5-year period that is scheduled to conclude in 2020. Limited investments will be made in PV facilities located at customer sites on selected distribution circuits within FPL's service territory.

The primary objective is to examine the effect of high localized PV penetration on FPL's distribution system and to determine how best to address any problems that may be identified. FPL has installed approximately 3.5 MW of PV facilities on circuits that experience specific loading conditions to better study feeder loading impacts. In addition, FPL is now evaluating the integration of solar into urban areas to test its impact on the distribution system on feeders that are heavily loaded as well as investigate the capabilities of "bifacial solar panel" technology, which, unlike traditional panels, is able to produce energy on both sides

Battery Storage Efforts:

Battery storage technology has continued to advance, and the costs of storage are projected to continue to decline. As a result, battery storage, particularly when charged solely by utility-scale solar facilities, has become an economically competitive firm capacity option for FPL's system. The resource plan presented in this 2020 Site Plan shows an increased amount of battery storage compared to what was presented in the 2019 Site Plan. As previously discussed, a 409 MW battery storage facility will be added in late 2021 at the existing Manatee plant site to partially offset the loss of capacity that will occur with the retirement of existing Manatee Units 1 & 2. Additional battery storage capacity is projected to be added by late 2021 with 30 MW of battery storage added at both the existing Sunshine Gateway Solar Energy Center and at the Echo River Solar Energy Center currently in

¹⁴ In the SolarTogether community solar program, participating customers share in the costs and benefits of a dedicated FPL SolarTogether PV facility and are entitled, upon their request, to have the environmental attributes associated with their participation retired by FPL on their behalf.

construction. An additional total of approximately 700 MW of battery storage is also included in the resource plan in the years 2028 and 2029 in Gulf's area.

In addition, FPL is analyzing the potential of battery storage technology to benefit FPL's customers in other ways. These analyses have been, and are currently, being carried out through implementation of two pilot projects designed to evaluate different potential applications for batteries on FPL's system.

The objectives of the two pilot projects are to identify the most promising applications for batteries on FPL's system and to gain experience with battery installation and operation. This information will position FPL to expeditiously take advantage of battery storage for the benefit of FPL's and Gulf's customers as the economics of the technology continue to improve. For the purpose of discussing these two pilot projects, they will be referred to as the "small scale" and "large scale" storage pilot projects.

1) Small Scale Storage Pilot Projects:

In 2016 and early 2017, FPL installed approximately 4 MW of battery storage systems, spread across six sites, with the general objective of demonstrating the operational capabilities of batteries and learning how to integrate them into FPL's system. These small storage projects were designed with a distinct set of high-priority battery storage grid applications in mind. These applications include: peak shaving, frequency response, and backup power. In addition, these initial projects were designed to provide FPL with an opportunity to determine how to best integrate storage into FPL's operational software systems and how best to dispatch and/or control the storage systems.

To this end, FPL installed: (i) a 1.5 MW battery in Miami-Dade County primarily for peak shaving and frequency response, (ii) another 1.5 MW battery in Monroe County for backup power and voltage support, (iii) a relocatable 0.75 MW uninterruptible power supply (UPS) battery at the Tennis Center at Crandon Park in Key Biscayne for mitigation of momentary disruptions, and (iv) several smaller kilowatt-scale systems at other locations to study distributed storage reliability applications. All of these projects have been in service for more than 2 years and have yielded valuable information regarding the applications listed above.

2) Large Scale (50 MW) Storage Pilot Project:

The small scale energy storage pilot projects described above are complemented by up to 50 MW of additional battery projects that will be deployed. These pilot projects were authorized under the Settlement Agreement in FPL's 2016 base rate case. The 50 MW of

batteries that will be deployed in this larger pilot project will expand the number of storage applications and configurations that FPL will be able to test, as well as making the scale of deployment more meaningful, given the large size of FPL's system.

The first two storage projects under this pilot involve pairing battery storage with existing universal PV facilities, and these projects went into service in the 1st Quarter of 2018. One of the projects is a 4 MW battery sited at FPL's Citrus Solar Energy Center, which captures clipped (curtailed) solar energy from the solar panels during high solar insolation hours, then releases this energy in other hours. The second of these two projects is a 10 MW battery at FPL's Babcock Ranch Solar Energy Center. This project is designed to shift PV output from non-peak times to peak times and also to provide "smoothing" of solar output and regulation services. These two projects are designed to enhance the operations of existing solar facilities that were installed in 2016 as outlined in FPL's base rate case Settlement Agreement. The data and lessons gathered from these two projects will result in more optimized design configurations for solar-paired battery projects as well as improved operational parameters for economic dispatch.

The third project, placed in-service in the 4th Quarter of 2019, is a 10 MW battery in Wynwood, a dense urban area that is close to downtown Miami. The project is designed to examine the use of batteries to support the distribution system with a focus on addressing grid, system, and customer challenges.

Three additional pilot projects are under development and expected to go in-service in 2020. One project entails deploying a 3 MW battery alongside an existing solar PV system to create a microgrid. The microgrid will be used for local resiliency and to provide additional grid services, including mitigation of disruptions potentially caused by solar in the distribution system. Another project currently under development will deploy up to 1 MW of Electric-Vehicle-to-Grid (EV2G) batteries using electric school buses that will be able to discharge electricity to the grid when needed. This project will explore the potential for utilizing electric vehicles as grid resources on FPL's system for the first time ever. Yet another project will site an 11.5 MW battery at the future Dania Beach Clean Energy Center Unit 7 to provide FPL an opportunity to test using battery storage for black start capability of large generating units.

Together, all of these projects will utilize approximately 39 MW of the 50 MW allowed under the Settlement Agreement. In regard to the remaining 11 MW of allowed storage capacity, FPL is continuing to evaluate which types of battery storage configurations and applications

are projected to be the most meaningful to examine at this time. Potential project ideas are evaluated on an ongoing basis, considering current trends in the battery storage market, as well as the needs of FPL's system and the potential for projects of a given type to create future customer savings and value.

In addition to the two storage pilot projects described above (Small Scale and Large Scale 50 MW), FPL is now testing battery storage in the residential setting. This test involves up to 20 residential sites in the Palm Beach County area. The test addresses both potential benefits of having a 5-to-8 kW storage system for home backup power and the ability of FPL to remotely control the storage systems to provide services to the electric grid.

These battery storage pilot projects, plus other planned battery storage efforts projected to be in-service by late 2021/beginning of 2022, are presented in Table III.F.2 below. The table also presents the firm capacity values for Summer and Winter that FPL is currently assigning to these facilities. In total, FPL is currently projecting approximately 480 MW of cumulative firm capacity value from battery storage by 2022 and this firm capacity is accounted for in FPL's resource planning work.

Table III.F.2: List of FPL Battery Storage Facilities

In-Service Date	Location / Projects	Status	Nameplate MW	Firm Summer capacity MW	Firm Winter capacity MW
2016-2017	2016 Pilots	Operation	4	0	0
2018	Citrus Solar Energy Center	Operation	4	4	4
2018	Babcock Solar Energy Center	Operation	10	10	10
2019	Wynwood	Operation*	10	0	0
2020	Dania Beach Energy Center	Development	11.5	0	0
2020	Micro grid	Development	3	0	0
2020	EV2G	Development	0.4	0	0
2021	Manatee	Development	409	409	409
2022	Sunshine Gateway	Development	30	30	30
2022	Echo River	Development	30	23	30
	Total		512	476	483

* The Wynwood battery has 2 interconnection points. The first was energized in Dec. 2019; the second will be energized in Apr. 2020.

Electric Vehicle Efforts:

Florida continues to rank in the top four in the nation for electric vehicle (EV) adoption, and more Floridians are buying electric vehicles every year. FPL began implementation of the new FPL EVolution pilot program in 2019 to support the growth of EVs with the goal to install more than 1,000 charging ports, thus increasing the availability of public charging stations for EVs in Florida by 50%. This pilot program will be conducted in partnership with interested host customers over an approximate 3-year period. Limited investments will be made in EV charging infrastructure. Installations will encompass different EV charging technologies and market segments, including workplace, destination, public fast charging, and residential. These places will include rest stops, public parks, shopping malls, and large businesses that employ thousands of Florida residents. As of December 31, 2019, FPL has installed 50 ports at 7 locations.

In regard to EVs, the primary objective of the integrated utility is to examine EV use, adoption, potential new rate structures, power quality, and customer experience ahead of mass adoption to ensure future electric vehicle investments enhance service for electric customers who select EVs.

III.G Fuel Mix and Fuel Price Forecasts

1. Fuel Mix: FPL and Gulf

Until the mid-1980s, FPL relied primarily on a combination of fuel oil, natural gas, and nuclear energy to generate electricity with significant reliance on oil-fueled generation. In the early 1980s, FPL began to purchase “coal-by-wire.” In 1987, coal was first added to the fuel mix through FPL’s partial ownership (20%) and additional purchases (30%) from the St. Johns River Power Park (SJRPP). This allowed FPL to meet its customers’ energy needs with a more diversified mix of energy sources. Additional coal resources were added with the partial acquisition (76%) of Scherer Unit 4, which began serving FPL’s customers in 1991.

The trend since the early 1990s has been a steady increase in the amount of natural gas, which FPL uses to produce electricity due, in part, to the introduction of highly efficient and cost-effective CC generating units and the ready availability of abundant, U.S.-produced natural gas. FPL placed into commercial operation two new gas-fueled CC units at the West County Energy Center (WCEC) site in 2009. FPL added a third new CC unit to the WCEC site in 2011. In addition, FPL has completed the modernization of its Cape Canaveral, Riviera Beach, and Port Everglades plant sites. These new CC units have dramatically

improved the efficiency of FPL's generation system in general and, more specifically, the efficiency with which natural gas is utilized. In March of 2018, the FPSC authorized a modernization of FPL's Lauderdale site in which two existing steam-type generating units were retired in late 2018, and a new, much more fuel-efficient CC unit, DBEC Unit 7, will be added at the site by mid-2022.

The uprates at Plant Smith's Unit 3 in Gulf's area will increase the efficiency of the current unit, and alternatives that allow more output from existing units across the FPL and Gulf systems will continue to be evaluated. The addition of 4 CT's at Plant Crist in 2021, capable of burning natural gas or ULSD oil, will provide additional fuel diversity and reliability.

FPL has also taken measures over the last few years to reduce the use of coal as a fuel. FPL shuttered Cedar Bay in 2016, St. Johns River Power Park in 2018 and plans to retire the Indiantown Co-Gen coal-fueled unit in late 2020. Gulf's conversion of the Crist plant to natural gas in 2020 demonstrates a continued commitment to eliminate coal from the generation portfolio.

In addition, FPL increased its utilization of nuclear energy through capacity uprates of its four existing nuclear units. With these uprates, more than 500 MW of additional nuclear capacity have been added to the FPL system. As mentioned previously, FPL has obtained the Combined Operating Licenses from the NRC for two new nuclear units, Turkey Point Units 6 & 7. FPL has now paused in this process to decide when to pursue approval from the FPSC to proceed to construction. In addition, on January 30, 2018, FPL applied to the Nuclear Regulatory Commission (NRC) for Subsequent License Renewal (SLR) for FPL's Turkey Point Units 3 & 4. The current license terms for these two existing nuclear units extend into the years 2032 and 2033, respectively. The SLR request has now been approved by the NRC which extends the operating licenses for Turkey Point Units 3 & 4 by 20 years to 2052 and 2053, respectively.

In regard to utilizing renewable energy, by April 2020, FPL will have an approximate 75 MW solar thermal steam generating facility at the existing Martin site and a total of approximately 1,675 MW PV generating capability comprised of 74.5 MW solar facilities at 23 other sites. In addition, Gulf has one 74.5 MW PV facility. A significant amount of additional solar is projected in the current resource plan as discussed throughout this Site Plan. However, as previously discussed in this chapter, the contribution to fuel diversity of this additional PV capability will be lower on a MWh basis than the large MW additions of PV might suggest.

Ongoing resource planning work will continue to focus on identifying and evaluating alternatives that would most cost-effectively maintain and/or enhance long-term fuel diversity. These fuel-diverse alternatives may include: the purchase of power from renewable energy facilities, additional solar energy facilities, obtaining additional access to diversified sources of natural gas such as liquefied natural gas (LNG) and natural gas from the Mid-Continent and Marcellus regions, preserving the ability to utilize fuel oil at existing units, and increased utilization of nuclear energy. (As previously discussed, new, advanced technology coal-fueled generating units are not currently considered as viable options in Florida in the 10-year reporting period of this document.) The evaluation of the feasibility and cost-effectiveness of these and other possible fuel diversity alternatives will be part of on-going resource planning efforts.

Current use of various fuels to supply energy to customers, plus a projection of this “fuel mix” through 2029 based on the resource plan presented in this document, is presented in Schedules 5, 6.1, and 6.2 that appear later in this chapter. As noted on Schedules 6.1 and 6.2, the fuel mix projections for the Gulf system for the years 2020 and 2021 were provided by the Southern Company which will continue to operate the Gulf generating units until the FPL and Gulf systems are integrated into a single operating system.

2. Fossil Fuel Cost Forecasts

FPL’s Fuel Cost Forecasts

Fossil fuel price forecasts, and the resulting projected price differentials between fuels, are major drivers used to evaluate alternatives for meeting future resource needs. FPL’s forecasts are generally consistent with other published contemporary forecasts. A January 2020 fuel cost forecast was used in the analyses which developed the resource plan presented in this 2020 Site Plan.

Future oil and natural gas prices, and to a lesser extent, coal prices, are inherently uncertain due to a significant number of unpredictable and uncontrollable drivers that influence the short- and long-term price of oil, natural gas, and coal. These drivers include U.S. and worldwide demand, production capacity, economic growth, environmental requirements, and politics.

The inherent uncertainty and unpredictability of these factors today and in the future clearly underscore the need to develop a set of plausible oil, natural gas, and solid fuel (coal) price

scenarios that will bound a reasonable set of long-term price outcomes. In this light, Low, Medium, and High price forecasts for fossil fuels were developed in anticipation of the 2020 resource planning work.

FPL's Medium price forecast methodology is consistent for oil and natural gas. For oil and natural gas commodity prices, FPL's Medium price forecast applies the following methodology:

- a. For the current + 2 years (2020-2022), the methodology used the January 2020 forward curve for New York Harbor 0.7% sulfur heavy oil, WTI Crude Oil, Ultra-Low Sulfur Diesel (ULSD) fuel oil, and Henry Hub natural gas commodity prices;
- b. For the next two years (2023 and 2024), FPL used a 50/50 blend of the January 2020 forward curve and the most current projections at the time from The PIRA Energy Group;
- c. For the 2025 through 2040 period, FPL used the annual projections from The PIRA Energy Group; and,
- d. For the period beyond 2040, FPL used the real rate of escalation from the Energy Information Administration (EIA). In addition to the development of oil and natural gas commodity prices, nominal price forecasts also were prepared for oil and natural gas transportation costs. The addition of commodity and transportation forecasts resulted in delivered price forecasts.

FPL's Medium price forecast methodology is also consistent for coal prices. Forecasted coal prices were based upon the following approach:

- a. JD Energy provides regular (once every 1-2 months) short-term price forecasts (currently through 2021 issued in December 2019) for Powder River Basin (PRB) minemouth/FOB coal.
- b. JD Energy also provides a long-term price forecast through 2065 of the delivered price of coal to Scherer. The most recent forecast was issued in September 2019.
- c. The short term delivered coal price forecast for Plant Scherer is updated with PRB minemouth/FOB coal price updates from JD Energy while keeping the long-term prices the same as the September 2019 long-term forecast.
- d. Beyond 2065, prices are escalated at JD Energy's annual price escalation from 2064 to 2065.

In cases where multiple fuel cost forecasts are used, a Medium fuel cost forecast is developed first. FPL's approach has been to then adjust the Medium fuel cost forecast upward (for the High fuel cost forecast) or downward (for the Low fuel cost forecast) by multiplying the annual cost values from the Medium fuel cost forecast by a factor of $(1 + \text{the historical volatility of the 12-month forward price, one year ahead})$ for the High fuel cost forecast, or by a factor of $(1 - \text{the historical volatility of the 12-month forward price, one year ahead})$ for the Low fuel cost forecast.

Gulf Power's Fuel Cost Forecasts

Fossil fuel price forecasts, and the resulting projected price differentials between fuels, are major drivers used to evaluate alternatives for meeting future resource needs. Gulf Power's forecasts are generally consistent with other published contemporary forecasts. A January 2020 fuel cost forecast was used in analyses, the results of which led to the resource plan presented in this 2020 Site Plan.

Future oil and natural gas prices, and to a lesser extent, coal prices, are inherently uncertain due to a significant number of unpredictable and uncontrollable drivers that influence the short- and long-term price of oil, natural gas, and coal. These drivers include U.S. and worldwide demand, production capacity, economic growth, environmental requirements, and politics.

The inherent uncertainty and unpredictability of these factors today and in the future clearly underscore the need to develop a set of plausible oil, natural gas, and solid fuel (coal) price scenarios that will bound a reasonable set of long-term price outcomes. In this light, Low, Medium, and High price forecasts for fossil fuels were developed in anticipation of the 2020 resource planning work.

Gulf's Medium price forecast methodology for natural gas is consistent with FPL's methodology for natural gas and light oil. For natural gas and light oil commodity prices, Gulf's Medium price forecast applies the following methodology:

- a. For the current + 2 years (2020-2022), the methodology used the January 2020 forward curve for Henry Hub natural gas and Ultra-Low Sulfur Diesel (ULSD) fuel oil commodity prices;
- b. For the next two years (2023 and 2024), a 50/50 blend of the January 2020 forward curve, and the most current projections at the time from The PIRA Energy Group, were used;

- c. For the 2025 through 2040 period, the annual projections from The PIRA Energy Group were used; and,
- d. For the period beyond 2040, the real rate of escalation from the Energy Information Administration (EIA) was used. In addition to the development of oil and natural gas commodity prices, nominal price forecasts also were prepared for oil and natural gas transportation costs. The addition of commodity and transportation forecasts resulted in delivered price forecasts.

Gulf's Medium price forecast methodology for coal is also consistent with FPL's methodology for coal prices at Plant Scherer. Forecasted coal prices were based upon the following approach:

- a. JD Energy provides regular (once every 1-2 months) short-term price forecasts (currently through 2021 issued in December 2019) for Powder River Basin (PRB), Uinta Basin, Illinois River Basin (ILB) and Colombian minemouth/FOB coal.
- b. JD Energy also provides a long-term price forecast through 2065 of the delivered price of coal to Crist, Smith, and Scherer. The most recent forecast was issued in September 2019.
- c. The short-term delivered coal price forecast for Plant Scherer is updated with PRB minemouth/FOB coal price updates from JD Energy while keeping the long-term prices the same as the September 2019 long-term forecast.
- d. Currently coal price forecasts for plants Crist and Daniels are kept the same as the September 2019 long-term coal forecast provided by JD Energy.
- e. Beyond 2065, all plant prices are escalated at JD Energy's annual price escalation from 2064 to 2065.

In cases where multiple fuel cost forecasts are used, a Medium fuel cost forecast is developed first. Then the Medium fuel cost forecast is adjusted upward (for the High fuel cost forecast) or downward (for the Low fuel cost forecast) by multiplying the annual cost values from the Medium fuel cost forecast by a factor of $(1 + \text{the historical volatility of the 12-month forward price, one year ahead})$ for the High fuel cost forecast, or by a factor of $(1 - \text{the historical volatility of the 12-month forward price, one year ahead})$ for the Low fuel cost forecast.

3. Natural Gas Storage

FPL currently has under contract 4.0 billion cubic feet (Bcf) of firm natural gas storage capacity at the Bay Gas storage facility in Alabama. The contract is set to expire March 31, 2021, but will automatically renew for up to four more successive one-year terms unless otherwise terminated by either party on or before December 31 of 2020. FPL has predominately utilized natural gas storage to help mitigate gas supply problems caused by severe weather and/or infrastructure problems. To diversify FPL's natural gas storage portfolio, FPL entered into a storage contract with SG Resources Mississippi, L.L.C. (Southern Pines Storage) for 1 Bcf of storage capacity. The current contract with Southern Pines Storage is set to expire March 31, 2022. This storage facility is located in Mississippi and is connected to numerous pipelines including FGT, Southeast Supply Header, and Transco. Gulf currently holds total storage capacity of 2.45 Bcf across three facilities: Bay Gas (1.1 Bcf), Leaf River (0.85 Bcf), and Petal (0.50 Bcf). This storage capacity is utilized for Plant Smith, Plant Crist, and Gulf's SENA (Shell) PPA.

Over the past several years, FPL has acquired upstream transportation capacity on several pipelines to help mitigate the risk of off-shore supply problems caused by severe weather in the Gulf of Mexico. While this transportation capacity has reduced FPL's off-shore exposure, a portion of FPL's supply portfolio remains tied to off-shore natural gas sources. Therefore, natural gas storage remains an important tool to help mitigate the risk of supply disruptions.

As FPL's reliance on natural gas has increased, its ability to manage the daily "swings" that can occur on its system due to weather and unit availability changes has become more challenging, particularly from oversupply situations. Natural gas storage is a valuable tool to help manage the daily balancing of supply and demand. From a balancing perspective, injection and withdrawal rights associated with gas storage have become an increasingly important part of the evaluation of overall gas storage requirements.

As the integrated utility system grows to meet customer needs, it must maintain adequate gas storage capacity to continue to help mitigate supply and/or infrastructure problems and to provide the ability to manage its supply and demand on a daily basis. The gas storage portfolio is continually evaluated and subscription for additional gas storage capacity is possible if needed to help increase reliability, provide the necessary flexibility to respond to demand changes, and diversify the overall portfolio.

4. Securing Additional Natural Gas:

Significant reliance upon natural gas to produce electricity for FPL's customers is projected to continue over the long-term due to FPL's growing load. The addition of highly fuel-efficient CC units at Cape Canaveral, Riviera Beach, Port Everglades, and Okeechobee, plus the additional CC capacity at the Dania Beach site that will come in-service in 2022, will reduce the growth in natural gas use from what it otherwise might have been due to the high fuel-efficiency levels of these new CC units. In addition, as discussed above, FPL currently plans to add significantly more solar PV facilities that utilize no fossil fuel.

FPL has historically purchased the gas transportation capacity required for new natural gas supply from two existing natural gas pipeline companies: FGT and Gulfstream. In mid-2017, a third new pipeline system, consisting of the Sabal Trail and Florida Southeast Connection pipelines, went into operation. This new pipeline system is now providing fuel for FPL's Riviera and Martin plants. The new pipeline system also provides the primary fuel for the recently added Okeechobee CC unit. The new pipeline system will also allow needed support for gas-fueled FPL generation facilities in several counties.

Southern Company Services (SCS) is currently managing the fuel supply for the Gulf power plants. Gulf is working to transition some of these fuel management activities by the end of 2021, but nothing has been transitioned to-date. Gulf is currently working with SCS to determine the appropriate fuel plans for the increased gas requirements at Plants Crist and Smith.

5. Nuclear Fuel Cost Forecast

This section discusses the various steps needed to fabricate nuclear fuel for delivery to nuclear power plants, the method used to forecast the price for each step, and other comments regarding FPL's nuclear fuel cost forecast.

a) Steps Required for Nuclear Fuel to be delivered to FPL's Plants

Four separate steps are required before nuclear fuel can be used in a commercial nuclear power reactor. These steps are summarized below.

(1) Mining: Uranium is produced in many countries such as Canada, Australia, Kazakhstan, and the United States. During the first step, uranium is mined from the ground using techniques such as open pit mining, underground mining, in-situ leaching operations, or production as a by-product from other mining operations, such as gold,

copper, or phosphate rocks. The product from this first step is the raw uranium delivered as an oxide, U₃O₈ (sometimes referred to as yellowcake).

(2) Conversion: During the second step, the U₃O₈ is chemically converted into UF₆ which, when heated, changes into a gaseous state. This second step further removes any chemical impurities and serves as preparation for the third step, which requires uranium to be in a gaseous state.

(3) Enrichment: Natural uranium contains 0.711% of uranium at an atomic mass of 235 (U-235) and 99.289% of uranium at an atomic mass of 238 (U-238). FPL's nuclear reactors use uranium with a higher percentage of up to almost five percent (5%) of U-235 atoms. Because natural uranium does not contain a sufficient amount of U-235, the third step increases the percentage amount of U-235 from 0.711% to a level specified when designing the reactor core (typically in a range from approximately 2.0% to as high as 4.95%). The output of this enrichment process is enriched uranium in the form of UF₆.

(4) Fabrication: During the last step, fuel fabrication, the enriched UF₆ is changed to a UO₂ powder, pressed into pellets, and fed into tubes, which are sealed and bundled together into fuel assemblies. These fuel assemblies are then delivered to the plant site for insertion in a reactor.

Like other utilities, FPL has purchased raw uranium and the other components of the nuclear fuel cycle separately from numerous suppliers from different countries.

b) Price Forecasts for Each Step

(1) Mining: The impact of the earthquake and tsunami that struck the Fukushima nuclear complex in Japan in March 2011 is still being felt in the uranium market because the majority of the Japanese nuclear reactors are still not operating. As a result, current demand has remained declined and several of the production facilities have either closed or announced delays. Factors of importance are:

- Some of the uranium inventory from the U.S. Department of Energy (DOE) is finding its way into the market periodically to fund cleanup of certain Department of Energy facilities.
- Although only two new nuclear units are scheduled to start production in the U.S. during the next 2 to 3 years, other countries, more specifically China, have

announced an increase in construction of new units which may cause uranium prices to trend up in the near future.

Over a 10-year horizon, FPL expects the market to be more consistent with market fundamentals. The supply picture is more stable, with laws enacted to resolve the import of Russian-enriched uranium, by allowing some imports of Russian-enriched uranium to meet about 20-25% of needs for currently operating units, but with no restriction on the first core for new units and no restrictions after 2020 (an extension of these restrictions is currently under review). New and current uranium production facilities are decreasing capacity due to continued low prices and demands. Actual demand tends to grow over time because of the long lead time to build nuclear units. However, FPL cannot discount the possibility of future periodic sharp increases in prices, but believes such occurrences will likely be temporary in nature.

(2) Conversion: The conversion market is also in a state of flux due to the Fukushima events. Planned production is currently forecasted to be insufficient to meet a higher demand scenario, but it is projected to be sufficient to meet most reference case scenarios. As with additional raw uranium production, supply will expand beyond the current level if more firm commitments are made. FPL expects long-term price stability for conversion services to support world demand.

(3) Enrichment: Since the Fukushima events in March 2011, the near-term price of enrichment services has declined. However, plans for construction of several new facilities that were expected to come on-line after 2011 have been delayed and/or cancelled. Also, some of the existing high operating cost diffusion plants have shut down. As with supply for the other steps of the nuclear fuel cycle, expansion of future capacity is feasible within the lead time for constructing new nuclear units and any other projected increase in demand. Meanwhile, world supply and demand will continue to be balanced such that FPL expects adequate supply of enrichment services. The current supply/demand profile will likely result in the price of enrichment services remaining stable for the next few years, then starting to increase.

(4) Fabrication: Because the nuclear fuel fabrication process is highly regulated by the Nuclear Regulatory Commission (NRC), not all production facilities can qualify as suppliers to nuclear reactors in the U.S. Although world supply and demand is expected to show significant excess capacity for the foreseeable future, the gap is not as wide for

U.S. supply and demand. The supply for the U.S. market is expected to be sufficient to meet U.S. demand for the foreseeable future.

c) Other Comments Regarding FPL's Nuclear Fuel Cost Forecast

FPL's nuclear fuel price forecasts are the result of FPL's analysis based on inputs from various nuclear fuel market expert reports and studies. There is adequate projected supply, including planned and prospective mine expansions, to meet FPL demands, including operation of the Turkey Point nuclear units through the recently approved second life extension through the early 2050s.

**Schedule 5: Actual
Fuel Requirements**

Fuel Requirements	Units	Actual ^{1/}			
		2018	2019	2018	2019
		FPL		Gulf	
(1) Nuclear	Trillion BTU	309	303	0	0
(2) Coal	1,000 TON	1,691	1,684	2,935	2,687
(3) Residual (FO6) - Total	1,000 BBL	440	187	0	0
(4) Steam	1,000 BBL	440	187	0	0
(5) Distillate (FO2) - Total	1,000 BBL	187	203	30	17
(6) Steam	1,000 BBL	4	1	27	17
(7) CC	1,000 BBL	94	191	0	0
(8) CT	1,000 BBL	89	11	3	0
(9) Natural Gas - Total	1,000 MCF	660,569	665,984	59,283	28,616
(10) Steam	1,000 MCF	38,572	29,028	1,255	1,124
(11) CC	1,000 MCF	616,949	630,185	56,948	27,492
(12) CT	1,000 MCF	5,048	6,771	1,080	0
(13) Other ^{2/}	1,000 MCF	0	0	250	0

1/ Source: A Schedules.

2/ Perdido Units' landfill gas burn included in Other

Note: Solar contributions are provided on Schedules 6.1 and 6.2.

**Schedule 5: Forecasted
Fuel Requirements**

Fuel Requirements	Units	Forecasted											
		2020	2021	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
		FPL		Gulf		Integrated FPL and Gulf							
(1) Nuclear	Trillion BTU	298	298	0	0	305	298	301	306	301	300	307	301
(2) Coal	1,000 TON	1,003	1,132	514	189	77	146	87	152	178	187	206	152
(3) Residual (FO6) - Total	1,000 BBL	0	13	0	0	0	0	0	0	0	0	0	0
(4) Steam	1,000 BBL	0	13	0	0	0	0	0	0	0	0	0	0
(5) Distillate (FO2) - Total	1,000 BBL	9	5	3	5	39	10	21	24	9	22	19	16
(6) Steam	1,000 BBL	0	0	0	0	0	0	0	0	0	0	0	0
(7) CC	1,000 BBL	5	2	0	0	33	3	11	19	2	9	9	5
(8) CT	1,000 BBL	4	3	3	5	7	8	10	6	7	13	11	11
(9) Natural Gas - Total	1,000 MCF	594,809	575,238	28,846	33,608	617,672	631,009	637,355	625,116	615,165	604,104	591,178	583,767
(10) Steam	1,000 MCF	2,126	1,522	5,088	10,121	4,055	8,097	6,768	6,613	5,930	5,183	3,491	1,906
(11) CC	1,000 MCF	588,978	570,110	23,738	23,460	610,518	619,975	628,258	614,965	607,363	596,260	585,060	580,366
(12) CT	1,000 MCF	3,705	3,606	20	27	3,098	2,937	2,329	3,538	1,871	2,660	2,627	1,494
(13) Other ^{2/}	1,000 MCF	0	0	246	245	245	245	245	240	245	245	245	256

1/ Source: A Schedules.

2/ Perdido Units' landfill gas burn included in Other

Note: Solar contributions are provided on Schedules 6.1 and 6.2.

**Schedule 6.1 Actual
Energy Sources**

<u>Energy Sources</u>	<u>Units</u>	<u>Actual ^{1/}</u>			
		<u>2018</u>	<u>2019</u>	<u>2018</u>	<u>2019</u>
		<u>FPL</u>		<u>Gulf</u>	
(1) Annual Energy Interchange ^{2/}	GWH	0	0	(3,095)	(3,556)
(2) Nuclear	GWH	28,176	27,791	0	0
(3) Coal	GWH	2,586	2,488	5,526	4,125
(4) Residual(FO6) -Total	GWH	248	223.5	0	0
(5) Steam	GWH	248	224	0	0
(6) Distillate(FO2) -Total	GWH	129	223.5	1	0
(7) Steam	GWH	2	14	0	0
(8) CC	GWH	78	204	0	0
(9) CT	GWH	49	5	1	0
(10) Natural Gas -Total	GWH	91,214	93,373	8,150	8,808
(11) Steam	GWH	3,133	2,442	29	62
(12) CC	GWH	87,625	90,302	3,934	3,913
(13) CC PPAs - Gas	GWH	0	0	4,114	4,833
(14) CT	GWH	456	630	73	0
(15) Solar ^{3/}	GWH	1,887	2,396	227	232
(16) PV	GWH	1,836	2,368	0	0
(17) Solar Together ^{4/}	GWH	0	0	0	0
(18) Solar Thermal	GWH	51	28	0	0
(19) Solar PPAs	GWH	0	0	227	232
(20) Wind PPAs	GWH	0	0	1,031	1,031
(21) Other ^{5/}	GWH	(1,793)	(1,328)	218	1,101
Net Energy For Load ^{6/}	GWH	122,447	125,168	12,057	11,742

1/ Sources: Actuals for FPL and Gulf: A Schedules and Actual Data for Next Generation Solar Centers Report. Forecast for Gulf 2020 and 2021: Projections from Southern Company

2/ Represents interchange between FPL/Gulf and other utilities. For Gulf, this number represents the net energy exchange with Southern Co.

3/ Represents output from FPL's PV and solar thermal facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. At the request of any ST participant, environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced will be retired on the participant's behalf.

5/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales.

6/ Net Energy For Load values for the years 2020 - 2029 are also shown in Col. (19) on Schedule 2.3.

**Schedule 6.2 Actual
Energy Sources % by Fuel Type**

<u>Energy Source</u>	<u>Units</u>	<u>Actual ^{1/}</u>			
		<u>2018</u>	<u>2019</u>	<u>2018</u>	<u>2019</u>
		<u>FPL</u>		<u>Gulf</u>	
(1) Annual Energy Interchange ^{2/}	%	0.0	0.0	(25.7)	(30.3)
(2) Nuclear	%	23.0	22.2	0.0	0.0
(3) Coal	%	2.1	2.0	45.8	35.1
(4) Residual (FO6) -Total	%	0.2	0.2	0.0	0.0
(5) Steam	%	0.2	0.2	0.0	0.0
(6) Distillate (FO2) -Total	%	0.1	0.2	0.0	0.0
(7) Steam	%	0.0	0.0	0.0	0.0
(8) CC	%	0.1	0.2	0.0	0.0
(9) CT	%	0.0	0.0	0.0	0.0
(10) Natural Gas -Total	%	74.5	74.6	67.6	75.0
(11) Steam	%	2.6	2.0	0.2	0.5
(12) CC	%	71.6	72.1	32.6	33.3
(13) CC PPAs - Gas	%	0.0	0.0	34.1	41.2
(14) CT	%	0.4	0.5	0.6	0.0
(15) Solar ^{3/}	%	1.5	1.9	1.9	2.0
(16) PV	%	1.5	1.9	0.0	0.0
(17) Solar Together ^{4/}	%	0.0	0.0	0.0	0.0
(18) Solar Thermal	%	0.0	0.0	0.0	0.0
(19) Solar PPAs	%	0.0	0.0	1.9	2.0
(20) Wind PPAs	%	0.0	0.0	8.6	8.8
(21) Other ^{5/}	%	(1.5)	(1.1)	1.8	9.4
		100	100	100	100

1/ Sources: Actuals for FPL and Gulf: A Schedules and Actual Data for Next Generation Solar Centers Report. Forecast for Gulf 2020 and 2021: Projections from Southern Company

2/ Represents interchange between FPL/Gulf and other utilities. For Gulf, this number represents the net energy exchange with Southern Co.

3/ Represents output from FPL's PV and solar thermal facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. At the request of any ST participant, environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced will be retired on the participant's behalf.

5/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales.

**Schedule 6.1 Forecasted
Energy Sources**

Energy Sources	Units	Forecasted											
		2020	2021	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
		FPL		Gulf ^{1/}		Integrated FPL and Gulf							
(1) Annual Energy Interchange ^{2/}	GWH	0	0	(4,576)	(4,538)	0	0	0	0	0	0	0	0
(2) Nuclear	GWH	28,162	28,395	0	0	28,978	28,319	28,556	29,037	28,598	28,519	29,110	28,590
(3) Coal	GWH	1,404	1,582	2,793	1,906	110	207	127	224	265	279	312	232
(4) Residual(FO6) -Total	GWH	0	9	0	0	0	0	0	0	0	0	0	0
(5) Steam	GWH	0	9	0	0	0	0	0	0	0	0	0	0
(6) Distillate(FO2) -Total	GWH	5	3	0	0	29	3	10	19	4	9	9	5
(7) Steam	GWH	0	0	0	0	0	0	0	0	0	0	0	0
(8) CC	GWH	4	2	0	0	26	2	8	15	1	7	7	4
(9) CT	GWH	1	1	0	0	3	1	2	4	2	2	2	1
(10) Natural Gas -Total	GWH	88,099	85,382	11,876	12,660	94,603	95,049	95,067	93,254	91,945	90,245	88,268	87,157
(11) Steam	GWH	208	148	1,365	2,317	365	738	608	604	536	475	320	177
(12) CC	GWH	87,532	84,891	4,789	4,744	91,268	93,096	94,237	92,314	91,233	89,519	87,696	86,837
(13) CC PPAs - Gas	GWH	0	0	5,655	5,532	2,671	933	0	0	0	0	0	0
(14) CT	GWH	360	343	67	67	300	281	222	337	176	250	251	144
(15) Solar ^{3/}	GWH	4,366	6,679	416	413	8,587	9,483	10,402	12,075	14,805	17,528	20,294	22,947
(16) PV	GWH	3,200	3,423	191	190	4,831	5,738	6,659	8,352	11,093	13,826	16,594	19,268
(17) Solar Together ^{4/}	GWH	1,041	3,130	0	0	3,407	3,397	3,396	3,377	3,367	3,357	3,355	3,336
(18) Solar Thermal	GWH	126	125	0	0	125	125	126	125	125	125	126	125
(19) Solar PPAs	GWH	0	0	224	223	223	222	222	221	220	219	219	218
(20) Wind PPAs	GWH	0	0	1,033	1,031	1,031	1,031	1,033	1,031	1,031	1,031	1,033	1,031
(21) Other ^{5/}	GWH	1,036	1,084	172	171	1,460	1,508	1,565	1,901	1,894	1,864	1,848	1,789
Net Energy For Load ^{6/}	GWH	123,073	123,134	11,715	11,643	134,800	135,600	136,761	137,540	138,541	139,474	140,874	141,751

1/ Sources: Actuals for FPL and Gulf: A Schedules and Actual Data for Next Generation Solar Centers Report. Forecast for Gulf 2020 and 2021: Projections from Southern Company

2/ Represents interchange between FPL/Gulf and other utilities. For Gulf, this number represents the net energy exchange with Southern Co.

3/ Represents output from FPL's PV and solar thermal facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program.

At the request of any ST participant, environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced will be retired on the participant's behalf.

5/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales.

6/ Net Energy For Load values for the years 2020 - 2029 are also shown in Col. (19) on Schedule 2.3.

**Schedule 6.2 Forecasted
Energy Sources % by Fuel Type**

Energy Source	Units	Forecasted											
		2020	2021	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029
		FPL		Gulf ^{1/}		Integrated FPL and Gulf							
(1) Annual Energy Interchange ^{2/}	%	0.0	0.0	(39.1)	(39.0)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(2) Nuclear	%	22.9	23.1	0.0	0.0	21.5	20.9	20.9	21.1	20.6	20.4	20.7	20.2
(3) Coal	%	1.1	1.3	23.8	16.4	0.1	0.2	0.1	0.2	0.2	0.2	0.2	0.2
(4) Residual (FO6) -Total	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(5) Steam	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(6) Distillate (FO2) -Total	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(7) Steam	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(8) CC	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(9) CT	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(10) Natural Gas -Total	%	71.6	69.3	101.7	108.8	70.2	70.1	69.5	67.8	66.4	64.7	62.7	61.5
(11) Steam	%	0.2	0.1	12.0	20.0	0.3	0.5	0.4	0.4	0.4	0.3	0.2	0.1
(12) CC	%	71.1	68.9	40.9	40.7	67.7	68.7	68.9	67.1	65.9	64.2	62.3	61.3
(13) CC PPAs - Gas	%	0.0	0.0	48.3	47.5	2.0	0.7	0.0	0.0	0.0	0.0	0.0	0.0
(14) CT	%	0.3	0.3	0.6	0.6	0.2	0.2	0.2	0.2	0.1	0.2	0.2	0.1
(15) Solar ^{3/}	%	3.5	5.4	3.6	3.5	6.4	7.0	7.6	8.8	10.7	12.6	14.4	16.2
(16) PV	%	2.6	2.8	1.6	1.6	3.6	4.2	4.9	6.1	8.0	9.9	11.8	13.6
(17) Solar Together ^{4/}	%	0.8	2.5	0.0	0.0	2.5	2.5	2.5	2.5	2.4	2.4	2.4	2.4
(18) Solar Thermal	%	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
(19) Solar PPAs	%	0.0	0.0	1.9	1.9	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
(20) Wind PPAs	%	0.0	0.0	8.8	8.9	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.7
(21) Other ^{5/}	%	0.8	0.9	1.5	1.5	1.1	1.1	1.1	1.4	1.4	1.3	1.3	1.3
		100	100	100	100	100	100	100	100	100	100	100	100

1/ Sources: Actuals for FPL and Gulf: A Schedules and Actual Data for Next Generation Solar Centers Report. Forecast for Gulf 2020 and 2021: Projections from Southern Company

2/ Represents interchange between FPL/Gulf and other utilities. For Gulf, this number represents the net energy exchange with Southern Co.

3/ Represents output from FPL's PV and solar thermal facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program.

At the request of any ST participant, environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced will be retired on the participant's behalf.

5/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales.

**Schedule 7.1
Forecast of Capacity, Demand, and Scheduled
Maintenance At Time Of Summer Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
August of Year	Firm Installed Capacity MW	Firm Capacity Import MW	Firm Capacity Export MW	Firm QF MW	Total Firm Capacity Available MW	Total Peak Demand MW	DSM MW	Firm Summer Peak Demand MW	Total Reserve Margin Before Maintenance MW	% of Peak	Scheduled Maintenance MW	Total Reserve Margin After Maintenance MW	% of Peak	Generation Only Reserve Margin After Maintenance MW	% of Peak
FPL															
2020	27,145	110	0	434	27,689	24,624	1,786	22,838	4,851	21.2	0	4,851	21.2	3,065	12.4
2021	27,722	110	0	4	27,836	24,720	1,833	22,887	4,948	21.6	0	4,948	21.6	3,116	12.6
Gulf															
2020	2,389	1,039	0	0	3,429	2,464	6	2,458	970	39.5	0	970	39.5	965	39.1
2021	2,389	1,039	0	0	3,428	2,496	14	2,482	947	38.1	0	947	38.1	932	37.3
Integrated FPL and Gulf															
2022	30,763	1,149	0	4	31,915	27,220	1,903	25,317	6,599	26.1	0	6,599	26.1	4,695	17.2
2023	31,164	264	0	4	31,431	27,564	1,962	25,602	5,829	22.8	0	5,829	22.8	3,867	14.0
2024	31,061	264	0	4	31,328	27,953	2,026	25,927	5,401	20.8	0	5,401	20.8	3,375	12.1
2025	31,386	263	0	4	31,653	28,349	2,071	26,278	5,375	20.5	0	5,375	20.5	3,304	11.7
2026	31,892	263	0	4	32,159	28,775	2,107	26,668	5,490	20.6	0	5,490	20.6	3,384	11.8
2027	32,230	263	0	0	32,493	29,143	2,142	27,001	5,492	20.3	0	5,492	20.3	3,350	11.5
2028	32,639	263	0	0	32,902	29,592	2,177	27,415	5,486	20.0	0	5,486	20.0	3,310	11.2
2029	33,322	262	0	0	33,585	30,195	2,212	27,983	5,602	20.0	0	5,602	20.0	3,390	11.2

Col. (2) represents peak capacity additions and changes projected to be in-service by June 1st of each year. These MW are generally considered to be available to meet Summer peak loads which are forecasted to occur during August of the year indicated.

Col. (6) = Col.(2) + Col.(3) - Col.(4) + Col.(5).

Col.(7) reflects the 2019 peak load forecasts without incremental energy efficiency after 9/2019 or cumulative load management.

Col.(8) represents cumulative load management capability, plus incremental energy efficiency and load management, from 9/2019-on, intended for use with the 2019 load forecasts.

Col.(10) = Col.(6) - Col.(9)

Col.(11) = Col.(10) / Col.(9)

Col.(12) indicates the capacity of units projected to be out-of-service for planned maintenance during the Summer peak period.

Col.(13) = Col.(10) - Col.(12)

Col.(14) = Col.(13) / Col.(9)

Col.(15) = Col.(6) - Col.(7) - Col.(12)

Col.(16) = Col.(15) / Col.(7)

**Schedule 7.2
Forecast of Capacity, Demand, and Scheduled
Maintenance At Time Of Winter Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
January of Year	Firm Installed Capacity	Firm Capacity Import	Firm Capacity Export	Firm QF	Total Firm Capacity Available	Total Peak Demand	DSM	Firm Winter Peak Demand	Total Reserve Margin Before Maintenance	% of Peak	Scheduled Maintenance	Total Reserve Margin After Maintenance	% of Peak	Generation Only Reserve Margin After Maintenance	% of Peak
	MW	MW	MW	MW	MW	MW	MW	MW	MW	% of Peak	MW	MW	% of Peak	MW	% of Peak
FPL															
2020	26,908	110	0	404	27,422	19,959	1,360	18,599	8,822	47.4	0	8,822	47.4	7,463	37.4
2021	26,989	110	0	4	27,103	20,250	1,387	18,863	8,239	43.7	0	8,239	43.7	6,853	33.8
Gulf															
2020	2,345	994	0	0	3,339	2,256	0	2,256	1,083	48.0	0	1,083	48.0	1,083	48.0
2021	2,345	994	0	0	3,339	2,293	6	2,287	1,052	46.0	0	1,052	46.0	1,046	45.6
Integrated FPL and Gulf															
2022	28,479	1,104	0	4	29,587	22,369	1,430	20,939	8,647	41.3	0	8,647	41.3	7,218	32.3
2023	29,766	1,104	0	4	30,874	22,617	1,468	21,149	9,725	46.0	0	9,725	46.0	8,257	36.5
2024	29,559	219	0	4	29,782	22,861	1,508	21,353	8,429	39.5	0	8,429	39.5	6,921	30.3
2025	29,741	219	0	4	29,964	23,103	1,555	21,548	8,415	39.1	0	8,415	39.1	6,861	29.7
2026	29,983	219	0	4	30,206	23,388	1,585	21,803	8,403	38.5	0	8,403	38.5	6,818	29.1
2027	29,908	219	0	0	30,127	23,608	1,616	21,992	8,135	37.0	0	8,135	37.0	6,519	27.6
2028	30,068	219	0	0	30,287	23,941	1,647	22,294	7,993	35.9	0	7,993	35.9	6,346	26.5
2029	30,568	219	0	0	30,787	24,293	1,677	22,616	8,171	36.1	0	8,171	36.1	6,494	26.7

Col. (2) represents firm capacity additions and changes projected to be in-service by January 1st of each year. These MW are generally considered to be available to meet Winter peak loads which are forecasted to occur during January of the year indicated.

Col. (6) = Col.(2) + Col.(3) - Col.(4) + Col.(5).

Col.(7) reflects the 2019 peak load forecasts without incremental energy efficiency after 9/2019 or cumulative load management. The January 2020 load is an actual load value.

Col.(8) represents cumulative load management capability, plus incremental energy efficiency and load management, from 9/2019-on, intended for use with the 2019 load forecasts.

Col.(10) = Col.(6) - Col.(9)

Col.(11) = Col.(10) / Col.(9)

Col.(12) indicates the capacity of units projected to be out-of-service for planned maintenance during the Winter peak period.

Col.(13) = Col.(10) - Col.(12)

Col.(14) = Col.(13) / Col.(9)

Col.(15) = Col.(6) - Col.(7) - Col.(12)

Col.(16) = Col.(15) / Col.(7)

**Schedule 8
Planned And Prospective Generating Facility Additions And Changes ⁽¹⁾: FPL**

Plant Name	Unit No.	Location	Unit Type	Fuel				Const. Start Mo./Yr.	Comm. In-Service Mo./Yr.	Expected Retirement Mo./Yr.	Gen. Max. Nameplate KW	Firm Net Capacity ⁽²⁾		Status
				Pri.	Alt.	Pri.	Alt.					Winter MW	Summer MW	
ADDITIONS/ CHANGES														
FPL Changes														
2020														
Northern Preserve Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Baker County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Twin Lakes Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Putnam County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Cattle Ranch Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Desoto County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Sweetbay Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Martin County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Babcock Preserve Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Charlotte County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Blue Heron Solar ⁽³⁾ (Solar facility in-service January of 2020)	1	Hendry County	PV Solar Solar	N/A	N/A	-	1st Q 2020	Unknown	74,500	-	41	P		
Hibiscus Solar ⁽³⁾	1	Palm Beach County	PV Solar Solar	N/A	N/A	-	2nd Q 2020	Unknown	74,500	-	41	P		
Southfork Solar ⁽³⁾	1	Manatee County	PV Solar Solar	N/A	N/A	-	2nd Q 2020	Unknown	74,500	-	41	P		
Echo River Solar ⁽³⁾	1	Suwannee County	PV Solar Solar	N/A	N/A	-	2nd Q 2020	Unknown	74,500	-	41	P		
Okeechobee Solar ⁽³⁾	1	Okeechobee Manatee County	PV Solar Solar	N/A	N/A	-	2nd Q 2020	Unknown	74,500	-	41	P		
Sanford	4	Volusia County	CC NG	No	PL	No	2nd Q 2020	Unknown	1,265,732	-	147	OP		
2020 Changes/Additions Total:											0	560		
2021														
Sanford	4	Volusia County	CC NG	No	PL	No	2nd Q 2020	Unknown	1,265,732	41	-	OP		
West County	3	Palm Beach County	CC NG	FO2	PL	TK	3rd Q 2020	Unknown	1,366,800	20	21	OP		
Turkey Point	4	Miami Dade County	ST Nuc	No	TK	No	4th Q 2020	Unknown	877,200	20	20	OP		
Lakeside Solar ⁽³⁾	1	Okeechobee County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Trailside Solar ⁽³⁾	1	St. Johns County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Union Springs Solar ⁽³⁾	1	Union County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Magnolia Springs Solar ⁽³⁾	1	Clay County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Egret Solar ⁽³⁾	1	Baker County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Nassau Solar ⁽³⁾	1	Nassau County	PV Solar Solar	N/A	N/A	-	4th Q 2020	Unknown	74,500	-	39	P		
Pelican Solar ⁽³⁾	1	St. Lucie County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Palm Bay Solar ⁽³⁾	1	Brevard County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Discovery Solar ⁽³⁾	1	Brevard County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Orange Blossom Solar ⁽³⁾	1	Indian River County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Sabal Palm Solar ⁽³⁾	1	Palm Beach County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Fort Drum Solar ⁽³⁾	1	Okeechobee County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Rodeo Solar ⁽³⁾	1	DeSoto County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Willow Solar ⁽³⁾	1	Manatee County	PV Solar Solar	N/A	N/A	-	1st Q 2021	Unknown	74,500	-	39	P		
Solar Degradation ⁽⁴⁾	NA	NA	N/A	N/A	N/A	N/A	-	N/A	N/A	-	(3)	OT		
2021 Changes/Additions Total:											81	577		
Integrated FPL and Gulf: FPL Changes														
2022														
Manatee Retirement	1	Manatee County	ST NG	FO6	PL	WA	Oct-76	4th Q 2021	863,300	(819)	(809)	P		
Manatee Retirement	2	Manatee County	ST NG	FO6	PL	WA	Dec-77	4th Q 2021	863,300	(819)	(809)	P		
Scherer Retirement	4	Monroe, GA	ST SUB	No	RR	No	Jul-89	4th Q 2021	680,368	(635)	(634)	P		
Manatee Energy Storage	1	Manatee County	BS	N/A	N/A	N/A	-	4th Q 2021	Unknown	409	409	P		
Sunshine Gateway Energy Storage	1	Columbia County	BS	N/A	N/A	N/A	-	4th Q 2021	Unknown	30	30	P		
Echo River Energy Storage	1	Suwannee County	BS	N/A	N/A	N/A	-	4th Q 2021	Unknown	30	30	P		
Fort Myers Upgrade	2	Lee County	CC NG	No	PL	No	2nd Q 2022	Unknown	1,836,798	-	40	OP		
Dania Beach Clean Energy Center	7	Broward County	CC NG	FO2	PL	WA	2nd Q 2022	Unknown	-	-	1,163	P		
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	-	(5)	OT		
2022 Changes/Additions Total:											(1,804)	(585)		

(1) Schedule 8 shows only planned and prospective changes to FPL and Gulf generating facilities and does not reflect changes to purchases. Changes to purchases are reflected on Tables ES-1, IA.3.1, IA.3.2, IB.3.1 and IB.3.2.
 (2) The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by August. All MW additions/changes occurring after August each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total due to rounding.
 (3) Solar MW values reflect firm capacity only values, not nameplate ratings.
 (4) An annual 0.3% degradation for PV output is assumed for both FPL and Gulf Solar. Total degradation shown is for both FPL and Gulf.

**Schedule 8
Planned And Prospective Generating Facility Additions And Changes ⁽¹⁾: FPL**

Plant Name	Unit No.	Location	Unit Type	Fuel				Const. Start Mo./Yr.	Comm. In-Service Mo./Yr.	Expected Retirement Mo./Yr.	Gen. Max. Nameplate KW	Firm Net Capacity ⁽²⁾		Status
				Pri.	Alt.	Pri.	Alt.					Winter MW	Summer MW	
ADDITIONS/ CHANGES														
Integrated FPL and Gulf Continued: FPL Changes														
2023														
Dania Beach Clean Energy Center	7	Broward County	CC	NG	FO2	PL	WA	-	2nd Q 2022	Unknown	-	1,176	-	P
Martin Upgrade	8	Martin County	CC	NG	FO2	PL	TK	-	4th Q 2022	Unknown	-	28	40	OP
Manatee Upgrade	3	Manatee County	CC	NG	No	PL	No	-	2nd Q 2023	Unknown	1,301,382	28	79	OP
Fort Myers Upgrade	2	Lee County	CC	NG	No	PL	No	-	3rd Q 2023	Unknown	1,836,798	55	79	OP
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(6)	OT
2023 Changes/Additions Total:												1,287	192	
2024														
Martin Upgrade	8	Martin County	CC	NG	FO2	PL	TK	-	4th Q 2022	Unknown	-	28	-	OP
Manatee Upgrade	3	Manatee County	CC	NG	No	PL	No	-	2nd Q 2023	Unknown	1,301,382	83	-	OP
Fort Myers Upgrade	2	Lee County	CC	NG	No	PL	No	-	3rd Q 2023	Unknown	1,836,798	110	-	OP
Turkey Point Upgrade	5	Miami Dade County	CC	NG	FO2	PL	TK	-	1st Q 2024	Unknown	1,301,382	-	79	OP
Okeechobee Energy Center	1	Okeechobee County	CC	NG	FO2	PL	TK	Jun-17	1st Q 2024	Unknown	1,886,150	-	58	OP
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(6)	OT
2024 Changes/Additions Total:												221	131	
2025														
Turkey Point Upgrade	5	Miami Dade County	CC	NG	FO2	PL	TK	-	1st Q 2024	Unknown	1,301,382	110	-	OP
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2025	Unknown	-	-	264	P
Sanford Upgrade	4	Volusia County	CC	NG	No	PL	No	-	2nd Q 2025	Unknown	1,265,732	34	78	OP
Sanford Upgrade	5	Volusia County	CC	NG	No	PL	No	-	2nd Q 2025	Unknown	1,265,732	34	78	OP
Okeechobee Energy Center	1	Okeechobee County	CC	NG	FO2	PL	TK	Jun-17	Apr-19	Unknown	1,886,150	79	-	OP
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(7)	OT
2025 Changes/Additions Total:												257	413	
2026														
Martin Upgrade	8	Martin County	CC	NG	FO2	PL	TK	-	4th Q 2025	Unknown	-	55	40	OP
Sanford Upgrade	4	Volusia County	CC	NG	No	PL	No	-	4th Q 2025	Unknown	1,265,732	101	26	OP
Sanford Upgrade	5	Volusia County	CC	NG	No	PL	No	-	4th Q 2025	Unknown	1,265,732	101	26	OP
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	-	-	422	P
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(8)	OT
2026 Changes/Additions Total:												257	506	
2027														
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1 st Q 2027	Unknown	-	-	422	P
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(9)	OT
2027 Changes/Additions Total:												0	413	
2028														
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1 st Q 2028	Unknown	-	-	252	P
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(11)	OT
2028 Changes/Additions Total:												0	241	
2029														
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1 st Q 2029	Unknown	-	-	194	P
Solar Degradation ⁽⁴⁾	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(11)	OT
2029 Changes/Additions Total:												0	183	

(1) Schedule 8 shows only planned and prospective changes to generating facilities and does not reflect changes to existing purchases. Those changes are reflected on Tables ES-1, IA.3.1, IA.3.2, IB.3.1 and IB.3.2.
 (2) The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by June. All MW additions/changes occurring after August each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total due to rounding.
 (3) Solar values reflect firm capacity only values, not nameplate ratings.
 (4) An annual 0.3% degradation for PV output is assumed for both FPL and Gulf Solar. Total degradation shown is for both FPL and Gulf.

**Schedule 8
Planned And Prospective Generating Facility Additions And Changes ⁽¹⁾: Gulf**

Plant Name	Unit No.	Location	Unit Type	Fuel				Const. Start Mo./Yr.	Comm. In-Service Mo./Yr.	Expected Retirement Mo./Yr.	Gen. Max. Nameplate KW	Firm Net Capacity ⁽²⁾		Status
				Pri.	Alt.	Transport						Winter MW	Summer MW	
						Pri.	Alt.							
ADDITIONS/ CHANGES														
Gulf Changes														
2020														
Blue Indigo Solar ⁽³⁾ (Solar facility in-service April 1st of 2020)	1	Jackson County	PV	Solar	Solar	N/A	N/A	-	Apr-20	Unknown	74,500	-	41	P
2020 Changes/Additions Total:												0	41	
2021														
2021 Changes/Additions Total:												0	0	
Integrated FPL and Gulf: Gulf Changes														
2022														
4X0 Crist CTs	8	Escambia County	CT	NG	FO2	PL	N/A	-	4th Q 2021	Unknown		949	938	P
Blue Springs Solar ^{3/}	1	Jackson County	PV	Solar	Solar	N/A	N/A	-	4th Q 2021	Unknown		-	37	P
Chautauqua Solar ^{3/}	1	Walton County	PV	Solar	Solar	N/A	N/A	-	4th Q 2021	Unknown		-	37	P
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2022	Unknown		-	224	P
2022 Changes/Additions Total:												949	1,237	
2023														
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1 st Q 2023	Unknown	-	-	209	P
2023 Changes/Additions Total:												0	209	
2024														
Lansing Smith Upgrade	3	Bay County	CC	NG	No	PL	No	-	Nov-23	Unknown	656,100	74	59	OP
Daniel Retirement	1	Jackson County, MS	FS	C	No	RR	No	-	Sep-77	1st Q 2024	274,125	(251)	(251)	P
Daniel Retirement	2	Jackson County, MS	FS	C	No	RR	No	-	Jun-81	1st Q 2024	274,125	(251)	(251)	P
Solar PV ⁽³⁾		Unknown	PV	Solar	Solar	N/A	N/A	-	1 st Q 2024	Unknown	-	-	209	P
2024 Changes/Additions Total:												(428)	(234)	
2025														
Crist Retirement	4	Escambia County	FS	C	NG	WA	PL	-	Jul-59	4th Q 2024	93,750	(75)	(75)	P
Pea Ridge Retirement	1	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	4,750	-	(4)	P
Pea Ridge Retirement	2	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	4,750	-	(4)	P
Pea Ridge Retirement	3	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	4,750	-	(4)	P
2025 Changes/Additions Total:												(75)	(87)	
2026														
Pea Ridge Retirement	1	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	Apr-25	4,750	(5)	-	P
Pea Ridge Retirement	2	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	Apr-25	4,750	(5)	-	P
Pea Ridge Retirement	3	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	Apr-25	4,750	(5)	-	P
2026 Changes/Additions Total:												(15)	0	
2027														
Crist Retirement	5	Escambia County	FS	C	NG	WA	PL	-	Jul-59	4th Q 2026	93,750	(75)	(75)	P
2027 Changes/Additions Total:												(75)	(75)	
2028														
Lansing Smith Retirement	A	Bay County	CT	LO	No	TK	No		May-71	4th Q 2027	41,850	(40)	(32)	OP
Energy Storage		Unknown	BS	N/A	N/A	N/A	N/A		1st Q 2028	Unknown		200	200	P
2028 Changes/Additions Total:												160	168	
2029														
Energy Storage		Unknown	BS	N/A	N/A	N/A	N/A		1st Q 2029	Unknown		500	500	P
2029 Changes/Additions Total:												500	500	

- (1) Schedule 8 shows only planned and prospective changes to FPL and Gulf generating facilities and does not reflect changes to purchases. Changes to purchases are reflected on Tables ES-1, IA.3.1, IA.3.2, IB.3.1 and IB.3.2.
- (2) The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by August. All MW additions/changes occurring after August each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total are due to rounding.
- (3) Solar MW values reflect firm capacity only values, not nameplate ratings and 0.3% degradation is assumed annually for PV output. Degradation for Gulf is captured on FPL's schedule 8.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Hibiscus Solar Energy Center (Palm Beach County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 41 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | | |
|-----------------------------------|------|--|
| a. Field construction start-date: | 2019 | |
| b. Commercial In-service date: | 2020 | |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 402 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.2% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,373 |
| Direct Construction Cost (2020 \$/kW): | 1,341 |
| AFUDC Amount (2020 \$/kW): | 32 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 6.27 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 0.98 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9

Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Okeechobee Solar Energy Center (Okeechobee County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 41 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 471 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 27.1% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F,100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F,100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,339 |
| Direct Construction Cost (2020 \$/kW): | 1,298 |
| AFUDC Amount (2020 \$/kW): | 41 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 6.41 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.04 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Southfork Solar Energy Center (Manatee County)
- (2) **Capacity**
 - a. Nameplate (AC) 74.5 MW
 - b. Summer Firm (AC)^{1/} 41 MW (Approximately)
 - c. Winter Firm (AC) -
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2019
 - b. Commercial In-service date: 2020
- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 548 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): 31.1% (First Full Year Operation)
 - Average Net Operating Heat Rate (ANOHR): Not applicable Btu/kWh
 - Base Operation 75F,100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable Btu/kWh
 - Peak Operation 75F,100%
- (13) **Projected Unit Financial Data ***
 - Book Life (Years): 30 years
 - Total Installed Cost (2020 \$/kW): 1,407
 - Direct Construction Cost (2020 \$/kW): 1,339
 - AFUDC Amount (2020 \$/kW): 68
 - Escalation (\$/kW): Accounted for in Direct Construction Cost
 - Fixed O&M (\$/kW-Yr.): (2020 \$) 6.70 (First Full Year Operation)
 - Variable O&M (\$/MWH): (2020 \$) 0.00
 - K Factor: 1.03

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Echo River Solar Energy Center (Suwannee County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 41 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 802 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 30.4% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|---------------------------------------|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,394 |
| Direct Construction Cost (2020\$/kW): | 1,330 |
| AFUDC Amount (2020 \$/kW): | 63 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 7.06 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.03 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9

Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Lakeside Solar Energy Center (Okeechobee County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 693 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,205 |
| Direct Construction Cost (2020 \$/kW): | 1,169 |
| AFUDC Amount (2020 \$/kW): | 36 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 6.57 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.06 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Trailside Solar Energy Center (St. Johns County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 846 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F,100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F,100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,245 |
| Direct Construction Cost (2020 \$/kW): | 1,207 |
| AFUDC Amount (2020 \$/kW): | 38 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 7.10 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.09 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Union Springs Solar Energy Center (Union County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 725 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.5% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,242 |
| Direct Construction Cost (2020 \$/kW): | 1,205 |
| AFUDC Amount (2020 \$/kW): | 38 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 7.10 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.09 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Magnolia Springs Solar Energy Center (Clay County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 850 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.5% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,197 |
| Direct Construction Cost (2020 \$/kW): | 1,160 |
| AFUDC Amount (2020 \$/kW): | 36 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 6.92 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.07 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Egret Solar Energy Center (Baker County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2019 |
| b. Commercial In-service date: | 2020 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 676 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.4% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F,100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F,100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2020 \$/kW): | 1,151 |
| Direct Construction Cost (2020 \$/kW): | 1,114 |
| AFUDC Amount (2020 \$/kW): | 37 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2020 \$) | 6.92 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2020 \$) | 0.00 |
| K Factor: | 1.08 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Nassau Solar Energy Center (Nassau County)
- (2) **Capacity**
 - a. Nameplate (AC) 74.5 MW
 - b. Summer Firm (AC)^{1/} 39 MW (Approximately)
 - c. Winter Firm (AC) -
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2019
 - b. Commercial In-service date: 2020
- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 928 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): 26.2% (First Full Year Operation)
 - Average Net Operating Heat Rate (ANOHR): Not applicable
 - Base Operation 75F, 100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable
 - Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data ***
 - Book Life (Years): 30 years
 - Total Installed Cost (2020 \$/kW): 1,300
 - Direct Construction Cost (2020 \$/kW): 1,261
 - AFUDC Amount (2020 \$/kW): 38
 - Escalation (\$/kW): Accounted for in Direct Construction Cost
 - Fixed O&M (\$/kW-Yr.): (2020 \$) 7.10 (First Full Year Operation)
 - Variable O&M (\$/MWH): (2020 \$) 0.00
 - K Factor: 1.07

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Pelican Solar Energy Center (St. Lucie County)

- (2) **Capacity**
 - a. Nameplate (AC) 74.5 MW
 - b. Summer Firm (AC)^{1/} 39 MW (Approximately)
 - c. Winter Firm (AC) -

- (3) **Technology Type:** Photovoltaic (PV)

- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2020
 - b. Commercial In-service date: 2021

- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable

- (6) **Air Pollution and Control Strategy:** Not applicable

- (7) **Cooling Method:** Not applicable

- (8) **Total Site Area:** 565 Acres

- (9) **Construction Status:** P (Planned Unit)

- (10) **Certification Status:** ---

- (11) **Status with Federal Agencies:** ---

- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): 26.7% (First Full Year Operation)
 - Average Net Operating Heat Rate (ANOHR): Not applicable Btu/kWh
 - Base Operation 75F, 100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable Btu/kWh
 - Peak Operation 75F, 100%

- (13) **Projected Unit Financial Data ***
 - Book Life (Years): 30 years
 - Total Installed Cost (2021 \$/kW): 1,265
 - Direct Construction Cost (2021 \$/kW): 1,227
 - AFUDC Amount (2021 \$/kW): 38
 - Escalation (\$/kW): Accounted for in Direct Construction Cost
 - Fixed O&M (\$/kW-Yr.): (2021 \$) 6.57 (First Full Year Operation)
 - Variable O&M (\$/MWH): (2021 \$) 0.00
 - K Factor: 1.06

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Palm Bay Solar Energy Center (Brevard County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 486 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,229 |
| Direct Construction Cost (2021 \$/kW): | 1,191 |
| AFUDC Amount (2021 \$/kW): | 38 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.74 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2021 \$) | 0.00 |
| K Factor: | 1.09 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Discovery Solar Energy Center (Brevard County)
- (2) **Capacity**
- | | | |
|-----------------------------------|-----------------------|--|
| a. Nameplate (AC) | 74.5 MW | |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) | |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | | |
|-----------------------------------|------|--|
| a. Field construction start-date: | 2020 | |
| b. Commercial In-service date: | 2021 | |
- (5) **Fuel**
- | | | |
|-------------------|----------------|--|
| a. Primary Fuel | Solar | |
| b. Alternate Fuel | Not applicable | |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 491 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | | |
|--|-----------------------------------|--|
| Planned Outage Factor (POF): | Not applicable | |
| Forced Outage Factor (FOF): | Not applicable | |
| Equivalent Availability Factor (EAF): | Not applicable | |
| Resulting Capacity Factor (%): | 24.3% (First Full Year Operation) | |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh | |
| Base Operation 75F, 100% | | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh | |
| Peak Operation 75F, 100% | | |
- (13) **Projected Unit Financial Data ***
- | | | |
|--|---|--|
| Book Life (Years): | 30 years | |
| Total Installed Cost (2021 \$/kW): | 1,087 | |
| Direct Construction Cost (2021 \$/kW): | 1,052 | |
| AFUDC Amount (2021 \$/kW): | 35 | |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost | |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.57 (First Full Year Operation) | |
| Variable O&M (\$/MWH): (2021 \$) | 0.00 | |
| K Factor: | 1.07 | |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Orange Blossom Solar Energy Center (Indian River County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 607 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.7% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,217 |
| Direct Construction Cost (2021 \$/kW): | 1,179 |
| AFUDC Amount (2021 \$/kW): | 38 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.74 (First Full Year Operation) |
| Variable O&M (\$/MWh): (2021 \$) | 0.00 |
| K Factor: | 1.09 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9

Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Sabal Palm Solar Energy Center (Palm Beach County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 646 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,345 |
| Direct Construction Cost (2021 \$/kW): | 1,306 |
| AFUDC Amount (2021 \$/kW): | 40 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.74 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2021 \$) | 0.00 |
| K Factor: | 1.07 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Fort Drum Solar Energy Center (Okeechobee County)
- (2) **Capacity**
- | | |
|-----------------------------------|-----------------------|
| a. Nameplate (AC) | 74.5 MW |
| b. Summer Firm (AC) ^{1/} | 39 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 930 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 23.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,137 |
| Direct Construction Cost (2021 \$/kW): | 1,102 |
| AFUDC Amount (2021 \$/kW): | 35 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.74 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2021 \$) | 0.00 |
| K Factor: | 1.09 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Rodeo Solar Energy Center (DeSoto County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 1,193 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 27.6% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,113 |
| Direct Construction Cost (2021 \$/kW): | 1,076 |
| AFUDC Amount (2021 \$/kW): | 36 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 6.92 (First Full Year Operation) |
| Variable O&M (\$/MWH): (2021 \$) | 0.00 |
| K Factor: | 1.11 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Willow Solar Energy Center (Manatee County)
- (2) **Capacity**
- | | | |
|-----------------------------------|------|--------------------|
| a. Nameplate (AC) | 74.5 | MW |
| b. Summer Firm (AC) ^{1/} | 39 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**^{2/}
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 812 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|-----------------------------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | 26.8% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR): | Not applicable Btu/kWh |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable Btu/kWh |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data ***
- | | |
|--|---|
| Book Life (Years): | 30 years |
| Total Installed Cost (2021 \$/kW): | 1,186 |
| Direct Construction Cost (2021 \$/kW): | 1,149 |
| AFUDC Amount (2021 \$/kW): | 37 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): (2021 \$) | 7.10 (First Full Year Operation) |
| Variable O&M (\$/MWh): (2021 \$) | 0.00 |
| K Factor: | 1.10 |

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9
Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Blue Springs Solar Energy Center (Jackson County)
- (2) **Capacity**
 - a. Nameplate (AC) 74.5 MW
 - b. Summer Firm (AC)^{1/} 37 MW (Approximately)
 - c. Winter Firm (AC) -
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2020
 - b. Commercial In-service date: 2021
- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 444 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): 26.4% (First Full Year Operation)
 - Average Net Operating Heat Rate (ANOHR): Not applicable Btu/kWh
 - Base Operation 75F,100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable Btu/kWh
 - Peak Operation 75F,100%
- (13) **Projected Unit Financial Data ***
 - Book Life (Years): 30 years
 - Total Installed Cost (2021 \$/kW): 1,071
 - Direct Construction Cost (2021 \$/kW): 1,039
 - AFUDC Amount (2021 \$/kW): 32
 - Escalation (\$/kW): Accounted for in Direct Construction Cost
 - Fixed O&M (\$/kW-Yr.): (2021 \$) 7.65 (First Full Year Operation)
 - Variable O&M (\$/MWH): (2021 \$) 0.00
 - K Factor: 0.91

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Chautauqua Solar Energy Center (Walton County)
- (2) **Capacity**
 - a. Nameplate (AC) 74.5 MW
 - b. Summer Firm (AC)^{1/} 37 MW (Approximately)
 - c. Winter Firm (AC) -
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2020
 - b. Commercial In-service date: 2021
- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 688 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): 26.4% (First Full Year Operation)
 - Average Net Operating Heat Rate (ANOHR): Not applicable Btu/kWh
 - Base Operation 75F,100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable Btu/kWh
 - Peak Operation 75F,100%
- (13) **Projected Unit Financial Data ***
 - Book Life (Years): 30 years
 - Total Installed Cost (2021 \$/kW): 1,071
 - Direct Construction Cost (2021 \$/kW): 1,039
 - AFUDC Amount (2021 \$/kW): 32
 - Escalation (\$/kW): Accounted for in Direct Construction Cost
 - Fixed O&M (\$/kW-Yr.): (2021 \$) 7.65 (First Full Year Operation)
 - Variable O&M (\$/MWH): (2021 \$) 0.00
 - K Factor: 0.91

* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Crist Unit 8 4x0 Combustion Turbine
- (2) **Capacity**
- | | |
|-----------|--------|
| a. Summer | 938 MW |
| b. Winter | 949 MW |
- (3) **Technology Type:** Combined Cycle
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|-----------------------------|
| a. Primary Fuel | Natural Gas |
| b. Alternate Fuel | Ultra-low sulfur distillate |
- (6) **Air Pollution and Control Strategy:** Dry Low NOx Burners, SCR, Natural Gas, 0.0015% S. Distillate and Water Injection
- (7) **Cooling Method:** Fin Fan / Evap Coolers
- (8) **Total Site Area:** Existing Site
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|---|
| Planned Outage Factor (POF): | 3.0% |
| Forced Outage Factor (FOF): | 1% |
| Equivalent Availability Factor (EAF): | 96.0% |
| Resulting Capacity Factor (%): | Approx. 3% (First Full Year Base Operation) |
| Average Net Operating Heat Rate (ANOHR): | 9,944 |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | 8,869 |
| Peak Firing and Wet Compression 75F, 100% | |
- (13) **Projected Unit Financial Data *,****
- | | |
|--|---|
| Book Life (Years): | 40 years |
| Total Installed Cost (2021 \$/kW): | 479 |
| Direct Construction Cost (2021 \$/kW): | 455 |
| AFUDC Amount (2021 \$/kW): | 23 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr. (2021 \$)) | 8.00 |
| Variable O&M (\$/MW (2021 \$)) | 0.02 |
| K Factor: | 1.13 |

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement

Note: Total installed cost includes transmission interconnection and integration, escalation, and AFUDC.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Manatee Energy Storage Center
- (2) **Capacity**
a. Summer 409 MW
b. Winter 409 MW
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
a. Field construction start-date: 2020
b. Commercial In-service date: 2021
- (5) **Fuel**
a. Primary Fuel Not applicable
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Existing Site 40 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
Planned Outage Factor (POF): Not applicable
Forced Outage Factor (FOF): Not applicable
Equivalent Availability Factor (EAF): Not applicable
Resulting Capacity Factor (%): Not applicable
Average Net Operating Heat Rate (ANOHR): Not applicable
Base Operation 75F,100%
Average Net Incremental Heat Rate (ANIHR): Not applicable
Peak Operation 75F,100%
- (13) **Projected Unit Financial Data *,****
Book Life (Years): 10 years
Total Installed Cost (2021 \$/kW): TBD
Direct Construction Cost (2021 \$/kW): TBD
AFUDC Amount (2021 \$/kW): TBD
Escalation (\$/kW): TBD
Fixed O&M (\$/kW-Yr.): (2021 \$) TBD
Long Term Capital Replenishment (\$/kW) (2021 \$) TBD
Variable O&M (\$/MWH): (2021 \$) TBD
K Factor: TBD

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement and annual capital replenishment

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Sunshine Gateway Energy Storage Center
- (2) **Capacity**
- | | | |
|-----------|----|----|
| a. Summer | 30 | MW |
| b. Winter | 30 | MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2021 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Existing Site 30 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | Not applicable |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F,100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F,100% | |
- (13) **Projected Unit Financial Data *,****
- | | | |
|---|-----------|-------|
| Book Life (Years): | 10 | years |
| Total Installed Cost (2021 \$/kW): | TBD | |
| Direct Construction Cost (2021 \$/kW): | TBD | |
| AFUDC Amount (2021 \$/kW): | TBD | |
| Escalation (\$/kW): | TBD | |
| Fixed O&M (\$/kW-Yr.): | (2021 \$) | TBD |
| Long Term Capital Replenishment (\$/kW) (2021 \$) | | TBD |
| Variable O&M (\$/MWH): | (2021 \$) | TBD |
| K Factor: | | TBD |

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement and annual capital replenishment

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Echo River Energy Storage Center
- (2) **Capacity**
- | | | |
|-----------|-------|--|
| a. Summer | 30 MW | |
| b. Winter | 30 MW | |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- | | | |
|-----------------------------------|------|--|
| a. Field construction start-date: | 2020 | |
| b. Commercial In-service date: | 2021 | |
- (5) **Fuel**
- | | | |
|-------------------|--|----------------|
| a. Primary Fuel | | Not applicable |
| b. Alternate Fuel | | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Existing Site 5 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | | |
|--|--|----------------|
| Planned Outage Factor (POF): | | Not applicable |
| Forced Outage Factor (FOF): | | Not applicable |
| Equivalent Availability Factor (EAF): | | Not applicable |
| Resulting Capacity Factor (%): | | Not applicable |
| Average Net Operating Heat Rate (ANOHR): | | Not applicable |
| Base Operation 75F, 100% | | |
| Average Net Incremental Heat Rate (ANIHR): | | Not applicable |
| Peak Operation 75F, 100% | | |
- (13) **Projected Unit Financial Data *,****
- | | | |
|---|-----------|----------|
| Book Life (Years): | | 10 years |
| Total Installed Cost (2021 \$/kW): | | TBD |
| Direct Construction Cost (2021 \$/kW): | | TBD |
| AFUDC Amount (2021 \$/kW): | | TBD |
| Escalation (\$/kW): | | TBD |
| Fixed O&M (\$/kW-Yr.): | (2021 \$) | TBD |
| Long Term Capital Replenishment (\$/kW) | (2021 \$) | TBD |
| Variable O&M (\$/MWH): | (2021 \$) | TBD |
| K Factor: | | TBD |
- * \$/kW values are based on Summer capacity.
- ** Levelized value for Fixed O&M also includes Capital Replacement and annual capital replenishment

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Dania Beach Clean Energy Center Unit 7
- (2) **Capacity**
- | | | |
|-----------|-------|----|
| a. Summer | 1,163 | MW |
| b. Winter | 1,176 | MW |
- (3) **Technology Type:** Combined Cycle
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2020 |
| b. Commercial In-service date: | 2022 |
- (5) **Fuel**
- | | |
|-------------------|-----------------------------|
| a. Primary Fuel | Natural Gas |
| b. Alternate Fuel | Ultra-low sulfur distillate |
- (6) **Air Pollution and Control Strategy:** Dry Low NOx Burners, SCR, Natural Gas, 0.0015% S. Distillate and Water Injection
- (7) **Cooling Method:** Once through cooling water
- (8) **Total Site Area:** Existing Site 392 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|--|
| Planned Outage Factor (POF): | 3.5% |
| Forced Outage Factor (FOF): | 1% |
| Equivalent Availability Factor (EAF): | 95.5% |
| Resulting Capacity Factor (%): | 90.0% (First Full Year Base Operation) |
| Average Net Operating Heat Rate (ANOHR): | 6,119 Btu/kWh on Gas |
| Base Operation 75F,100% | |
| Average Net Incremental Heat Rate (ANIHR): | 7,592 Btu/kWh on Gas |
| Peak Firing and Wet Compression 75F,100% | |
- (13) **Projected Unit Financial Data *,****
- | | |
|--|---|
| Book Life (Years): | 40 years |
| Total Installed Cost (2022 \$/kW): | 764 |
| Direct Construction Cost (2022 \$/kW): | 675 |
| AFUDC Amount (2022 \$/kW): | 89 |
| Escalation (\$/kW): | Accounted for in Direct Construction Cost |
| Fixed O&M (\$/kW-Yr.): | (2022 \$) 19.73 |
| Variable O&M (\$/MWH): | (2022 \$) 0.23 |
| K Factor: | 1.55 |

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement

Note: Total installed cost includes transmission interconnection and integration, escalation, and AFUDC.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | |
|-----------------------------------|------------------------------------|
| a. Nameplate (AC) | 447 MW (in six 74.5 MW increments) |
| b. Summer Firm (AC) ^{1/} | 224 MW (Approximately) |
| c. Winter Firm (AC) | - |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**^{2/}
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2021 |
| b. Commercial In-service date: | 2022 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | TBD |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data**
- | | |
|--|----------|
| Book Life (Years): | 30 years |
| Total Installed Cost (2022 \$/kW): | TBD |
| Direct Construction Cost (2022 \$/kW): | TBD |
| AFUDC Amount (2022 \$/kW): | TBD |
| Escalation (\$/kW): | TBD |
| Fixed O&M (\$/kW-Yr.): (2022 \$) | TBD |
| Variable O&M (\$/MWH): (2022 \$) | TBD |
| K Factor: | TBD |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | | |
|-----------------------------------|-----|--------------------------------|
| a. Nameplate (AC) | 447 | MW (in six 74.5 MW increments) |
| b. Summer Firm (AC) ^{1/} | 209 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2022 |
| b. Commercial In-service date: | 2023 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | TBD |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data**
- | | | |
|--|-----|----------|
| Book Life (Years): | | 30 years |
| Total Installed Cost (2023 \$/kW): | TBD | |
| Direct Construction Cost (2023 \$/kW): | TBD | |
| AFUDC Amount (2023 \$/kW): | TBD | |
| Escalation (\$/kW): | TBD | |
| Fixed O&M (\$/kW-Yr.): (2023 \$) | TBD | |
| Variable O&M (\$/MWH) (2023 \$) | TBD | |
| K Factor: | TBD | |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
 - a. Nameplate (AC) 447 MW (in six 74.5 MW increments)
 - b. Summer Firm (AC)^{1/} 209 MW (Approximately)
 - c. Winter Firm (AC) -
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2023
 - b. Commercial In-service date: 2024
- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): TBD
 - Average Net Operating Heat Rate (ANOHR): Not applicable
 - Base Operation 75F, 100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable
 - Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data**
 - Book Life (Years): 30 years
 - Total Installed Cost (2024 \$/kW): TBD
 - Direct Construction Cost (2024 \$/kW): TBD
 - AFUDC Amount (2024 \$/kW): TBD
 - Escalation (\$/kW): TBD
 - Fixed O&M (\$/kW-Yr.): (2024 \$) TBD
 - Variable O&M (\$/MWH): (2024 \$) TBD
 - K Factor: TBD

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV

- (2) **Capacity**
 - a. Nameplate (AC) 745 MW (in ten 74.5 MW increments)
 - b. Summer Firm (AC)^{1/} 264 MW (Approximately)
 - c. Winter Firm (AC) -

- (3) **Technology Type:** Photovoltaic (PV)

- (4) **Anticipated Construction Timing**
 - a. Field construction start-date: 2024
 - b. Commercial In-service date: 2025

- (5) **Fuel**
 - a. Primary Fuel Solar
 - b. Alternate Fuel Not applicable

- (6) **Air Pollution and Control Strategy:** Not applicable

- (7) **Cooling Method:** Not applicable

- (8) **Total Site Area:** Not applicable

- (9) **Construction Status:** P (Planned Unit)

- (10) **Certification Status:** ---

- (11) **Status with Federal Agencies:** ---

- (12) **Projected Unit Performance Data:**
 - Planned Outage Factor (POF): Not applicable
 - Forced Outage Factor (FOF): Not applicable
 - Equivalent Availability Factor (EAF): Not applicable
 - Resulting Capacity Factor (%): TBD
 - Average Net Operating Heat Rate (ANOHR): Not applicable
 - Base Operation 75F, 100%
 - Average Net Incremental Heat Rate (ANIHR): Not applicable
 - Peak Operation 75F, 100%

- (13) **Projected Unit Financial Data**
 - Book Life (Years): 30 years
 - Total Installed Cost (2025 \$/kW): TBD
 - Direct Construction Cost (2025 \$/kW): TBD
 - AFUDC Amount (2025 \$/kW): TBD
 - Escalation (\$/kW): TBD
 - Fixed O&M (\$/kW-Yr.): (2025 \$) TBD
 - Variable O&M (\$/MWH): (2025 \$) TBD
 - K Factor: TBD

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | | |
|-----------------------------------|-------|------------------------------------|
| a. Nameplate (AC) | 1,192 | MW (in sixteen 74.5 MW increments) |
| b. Summer Firm (AC) ^{1/} | 422 | MW (Approximately) |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2025 |
| b. Commercial In-service date: | 2026 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | TBD |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data**
- | | | |
|--|--|----------|
| Book Life (Years): | | 30 years |
| Total Installed Cost (2026 \$/kW): | | TBD |
| Direct Construction Cost (2026 \$/kW): | | TBD |
| AFUDC Amount (2026 \$/kW): | | TBD |
| Escalation (\$/kW): | | TBD |
| Fixed O&M (\$/kW-Yr.): (2026 \$) | | TBD |
| Variable O&M (\$/MWH): (2026 \$) | | TBD |
| K Factor: | | TBD |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | | |
|-----------------------------------|--|--|
| a. Nameplate (AC) | 1,192 MW (in sixteen 74.5 MW increments) | |
| b. Summer Firm (AC) ^{1/} | 422 MW (Approximately) | |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | | |
|-----------------------------------|------|--|
| a. Field construction start-date: | 2026 | |
| b. Commercial In-service date: | 2027 | |
- (5) **Fuel**
- | | | |
|-------------------|----------------|--|
| a. Primary Fuel | Solar | |
| b. Alternate Fuel | Not applicable | |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | | |
|--|----------------|--|
| Planned Outage Factor (POF): | Not applicable | |
| Forced Outage Factor (FOF): | Not applicable | |
| Equivalent Availability Factor (EAF): | Not applicable | |
| Resulting Capacity Factor (%): | TBD | |
| Average Net Operating Heat Rate (ANOHR): | Not applicable | |
| Base Operation 75F, 100% | | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable | |
| Peak Operation 75F, 100% | | |
- (13) **Projected Unit Financial Data**
- | | | |
|--|-----|----------|
| Book Life (Years): | | 30 years |
| Total Installed Cost (2027 \$/kW): | TBD | |
| Direct Construction Cost (2027 \$/kW): | TBD | |
| AFUDC Amount (2027 \$/kW): | TBD | |
| Escalation (\$/kW): | TBD | |
| Fixed O&M (\$/kW-Yr.): (2027 \$) | TBD | |
| Variable O&M (\$/MWH) (2027 \$) | TBD | |
| K Factor: | TBD | |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | | |
|-----------------------------------|--|--|
| a. Nameplate (AC) | 1,192 MW (in sixteen 74.5 MW increments) | |
| b. Summer Firm (AC) ^{1/} | 251 MW (Approximately) | |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2027 |
| b. Commercial In-service date: | 2028 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | TBD |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data**
- | | |
|--|----------|
| Book Life (Years): | 30 years |
| Total Installed Cost (2028 \$/kW): | TBD |
| Direct Construction Cost (2028 \$/kW): | TBD |
| AFUDC Amount (2028 \$/kW): | TBD |
| Escalation (\$/kW): | TBD |
| Fixed O&M (\$/kW-Yr.): (2028 \$) | TBD |
| Variable O&M (\$/MWH): (2028 \$) | TBD |
| K Factor: | TBD |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited Energy Storage
- (2) **Capacity**
- | | | |
|-----------|-----|----|
| a. Summer | 200 | MW |
| b. Winter | 200 | MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2027 |
| b. Commercial In-service date: | 2028 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | Not applicable |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data *,****
- | | | |
|---|-----------|----------|
| Book Life (Years): | | 10 years |
| Total Installed Cost (2028 \$/kW): | | TBD |
| Direct Construction Cost (2028 \$/kW): | | TBD |
| AFUDC Amount (2028 \$/kW): | | TBD |
| Escalation (\$/kW): | | TBD |
| Fixed O&M (\$/kW-Yr.): | (2028 \$) | TBD |
| Long Term Capital Replenishment (\$/kW) (2028 \$) | | TBD |
| Variable O&M (\$/MWH): | (2028 \$) | TBD |
| K Factor: | | TBD |

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement and annual capital replenishment

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited PV
- (2) **Capacity**
- | | | |
|-----------------------------------|--|--|
| a. Nameplate (AC) | 1,192 MW (in sixteen 74.5 MW increments) | |
| b. Summer Firm (AC) ^{1/} | 194 MW (Approximately) | |
| c. Winter Firm (AC) | - | |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2028 |
| b. Commercial In-service date: | 2029 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Solar |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | TBD |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data**
- | | |
|--|----------|
| Book Life (Years): | 30 years |
| Total Installed Cost (2029 \$/kW): | TBD |
| Direct Construction Cost (2029 \$/kW): | TBD |
| AFUDC Amount (2029 \$/kW): | TBD |
| Escalation (\$/kW): | TBD |
| Fixed O&M (\$/kW-Yr.): (2029 \$) | TBD |
| Variable O&M (\$/MWH): (2029 \$) | TBD |
| K Factor: | TBD |

^{1/} The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased. FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

Schedule 9
Status Report and Specifications of Proposed Generating Facilities

- (1) **Plant Name and Unit Number:** Unsited Energy Storage
- (2) **Capacity**
- | | | |
|-----------|-----|----|
| a. Summer | 500 | MW |
| b. Winter | 500 | MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- | | |
|-----------------------------------|------|
| a. Field construction start-date: | 2028 |
| b. Commercial In-service date: | 2029 |
- (5) **Fuel**
- | | |
|-------------------|----------------|
| a. Primary Fuel | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** Not applicable
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** ---
- (11) **Status with Federal Agencies:** ---
- (12) **Projected Unit Performance Data:**
- | | |
|--|----------------|
| Planned Outage Factor (POF): | Not applicable |
| Forced Outage Factor (FOF): | Not applicable |
| Equivalent Availability Factor (EAF): | Not applicable |
| Resulting Capacity Factor (%): | Not applicable |
| Average Net Operating Heat Rate (ANOHR): | Not applicable |
| Base Operation 75F, 100% | |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100% | |
- (13) **Projected Unit Financial Data *,****
- | | | |
|---|-----------|-------|
| Book Life (Years): | 10 | years |
| Total Installed Cost (2029 \$/kW): | TBD | |
| Direct Construction Cost (2029 \$/kW): | TBD | |
| AFUDC Amount (2029 \$/kW): | TBD | |
| Escalation (\$/kW): | TBD | |
| Fixed O&M (\$/kW-Yr.): | (2029 \$) | TBD |
| Long Term Capital Replenishment (\$/kW) | (2029 \$) | TBD |
| Variable O&M (\$/MWH): | (2029 \$) | TBD |
| K Factor: | TBD | |

* \$/kW values are based on Summer capacity.

** Levelized value for Fixed O&M also includes Capital Replacement and annual capital replenishment

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Hibiscus Solar Energy Center (Palm Beach County)

The Hibiscus Solar Energy Center will require bifurcating the FPL Ranch-Corbett 230 kV line approximately 1-mile west of FPL's Westlake substation to loop into the new Minto Substation.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Westlake-Corbett 230 kV line section to Minto Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 0.07 miles |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2019
End date: 2020 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Minto Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Okeechobee Solar Energy Center (Okeechobee County)

The Okeechobee Solar Energy Center will connect to the new Okeechobee Next Generation Clean Energy Center project and does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Southfork Solar Energy Center (Manatee County)

The Southfork Solar Energy Center will require bifurcating the existing FPL Manatee-Keentown 230 kV transmission line looping the new Duette substation.

(1) Point of Origin and Termination:	Manatee-Keentown 230 kV line to Duette Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.15 mile
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2019 End date: 2020
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Duette Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Echo River Solar Energy Center (Suwannee County)

The Echo River Solar Energy Center will require bifurcating the existing Suwannee (Duke Energy Florida, DEF) – Columbia (FPL) 115 kV tie line between FPL's Wellborn-Live Oak section, looping the new Hogan Substation.

(1) Point of Origin and Termination:	Wellborn-Live Oak 115 kV line section to Hogan Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.05 miles
(5) Voltage:	115 kV
(6) Anticipated Construction Timing:	Start date: 2019 End date: 2020
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Hogan Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Lakeside Solar Energy Center (Okeechobee County)

The Lakeside Solar Energy Center will require bifurcating the existing FPL Martin-Sherman 230 kV transmission line and looping the new Nubbin Substation adjacent to the existing line.

- | | |
|--|---|
| (1) Point of Origin and Termination: | Martin-Sherman 230 kV line to Nubbin Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 300 feet |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2019
End date: 2020 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Nubbin Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Trailside Solar Energy Center (St. Johns County)

The Trailside Solar Energy Center will require bifurcating the existing FPL Putnam-St. Johns 115 kV transmission line between the Elkton-St. Johns section and extending two parallel sections approximately 1 mile to loop the new Moccasin Substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Elkton-St. Johns 115 kV line to Moccasin Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	1 mile (double-circuit)
(5) Voltage:	115 kV
(6) Anticipated Construction Timing:	Start date: 2019 End date: 2020
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Moccasin Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Union Springs Solar Energy Center (Union County)

The Union Springs Solar Energy Center will require bifurcating the existing FPL Raven-Bradford 115 kV transmission line between the Bradford-Lake Butler section and extending two parallel sections approximately 0.1 mile to loop the new Plum Substation.

- | | |
|--|---|
| (1) Point of Origin and Termination: | Bradford-Lake Butler 115 kV line section to Plum Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 0.1 mile |
| (5) Voltage: | 115 kV |
| (6) Anticipated Construction Timing: | Start date: 2019
End date: 2020 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Plum Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Magnolia Springs Solar Energy Center (Clay County)

The Magnolia Springs Solar Energy Center will require bifurcating the existing Seminole Plant-Springbank 230 kV transmission line between the Titanium-Green Cove Springs section and extending two parallel sections approximately 0.1 mile to loop a new Leno substation.

(1) Point of Origin and Termination:	Titanium-Green Cove Springs 230 kV line section to Leno substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.1 mile
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2019 End date: 2020
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Leno Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Egret Solar Energy Center (Baker County)

The Egret Solar Energy Center will require bifurcating the existing FPL Duval-Raven 230 kV transmission line and extending two parallel sections approximately 2 miles to loop the new Claude Substation and connect the solar PV inverter array.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Duval-Raven 230 kV line to Claude Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 2 miles (double-circuit) |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2019
End date: 2020 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Claude Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Nassau Solar Energy Center (Nassau County)

The Nassau Solar Energy Center will require bifurcating the existing FPL Duval-Yulee 230 kV transmission line between the Duval-West Nassau (GTC) section and extending two parallel sections approximately 1 mile to loop the new Crawford Substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Duval-West Nassau (GTC) 230 kV line to Crawford Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	1 mile (double-circuit)
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2019 End date: 2020
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Crawford Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Pelican Solar Energy Center (St. Lucie County)

The Pelican Solar Energy Center will require extending a 230 kV transmission line from Eldora Substation to the new Morrow Substation to connect the solar PV inverter array.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Eldora 230 kV Substation to Morrow Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 1.25 miles |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2020
End date: 2021 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Morrow Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Palm Bay Solar Energy Center (Brevard County)

The Palm Bay Solar Energy Center will require bifurcating the existing FPL Midway-Malabar 230 kV transmission line between the Glendale-Hield section and extending two parallel sections approximately 2.5 miles to loop the new Hayward Substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Glendale-Hield 230 kV line to Hayward Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	2.5 miles (double-circuit)
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2020 End date: 2021
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Hayward Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Discovery Solar Energy Center (Brevard County)

The Discovery Solar Energy Center will require bifurcating the existing FPL C5-Barna 115 kV transmission line and looping the new Rocket Substation and connect the solar PV inverter array.

- | | |
|--|--|
| (1) Point of Origin and Termination: | C5-Barna kV line to Rocket Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 300 feet |
| (5) Voltage: | 115 kV |
| (6) Anticipated Construction Timing: | Start date: 2020
End date: 2021 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Rocket Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Orange Blossom Solar Energy Center (Indian River County)

The Orange Blossom Solar Energy Center will connect to the existing FPL Eldora-Heritage 230 kV transmission line via a line switch to connect the new Finca Substation and the solar PV inverter array.

(1) Point of Origin and Termination:	None
(2) Number of Lines:	0
(3) Right-of-way	N/A
(4) Line Length:	0
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2020 End date: 2021
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Finca Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Sabal Palm Solar Energy Center (Palm Beach County)

The Sabal Palm Solar Energy Center will require extending a transmission line from the Minto Substation approximately 1.5 miles to connect the new Costa Substation and connect the solar PV inverter array.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Minto Substation to Costa Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 1.5 miles |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2020
End date: 2021 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Costa Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Fort Drum Solar Energy Center (Okeechobee County)

The Fort Drum Solar Energy Center will connect to the new Okeechobee Next Generation Clean Energy Center project and does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Rodeo Solar Energy Center (DeSoto County)

The Rodeo Solar Energy Center will connect to the Gleam substation at the new Cattle Ranch Solar Energy Center and does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Willow Solar Energy Center (Manatee County)

The Willow Solar Energy Center will require bifurcating the existing FPL Keentown-Sunshine 230 kV transmission line to connect a new Coachwhip substation and the solar PV inverter array.

- | | |
|--|---|
| (1) Point of Origin and Termination: | Keentown-Sunshine 230 kV line to new Coachwhip Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 0 |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2020
End date: Late 2020 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Coachwhip Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Battery Storage in Manatee County

The 409 MW Battery Storage project in Manatee County does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Sunshine Gateway Battery Energy Storage addition in Columbia County

The Sunshine Gateway Battery Energy Storage addition project in Columbia County does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Echo River Battery Energy Storage addition in Suwannee County

The Echo River Battery Energy Storage addition project in Suwannee County does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Dania Beach Clean Energy Center Unit 7

Dania Beach Clean Energy Center Unit 7 does not require any new transmission lines.

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Blue Springs Solar Energy Center (Jackson County)

The Blue Springs Solar Energy Center will require bifurcating the existing Gulf Cypress-Chipola section of the Gulf Marianna-West Grandridge 115 kV transmission line to connect a new Americus substation and the solar PV inverter array.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Gulf Marianna-West Grandridge 115 kV line to new Americus Substation |
| (2) Number of Lines: | 1 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | 2 miles |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2021
End date: 2022 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Americus Substation |
| (9) Participation with Other Utilities: | None |

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Chautauqua Solar Energy Center (Walton County)

The Chautauqua Solar Energy Center will require bifurcating the existing Gulf Shoal River-Samson 230 kV transmission to connect a new Liddie substation and the solar PV inverter array.

(1) Point of Origin and Termination:	Gulf Shoal River-Samson 230 kV line to new Liddie Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	TBD
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2021 End date: 2022
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Liddie Substation
(9) Participation with Other Utilities:	None

Schedule 10
Status Report and Specifications of Proposed Transmission Lines

Crist Unit 8 Combustion Turbine Project (Escambia County)

The Crist Unit 8 Combustion Turbine Project will require bifurcating the existing Crist-Alligator Swamp #2-230kV and Crist-Bellview 230kV lines near Crist to connect into a new Conecuh substation switchyard, and relocating the existing line terminal at Crist for the Crist-Barry 230 kV line to Conecuh substation.

- | | |
|--|--|
| (1) Point of Origin and Termination: | Crist substation to new Conecuh substation |
| (2) Number of Lines: | 3 |
| (3) Right-of-way | FPL – Owned |
| (4) Line Length: | Approximately 0.25 miles |
| (5) Voltage: | 230 kV |
| (6) Anticipated Construction Timing: | Start date: 2021
End date: 2022 |
| (7) Anticipated Capital Investment:
(Trans. and Sub.) | Included in total installed cost on Schedule 9 |
| (8) Substations: | Conecuh Substation |
| (9) Participation with Other Utilities: | None |

Schedule 11.1: FPL

**Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type
Actuals for the Year 2019**

	(1) Generation by Primary Fuel	(3) Net (MW) Capability				(6) NEL GWh ⁽²⁾	(7) Fuel Mix %
		(2) Summer (MW)	(3) Summer (%)	(4) Winter (MW)	(5) Winter (%)		
(1)	Coal	634	2.3%	635	2.2%	2,488	2.0%
(2)	Nuclear	3,479	12.6%	3,570	12.5%	27,791	22.2%
(3)	Residual	0	0.0%	0	0.0%	224	0.2%
(4)	Distillate	108	0.4%	123	0.4%	224	0.2%
(5)	Natural Gas	21,731	78.9%	22,580	79.2%	93,373	74.6%
(6)	Solar (Firm & Non-Firm)	1,153	4.2%	1,153	4.0%	2,396	1.9%
(7)	FPL Existing Units Total ⁽¹⁾ :	27,105	98.4%	28,061	98.4%	126,496	101.1%
(8)	Renewables (Purchases)- Firm	114.0	0.4%	114.0	0.4%	892	0.7%
(9)	Renewables (Purchases)- Non-Firm	Not Applicable	---	Not Applicable	---	209	0.2%
(10)	Renewable Total:	114.0	0.4%	114.0	0.4%	1,101	0.88%
(11)	Purchases Other / (Sales) :	330.0	1.2%	330.0	1.2%	(2,429)	-1.9%
(12)	Total :	27,548.8	100.0%	28,504.6	100.0%	125,168	100.0%

Note:

- (1) FPL Existing Units Total values on row (7), columns (2) and (4), match the Total System Generating Capacity values found on Schedule 1 for Summer and Winter.
- (2) Net Energy for Load GWh values on row (12), column (6), matches Schedule 6.1 value for 2019.

Schedule 11.1: Gulf

**Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type
Actuals for the Year 2019**

	(1) Generation by Primary Fuel	(2) (3) (4) (5) Net (MW) Capability				(6) NEL GWh ⁽²⁾	(7) Fuel Mix %
		Summer (MW)	Summer (%)	Winter (MW)	Winter (%)		
(1)	Coal	1,641	67.6%	1,641	66.9%	4,125	35.1%
(2)	Nuclear	0	0.0%	0	0.0%	0	0.0%
(3)	Residual	0	0.0%	0	0.0%	0	0.0%
(4)	Distillate	32	1.3%	40	1.6%	0	0.0%
(5)	Natural Gas	672	27.7%	661	26.9%	3,975	33.9%
(6)	Landfill Gas	3	0.1%	3	0.1%	0	0.0%
(7)	Solar (Firm & Non-Firm)	0	0.0%	0	0.0%	0	0.0%
(8)	Gulf Existing Units Total ⁽¹⁾ :	2,348	96.7%	2,345	95.6%	8,101	69.0%
(9)	Renewables (Purchases)- Firm	81.0	3.3%	109.0	4.5%	1,031	8.8%
(10)	Renewables (Purchases)- Non-Firm	Not Applicable	---	Not Applicable	---	373	3.2%
(11)	Renewable Total:	81.0	3.3%	109.0	4.5%	1,404	11.95%
(12)	Purchases Other / (Sales) :	0.0	0.0%	0.0	0.0%	2,237	19.1%
(13)	Total :	2,429.0	100.0%	2,454.0	100.0%	11,742	100.0%

Note:

- (1) Gulf Existing Units Total values on row (7), columns (2) and (4), match the Total System Generating Capacity values found on Schedule 1 for Summer and Winter.
- (2) Net Energy for Load GWh values on row (12), column (6), matches Schedule 6.1 value for 2019.

Schedule 11.2: FPL

**Existing Non-Firm Self-Service Renewable Generation Facilities
Actuals for the Year 2019 ^{1/}**

(1)	(2)	(3)	(4)	(5)	(6) = (3)+(4)-(5)
Type of Facility	Installed Capacity DC (MW)	Renewable Projected Annual Output (MWh) 2/	Annual Energy Purchased from FPL (MWh) 3/	Annual Energy Sold to FPL - Total (MWh) 4/	Projected Annual Energy Used by Customers 6/
Customer-Owned Renewable Generation (0 kW to 10 kW)	111.06	158,164	416,346	49,639	524,871
Customer-Owned Renewable Generation (> 10 kW to 100 kW)	42.70	60,374	293,892	14,885	339,381
Customer-Owned Renewable Generation (> 100 kW - 2 MW)	28.59	82,547	294,557	7,560	369,544
Totals	182.35	301,085	1,004,795	72,084	1,233,797

1/ There were approximately 16,971 customers with renewable generation facilities interconnected with FPL on December 31, 2019.

2/ The Projected Annual Output value is based on NREL's PV Watts 1 program and uses the Installed Capacity value in column (2), adjusted for the date when each facility was installed and assuming each facility operated as planned.

3/ The Annual Energy Purchased from FPL is an actual value from FPL's metered data for 2019.

4/ The Annual Energy Sold to FPL - Total is an actual value from FPL's metered data for 2019. These are the total MWh that were "overproduced" by the customer each month throughout 2019.

5/ The Projected Annual Energy Used by Customers is a projected value that equals:

(Renewable Projected Annual output + Annual Energy Purchased) minus the Annual Energy Sold to FPL - Total).

Schedule 11.2: Gulf

**Existing Non-Firm Self-Service Renewable Generation Facilities
Actuals for the Year 2019 ^{1/}**

(1)	(2)	(3)	(4)	(5)	(6) = (3)+(4)-(5)
Type of Facility	Installed Capacity DC (MW)	Renewable Projected Annual Output (MWh) ^{2/}	Annual Energy Purchased from FPL (MWh) ^{3/}	Annual Energy Sold to FPL - Total (MWh) ^{4/}	Projected Annual Energy Used by Customers ^{5/}
(All) Totals	18.85	27,676	19,339	6,821	40,195

1) Total count of renewable generation facilities as of 12/31/2019 = 2,229

2) Projected Annual Output value is based on NREL's PV Watts calculation assuming average annual kWh's per year at 1,468 for a (1) kW system

3) The Annual Energy Purchased from Gulf is an actual value from Gulf Power's metered data for 2019

4) The annual energy sold to Gulf Power - Total is an actual value from Gulf Power's metered data for 2019. These are the total MWh that were "overproduced" by the customer each month throughout 2019

5) The Projected Annual Energy Used by Customers is a projected value that equals:

(Renewable Projected Annual output + Annual Energy Purchased) minus the Annual Energy Sold to Gulf Power - Total)

(This page is intentionally left blank.)

CHAPTER IV

Environmental and Land Use Information

(This page is intentionally left blank.)

IV. Environmental and Land Use Information

IV.A. Protection of the Environment

Clean, affordable energy is the lifeblood of Florida's growing population, expanding economy, and environmental resource restoration and management. Through its commitment to environmental excellence, FPL and Gulf are helping to solve Florida's energy challenges sustainably and responsibly. With one of the cleanest, most efficient power-generation fleets in the nation, FPL has reduced its use of oil, including foreign oil, by approximately 98 percent – from approximately 40 million barrels annually in 2001 to 0.4 million barrels in 2019. FPL also has one of the lowest emissions profiles among U.S. utilities, and its carbon dioxide (CO₂) emission rate in 2019 was approximately 30% lower (cleaner) than the industry national average. Gulf has reduced its sulfur dioxide emissions by 99%, its nitrogen oxide (NO_x) emissions by 81%, and its carbon dioxide emissions by 40%, from 2001 to 2018. FPL and Gulf together are also the largest producers of solar energy-generated electricity in Florida. At the end of 2019, FPL had approximately 1,228 MW of solar generation capability on its system which consists of approximately 1,153 MW of universal solar PV and 75 MW of solar thermal. Also at the end of 2019, Gulf has renewable energy purchase agreements for approximately 120 MW of universal solar PV generation and 81 MW of wind which is provided through multiple power purchase agreements (PPAs).

This 2020 Site Plan for FPL and Gulf presents a resource plan which shows a significant amount of additional solar. The merged system is projected to have approximately 10,000 MW of solar by the end of the 10-year reporting period (2029) for this Site Plan.

FPL and Gulf maintain their commitment to environmental stewardship through proactive collaboration with communities and organizations working to preserve Florida's unique habitat and natural resources. The many projects and programs in which FPL and Gulf actively participate include the creation and management of the Manatee Lagoon – An FPL Eco-Discovery Center, Everglades Mitigation Bank, Crocodile Management Program, and Longleaf pine restoration.

FPL, Gulf, and their parent company, NextEra Energy, Inc., have continuously been recognized as leaders among electric utilities for their commitment to the environment – a commitment that is ingrained in the corporate culture.

In 2020, Fortune ranked NextEra Energy, Inc. as No. 1 in the electric and gas utilities industry in their "2020 World's Most Admired Companies". The annual list recognizes companies that

have had a positive social impact through activities that are part of their core business strategy. NextEra Energy was also named one of the “2020 World’s Most Ethical Companies” by Ethisphere Institute which recognizes companies’ critical roles in influencing and driving positive change in both the business community and societies around the world. NextEra Energy is one of only six companies worldwide in the energy and utilities sector to receive Ethisphere Institute’s prestigious recognition in 2020.

NextEra Energy’s Juno Beach, Florida, campus, which includes FPL’s headquarters, has achieved the prestigious Leadership in Energy and Environmental Design (LEED) Gold certification for existing buildings and two Gulf facilities are also LEED certified. LEED is the U.S. Green Building Council’s leading rating system for designating the world’s greenest, most energy-efficient, and high-performing buildings. Key achievements that led to the certification include heating, ventilation and air conditioning improvements, lighting upgrades, water management and recycling programs, and changes to specifications for paper, carpet, and other materials.

FPL and Gulf are committed to environmentally sustainable water use. Nearly 98% of the water FPL uses is returned to its original source. Similarly, nearly 90% of the water Gulf uses is returned to its original source. Pursuing alternate water sources, such as the use of 13.9 million gallons per day of treated wastewater for cooling the FPL West County Energy Center and 1.8 million gallons per day at Gulf’s Plant Crist, reduces the need to access ground or surface water resources.

IV.B Environmental Organization Contributions

In 2019, FPL supported a broad base of environmental organizations with donations, event sponsorships, and memberships. Those organizations include, but were not limited to: Everglades Foundation, The Nature Conservancy, Loggerhead Marinelifelife Center, Inc., Florida Wildflower Foundation, Florida State Parks Foundation, Florida Native Plant Society, Florida Wildlife Federation, Inwater Research Group, Defenders of Wildlife and Audubon state & local chapters. FPL employees serve in board and leadership positions for many organizations that focus on environmental restoration, preservation, and stewardship. A partial list of these organizations includes: Florida Fish and Wildlife Conservation Commission, The Nature Conservancy in Florida, Grassy Waters Conservancy, Loggerhead Marinelifelife Center, Everglades Foundation and Audubon Florida.

Gulf supports environmental organizations through financial contributions and volunteer hours. Every year Gulf employees invest an average of 1,200 volunteer hours supporting conservation partners in maintaining, restoring and protecting waters, wetlands, forests, beaches, parks,

historic sites, and wildlife. In 2019, the Gulf Power Foundation Amplify! awarded a \$40,000 grant to the Florida Wildlife Federation to assist large landowners near Panama City, Florida clean up and remove trees destroyed and damaged by Hurricane Michael in 2018 and restore their lands with longleaf pine trees. Other environmental organizations receiving financial contributions or volunteer hours in 2019 include, but are not limited to: The Nature Conservancy, E.O. Wilson Biophilia Center, FWC Scallop Restoration, Gulf Islands National Seashore, Eglin Air Force Base – Gopher Tortoise, Choctawhatchee Basin Alliance, Audubon Florida, and Walton County Dune Lake Restoration.

IV.C Environmental Communication and Facilitation

FPL is involved in many efforts to enhance environmental protection through the facilitation of energy efficiency, environmental awareness, and through public education. Some of FPL’s 2019 environmental outreach activities are summarized in Table IV.E.1.

Table IV.C.1: 2019 FPL Environmental Outreach Activities

Activity	Count (#)
Visitors to Manatee Lagoon - An FPL Eco-Discovery Center	162,422
Number of website visits to Manatee Lagoon website, visitmanateelagoon.com	565,642
Visitors to Manatee Park, Ft. Myers	271,386
Number of website visits to FPL’s Environmental & Corporate Sustainability Websites	>57,000
Visitors to FPL Living Lab, Martin Energy Center Solar & DeSoto Solar Tours	861
Environmental Brochures Distributed	~40,839
Home Energy Surveys	Field Visits: 19,587 Phone: 20,168 Online: 77,958 Total: 117,713

IV.D Environmental Policy

FPL, Gulf, and their parent company, NextEra Energy, Inc., are committed to remaining an industry leader in environmental protection and stewardship, not only because it makes business sense, but because it is the right thing to do. This commitment to compliance, conservation, communication, and continuous improvement fosters a culture of environmental excellence and drives the sustainable management of its business planning, operations, and daily work.

In accordance with commitments to environmental protection and stewardship, FPL, Gulf, and NextEra Energy, Inc. endeavor to:

Comply:

- Comply with all applicable environmental laws, regulations, and permits
- Proactively identify environmental risks and take action to mitigate those risks
- Pursue opportunities to exceed environmental standards
- Participate in the legislative and regulatory process to develop environmental laws, regulations, and policies that are technically sound and economically feasible
- Design, construct, operate, and maintain facilities in an environmentally sound and responsible manner

Conserve:

- Prevent pollution, minimize waste, and conserve natural resources
- Avoid, minimize, and/or mitigate impacts to habitat and wildlife
- Promote the efficient use of energy, both within our company and in our communities
- Seek innovative solutions

Communicate:

- Invest in environmental training and awareness to achieve a corporate culture of environmental excellence
- Maintain an open dialogue with stakeholders on environmental matters and performance
- Communicate this policy to all employees and publish it on the corporate website

Continuously Improve:

- Establish, monitor, and report progress toward environmental targets
- Review and update this policy on a regular basis
- Drive continuous improvement through ongoing evaluations of our environmental management system to incorporate lessons learned and best practices

FPL and Gulf's parent company, NextEra Energy, Inc., updated this policy in 2020 to reflect changing expectations and ensure that employees are doing the utmost to protect the environment. FPL and Gulf comply with all environmental laws, regulations, and permit requirements, and they design, construct, and operate their facilities in an environmentally sound and responsible manner. FPL and Gulf also respond immediately and effectively to any known environmental hazards or non-compliance situations. The commitment to the

environment does not end there. FPL and Gulf proactively pursue opportunities to perform better than current environmental standards require, including reducing waste and emission of pollutants, recycling materials, and conserving natural resources throughout their operations and day-to-day work activities. FPL and Gulf encourage cost-effective, efficient uses of energy, both within the Company and by their customers. These actions are just a few examples of how FPL and Gulf are committed to the environment.

To ensure FPL and Gulf are adhering to their environmental commitment, they have developed rigorous environmental governance procedures and programs. These include its Environmental Assurance Program. Through this program, FPL and Gulf conduct periodic environmental self-evaluations to verify that its operations comply with environmental laws, regulations, and permit requirements. Regular evaluations also help identify best practices and opportunities for improvement.

IV.E Environmental Management

In order to successfully implement the Environmental Policy, FPL and Gulf have developed a robust Environmental Management System to direct and control the fulfillment of the organization's environmental responsibilities. A key component of the system is an Environmental Assurance Program, which is described in section IV.F below. Other system components include: executive management support and commitment, dedicated environmental corporate governance program, written environmental policies and procedures, delineation of organizational responsibilities and individual accountabilities, allocation of appropriate resources for environmental compliance management (which includes reporting and corrective action when non-compliance occurs), environmental incident and/or emergency response, environmental risk assessment/management, environmental regulatory development and tracking, and environmental management information systems.

IV.F Environmental Assurance Program

FPL and Gulf's Environmental Assurance Program consists of activities that are designed to evaluate environmental performance, verify compliance with corporate policy as well as legal and regulatory requirements, and communicate results to corporate management. The principal mechanism for pursuing environmental assurance is an environmental audit. An environmental audit is defined as a management tool comprised of a systematic, documented, periodic, and objective evaluation of the performance of the organization and its specific management systems and equipment designed to protect the environment. An environmental audit's primary objective is to facilitate management control of environmental practices and assess compliance

with existing environmental regulatory requirements and corporate policies. In addition to FPL and Gulf facility audits, through the Environmental Assurance Program, audits of third-party vendors used for recycling and/or disposal of waste generated by FPL and Gulf operations are performed. Vendor audits provide information used for selecting candidate or incumbent vendors for disposal and recycling needs.

In addition to periodic environmental audits, NextEra Energy Inc.'s Environmental Construction Compliance Assurance Program provides routine onsite inspections during construction and site-specific environmental training to everyone anticipated to be onsite during construction. Similar to an environmental audit, these inspections are performed to ensure compliance with the requirements of environmental permits, licenses, and corporate policies during the construction phase.

FPL and Gulf have also implemented a Corporate Environmental Governance System in which quarterly reviews are performed of each business unit deemed to have potential for significant environmental exposure. Quarterly reviews evaluate operations for potential environmental risks and consistency with the Environmental Policy. Items tracked during the quarterly reviews include processes for the identification and management of environmental risks, metrics, and indicators and progress / changes since the most recent review.

IV.G Preferred and Potential Sites

Based upon projection of future resource needs and analyses of viable resource options, 26 Preferred Sites and 13 Potential Sites have been identified for adding future generation. Some of these sites currently have existing generation. Preferred Sites are those locations where significant reviews have taken place and action has either been taken, action is committed, or it is likely that action will be taken to site new generation. Potential Sites are those with attributes that would support the siting of generation and are under consideration as a location for future generation. The identification of a Potential Site does not necessarily indicate that a definitive decision to pursue new generation (or generation expansion or modernization in the case of an existing generation site) at that location has been made, nor does this designation necessarily indicate the that size or technology of a generating resource has been determined. The Preferred Sites and Potential Sites are discussed in separate sections below.

IV.G.1 Preferred Sites

For the 2020 Ten Year Site Plan, 26 Preferred Sites have been identified. These include a combination of existing and new sites in both the FPL and Gulf areas for the development of

solar generation facilities, natural gas-fueled combined cycle and combustion turbine units, battery storage, and/or nuclear generation. Sites for a number of solar additions in 2020 and 2021 have been selected, and these sites are described in this section. Potential sites for possible 2022-on solar additions, plus other types of generation, are discussed in the Potential Site section later in this chapter.

These 26 Preferred Sites are listed in Table IV.G.1 below, and information regarding each site is then presented on the following pages. The sites are presented in general chronological order of when resources are projected to be added to the FPL and Gulf areas. The topographical features of each site, land use, and facility layout figures are provided at the end of this chapter.

Table IV.G.1: List of FPL & Gulf Preferred Sites

Site Name	County	Technology
FPL Area		
Hibiscus Solar Energy Center	Palm Beach	Solar
Okeechobee Solar Energy Center	Okeechobee	Solar
Southfork Solar Energy Center	Manatee	Solar
Echo River Solar Energy Center	Suwannee	Solar
Lakeside Solar Energy Center	Okeechobee	Solar
Trailside Solar Energy Center	St. Johns	Solar
Union Springs Solar Energy Center	Union	Solar
Magnolia Springs Solar Energy Center	Clay	Solar
Egret Solar Energy Center	Baker	Solar
Nassau Solar Energy Center	Nassau	Solar
Pelican Solar Energy Center	St. Lucie	Solar
Palm Bay Solar Energy Center	Brevard	Solar
Discovery Solar Energy Center	Brevard	Solar
Orange Blossom Solar Energy Center	Indian River	Solar
Sabal Palm Solar Energy Center	Palm Beach	Solar
Fort Drum Solar Energy Center	Okeechobee	Solar
Rodeo Solar Energy Center	DeSoto	Solar
Willow Solar Energy Center	Manatee	Solar
Manatee Energy Storage Center	Manatee	Battery
Sunshine Gateway Energy Storage Center	Columbia	Battery
Echo River Energy Storage Center	Suwannee	Battery
Dania Beach Clean Energy Center Unit 7	Broward	CC
Turkey Point Units 6&7	Miami-Dade	Nuclear
Gulf Area		
Blue Springs Solar Energy Center	Jackson	Solar
Chautauqua Solar Energy Center	Walton	Solar
Crist Unit 8	Escambia	CT

Preferred Site #1 Hibiscus Solar Energy Center, Palm Beach County

	Facility Acreage	402
	COD	Q2 2020
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Abandoned citrus and pastureland
	Adjacent Areas	Residential, abandoned citrus, and pastureland
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site has minimal trees and is mostly comprised of herbaceous grasses. An existing network of irrigation canals is present.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Solar power generation is allowed within existing Agricultural land use designation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: August 22, 2018 Florida Environmental Resources Permit (ERP) received: February 13, 2018

Preferred Site #2 Okeechobee Solar Energy Center, Okeechobee County

	Facility Acreage	471
	COD	Q2 2020
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pastureland and fallow crop land
	Adjacent Areas	Pastureland, conservation, and existing electrical transmission
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is comprised of pastureland, fallow citrus, pine Flatwoods, mixed forested wetlands, saw palmetto prairie, and freshwater marsh.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	The Okeechobee Solar site is adjacent to the Ft. Drum Marsh Conservation Area.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation includes agricultural production and power generation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: October 18, 2018 Florida Environmental Resources Permit (ERP) received: September 21, 2018 Okeechobee County Development Approval: July 24, 2018

Preferred Site #3 Southfork Solar Energy Center, Manatee County

	Facility Acreage	548
	COD	Q2 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Agricultural production and fallow crop land
	Adjacent Areas	Agricultural production, forested and non-forested uplands
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately agricultural with some forested wetland areas.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Solar power generation is allowed within existing Agricultural land use designation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: November 13, 2018 Florida Environmental Resources Permit (ERP) received: September 21, 2018 Manatee County Site Plan Approval: February 6, 2019

Preferred Site #4 Echo River Solar Energy Center, Suwannee County

	Facility Acreage	802
	COD	Q2 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pine plantation and pastureland
	Adjacent Areas	Pine plantation and pastureland
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation and pasture with forested and herbaceous wetland areas.
2.	Listed Species	Listed species known to occur include gopher tortoise. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	Rocky Creek runs through the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation includes agricultural production and power generation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the North Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: N/A Florida Environmental Resources Permit (ERP) received: September 14, 2018 Suwannee County Development Approval: May 15, 2018

Preferred Site #5 Lakeside Solar Energy Center, Okeechobee County

	Facility Acreage	693
	COD	Q4 2020
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pastureland
	Adjacent Areas	Pastureland, low density residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly comprised of pastureland with freshwater herbaceous wetlands, drainage ditches, and a retention pond.
2.	Listed Species	Listed species known to occur onsite include Audubon's crested caracara, gopher tortoise and Florida burrowing owl. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	The Lakeside Solar site is adjacent to the Nubbin Slough and the Nubbin Slough Stormwater Treatment Area, which ultimately discharge to Lake Okeechobee, an Outstanding Florida Water.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. The project has been designed to maximize use of existing uplands to avoid wetland and surface water impacts. Therefore, no compensatory mitigation is required for this site.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Rural Estate.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants. Vegetated Natural Buffers will be incorporated adjacent to access paths to treat stormwater runoff.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: N/A Florida Environmental Resources Permit (ERP) received: February 15, 2019 Okeechobee County Development Approval: November 9, 2018

Preferred Site #6 Trailside Solar Energy Center, St. Johns County

	Facility Acreage	846
	COD	Q4 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pine Plantation
	Adjacent Areas	Open Rural
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly comprised of pine plantation with freshwater forested wetlands.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat no impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	Florida Forever Board of Trustees project as the Matanzas to Ocala Conservation Corridor is located at the southeast corner.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Compensatory mitigation for unavoidable wetland impacts will be accomplished through purchase of credits from Sundew Mitigation Bank.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agriculture.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: January 31, 2019 Florida Environmental Resources Permit (ERP) received: February 7, 2019 St. John's County Development Approval: November 15, 2018 (SUP) and December 12, 2018 (NZV)

Preferred Site #7 Union Springs Solar Energy Center, Union County

	Facility Acreage	725
	COD	Q2 2021
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pine plantation
	Adjacent Areas	Pine plantation and pine processing facility
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation with forested and herbaceous wetland areas.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agricultural.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	Florida Environmental Resources Permit (ERP) received: December 19, 2018 USACE Section 404 received: N/A Union County Site Plan Approval: Pending Union County Special Use Exception received: July 16, 2018

Preferred Site #8 Magnolia Springs Solar Energy Center, Clay County

	Facility Acreage	850
	COD	Q4 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Pine plantation
	Adjacent Areas	Pine plantation and low density residential
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation with forested wetland areas.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agricultural and Conservation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	Florida Environmental Resources Permit (ERP) received: February 18, 2019 USACE Section 404 received: N/A Clay County Comprehensive Plan Amendment Approval: October 23, 2018 Clay County Site Plan Approval: Pending

Preferred Site #9 Egret Solar Energy Center, Baker County

	Facility Acreage	676
	COD	Q3 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pine plantation
	Adjacent Areas	Pine plantation and low density residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation with forested and herbaceous wetland areas.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agricultural.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	Florida Environmental Resources Permit (ERP) received: pending USACE Section 404 received: pending Baker County Special Use Approval: pending

Preferred Site #10 Nassau Solar Energy Center, Nassau County

	Facility Acreage	927
	COD	Q1 2021
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pine plantation
	Adjacent Areas	Pine plantation and low density residential
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation with forested wetland areas.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Industrial.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	Florida Environmental Resources Permit (ERP) received: August 1, 2019 USACE NW51 Verification received: June 12, 2019 Nassau County Site Plan Approval: September 24, 2019

Preferred Site #11 Pelican Solar Energy Center, St. Lucie County

	Facility Acreage	564
	COD	Q1 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Citrus groves
	Adjacent Areas	Citrus groves, fallow cropland
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly citrus groves with agricultural drainage ditches and a spoil area.
2.	Listed Species	Listed species known to forage within surrounding area include Audubon's crested caracara. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, stormwater system and off-site transmission substation. The project has been designed to maximize use of existing uplands to avoid wetland and surface water impacts. Therefore, no compensatory mitigation is required for this site.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agricultural.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants. Vegetated Natural Buffers will be incorporated adjacent to access paths to treat stormwater runoff.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: N/A Florida Environmental Resources Permit (ERP) received: April 29, 2019 St. Lucie County Development Approval: August 13, 2019

Preferred Site #12 Palm Bay Solar Energy Center, Brevard County

	Facility Acreage	486
	COD	Q2 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Cleared citrus grove that is currently in use as cattle pasture
	Adjacent Areas	Agricultural, forested uplands and wetlands, and single-family residential
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly comprised of agricultural land with freshwater herbaceous wetlands and drainage ditches.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation
h.	Local Government Future Land Use Designations	Local government future land use for this site is Rural Residential.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: 7/12/2019 Florida Environmental Resources Permit (ERP) received: 5/21/2019 City of Palm Bay Development Approval: Pending

Preferred Site #13 Discovery Solar Energy Center, Brevard County

	Facility Acreage	491
	COD	Q1 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Undeveloped former citrus grove
	Adjacent Areas	Undeveloped and industrial
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately abandoned citrus groves, ditches and scattered freshwater forested and herbaceous wetlands which are now dominated by invasive, exotic vegetation.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, no impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	The site is adjacent to the Merritt Island National Refuge and adjacent to the Indian River Lagoon.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Compensatory mitigation for unavoidable wetland impacts will be accomplished through purchase of credits from NeoVerde Mitigation Bank.
h.	Local Government Future Land Use Designations	Site is federal land and therefore exempt from local zoning.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for PV Process: Not applicable for PV Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: Pending Florida Environmental Resources Permit (ERP) received: October 24, 2019 Brevard County Site Plan Approval: N/A

Preferred Site #14 Orange Blossom Solar Energy Center, Indian River County

	Facility Acreage	607
	COD	Q2 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Citrus grove
	Adjacent Areas	Citrus groves, fallow cropland
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly a citrus grove with canals/ditches. The site likely contains no jurisdictional wetlands.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation
h.	Local Government Future Land Use Designations	Local government future land use for this site is citrus, plant crops, and grazing.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: N/A Florida Environmental Resources Permit (ERP) received: 4/26/2019 Indian River County Approval: 8/13/2019

Preferred Site #15 Sabal Palm Solar Energy Center, Palm Beach County

	Facility Acreage	646
	COD	Q1 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Fallow Agricultural Production
	Adjacent Areas	Agriculture, single-family residential, vacant land
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominantly comprised of fallow agricultural land with freshwater herbaceous wetlands and drainage ditches.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, no impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Compensatory mitigation for unavoidable wetland impacts will be accomplished through purchase of credits from Bluefield Ranch Mitigation Bank.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Rural Residential.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: Pending Florida Environmental Resources Permit (ERP) received: Pending Palm Beach County Development Approval: October 25, 2019

Preferred Site #16 Fort Drum Solar Energy Center, Okeechobee County

	Facility Acreage	930
	COD	Q2 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pastureland and fallow crop land
	Adjacent Areas	Pastureland, conservation, and existing electrical transmission
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is comprised of pastureland, fallow citrus, pine Flatwoods, mixed forested wetlands, saw palmetto prairie, and freshwater marsh.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	The Fort Drum Solar site is near the Ft. Drum Marsh Conservation Area.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation includes agricultural production and power generation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE NW51 Verification: Pending Florida Environmental Resources Permit (ERP) received: Pending Okeechobee County Development Approval: Pending

Preferred Site #17 Rodeo Solar Energy Center, Desoto County

	Facility Acreage	1193
	COD	Q1 2021
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Pastureland
	Adjacent Areas	Utilities (solar), cropland and pastureland
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is comprised of pastureland, freshwater herbaceous and forested wetlands, pine Flatwoods, shrub and brushland, and other open land.
2.	Listed Species	Listed species known to occur onsite include Audubon's crested caracara and gopher tortoise. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	The site discharges to Sand Gully and Fish Branch, tributary to the Peace River, a Class III Florida water.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. The project has been designed to maximize use of existing uplands to avoid wetland impacts and minimize surface water impacts. Therefore, no compensatory mitigation is required for this site.
h.	Local Government Future Land Use Designations	Local government future land use for this site is Rural/Agricultural.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: N/A Florida Environmental Resources Permit (ERP) received: December 23, 2019 DeSoto County Development Approval: Pending

Preferred Site #18 Willow Solar Energy Center, Manatee County

	Facility Acreage	812
	COD	Q2 2021
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Abandoned agricultural
	Adjacent Areas	Cropland and pastureland
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately fallow cropland with drainage ditches/canals. Forested, herbaceous, and shrub marsh wetland areas are also present.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation
h.	Local Government Future Land Use Designations	Local government future land use for this site is Agriculture.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: Pending Florida Environmental Resources Permit (ERP) received: Pending Manatee County Approval: Pending

Preferred Site #19 Manatee Energy Storage Center, Manatee County

	Facility Acreage	40
	COD	Q4 2021
	For PV facilities: tracking or fixed	N/A
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Utility power generation
	Adjacent Areas	Utility power generation and agricultural production
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation with few forested and herbaceous wetland areas.
2.	Listed Species	No adverse impacts are expected due to previous development and lack of suitable onsite habitat for listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 400MW, 2.5 hour Battery Storage facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation is Utilities, requiring modification to include Battery Storage.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Groundwater will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Central Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Battery Storage Process: Not Applicable for Battery Storage Potable: Minimal, existing permitted supply Panel Cleaning: Not applicable for Battery Storage
m.	Water Supply Sources by Type	Cooling: Not Applicable for Battery Storage Process: Not Applicable for Battery Storage Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Battery Storage does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Battery Storage does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - Battery Storage energy does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	Battery Storage energy does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: Not yet filed. Florida Environmental Resources Permit (ERP) received: Not yet filed. Manatee County PUD Zoning amendment: Pending

Preferred Site #20 Sunshine Gateway Energy Storage Center, Columbia County

	Facility Acreage	30
	COD	Q4 2021
	For PV facilities: tracking or fixed	Fixed
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Agricultural production
	Adjacent Areas	Agricultural production and residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately agricultural with minimal forested wetlands and freshwater marshes.
2.	Listed Species	Listed species known to occur include gopher tortoise. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW of battery storage and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation includes agricultural production and power generation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for Battery Storage Process: Not applicable for Battery Storage Potable: Minimal, existing permitted supply Panel Cleaning: Not applicable for Battery Storage
m.	Water Supply Sources by Type	Cooling: Not Applicable for Battery Storage Process: Not Applicable for Battery Storage Potable and Panel Cleaning: Not applicable for Battery Storage
n.	Water Conservation Strategies Under Consideration	Battery Storage does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Battery Storage does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - Battery Storage energy does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	Battery Storage does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit expected: Q3 2020 Florida Environmental Resources Permit (ERP) Modification: expected Q3 2020 Suwannee County Development Approval: Expected April 2020

Preferred Site #21 Echo River Energy Storage Center, Suwannee County

	Facility Acreage	5
	COD	Q4 2021
	For PV facilities: tracking or fixed	Tracker
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Pine plantation and pastureland
	Adjacent Areas	Pine plantation and pastureland
f. General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately pine plantation and pasture with forested and herbaceous wetland areas.
2.	Listed Species	Listed species known to occur include gopher tortoise. No adverse impacts are anticipated to listed species.
3.	Natural Resources of Regional Significance Status	Rocky Creek runs through the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW of battery storage and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Local government future land use designation includes agricultural production and power generation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not applicable for Battery Storage Process: Not applicable for Battery Storage Potable: Minimal, existing permitted supply Panel Cleaning: Not applicable for Battery Storage
m.	Water Supply Sources by Type	Cooling: Not Applicable for Battery Storage Process: Not Applicable for Battery Storage Potable and Panel Cleaning: Not applicable for Battery Storage
n.	Water Conservation Strategies Under Consideration	Battery Storage does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Battery Storage does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - Battery Storage energy does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	Battery Storage does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	Florida Environmental Resources Permit (ERP) modification expected April 2020 Suwannee County Development Approval: Expected April 2020

Preferred Site #22 Dania Beach Clean Energy Center Unit 7, Broward County

	Facility Agerage	134
	COD	Q2 2022
	For PV facilities: tracking or fixed	N/A
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Electrical generating facilities
	Adjacent Areas	Low to high density urban, transportation, communication, utilities, commercial, water, and conservation
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is comprised of facilities related to power generation.
2.	Listed Species	Listed species known to occur within the cooling pond at the site include the West Indian manatee. No adverse impacts are anticipated to listed species due to previous development.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The project includes dismantlement of existing Units 4 & 5 and replacement with one new approximately 1,163 MW combined cycle unit consisting of two combustion turbines (CTs), two heat recovery steam generators (HRSGs), and a steam turbine. The CTs will operate using natural gas and Ultra-Low Sulfur Distillate.
h.	Local Government Future Land Use Designations	The site is zoned General Industrial.
i.	Site Selection Criteria Factors	The Lauderdale Plant has been selected as a preferred site for a site modernization due to consideration of various factors including system load and economics. Environmental issues were not a deciding factor since this site does not exhibit significant environmental sensitivity or other environmental issues. However, there are environmental benefits of replacing the existing, outdated combined cycle units with a new highly efficient combined cycle unit, including a significant reduction in system air emissions. In addition, the modernization project at this existing site will not require a new gas pipeline and will make use of the existing transmission facilities and water supply.
j.	Water Resources	Condenser cooling for the steam cycle portion of the new combined cycle unit and auxiliary cooling will come from the existing cooling water intake system. Process and potable water for the new unit will come from the existing water supply sources (Broward County and City of Hollywood).
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: No additional water required. Process: No additional water required. Potable: No additional water required. Panel Cleaning: Not Applicable
m.	Water Supply Sources by Type	Cooling: As existing, Dania Cut-Off Canal Process: As existing, Broward County Utilities Potable: As existing, City of Hollywood
n.	Water Conservation Strategies Under Consideration	No additional water resources are required beyond current usage.
o.	Water Discharges and Pollution Control	Continued discharge to the existing cooling pond is anticipated. No increase in water discharge is expected. Best Management Practices will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Natural gas will be transported via an existing pipeline. ULSD will be trucked to the facility and stored in existing ULSD tanks.
q.	Air Emissions and Control Systems	Fuel - Use of cleaner natural gas and Ultra-Low Sulfur Distillate • Natural Gas - Dry-low NOx combustion technology and Selective Catalytic Reduction will control NOx emissions, Greenhouse gas emissions will be substantially lower than the Environmental Protection Agency's proposed new source performance standard. • ULSD - Water injection and selective catalytic reduction will be used to reduce NOx emissions Combustion Control - will minimize formation of sulfur dioxide, particulate matter, nitrogen oxides (NOx), and other fuel-bound contaminate Combustor Design - will limit formation of carbon monoxide and volatile organic compounds
r.	Noise Emissions and Control Systems	Noise from the operation of the new unit will be within allowable levels.
s.	Status of Applications	Need Determination Issued: March 19, 2018 FL Site Certification Received: December 13, 2018 PSD Permit Received: December 4, 2017 USACE Section 404 Permit Received: January 7, 2019 IWW Received: December 3, 2018

Preferred Site #23 Turkey Point Unit 6&7, Miami-Dade County

	Facility Acreage	N/A
	COD	TBD
	For PV facilities: tracking or fixed	N/A
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Electrical generating facilities
	Adjacent Areas	Undeveloped, the Everglades Mitigation Bank, South Florida Water Management District Canal L-31E, Biscayne Bay, and state-owned land on Card Sound
General Environment Features On and In the Site Vicinity		
f.	Natural Environment	The site includes hypersaline mud flats, man-made active cooling canals and remnant canals, previously filled areas / roadways, mangrove heads associated with historical tidal channels, dwarf mangroves, open water / discharge canal associated with the cooling canals on the western portion of the site, wet spoil berms associated with remnant canals, and upland spoil areas.
1.	Listed Species	Listed species known to occur at the site or associated linear features include the peregrine falcon, wood stork, American crocodile, roseate spoonbill, little blue heron, snowy egret, American oystercatcher, least tern, white ibis, Florida manatee, eastern indigo snake, snail kite, and white-crowned pigeon. Some listed flora species likely to occur include pine pink, Florida brickell-bush, Florida lantana, mullein nightshade, and Lamarck's trema. The construction and operation of Turkey Point Units 6 & 7 are not expected to adversely affect any listed species.
2.	Natural Resources of Regional Significance Status	Significant features in the vicinity of the site include Biscayne Bay, Biscayne National Park, Biscayne Bay Aquatic Preserve, Miami-Dade County Homestead Bayfront Park, and Everglades National Park.
3.	Other Significant Features	FPL is not aware of any other significant features of the site.
4.	Design Features and Mitigation Options	The technology proposed is the Westinghouse AP1000 pressurized water reactor. This design is certified by the Nuclear Regulatory Commission under 10 CFR 52. The Westinghouse AP1000 consists of the reactor, steam generators, pressurizer, and steam turbine / electric generator. The projected generating capacity from each unit is 1,100 MW. Condenser cooling will use six circulating water cooling towers. The structures to be constructed include the containment building, shield building, auxiliary building, turbine building, annex building, diesel generator building, and radwaste building. The plant area will also contain the Clear Sky substation (switchyard) that will connect to FPL's transmission system.
g.	Local Government Future Land Use Designations	Current future land use designations include Industrial, Utilities, Communications, and Unlimited Manufacturing with a dual designation of Mangrove Protection Area. There are also areas of the site designated Interim District.
h.	Site Selection Criteria Factors	Site selection included the following criteria: existing transmission and transportation infrastructure to support new generation, the size and seclusion of the site while being relatively close to the load center, economics, and the long-standing record of safe and secure operation of nuclear generation at the site since the early 1970s.
i.	Water Resources	Water requirements will be met by reclaimed water from Miami-Dade County and a back-up supply of saline groundwater from below the marine environment of Biscayne Bay.
j.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
k.	Project Water Quantities for Various Uses	Cooling: 55.3 million gallons per day (mgd) Process: 1.3 mgd Potable: .05 mgd Panel Cleaning: Not Applicable
l.	Water Supply Sources by Type	Cooling: Miami-Dade reclaimed water and saline groundwater from Biscayne Bay via radial collector wells Process: Miami-Dade Water and Sewer Department Potable: Miami-Dade Water and Sewer Department
m.	Water Conservation Strategies Under Consideration	Turkey Point Units 6 & 7 will use reclaimed water 24 hours per day, 365 days per year when operating and when the reclaimed water is available in sufficient quantity and quality.
n.	Water Discharges and Pollution Control	Blowdown water or discharge from the cooling towers, along with other waste streams, will be injected into the boulder zone of the Floridan Aquifer. Non-point source discharges are not an issue since there will be none at this facility. Storm water runoff will be released to the closed-loop cooling canal system.
o.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	The Turkey Point Units 6 & 7 reactors will contain enriched uranium fuel assemblies. New fuel assemblies will be transported to Turkey Point for use in Units 6 & 7 by truck from a fuel fabrication facility in accordance with U.S. Department of Transportation (DOT) and NRC regulations. Spent fuel assemblies being discharged will remain in the permitted spent fuel pool while short half-life isotopes decay. After a sufficient decay period, the fuel would be transferred to a permitted on-site independent spent fuel storage installation facility or a permitted off-site disposal facility. Packaging of the fuel for off-site shipment will comply with the applicable DOT and NRC regulations for transportation of radioactive material. The U.S. Department of Energy (DOE) is responsible for spent fuel transportation from reactor sites to a repository under the Nuclear Waste Policy Act of 1982, as amended. FPL has executed a standard spent nuclear fuel disposal contract with DOE for fuel used in Units 6 & 7.
p.	Air Emissions and Control Systems	Fuel - The units will minimize FPL system air pollutant emissions by using nuclear fuel to generate electric power. Combustion Control / Combustor Design - Not Applicable Note: The diesel engines necessary to support Turkey Point Units 6 & 7 and fire pump engines will be purchased from manufacturers whose engines meet the EPA's New Source Performance Standards Subpart IIII emission limits.
q.	Noise Emissions and Control Systems	Predicted noise levels associated with these projects are not expected to result in adverse noise impacts in the vicinity of the site.
r.	Status of Applications	Need Determination Issued: April 2008 FL Site Certification Received: May 14, 2014 USACE Section 404 Permit: December 18, 2019 COL received: April 5, 2018 Miami-Dade County Unusual Use approvals: issued in 2007 and 2013 Land Use Consistency Determination: issued in 2013 Prevention of Significant Deterioration: issued in 2009

Preferred Site #24 Blue Springs Solar Energy Center, Jackson County

	Facility Acreage	444
	COD	Q4 2020
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Agricultural crops
	Adjacent Areas	Agricultural and low density residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is predominately cropland with few forested uplands and wetlands
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	0
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar fixed panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Solar power generation is allowed within existing Agricultural land use designation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	USACE Section 404 Permit received: NA Florida Environmental Resources Permit (ERP) received: February 26, 2019

Preferred Site #25 Chautauqua Solar Energy Center, Walton County

	Facility Acreage	868
	COD	Q4 2021
	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
	Site	Agricultural crops and pastureland
	Adjacent Areas	Agricultural and low density residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is predominately agricultural with some forested uplands and wetlands.
2.	Listed Species	Due to the existing disturbed nature of the site and lack of suitable onsite habitat, minimal, if any, impacts will occur to listed species.
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	Gulf and FPL are not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through a combination of on- and off-site mitigation.
h.	Local Government Future Land Use Designations	Solar power generation is allowed within existing Agricultural land use designation.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal, existing permitted supply Panel Cleaning: Minimal and only in absence of sufficient rainfall.
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Delivered to Site by Truck or via existing permitted supply.
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	0
s.	Status of Applications	USACE Permit received: NA Florida Environmental Resources Permit (ERP): pending, application filed

Preferred Site #26 Crist Unit 8, Escambia County

	Facility Acreage	58
	COD	Q4 2021
	For PV facilities: tracking or fixed	N/A
Reference Maps		
a.	USGS Map	See Figures at the end of this chapter
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Industrial (Electrical Generating Facility)
	Adjacent Areas	Public, Low & Medium Density Residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	The site is located in uplands within existing fenced plant property and consists of primarily of a pine and hardwood mix. The site has historically had silviculture operations.
2.	Listed Species	No adverse impacts to listed species are anticipated. However, Gopher Tortoise do occur in local area.
3.	Natural Resources of Regional Significance Status	Drainage from the site ultimately discharges into the Escambia river.
4.	Other Significant Features	Gulf is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes construction of four 235 MW combustion turbines, a switchyard, and associated wastewater and stormwater management systems. The site location has been selected in uplands with a significant buffer to any sensitive habitats. Final grading has been designed to match natural grades.
h.	Local Government Future Land Use Designations	The site is zoned General Industrial.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Groundwater will be used to meet water requirements.
k.	Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter site is located in the Panhandle Florida region.
l.	Project Water Quantities for Various Uses	NOx control: 1.95 MGD during fuel oil operations Potable: 0.01 MGD Process: 1.9 MGD
m.	Water Supply Sources by Type	Process: Existing permitted groundwater usage; Coast Utilities Authority Potable: Emerald
n.	Water Conservation Strategies Under Consideration	No additional water resources are required beyond currently permitted usage.
o.	Water Discharges and Pollution Control	The existing Plant Crist industrial wastewater treatment system will be utilized for the project. A new stormwater management system will be constructed to ensure the post development discharge rate is not greater than the predevelopment conditions. Best management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Natural gas will be transported via a new pipeline. Ultra Low Sulfur Distillate (ULSD) will be trucked to the facility and stored in a new ULSD tank.
q.	Air Emissions and Control Systems	Fuel - Use of cleaner natural gas and Ultra-Low Sulfur Distillate • Natural Gas - Dry-low NOx combustion technology will control NOx emissions, Greenhouse gas emissions will be substantially lower than the Environmental Protection Agency's proposed new source performance standard. • ULSD - Water injection will be used to reduce NOx emissions Combustion Control - will minimize formation of sulfur dioxide, particulate matter, nitrogen oxides (NOx), and other fuel-bound contaminate Combustor Design - will limit formation of carbon monoxide and volatile organic compounds
r.	Noise Emissions and Control Systems	Noise from the operation of the new unit will be within allowable levels.
s.	Status of Applications	USACE Jurisdictional Determination Received: September 20, 2019 ERP Permit Received: October 14, 2019 UIC Permit Received: October 25, 2019 PSD Permit Received: February 5, 2020 IWW Permit Revision: In Progress

IV.G.2 Potential Sites

There are 13 Potential Sites that have currently been identified for future generation and storage additions to meet projected capacity and energy needs.¹⁵ Each of these Potential Sites offers a range of considerations relative to engineering and/or costs associated with the construction and operation of feasible technologies. In addition, each Potential Site has different characteristics that would require further definition and attention. Unless otherwise noted, the water quantities discussed below are in reference to universal solar PV generation rather than for gas-fueled generation.

Permits are presently considered to be obtainable for each of these sites. No significant environmental constraints are currently known for any of these sites. At this time, FPL and Gulf consider each site to be equally viable. The Potential Sites briefly discussed below are presented in alphabetical order of Site name for those in FPL's area and by name of County for those in Gulf's area.

Table IV.G.2: List of FPL & Gulf Potential Sites

Site Name	County	Technology
FPL Area		
Elder Branch	Manatee	Solar
Everglades	Miami-Dade	Solar
Ghost Orchid	Hendry	Solar
Sawgrass	Hendry	Solar
Sundew	St Lucie	Solar
White Tail	Martin	Solar
Gulf Area		
TBD	Calhoun	Solar
TBD	Calhoun	Solar
TBD	Escambia	Solar
TBD	Gadsden	Solar
TBD	Jackson	Solar
TBD	Okaloosa	Solar
TBD	Santa Rosa	Solar

¹¹ As has been described in previous FPL Site Plans, a number of other locations are also possible sites for future generation additions. These include the remainder of FPL's and Gulf's existing generation sites and other greenfield sites. Specific greenfield sites may not be specifically identified as Potential Sites in order to protect the economic interests of the utility and its customers.

FPL Area Potential Site # 1: Elder Branch

This potential site in Manatee County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily fallow crop land surrounded by agricultural land, low density residential, and conservation lands.

c. Environmental Features

Site is predominately fallow cropland with some forested wetland. Site is located adjacent to publicly owned conservation lands. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

FPL Area Potential Site # 2: Everglades

This potential site in Miami-Dade County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily agricultural land surrounded by other agricultural lands.

c. Environmental Features

Site is agricultural land with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

FPL Area Potential Site # 3: Ghost Orchid

This potential site in Hendry County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Existing land use is primarily agricultural and surrounded by predominately agricultural and low density residential.

c. Environmental Features

Site is predominately agricultural with some forested wetlands with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

FPL Area Potential Site # 4: Sawgrass

This potential site in Hendry County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pastureland and surrounded by agricultural lands and forested wetlands.

c. Environmental Features

Site is predominately pastureland with a mosaic of forested wetlands throughout the site. Subject property is located almost entirely within the primary panther zone. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

FPL Area Potential Site # 5: Sundew

This potential site in St. Lucie County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily Improved pasture and fallow citrus groves surrounded by agricultural lands.

c. Environmental Features

Site is improved pasture and fallow citrus with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

FPL Area Potential Site # 6: White Tail

This potential site in Martin County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is predominately fallow cropland surrounded by agricultural lands.

c. Environmental Features

Site is mostly fallow cropland with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 1: Calhoun County

A potential site in Calhoun County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pine plantation surrounded by pine plantation and low density residential.

c. Environmental Features

Site is predominately pine plantation with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 2: Calhoun County

Another potential site in Calhoun County is also under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pine plantation and pastureland surrounded by agricultural land and low density residential.

c. Environmental Features

Site is predominately agricultural with some forested uplands and wetlands and no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 3: Escambia County

A potential site in Escambia County is under evaluation for future PV.

a. **U.S. Geological Survey (USGS) Map**

See Figures at the end of this chapter.

b. **Existing Land Uses of Site and Adjacent Areas**

Site is primarily pine plantation surrounded by other pine plantations and pastureland.

c. **Environmental Features**

Site is predominately pine plantation with forested wetlands and no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. **Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. **Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 4: Gadsden County

A potential site in Gadsden County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pine plantation surrounded by pine plantation and forested wetlands.

c. Environmental Features

Site is predominately pine plantation with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 5: Jackson County

A potential site in Jackson County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site primarily pine plantation surrounded by pastureland and low density residential.

c. Environmental Features

Site is predominately pine plantation with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 6: Okaloosa County

A potential site in Okaloosa County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pine plantation with some pastureland and is surrounded by agricultural lands and low density residential.

c. Environmental Features

Site is predominately pine plantation with forested uplands and some pastureland with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

Gulf Area Potential Site # 7: Santa Rosa County

A potential site in Santa Rosa County is under evaluation for future PV.

a. U.S. Geological Survey (USGS) Map

See Figures at the end of this chapter.

b. Existing Land Uses of Site and Adjacent Areas

Site is primarily pine plantation surrounded by pine plantations and low density residential.

c. Environmental Features

Site is predominately pine plantation with no significant environmental features on or nearby this site. No adverse impacts to listed species are anticipated.

d. Water Quantities Required

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal for PV.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

e. Supply Sources

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Not Applicable for PV.

Panel Cleaning: Trucked in if and when needed for PV.

***Environmental and Land Use Information:
Supplemental Information***


***Relationship of Regional Hydrogeologic Units
to Major Stratigraphic Units
and
Florida Regions***

Relationship of Regional Hydrogeologic Units to Major Stratigraphic Units

System	Series	Panhandle Florida		North Florida		South Florida	
		Stratigraphic Unit	Hydrogeologic Unit	Stratigraphic Unit	Hydrogeologic Unit	Stratigraphic Unit	Hydrogeologic Unit
Quaternary	Holocene	Undifferentiated terrace marine and fluvial deposits	Surficial aquifer system (Sand and Gravel aquifer)	Undifferentiated terrace marine and fluvial deposits	Surficial aquifer system	Terrace Deposits Miami Limestone Key Largo Limestone Anastasia Formation Fort Thompson Formation Caloosahatchee Marl	Surficial aquifer system (Biscayne aquifer)
	Pleistocene						
Tertiary	Pliocene	Citronelle Formation Undifferentiated coarse sand and gravel	Intermediate confining unit	Micosukee Formation Alachua Formation	Intermediate aquifer system or intermediate confining unit	Tamiami Formation	Intermediate aquifer system or intermediate confining unit
	Miocene	Alum Bluff Group Pensacola Clay Intracoastal Formation Hawthorn Group Chipola Formation Bruce Creek Limestone St. Marks Formation Chattahoochee Formation		Hawthorn Group St. Marks Formation		Hawthorn Group	
		Oligocene	Chickasawhay Limestone Suwannee Limestone	Suwannee Limestone	Floridan aquifer system	Suwannee Limestone	Floridan aquifer system
	Marianna Limestone Bucaturra Clay						
	Eocene	Ocala Limestone Lisbon Formation Tallahatta Formation Undifferentiated older Rocks	Cedar Keys Formation	Ocala Limestone Avon Park Formation Oldsmar Formation	Cedar Keys Formation	Ocala Limestone Avon Park Formation Oldsmar Formation	Sub-Floridan confining unit
		Paleocene		Undifferentiated			
Cretaceous and older		Undifferentiated	Sub-Floridan confining unit	Undifferentiated	Sub-Floridan confining unit		

Note: This information is referred to in subsection k, Geological Features of Site and Adjacent Areas, for each of the Preferred Sites.

Florida Regions Map

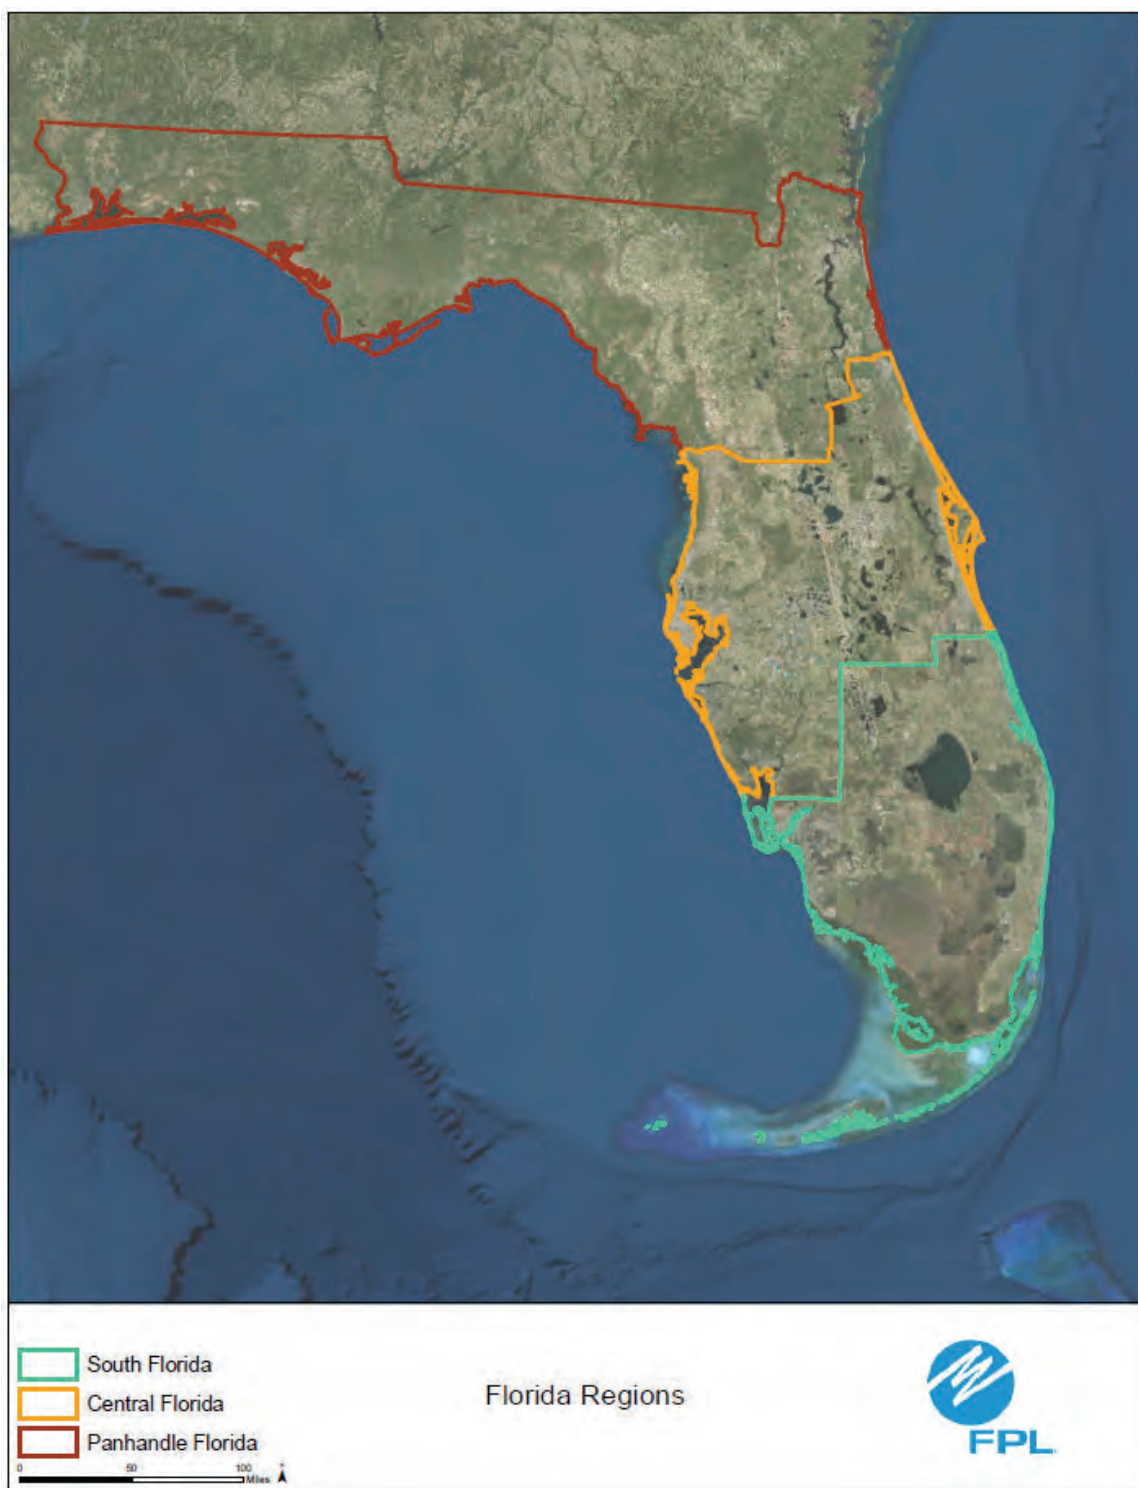


Note: This information is referred to in subsection k, Geological Features of Site and Adjacent Areas, for each of the Preferred Sites.

***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 1: Hibiscus Solar Energy Center,
Palm Beach County***




 Hibiscus Solar Energy Center

Hibiscus Solar Energy Center
USGS Topography Map



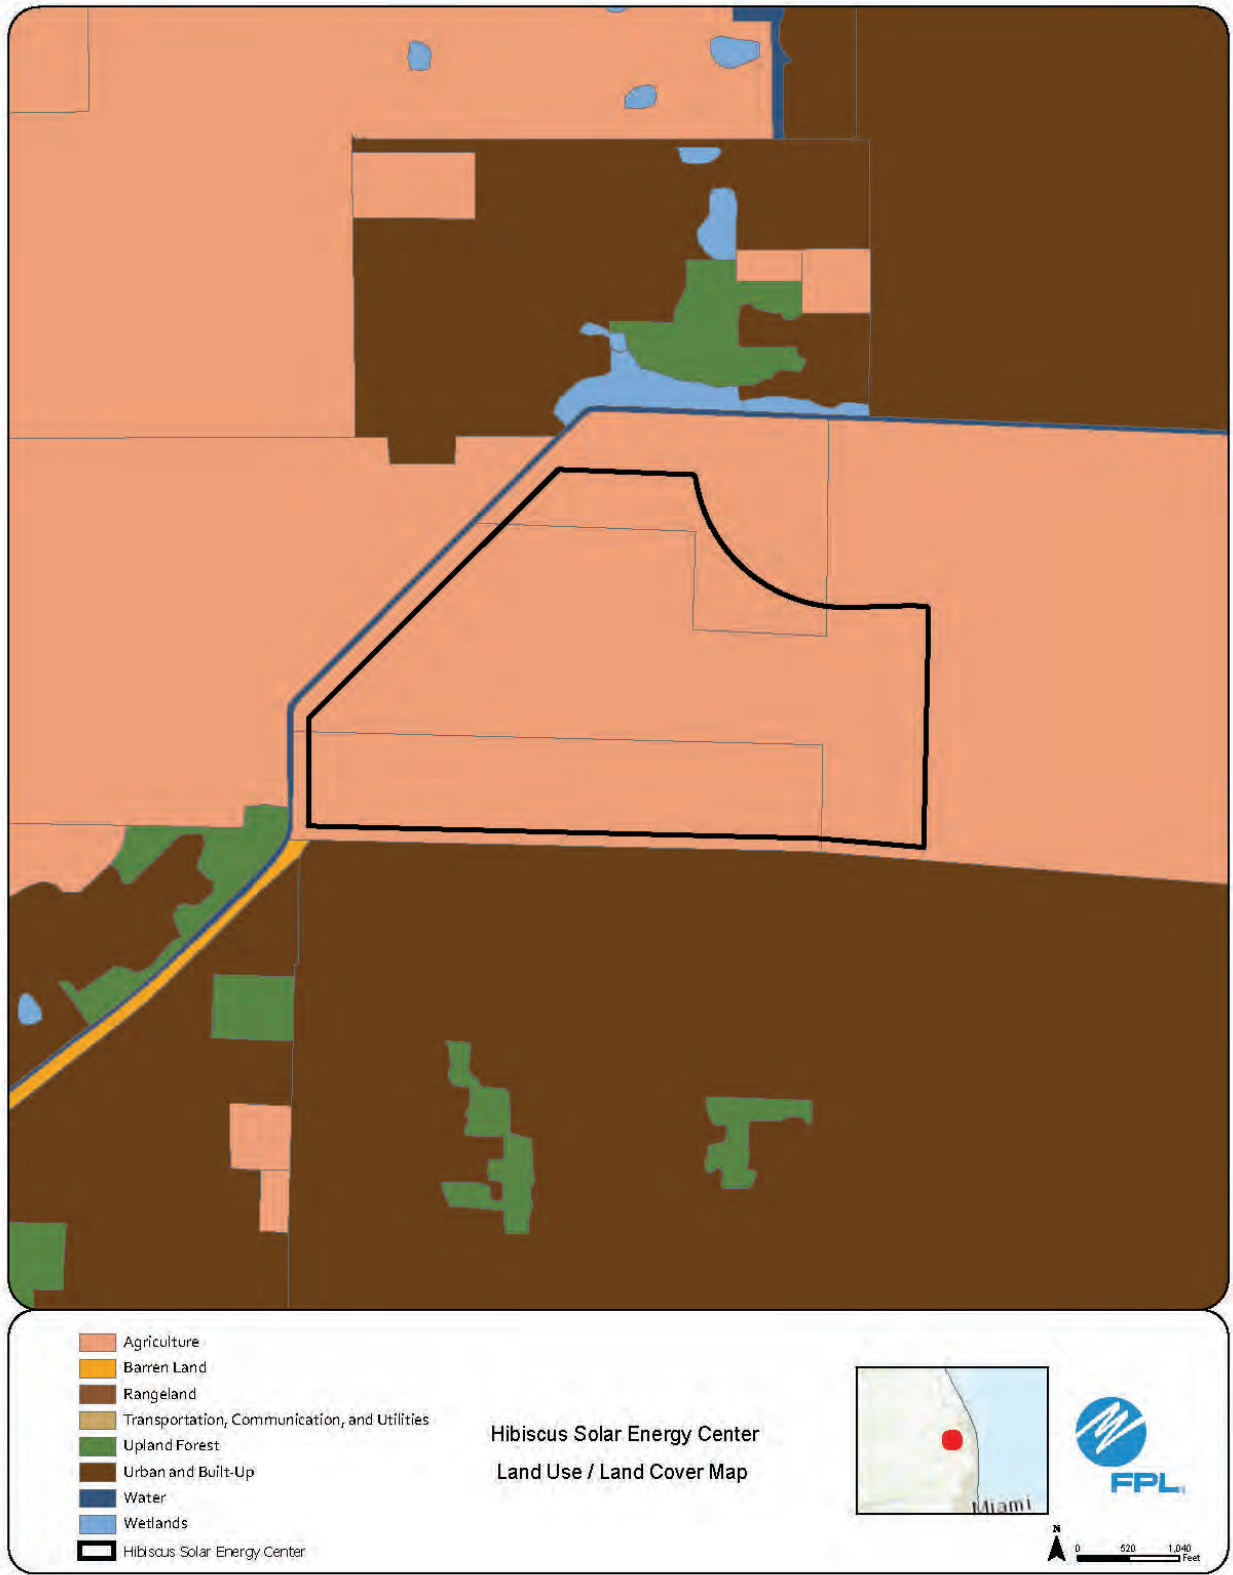

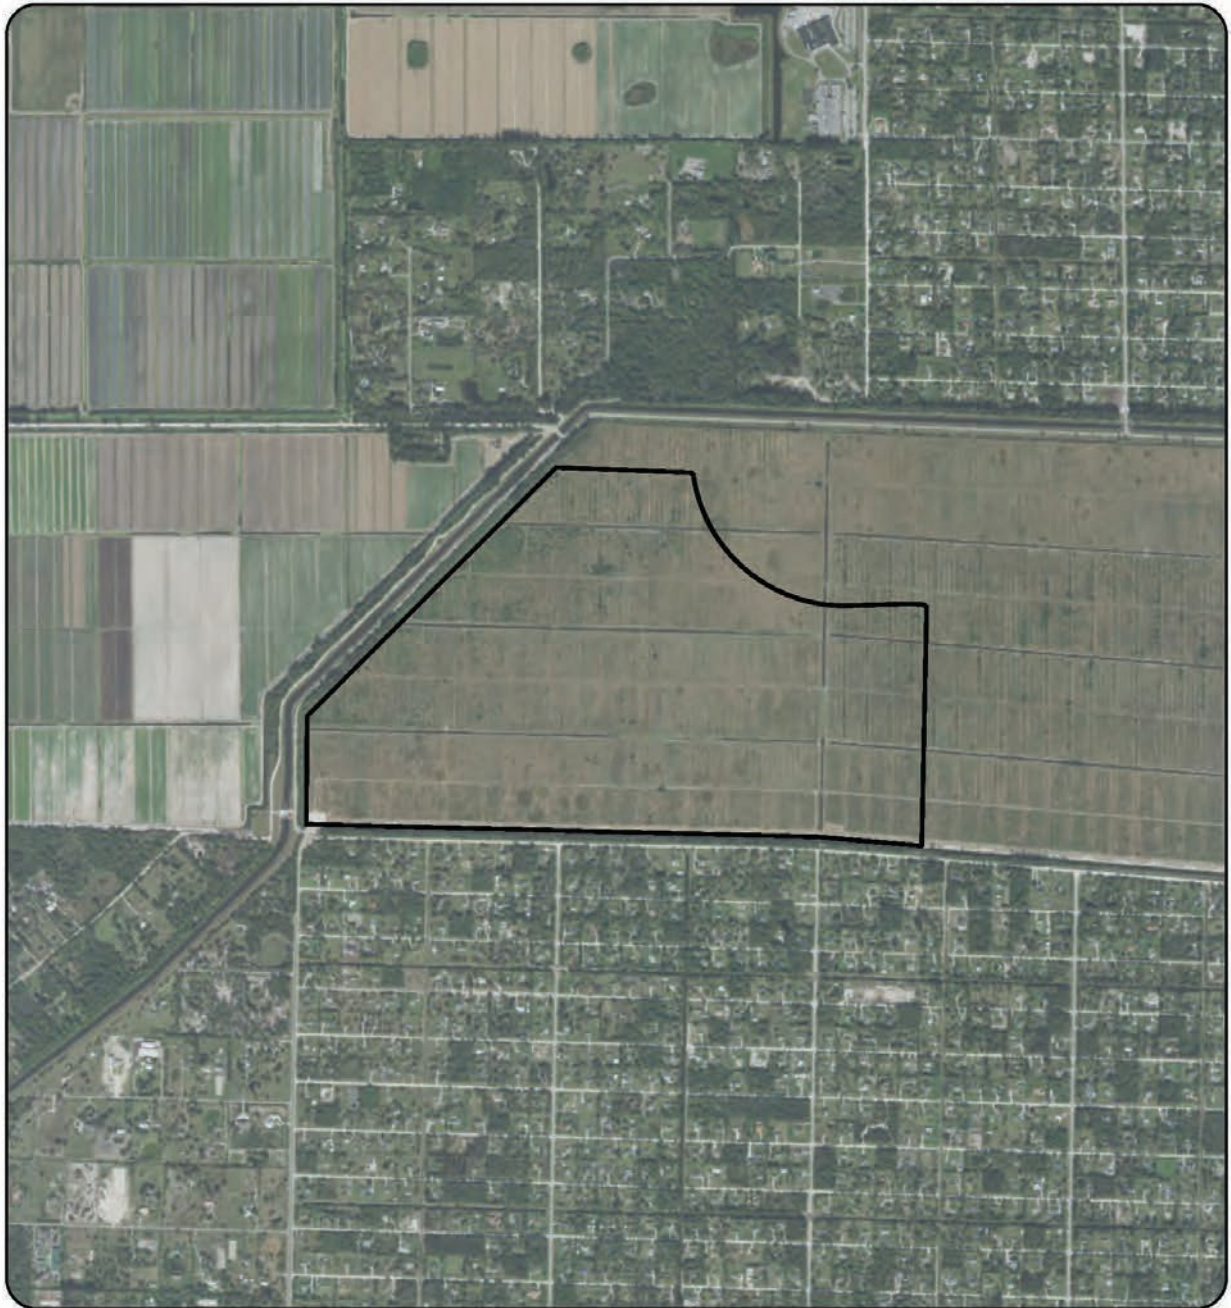

 Hibiscus Solar Energy Center


Hibiscus Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 2: Okeechobee Solar Energy Center,
Okeechobee County***

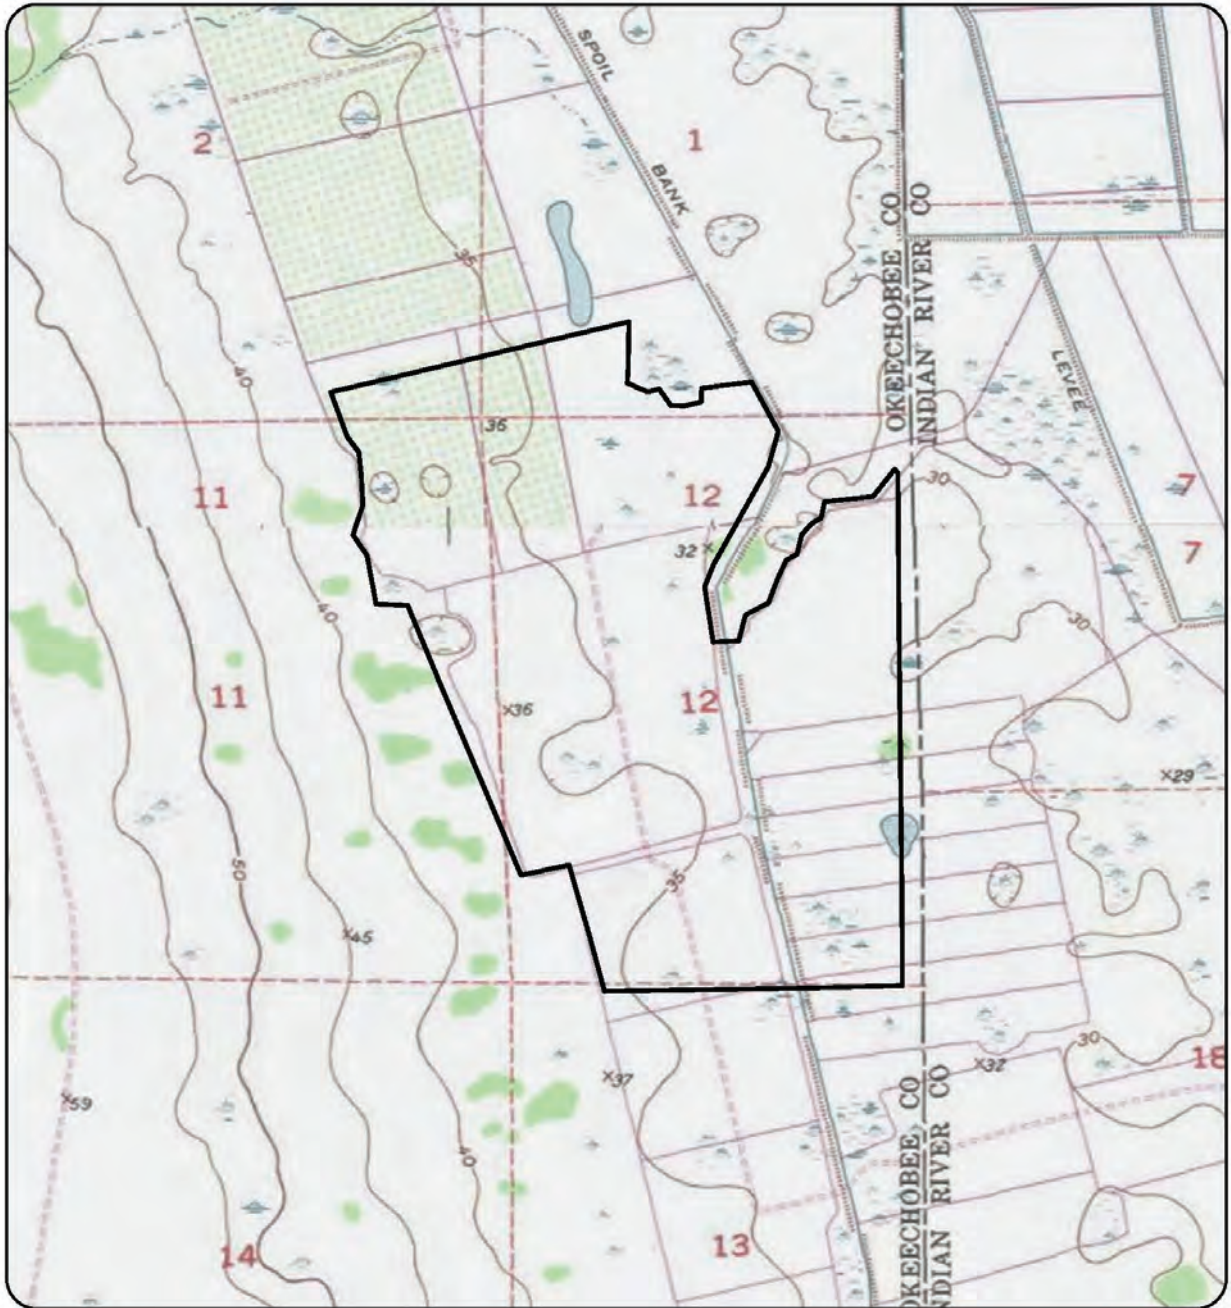


 Okeechobee Solar Energy Center

Okeechobee Solar Energy Center

USGS Topography Map




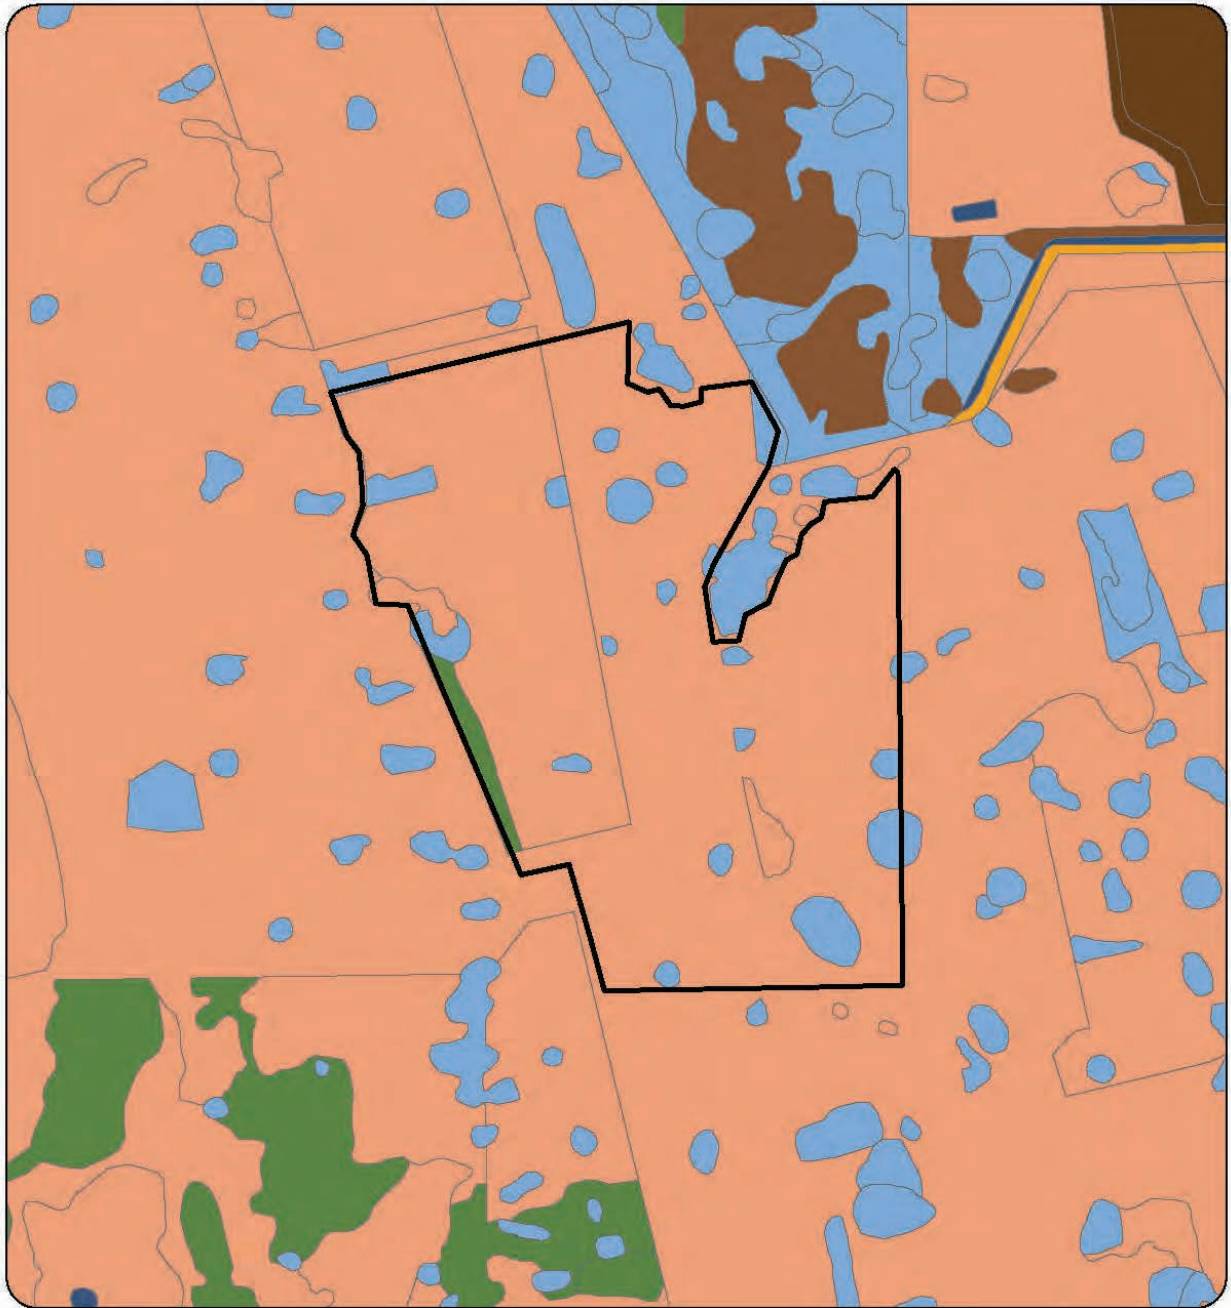

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Okeechobee Solar Energy Center

Okeechobee Solar Energy Center
Land Use / Land Cover Map



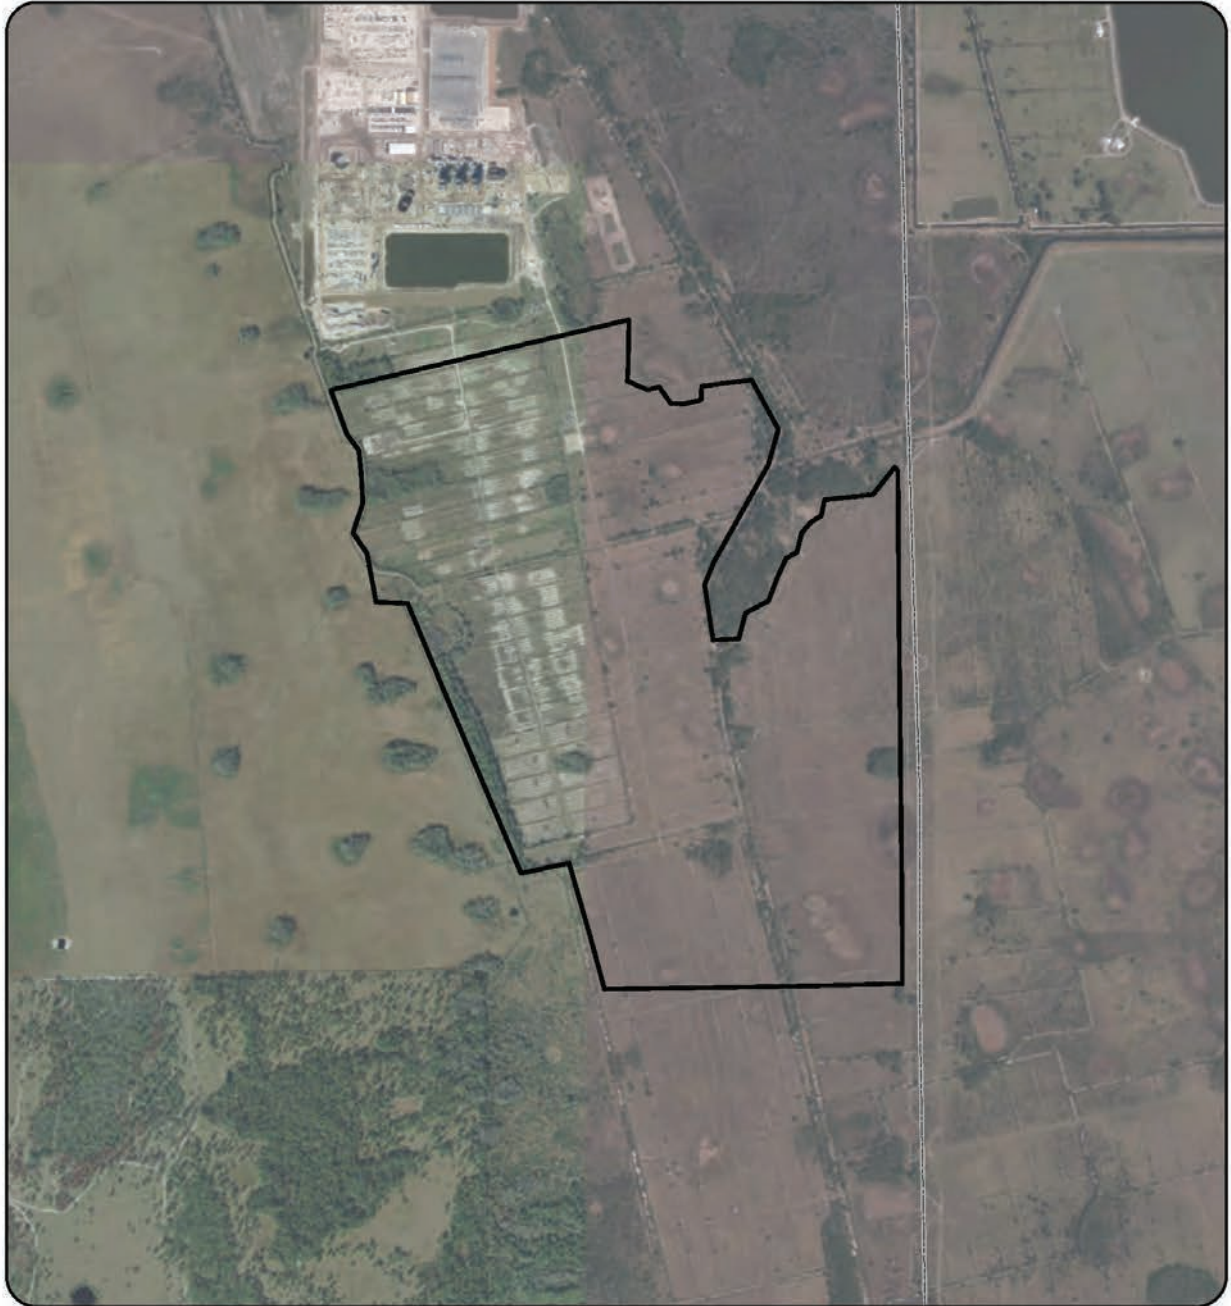

 Okeechobee Solar Energy Center


Okeechobee Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 3: Southfork Solar Energy Center,
Manatee County***

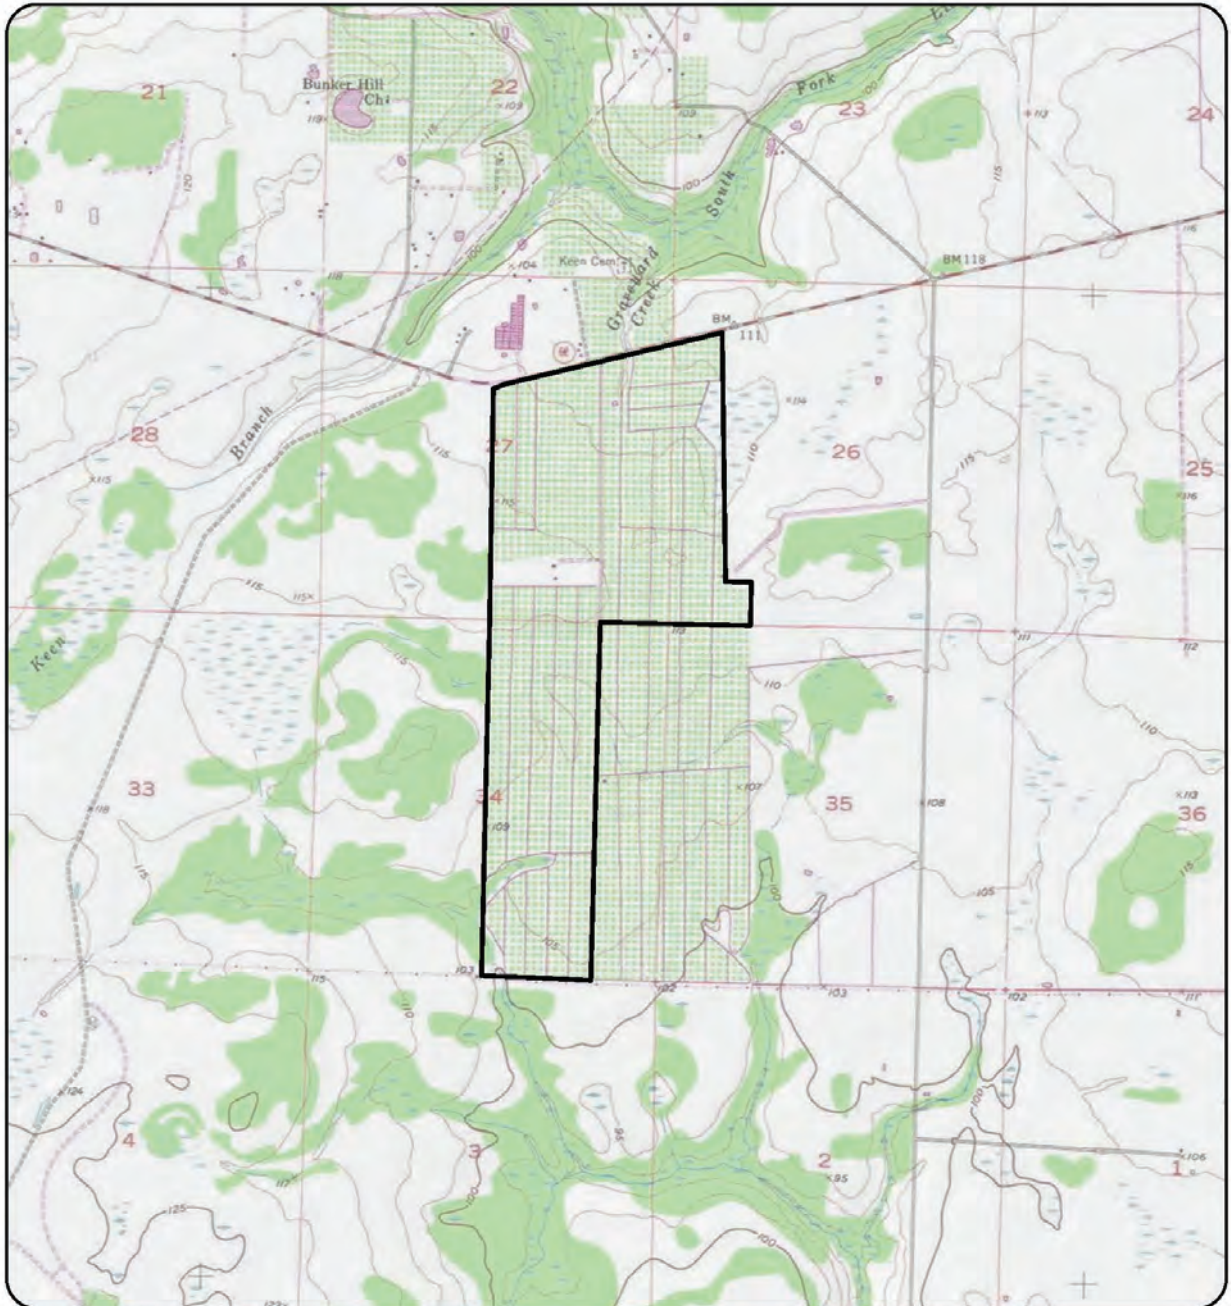

 Southfork Solar Energy Center



Southfork Solar Energy Center
USGS Topography Map




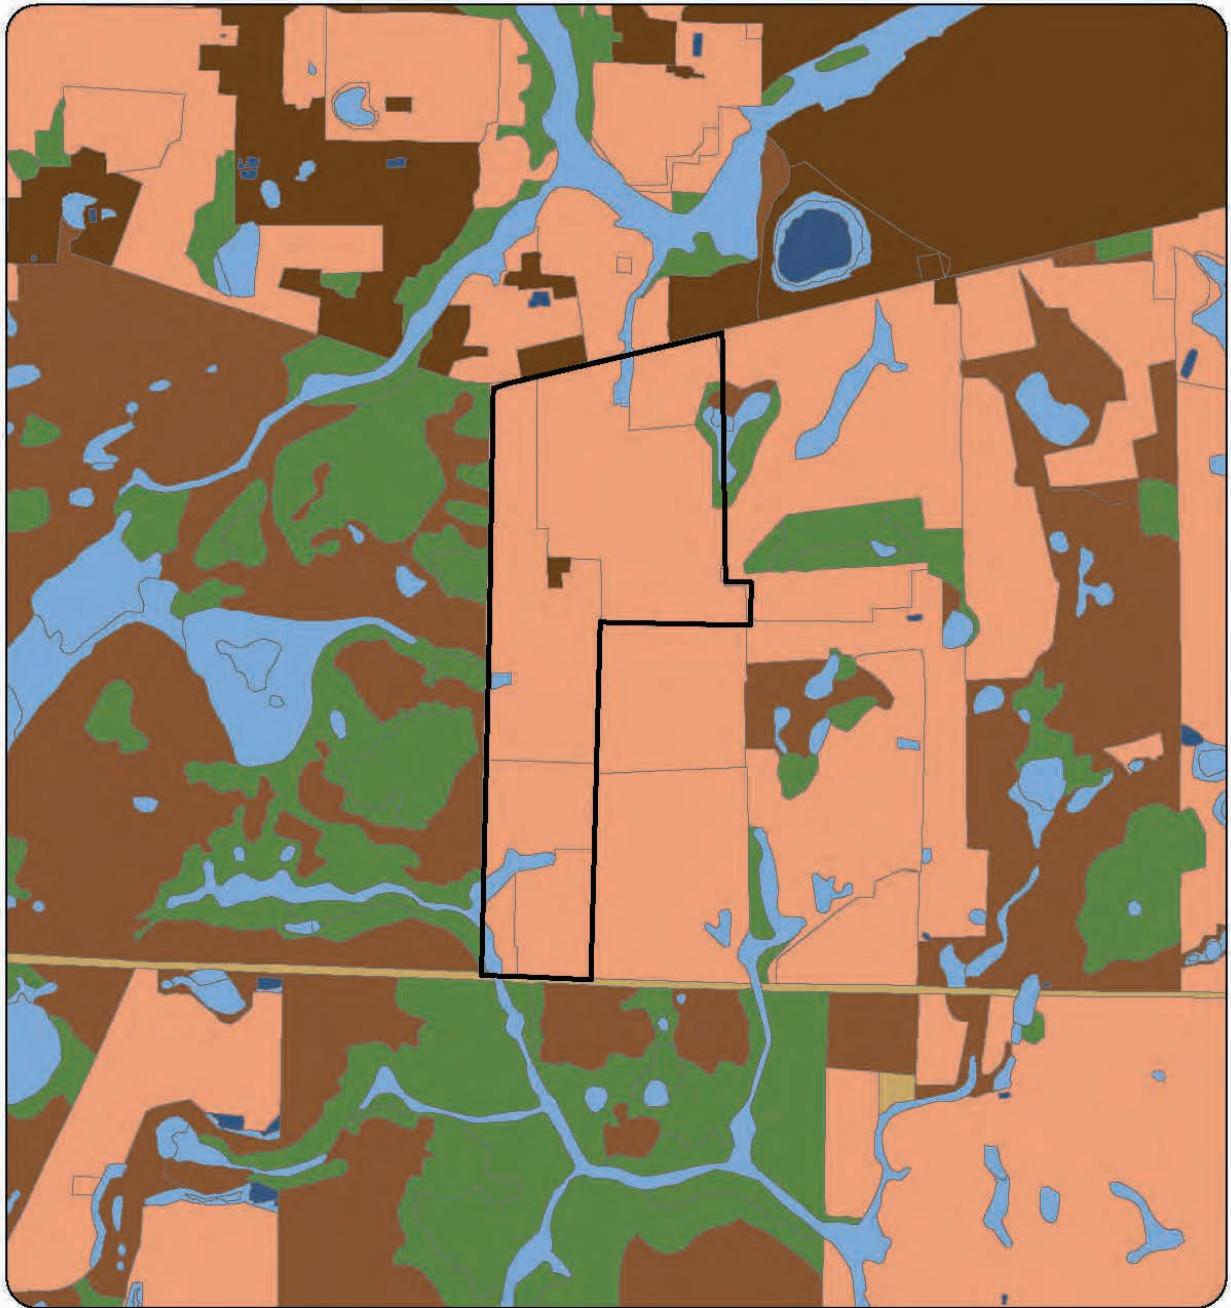

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Southfork Solar Energy Center

**Southfork Solar Energy Center
Land Use / Land Cover Map**



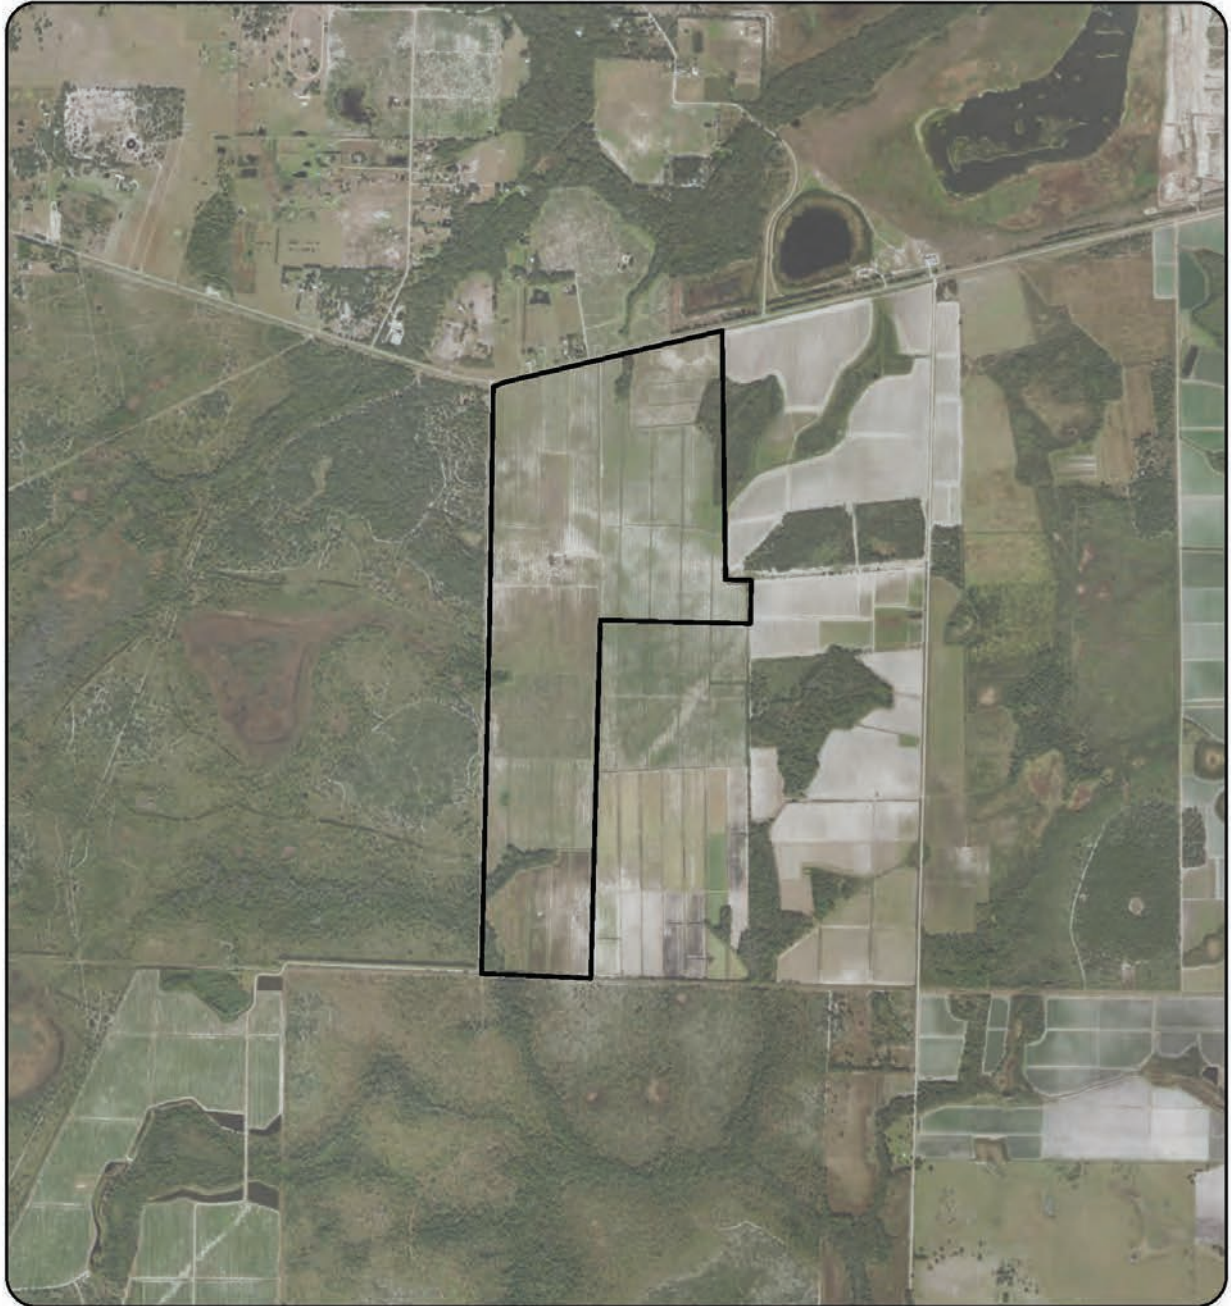

 Southfork Solar Energy Center


Southfork Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***

***Preferred Site # 4: Echo River Solar Energy Center,
Suwannee County***

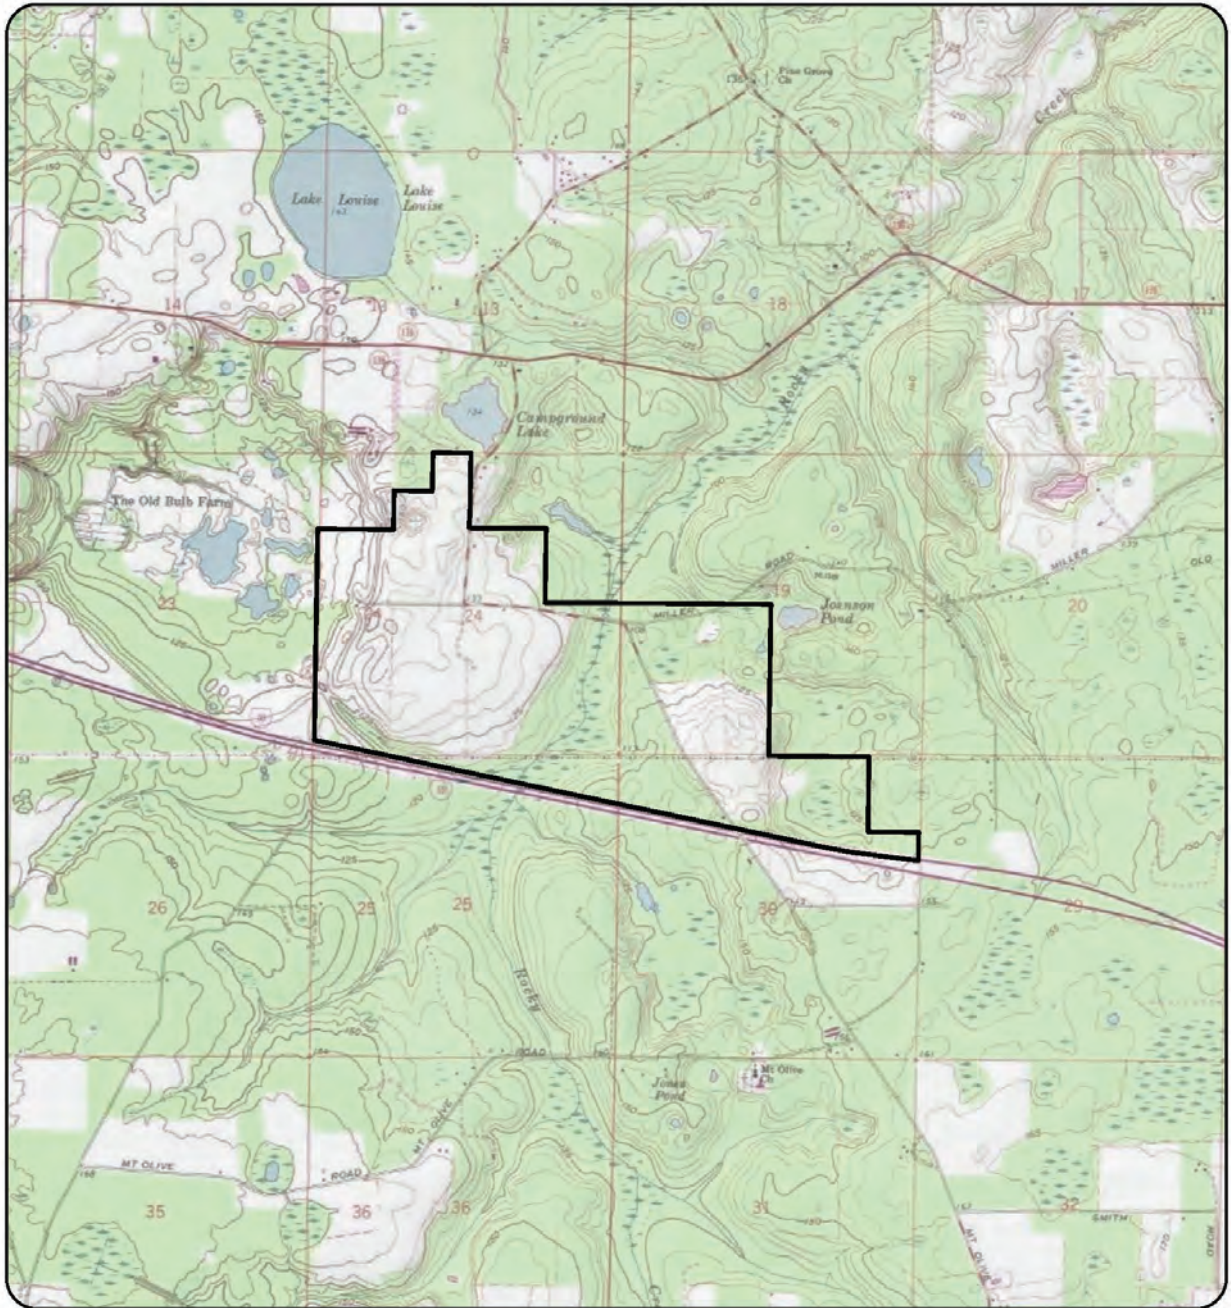


 Echo River Solar Energy Center

Echo River Solar Energy Center

USGS Topography Map




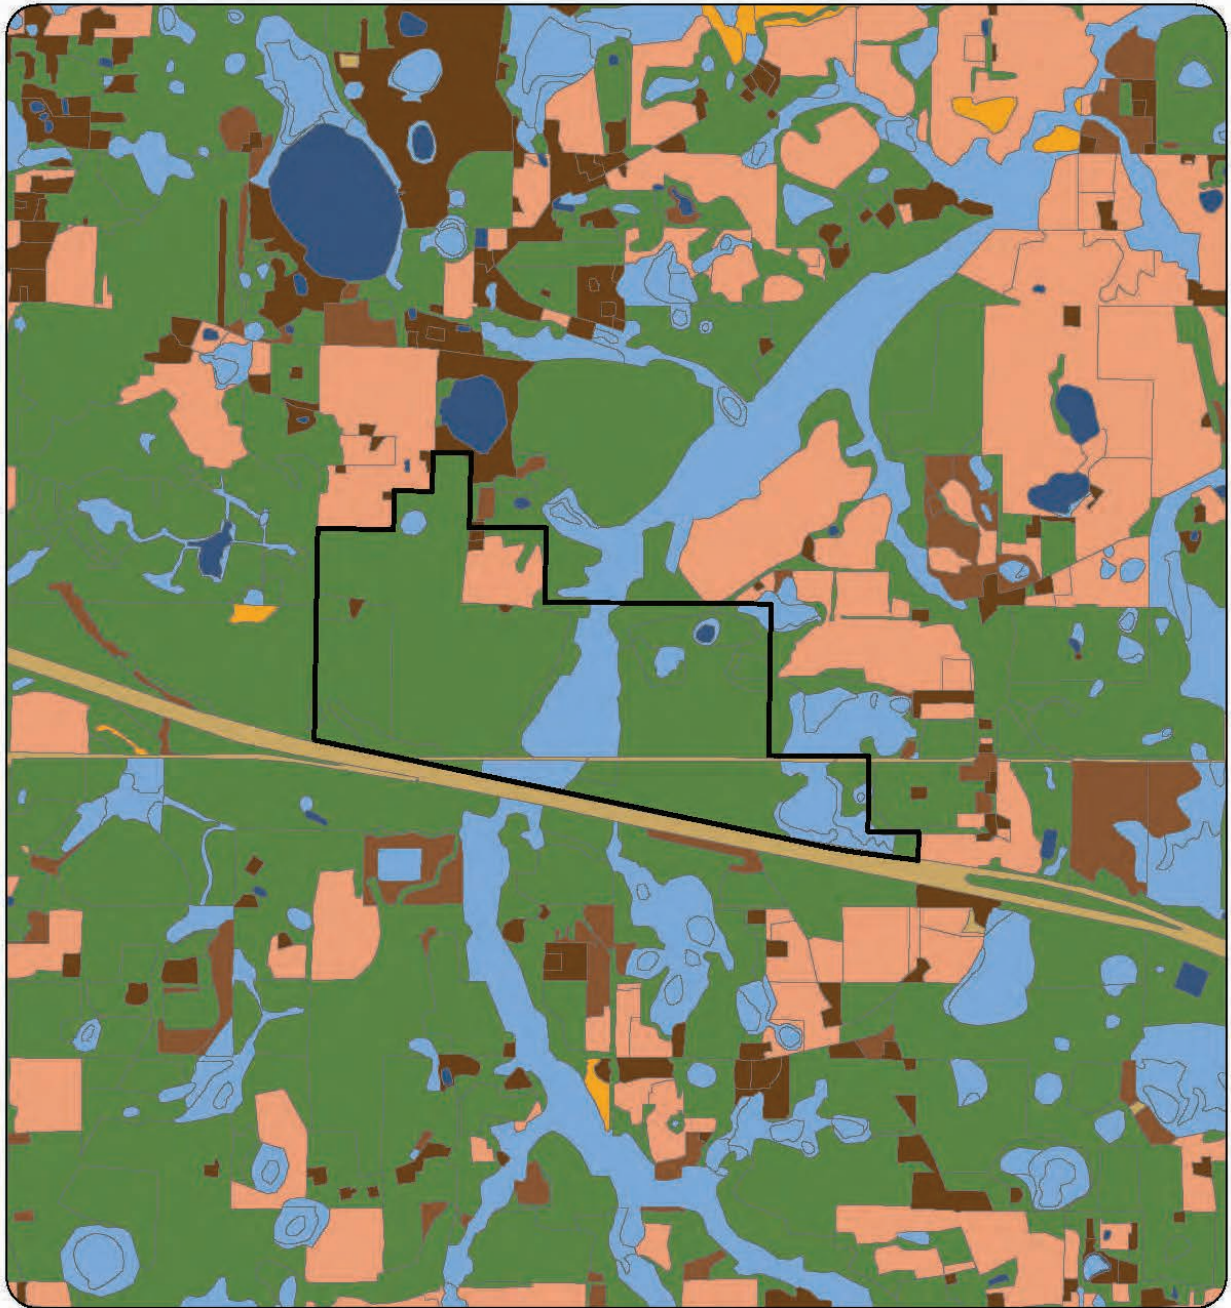

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Echo River Solar Energy Center

**Echo River Solar Energy Center
Land Use / Land Cover Map**



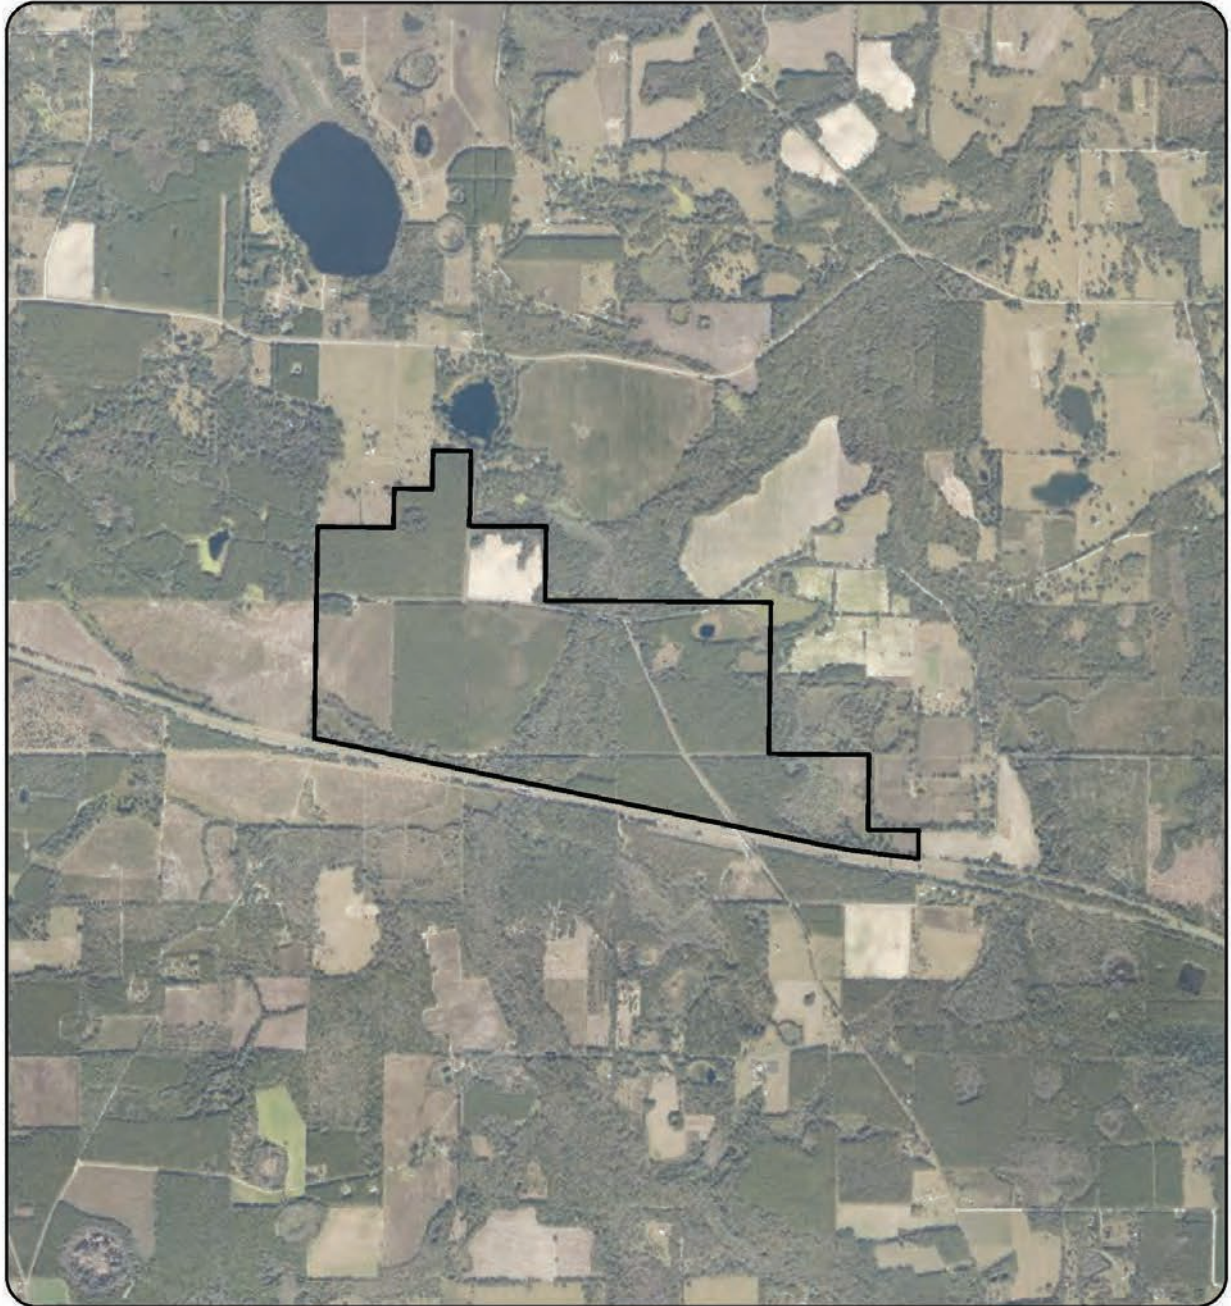

 Echo River Solar Energy Center


Echo River Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 5: Lakeside Solar Energy Center,
Okeechobee County***

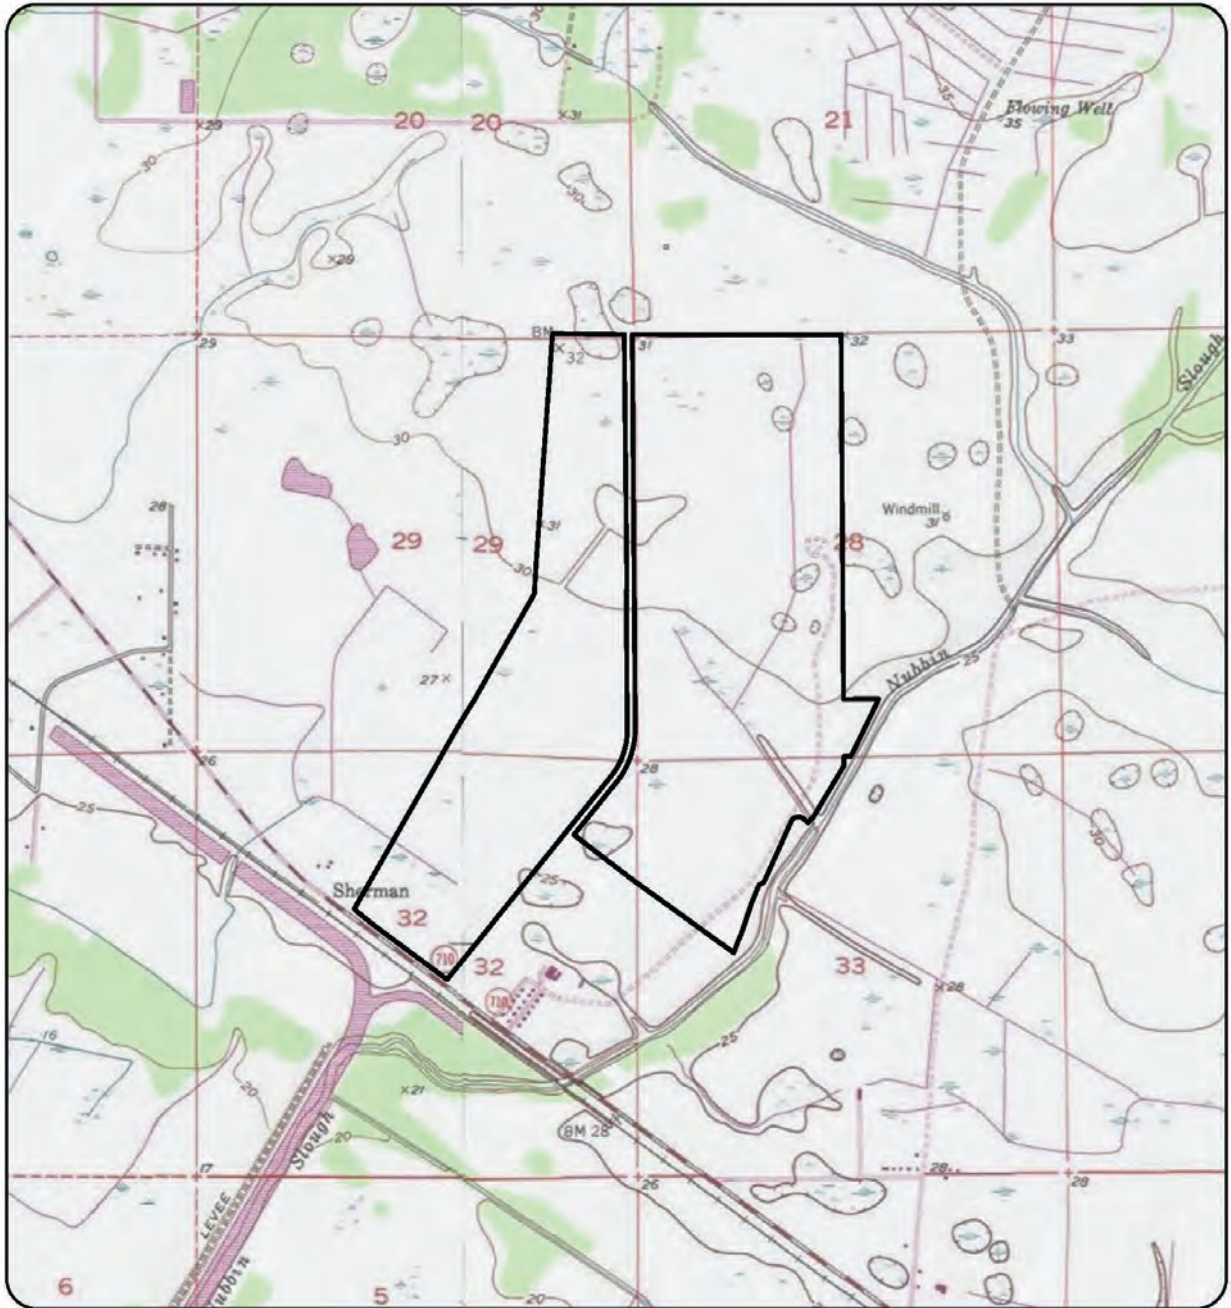

 Lakeside Solar Energy Center

Lakeside Solar Energy Center
USGS Topography Map




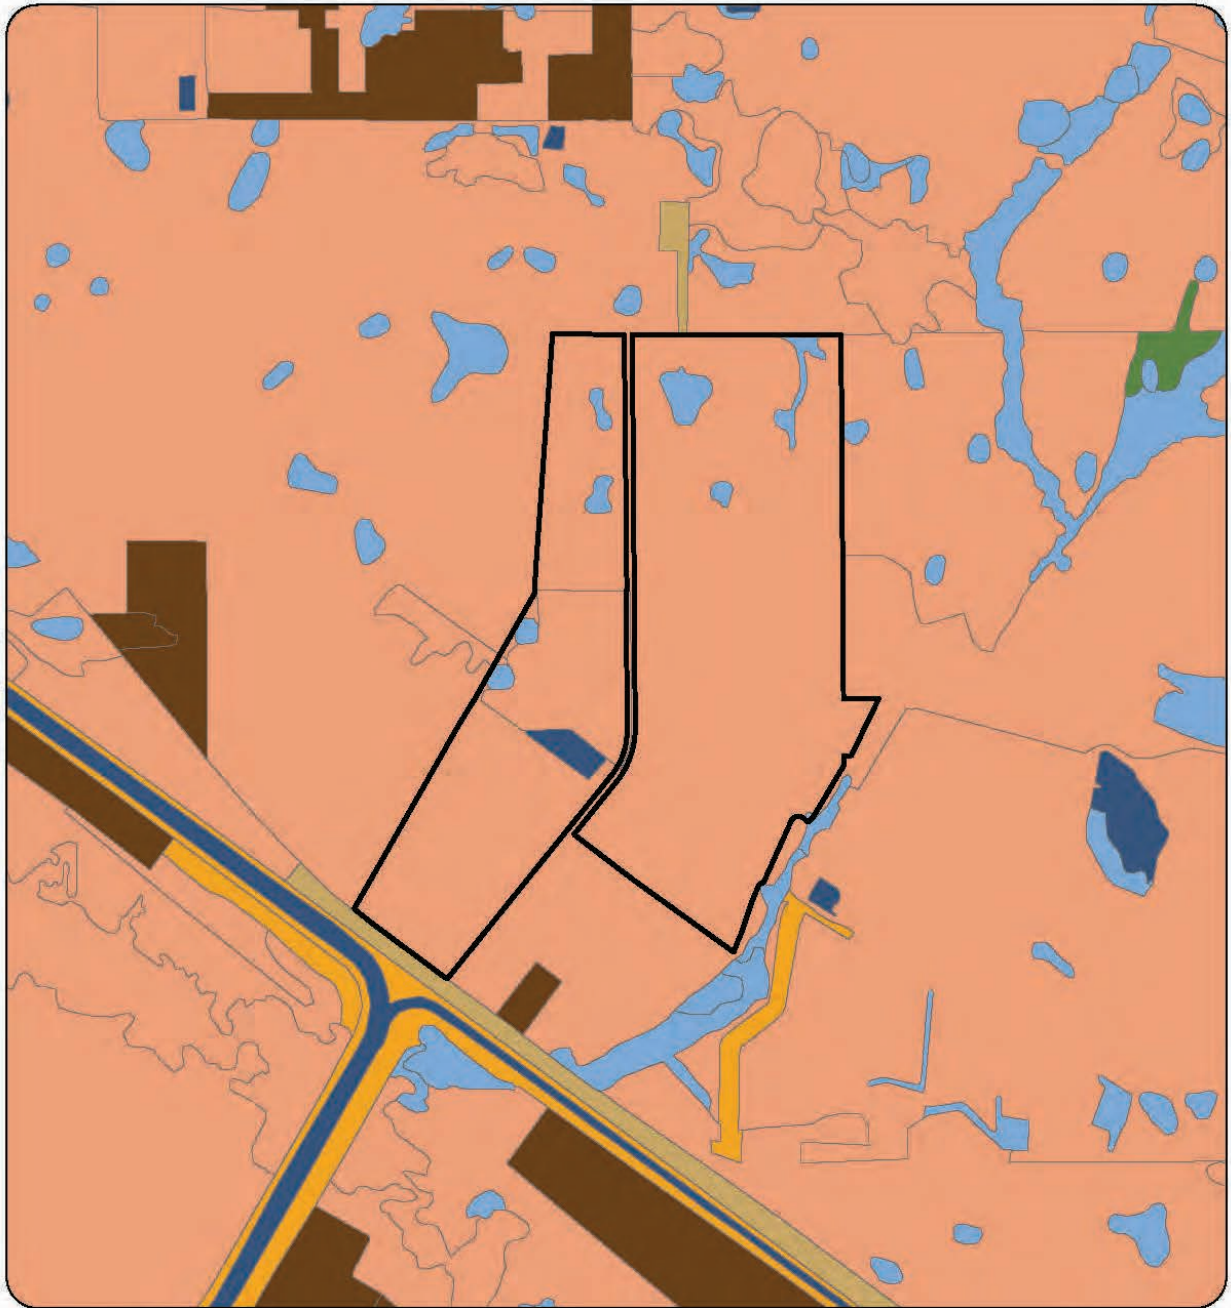

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Lakeside Solar Energy Center

**Lakeside Solar Energy Center
Land Use / Land Cover Map**



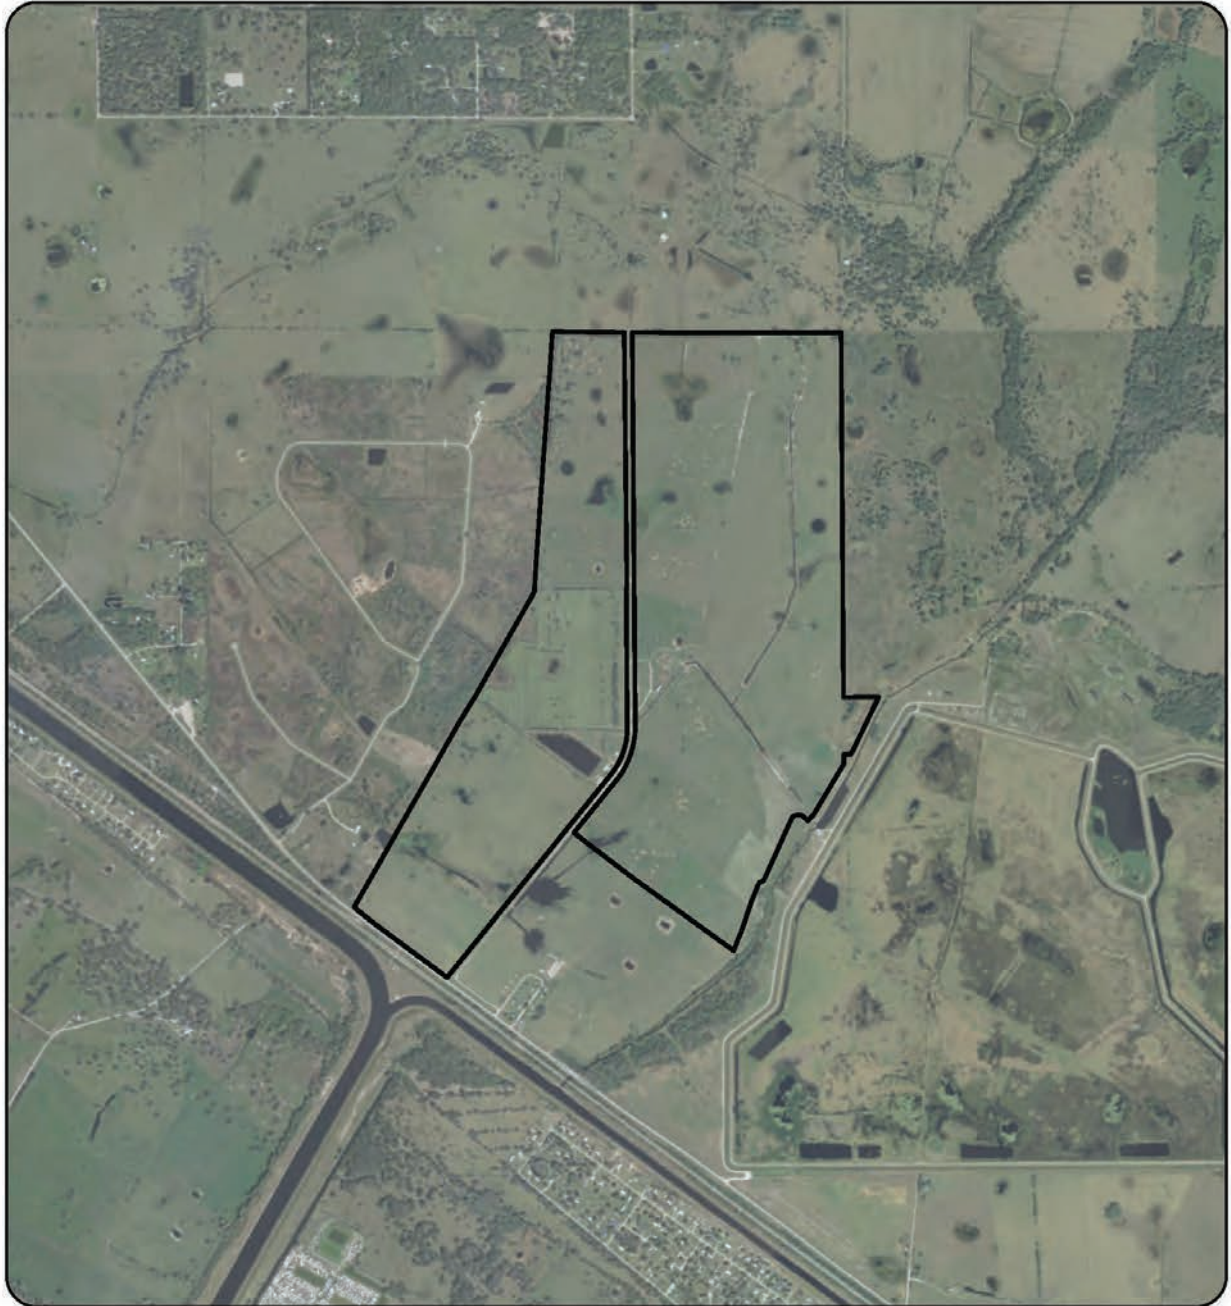

 Lakeside Solar Energy Center


Lakeside Solar Energy Center


Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 6: Trailside Solar Energy Center,
St. Johns County***

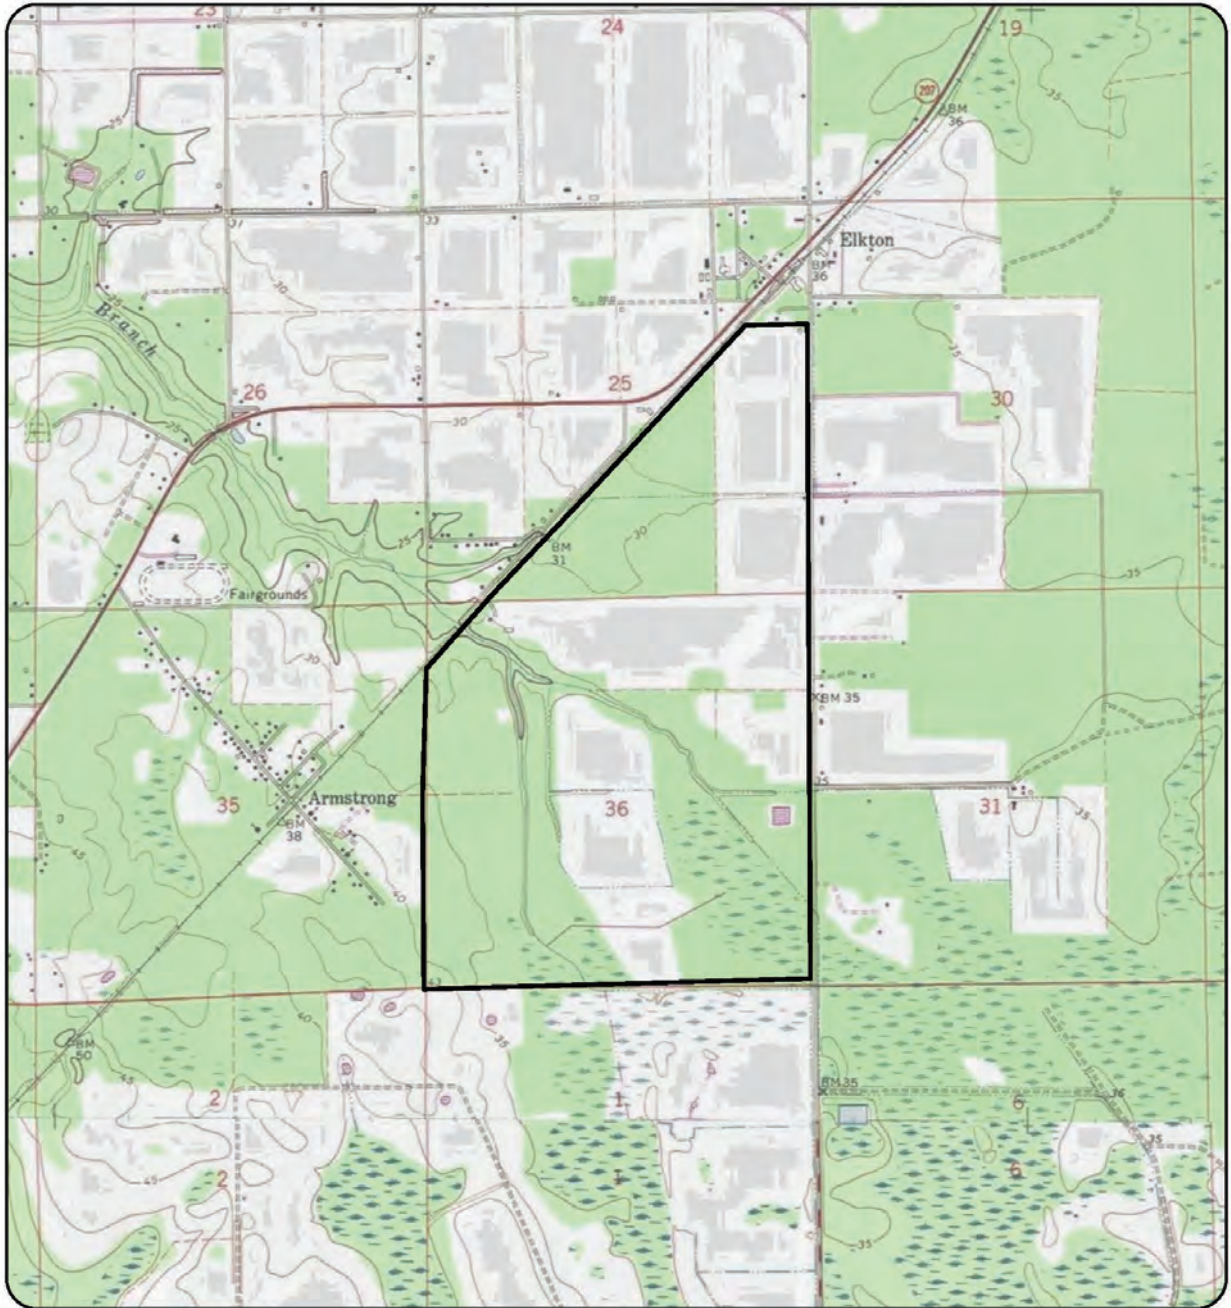

 Trailside Solar Energy Center

Trailside Solar Energy Center
USGS Topography Map




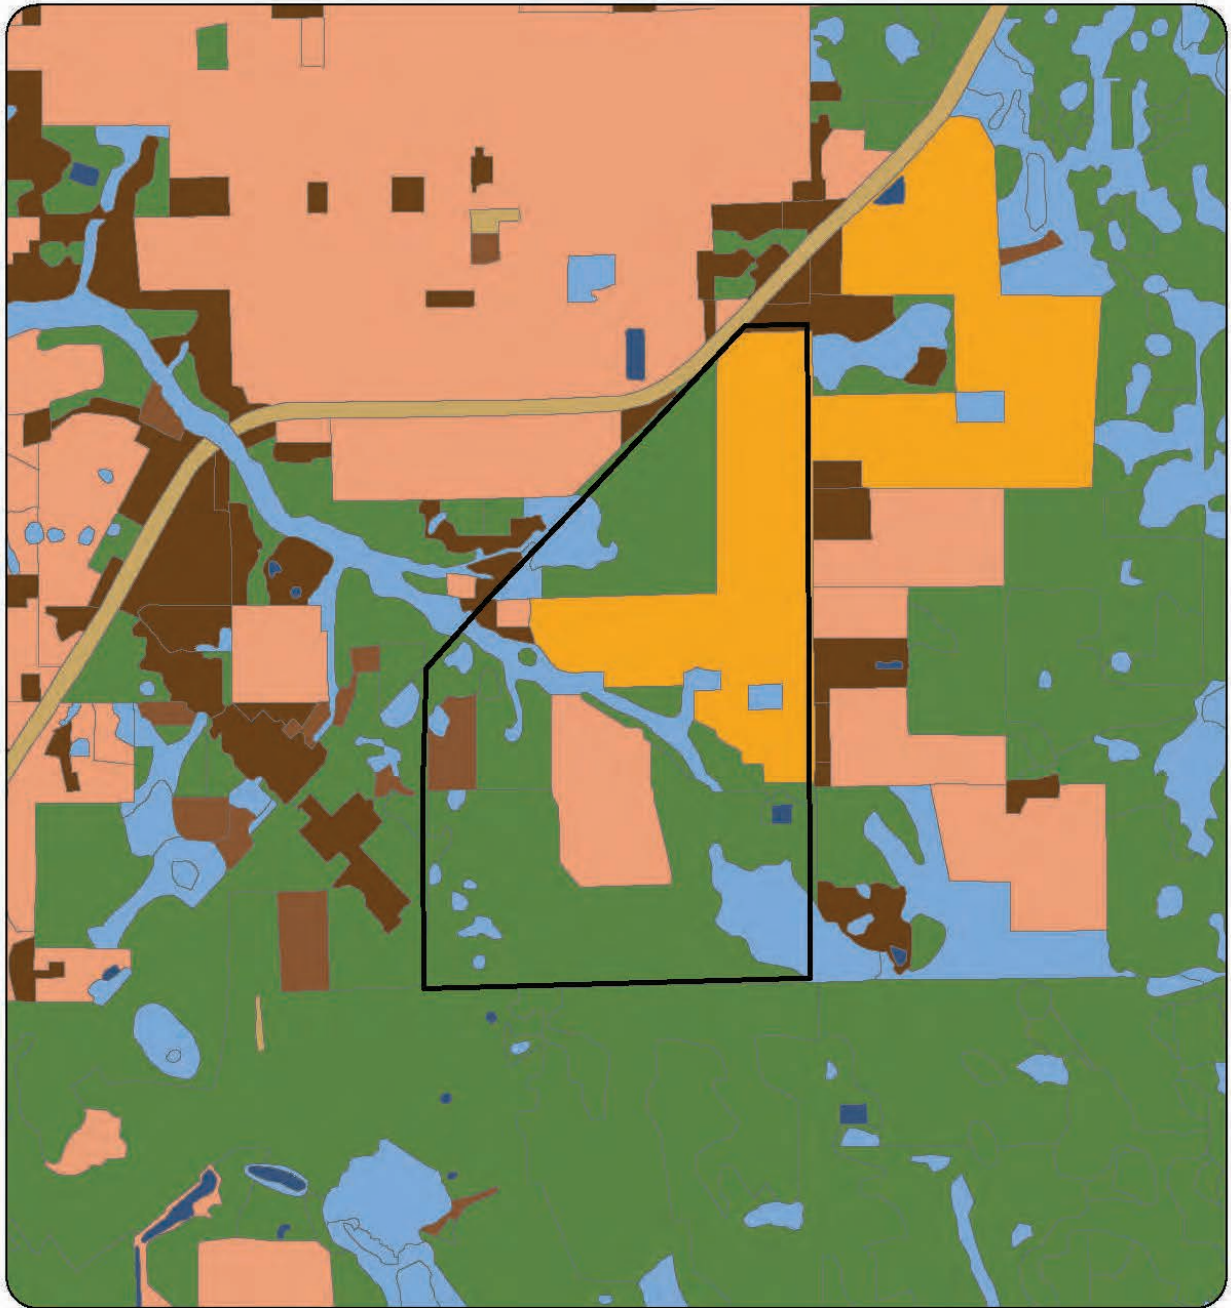

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Trailside Solar Energy Center

Trailside Solar Energy Center
Land Use / Land Cover Map



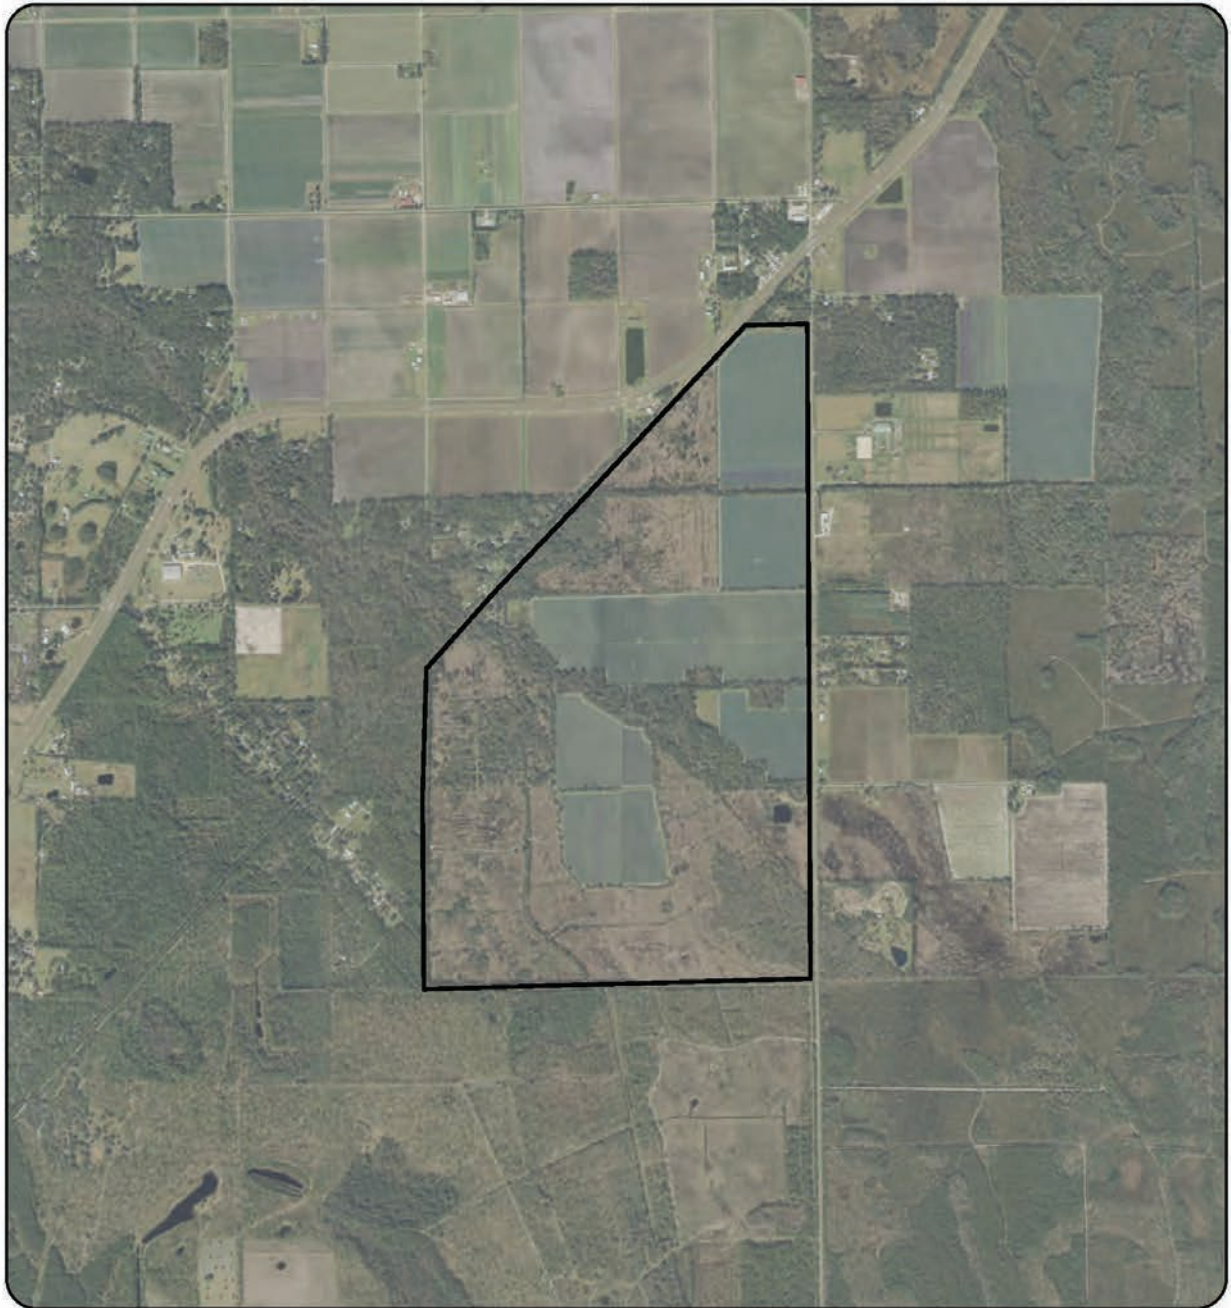

 Trailside Solar Energy Center


Trailside Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***

***Preferred Site # 7: Union Springs Solar Energy Center,
Union County***

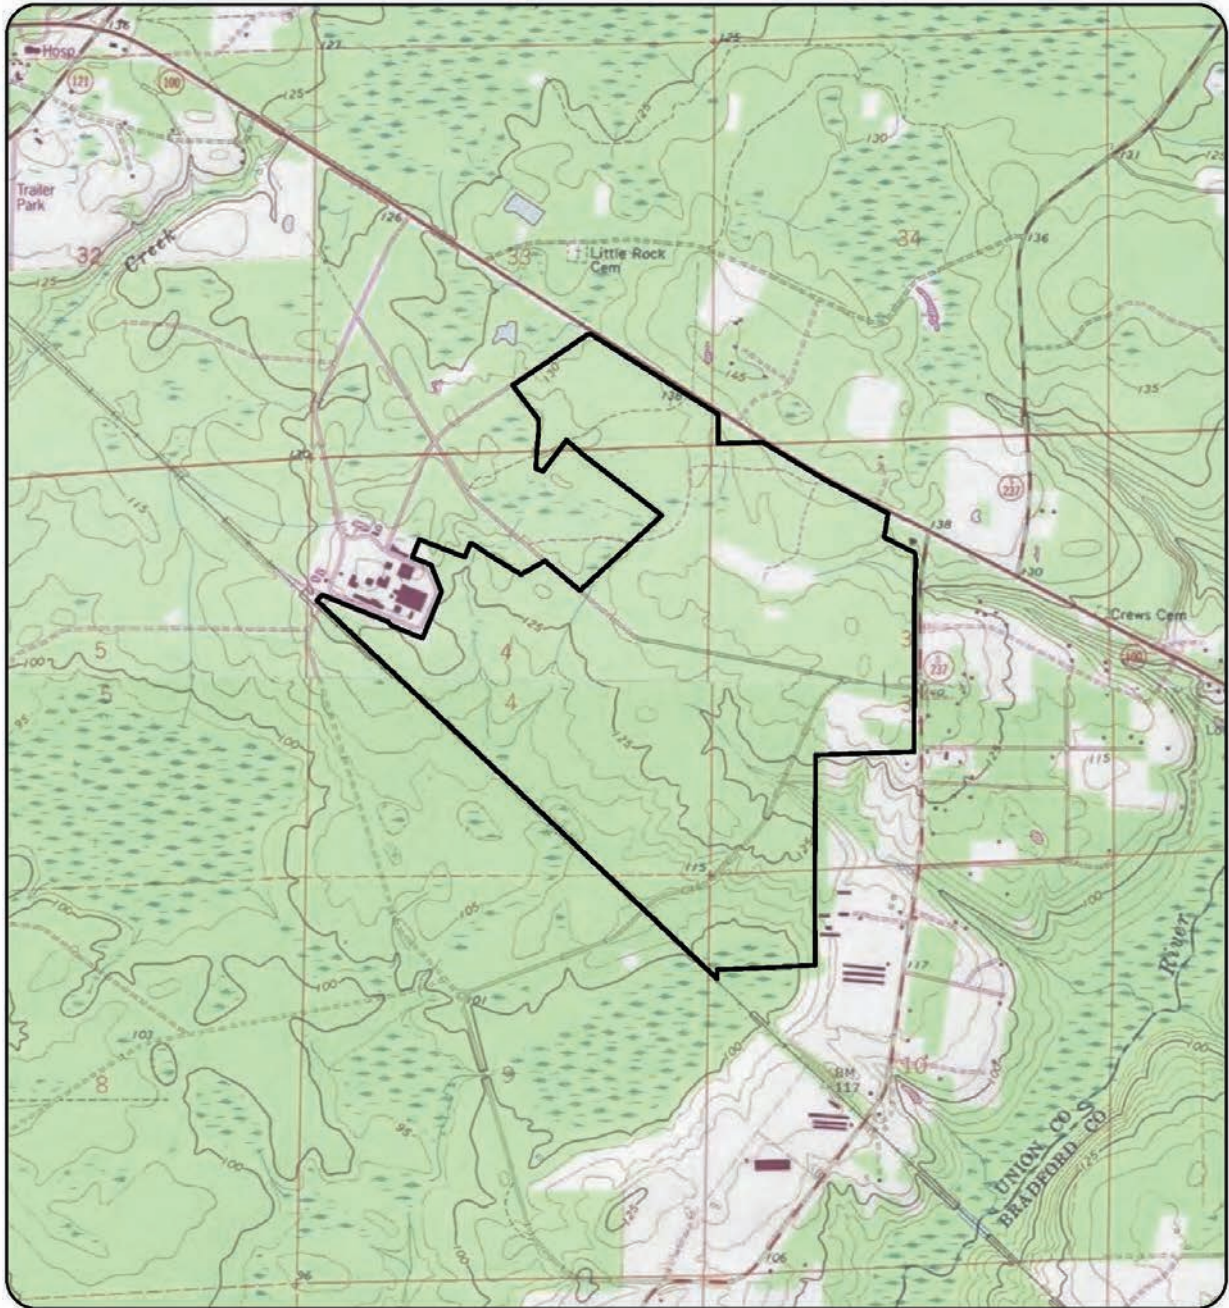


 Union Springs Solar Energy Center

Union Springs Solar Energy Center

USGS Topography Map




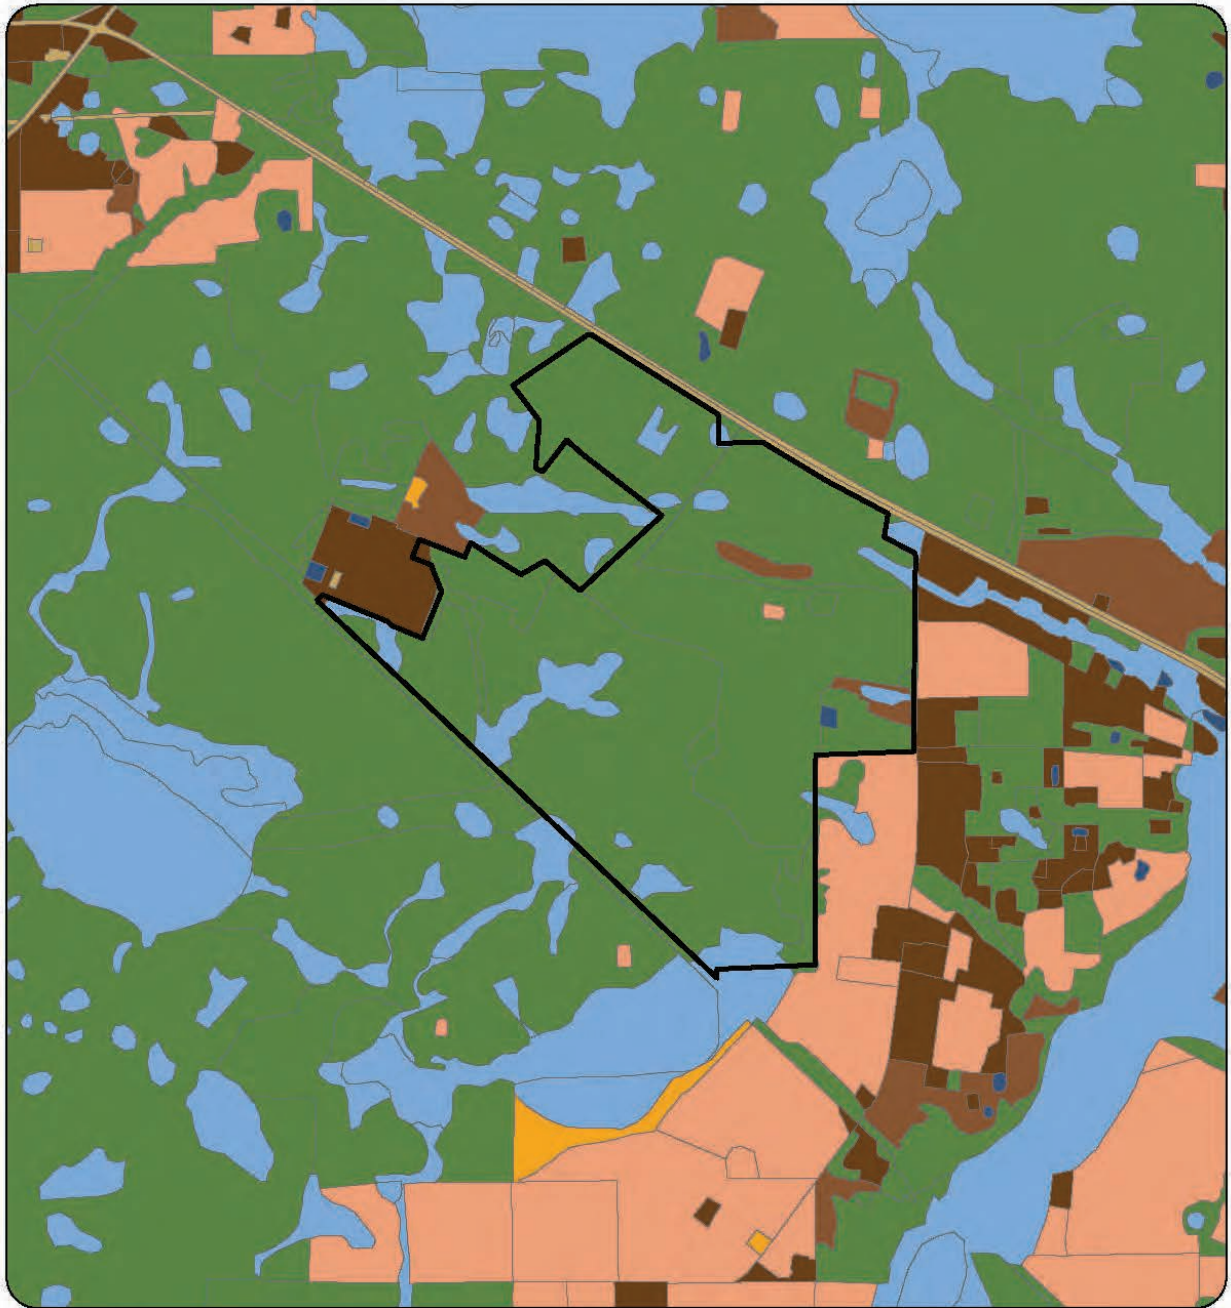

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Union Springs Solar Energy Center

Union Springs Solar Energy Center
Land Use / Land Cover Map



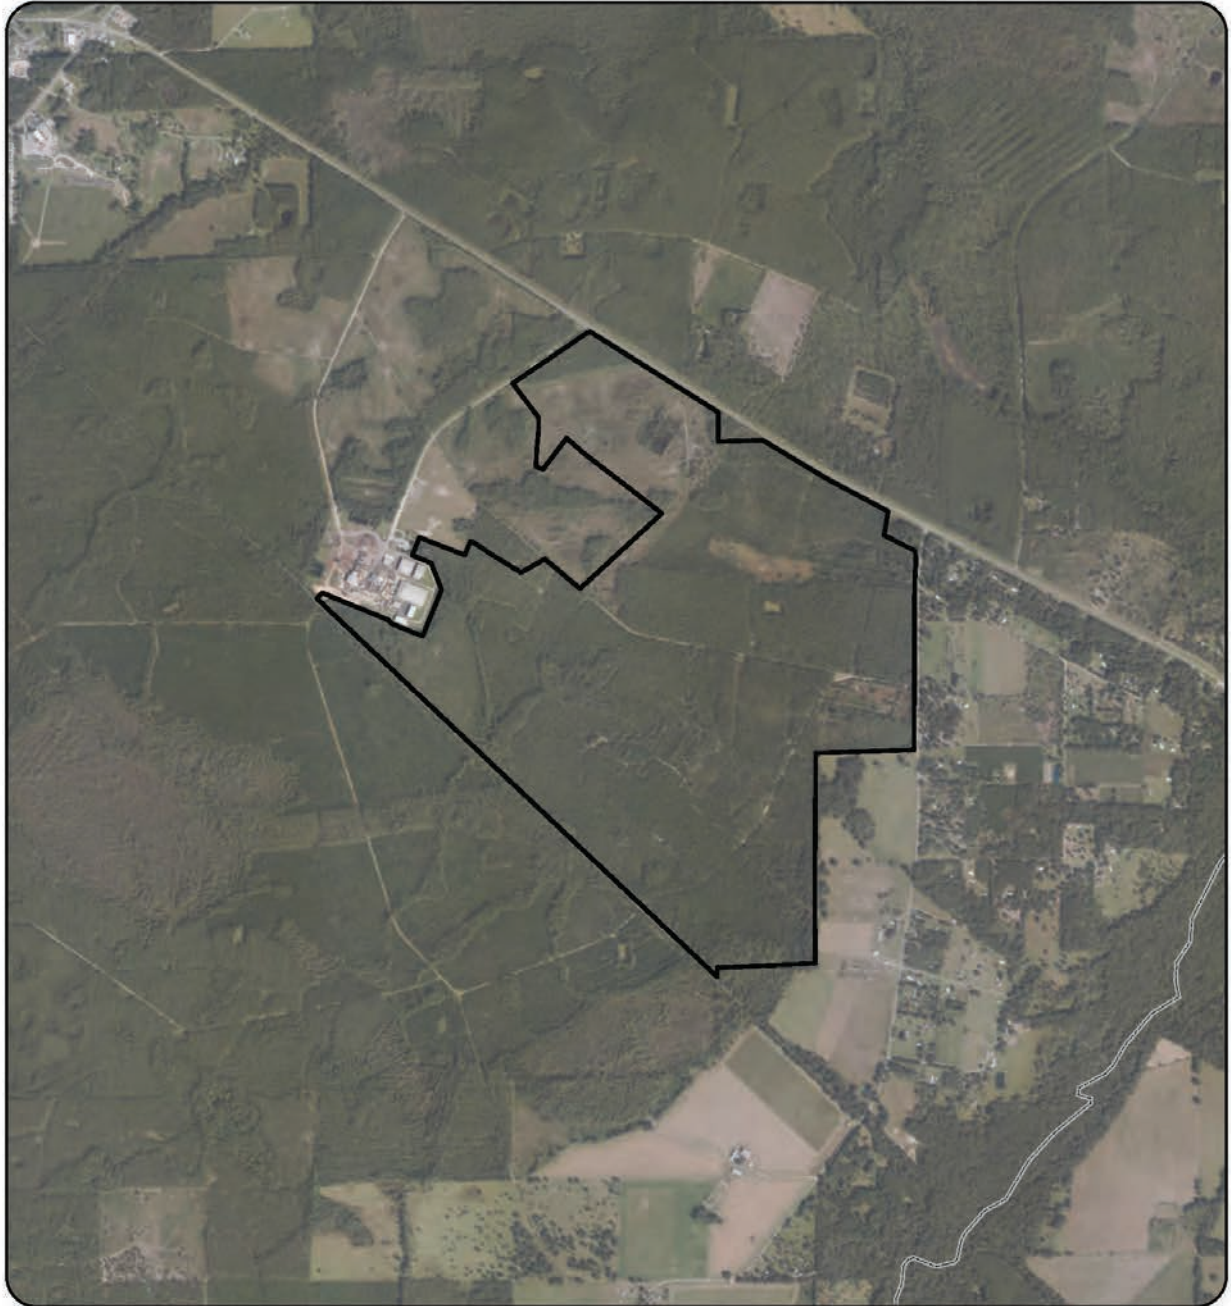

 Union Springs Solar Energy Center


Union Springs Solar Energy Center


Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 8: Magnolia Springs Solar Energy Center,
Clay County***

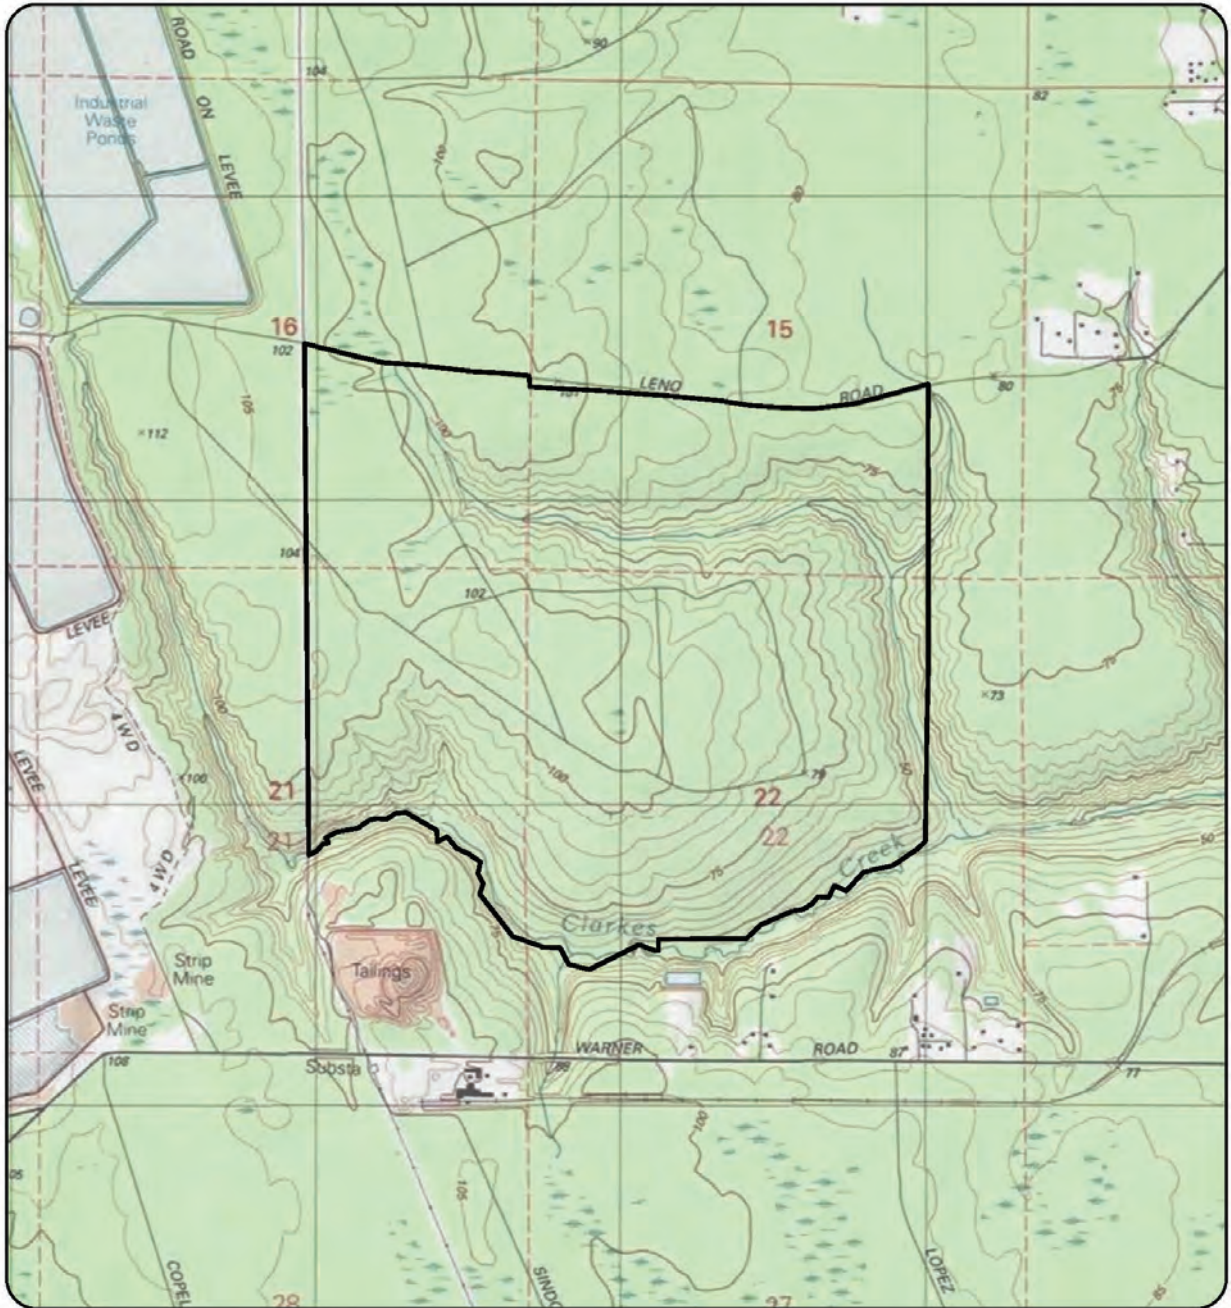

 Magnolia Springs Solar Energy Center


Magnolia Springs Solar Energy Center
USGS Topography Map




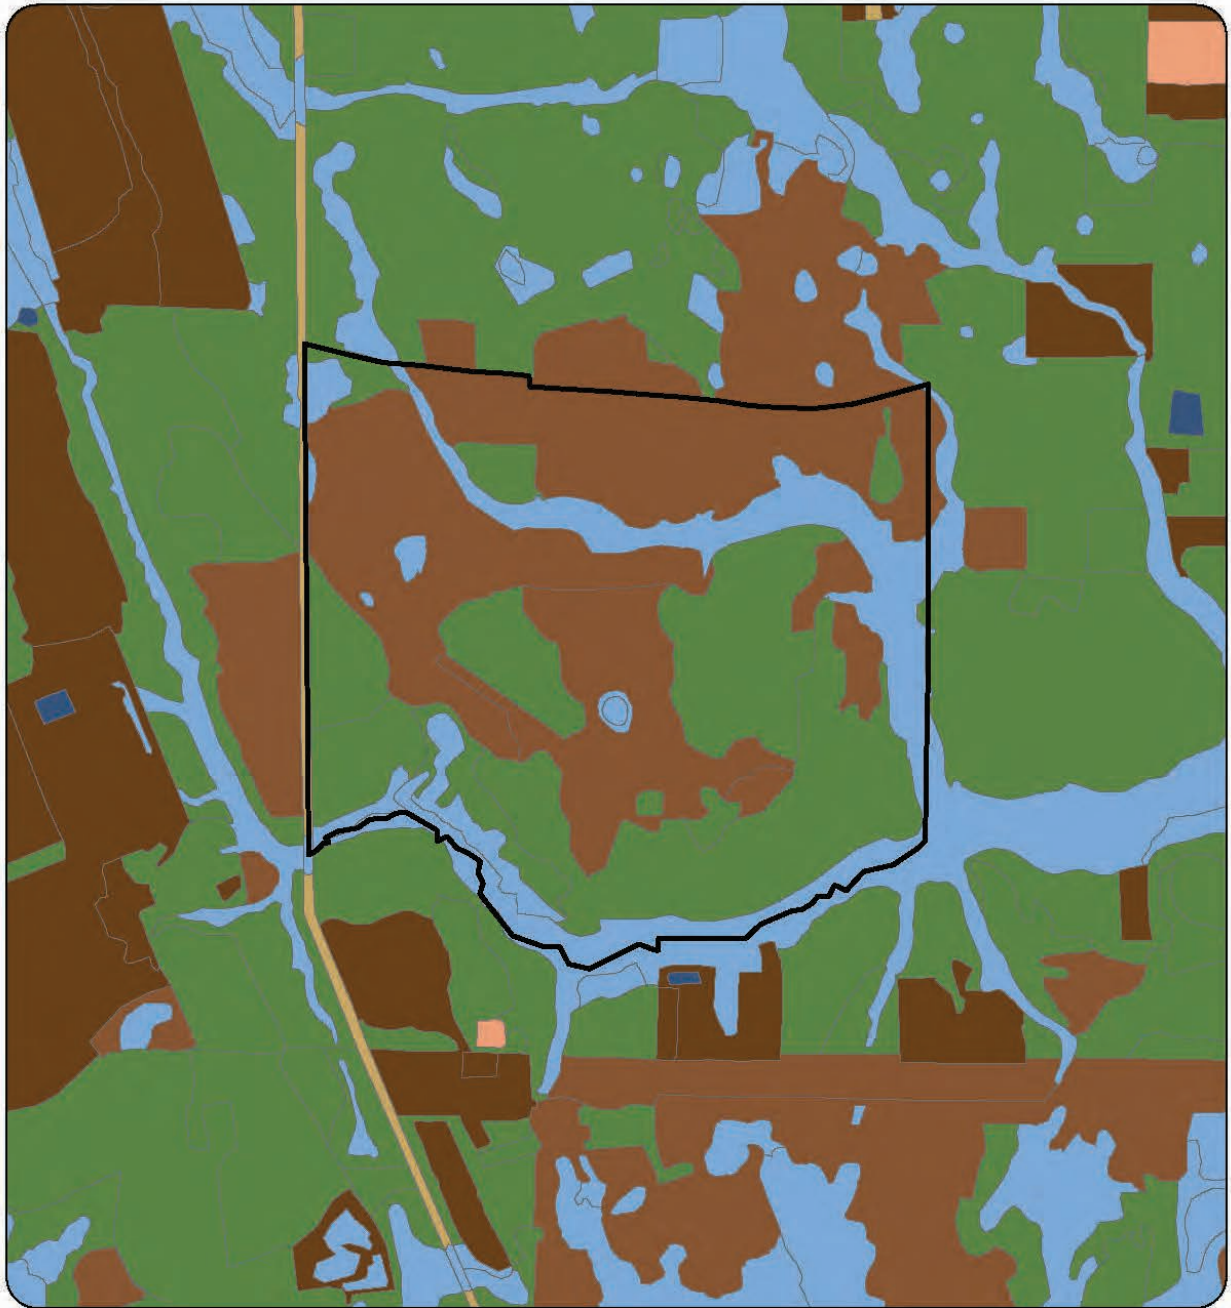

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Magnolia Springs Solar Energy Center

**Magnolia Springs Solar Energy Center
Land Use / Land Cover Map**



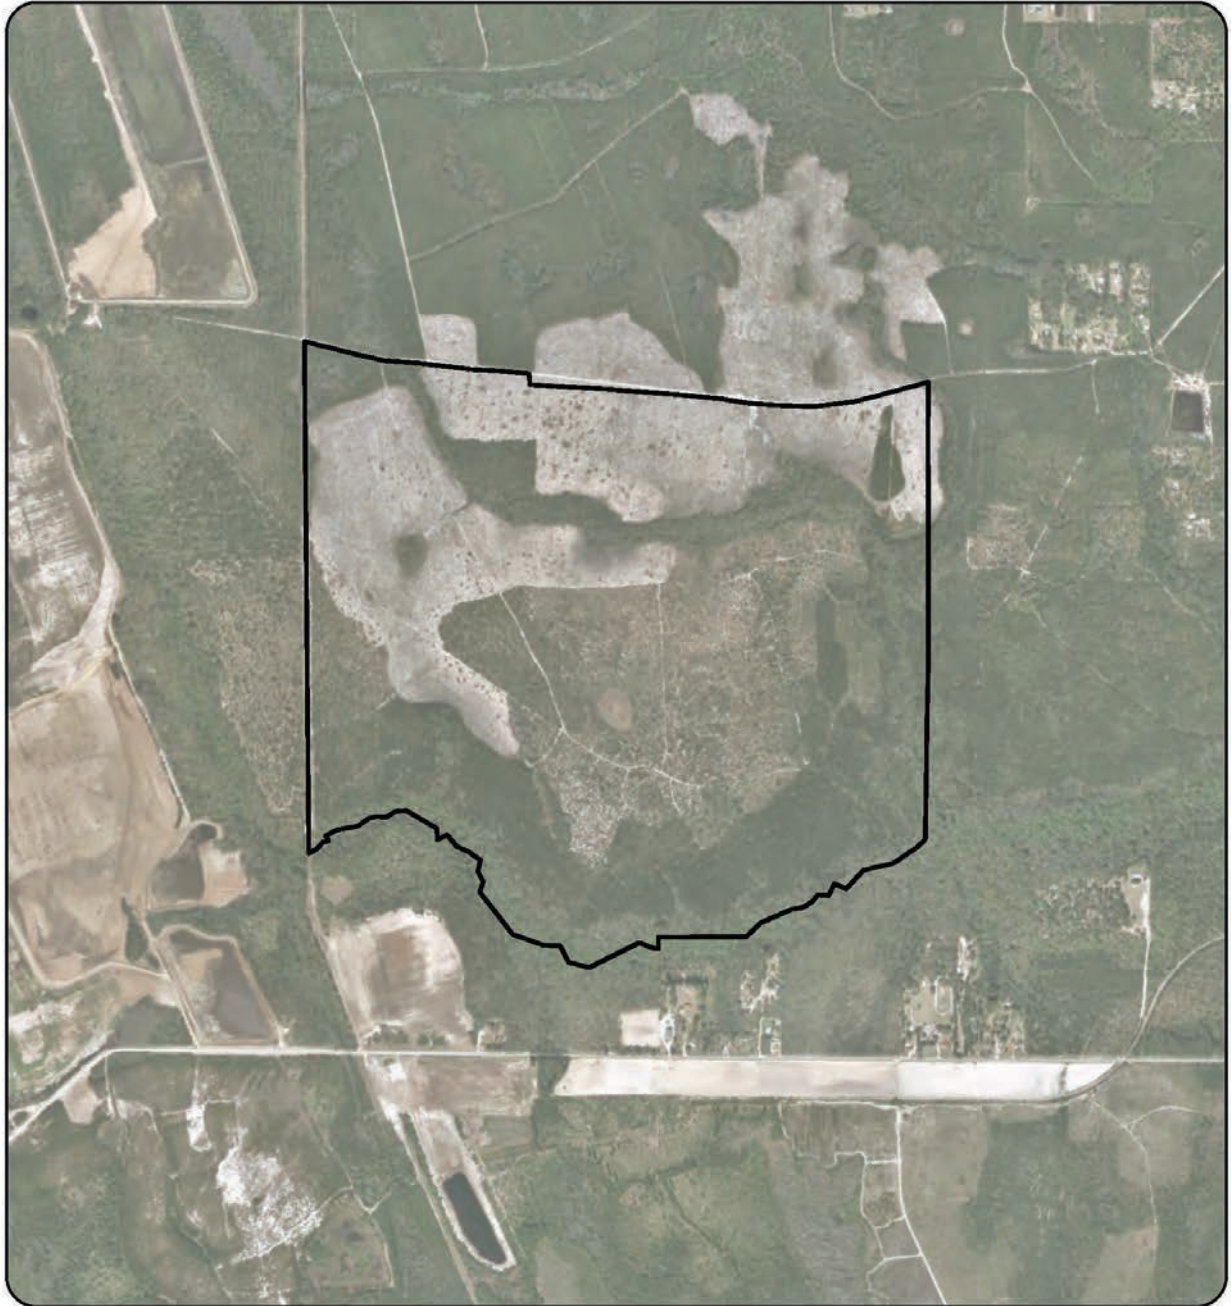

 Magnolia Springs Solar Energy Center


Magnolia Springs Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 9: Egret Solar Energy Center,
Baker County***

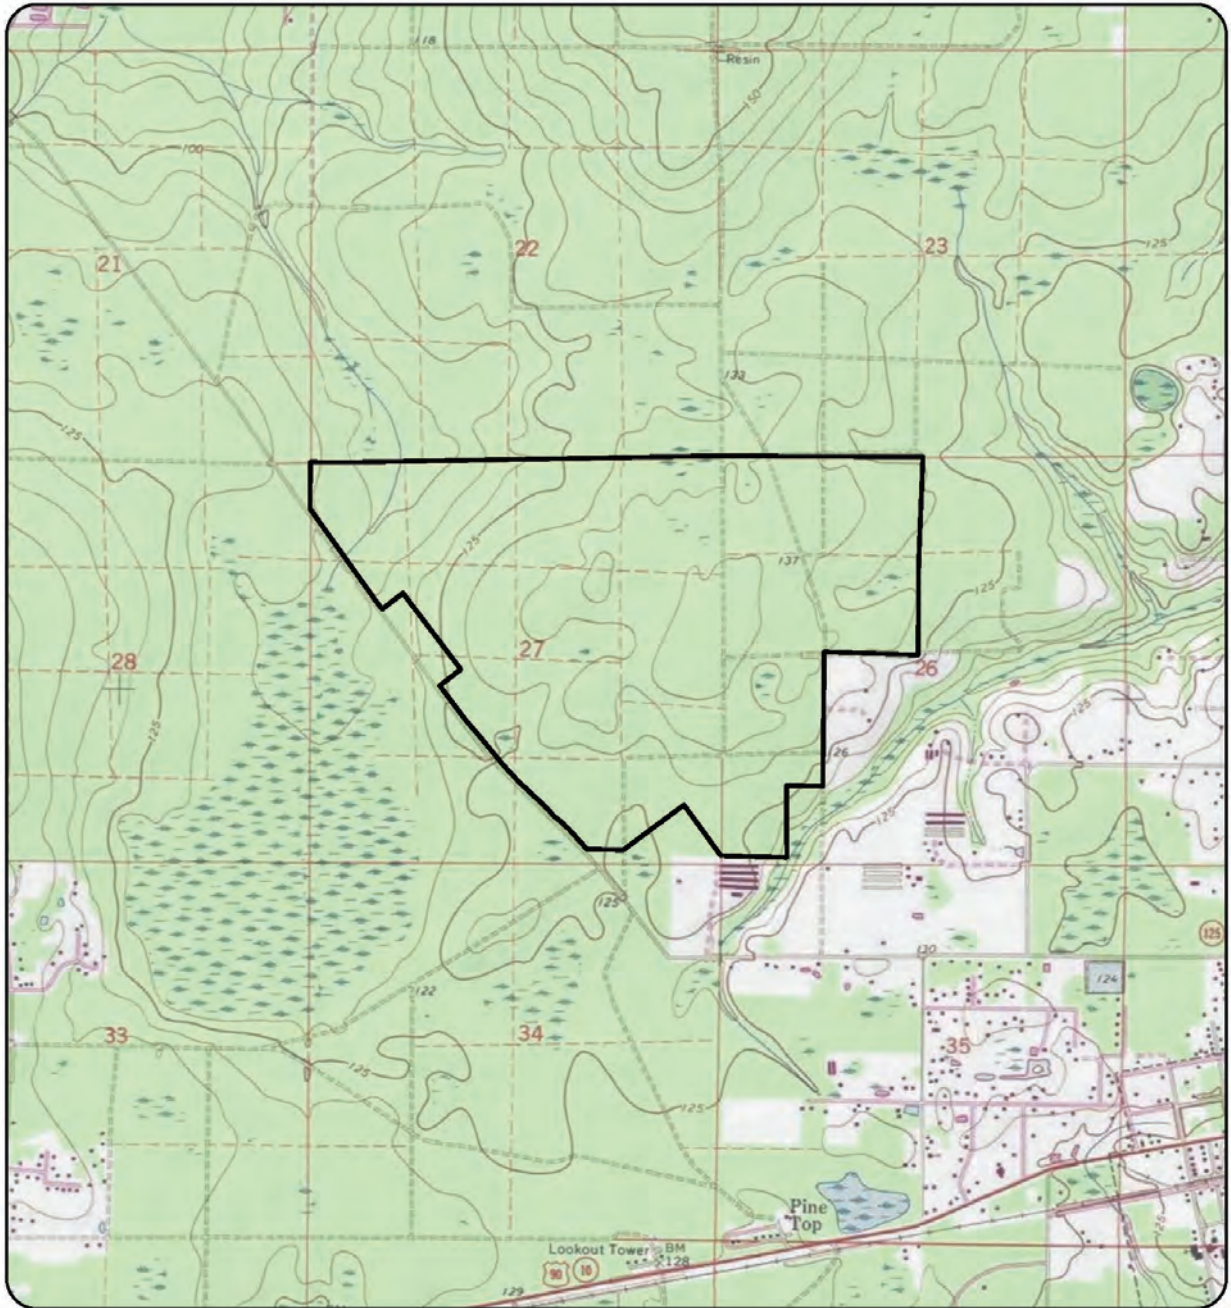

 Egret Solar Energy Center

Egret Solar Energy Center
USGS Topography Map




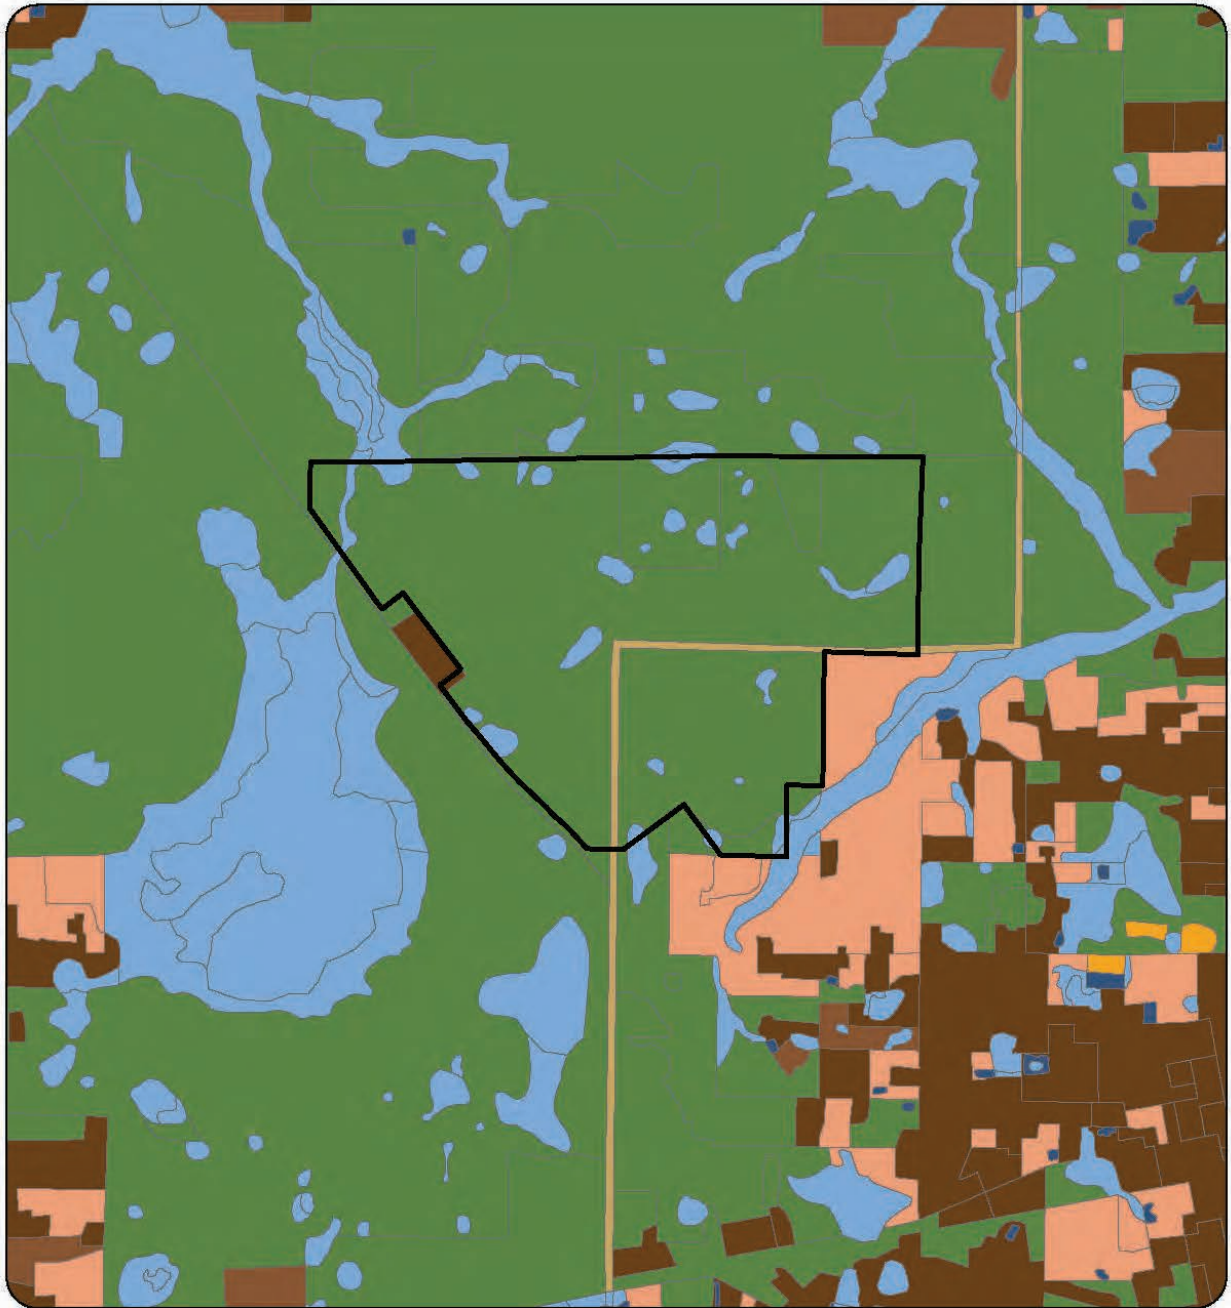

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Egret Solar Energy Center

**Egret Solar Energy Center
Land Use / Land Cover Map**



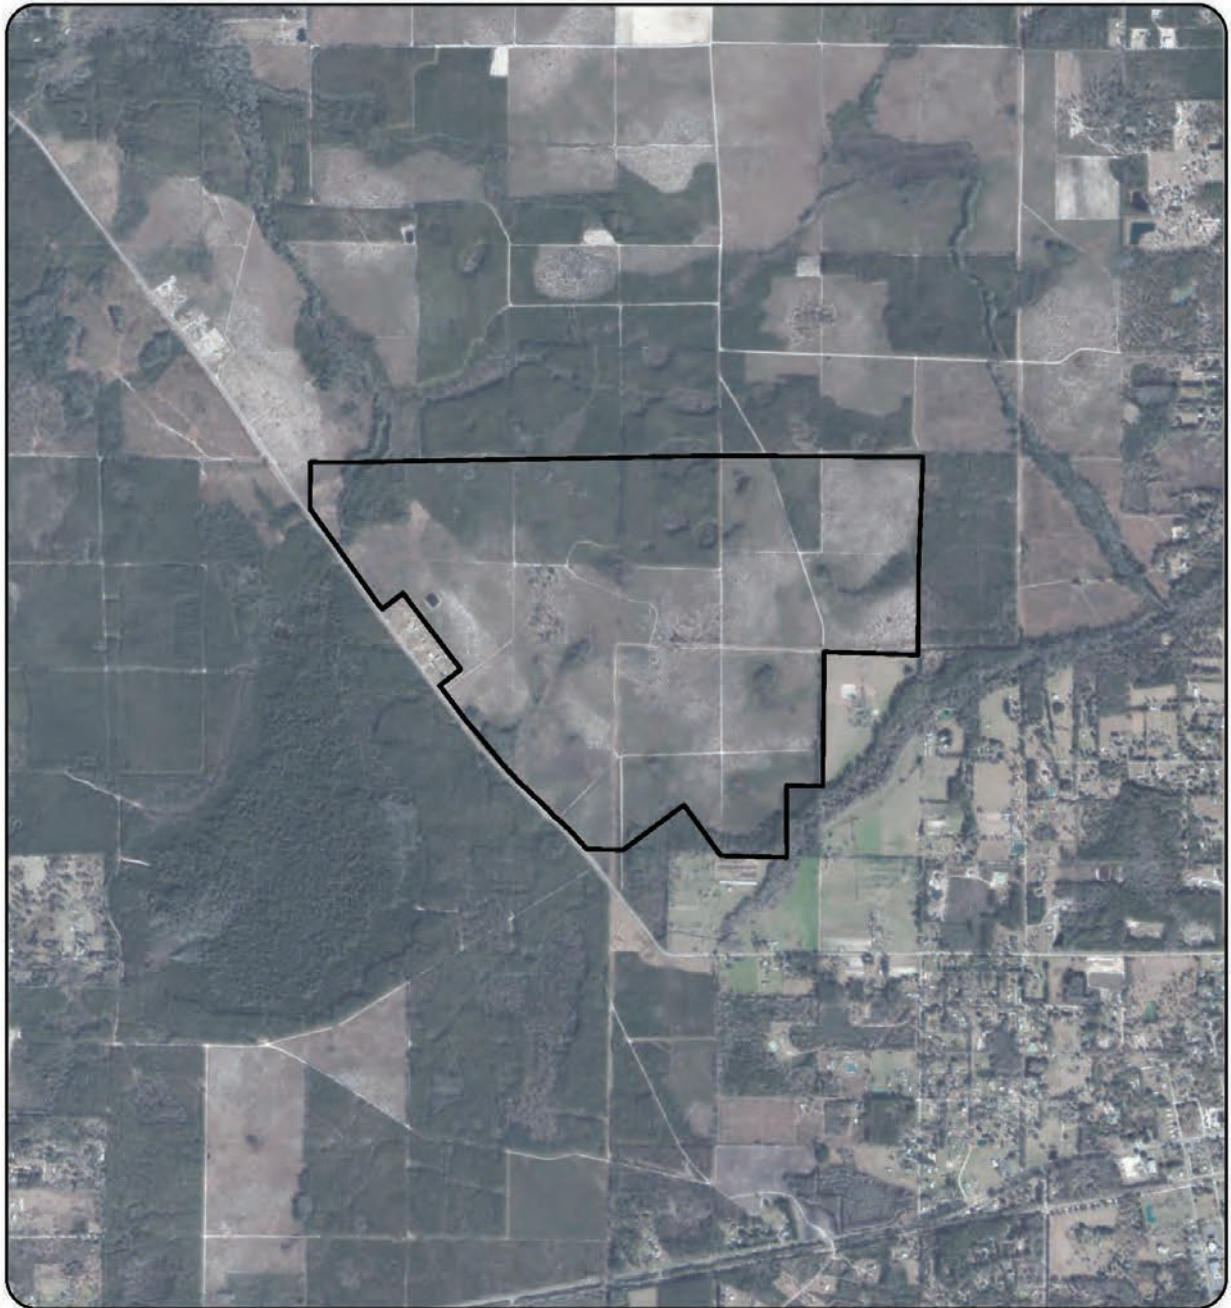

 Egret Solar Energy Center


Egret Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 10: Nassau Solar Energy Center,
Nassau County***

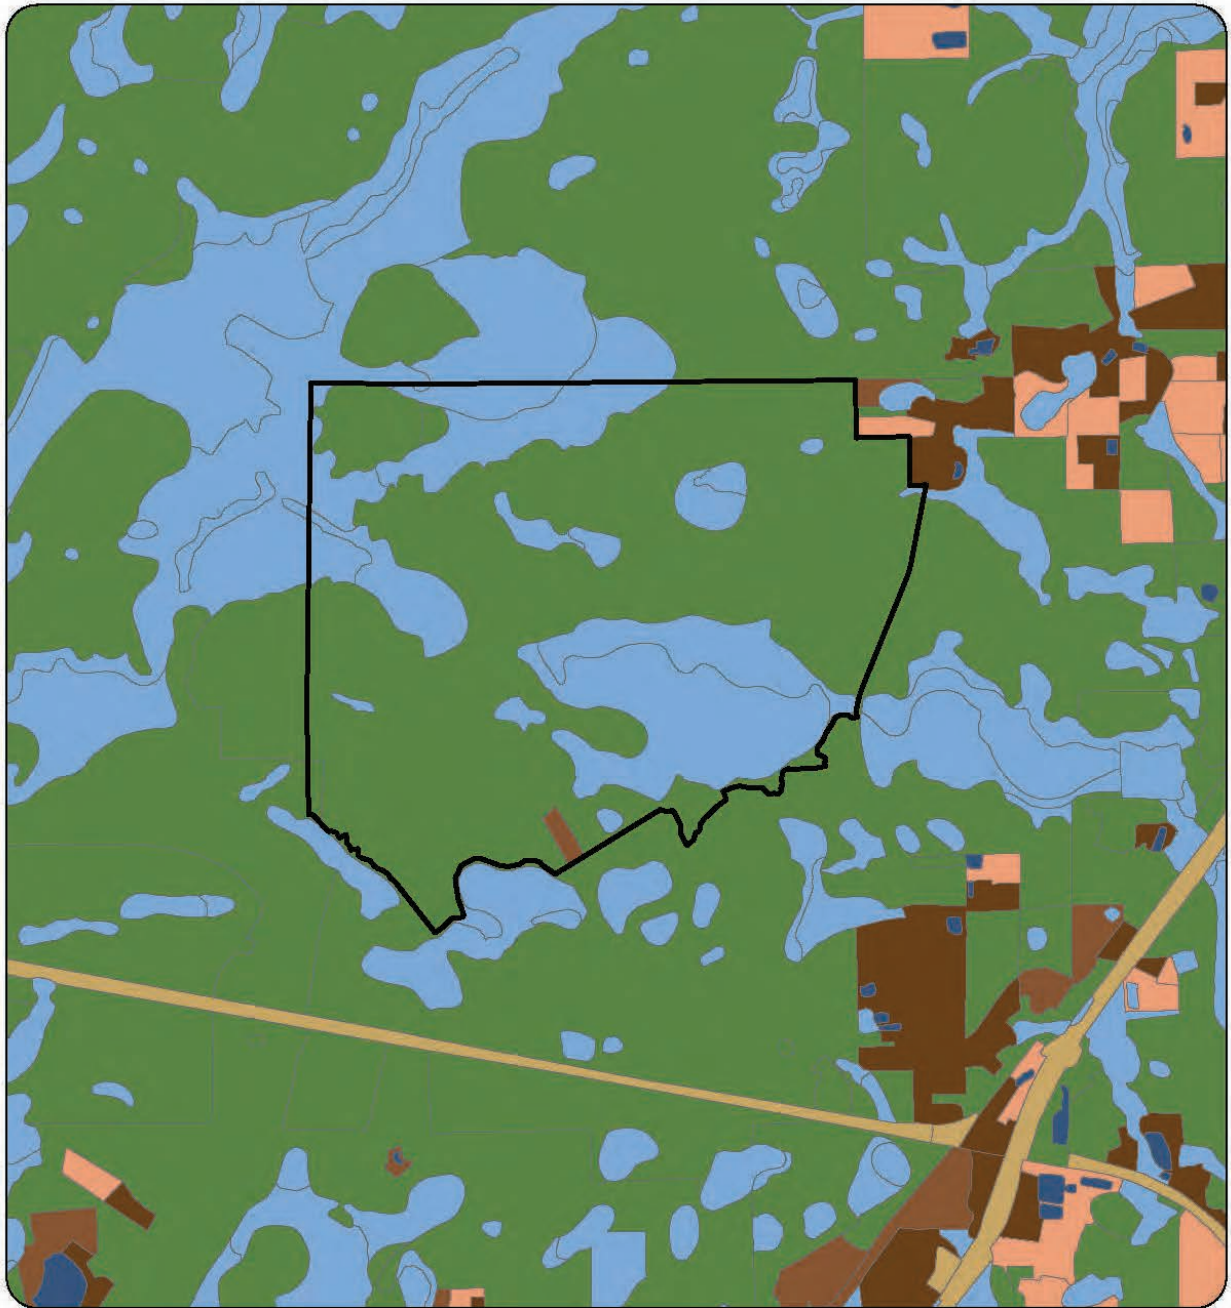

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Nassau Solar Energy Center

**Nassau Solar Energy Center
Land Use / Land Cover Map**



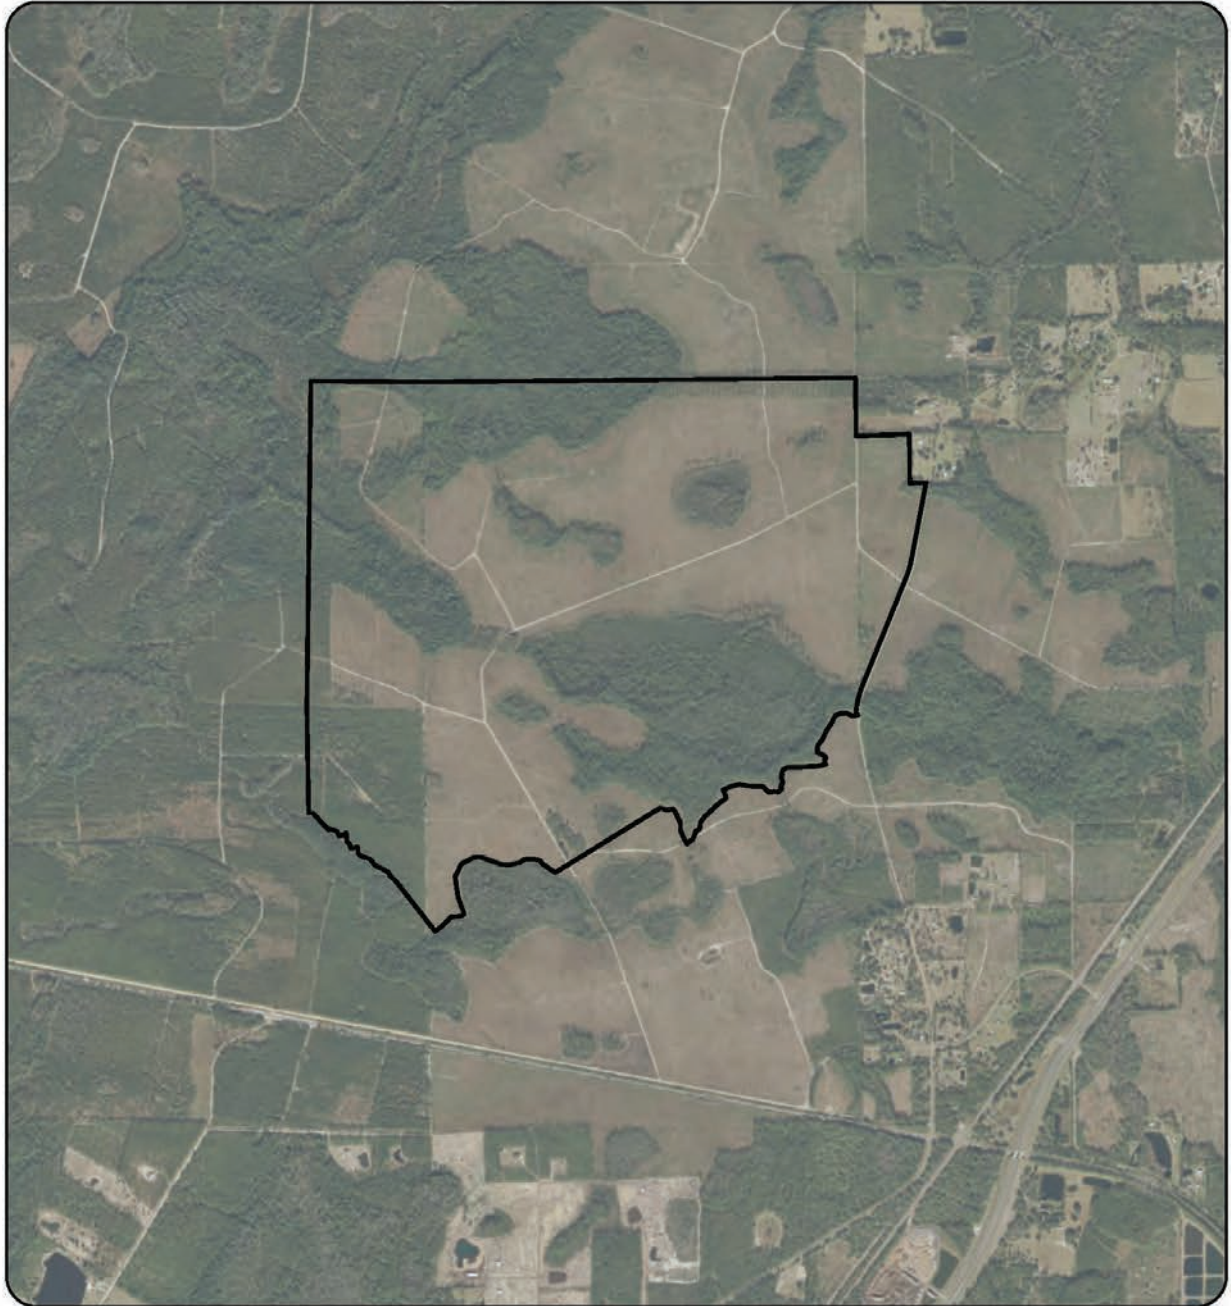

 Nassau Solar Energy Center


Nassau Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 11: Pelican Solar Energy Center,
St. Lucie County***

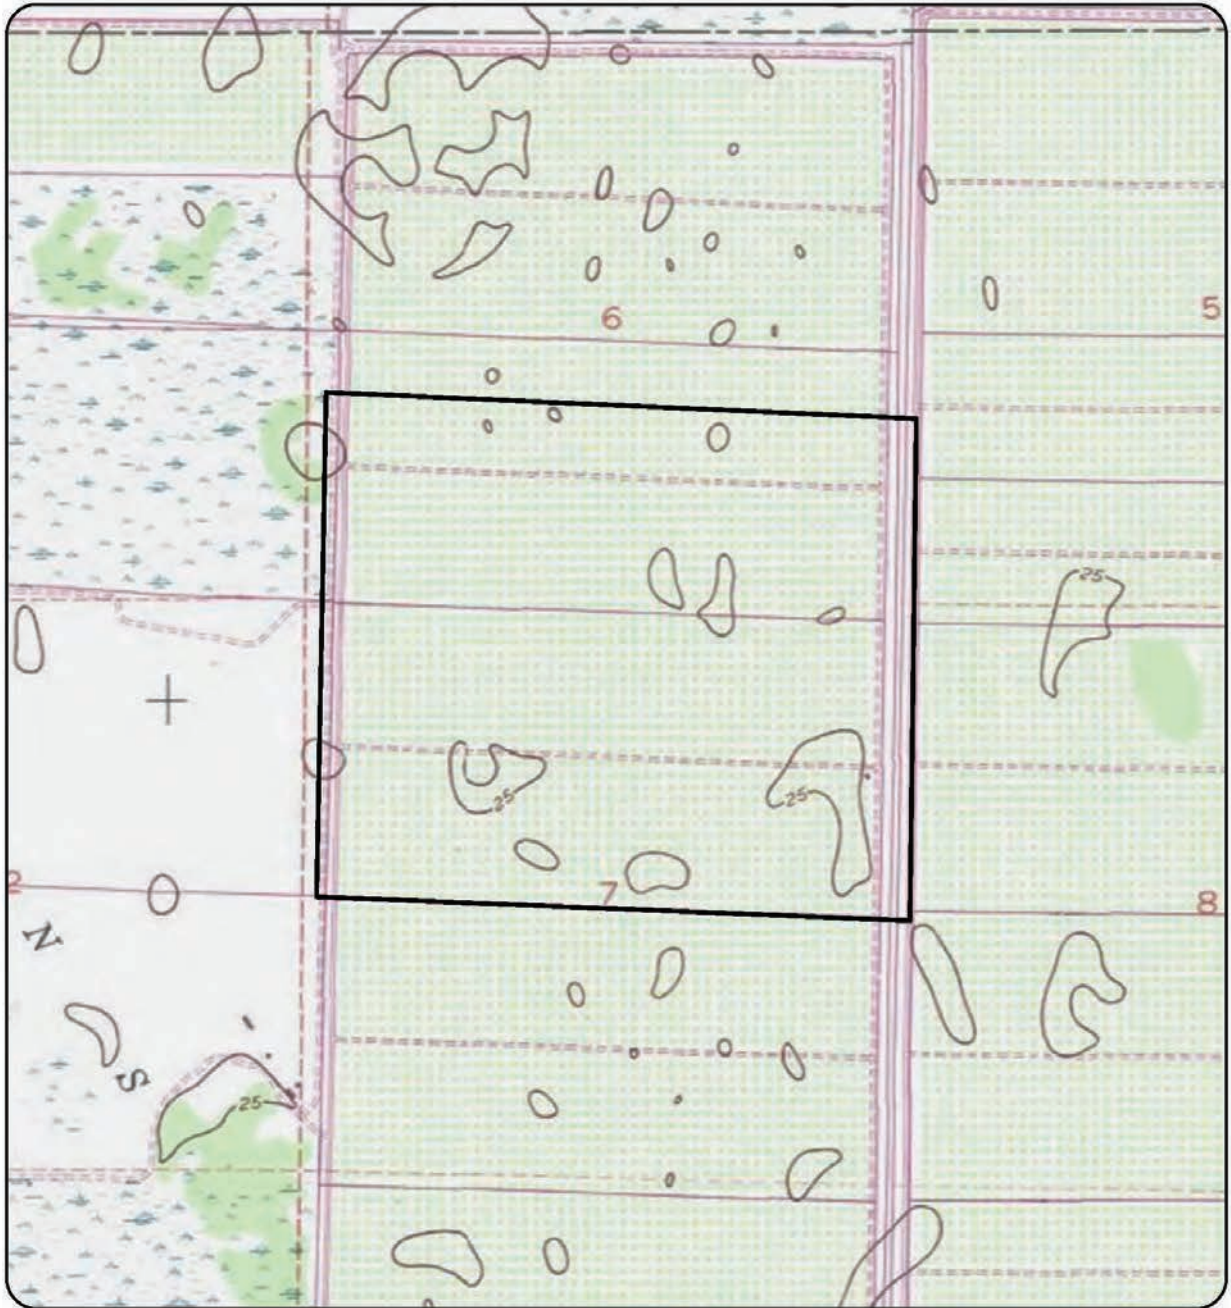

 Pelican Solar Energy Center

Pelican Solar Energy Center
USGS Topography Map



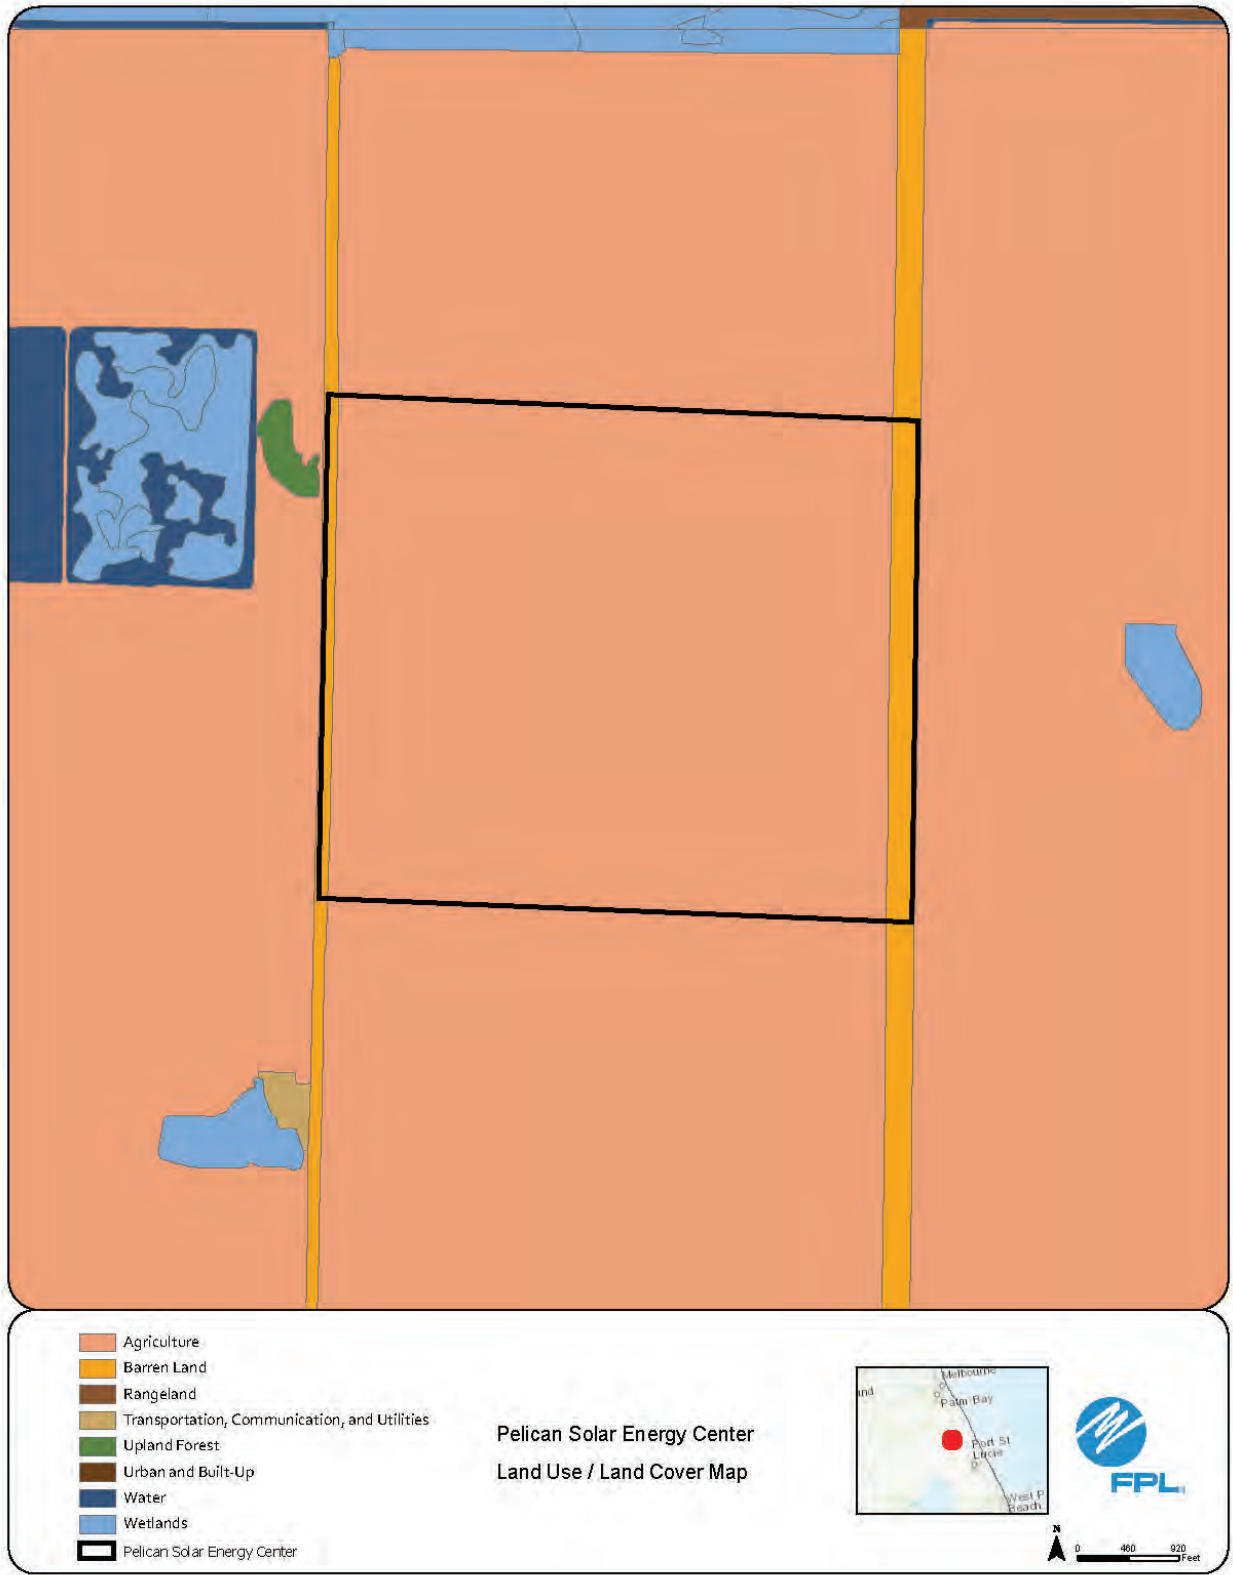



 Pelican Solar Energy Center


Pelican Solar Energy Center


Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 12: Palm Bay Solar Energy Center,
Brevard County***

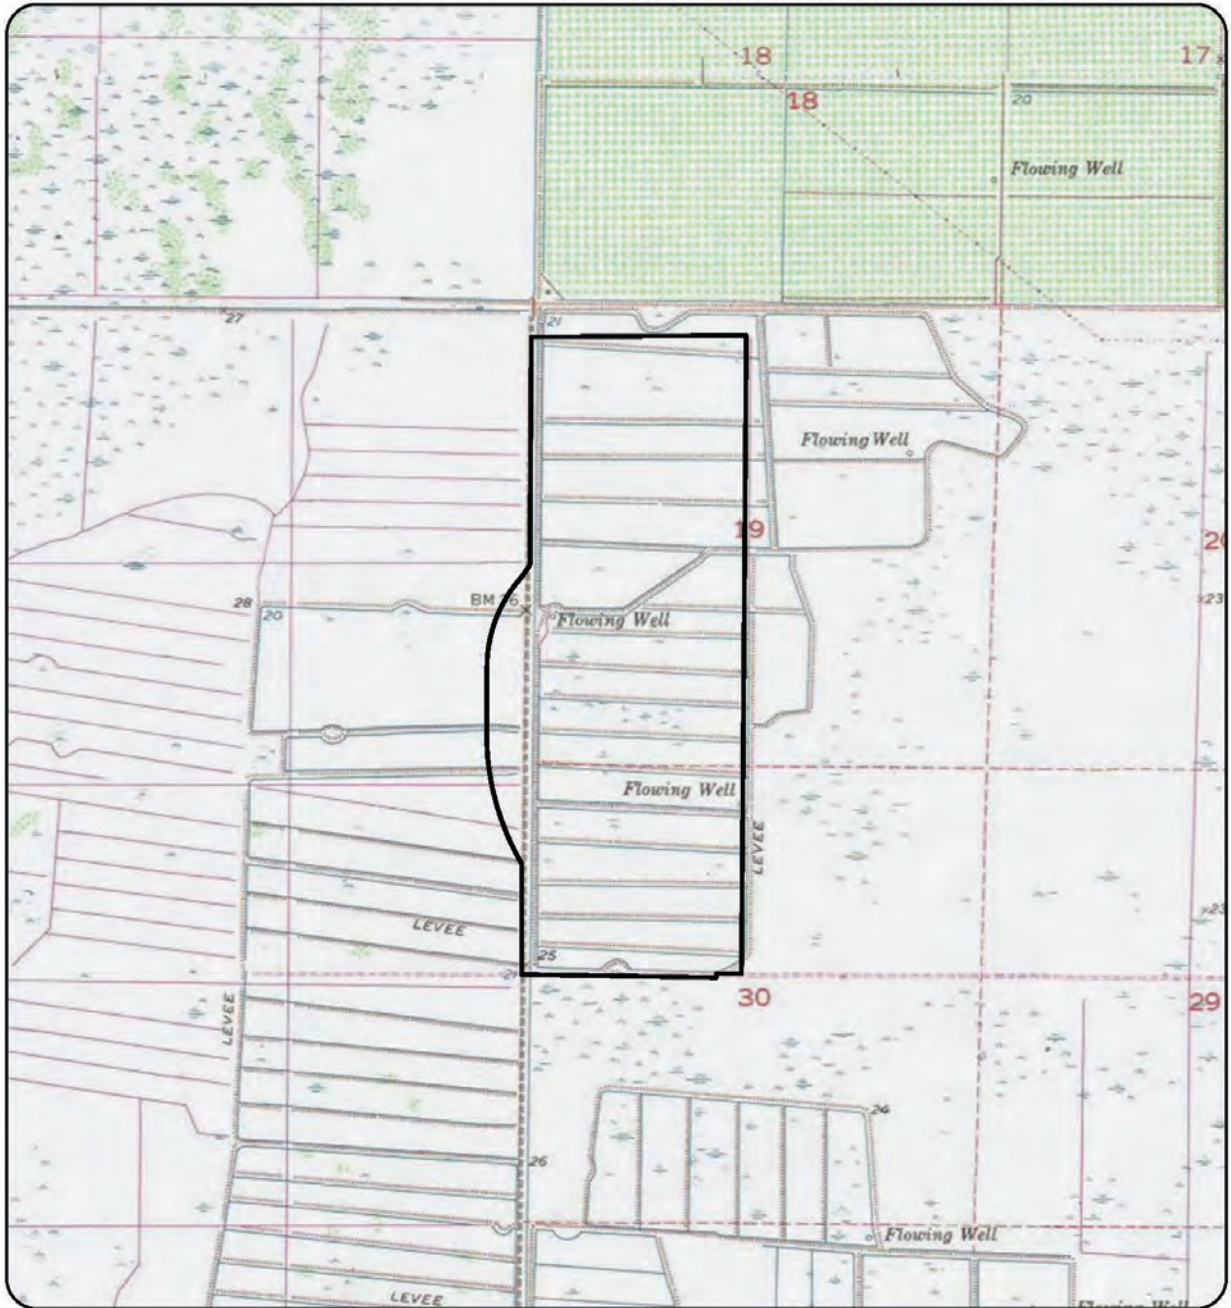

 Palm Bay Solar Energy Center

Palm Bay Solar Energy Center
USGS Topography Map



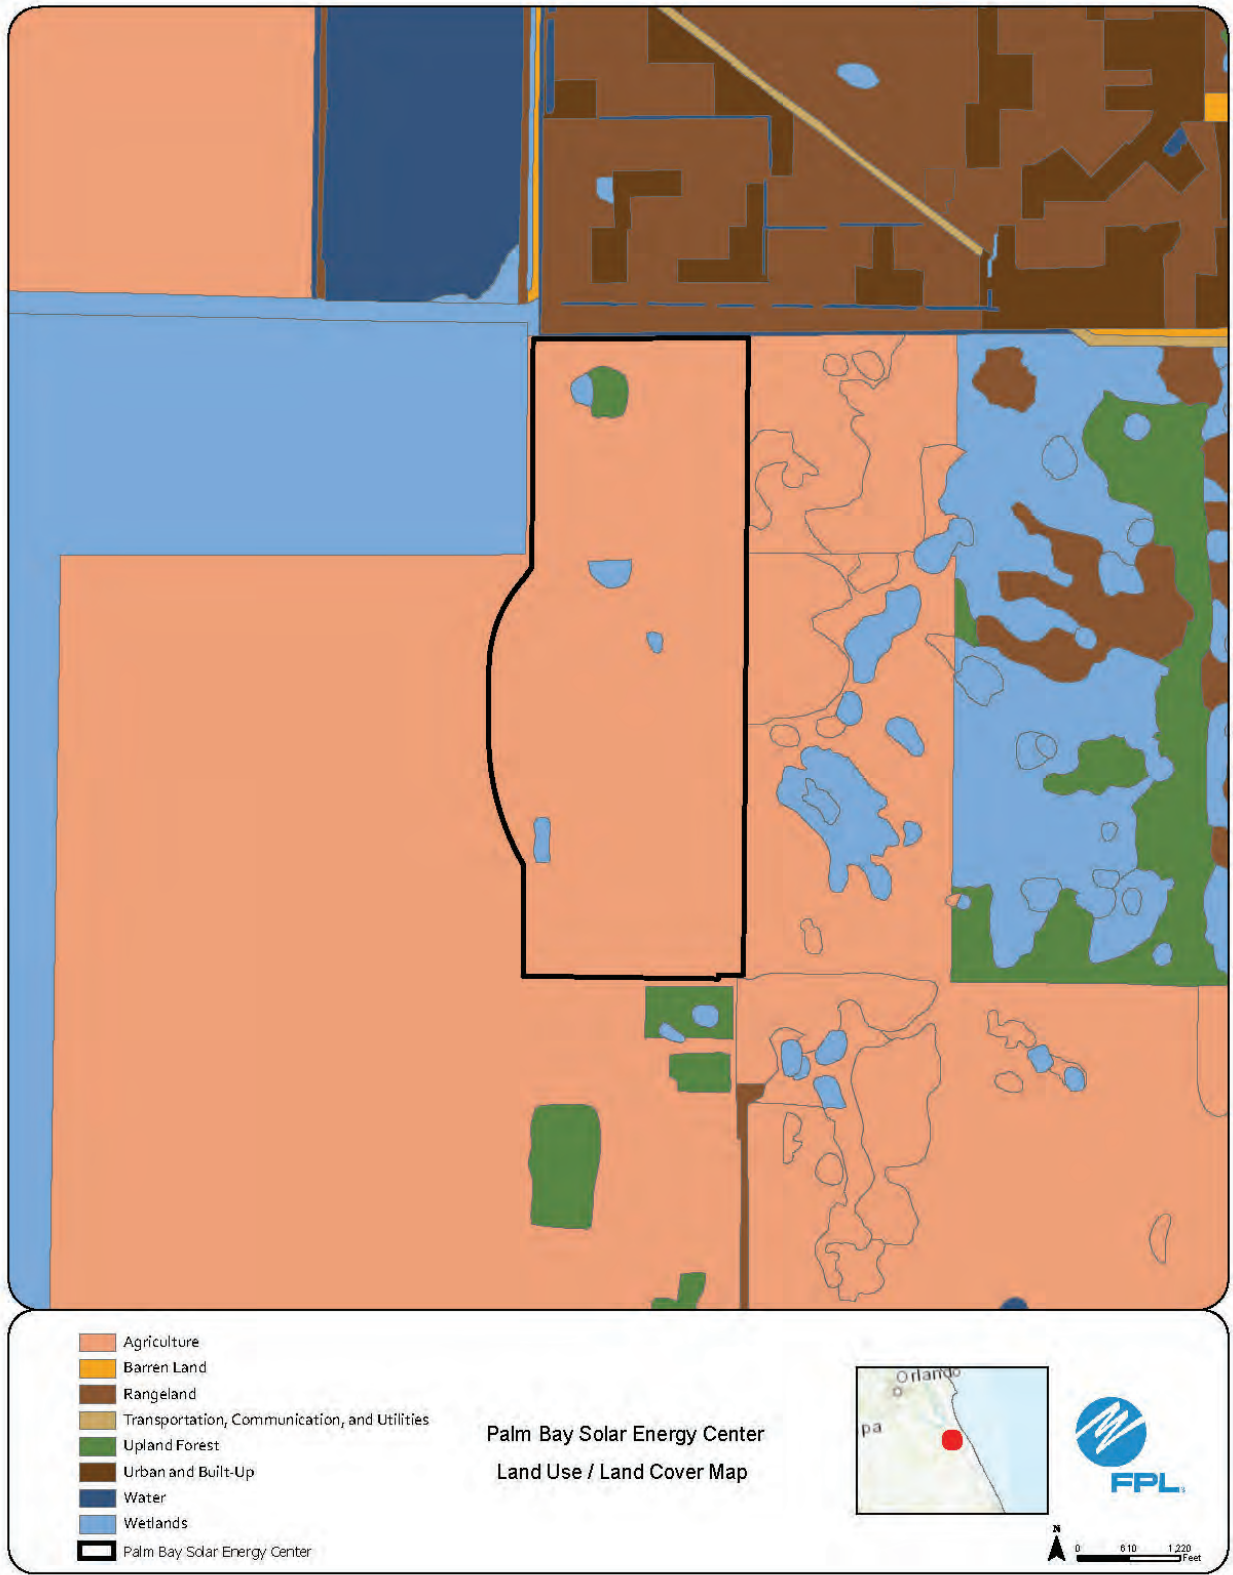



 Palm Bay Solar Energy Center


Palm Bay Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 13: Discovery Solar Energy Center,
Brevard County***

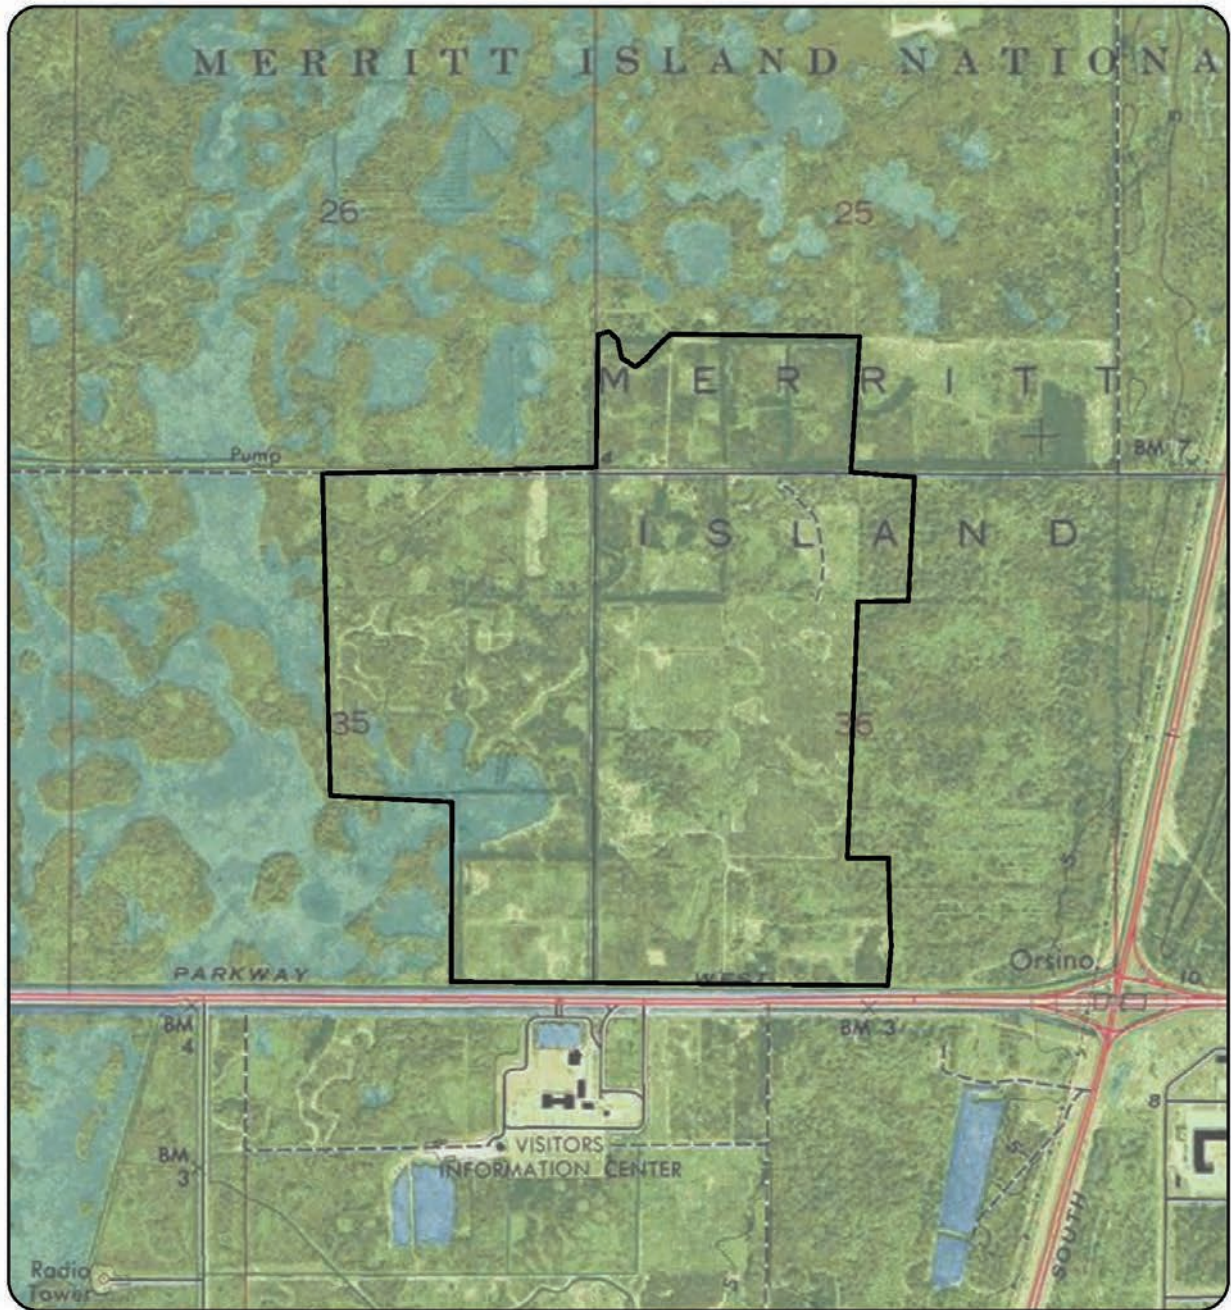


 Discovery Solar Energy Center

Discovery Solar Energy Center


USGS Topography Map




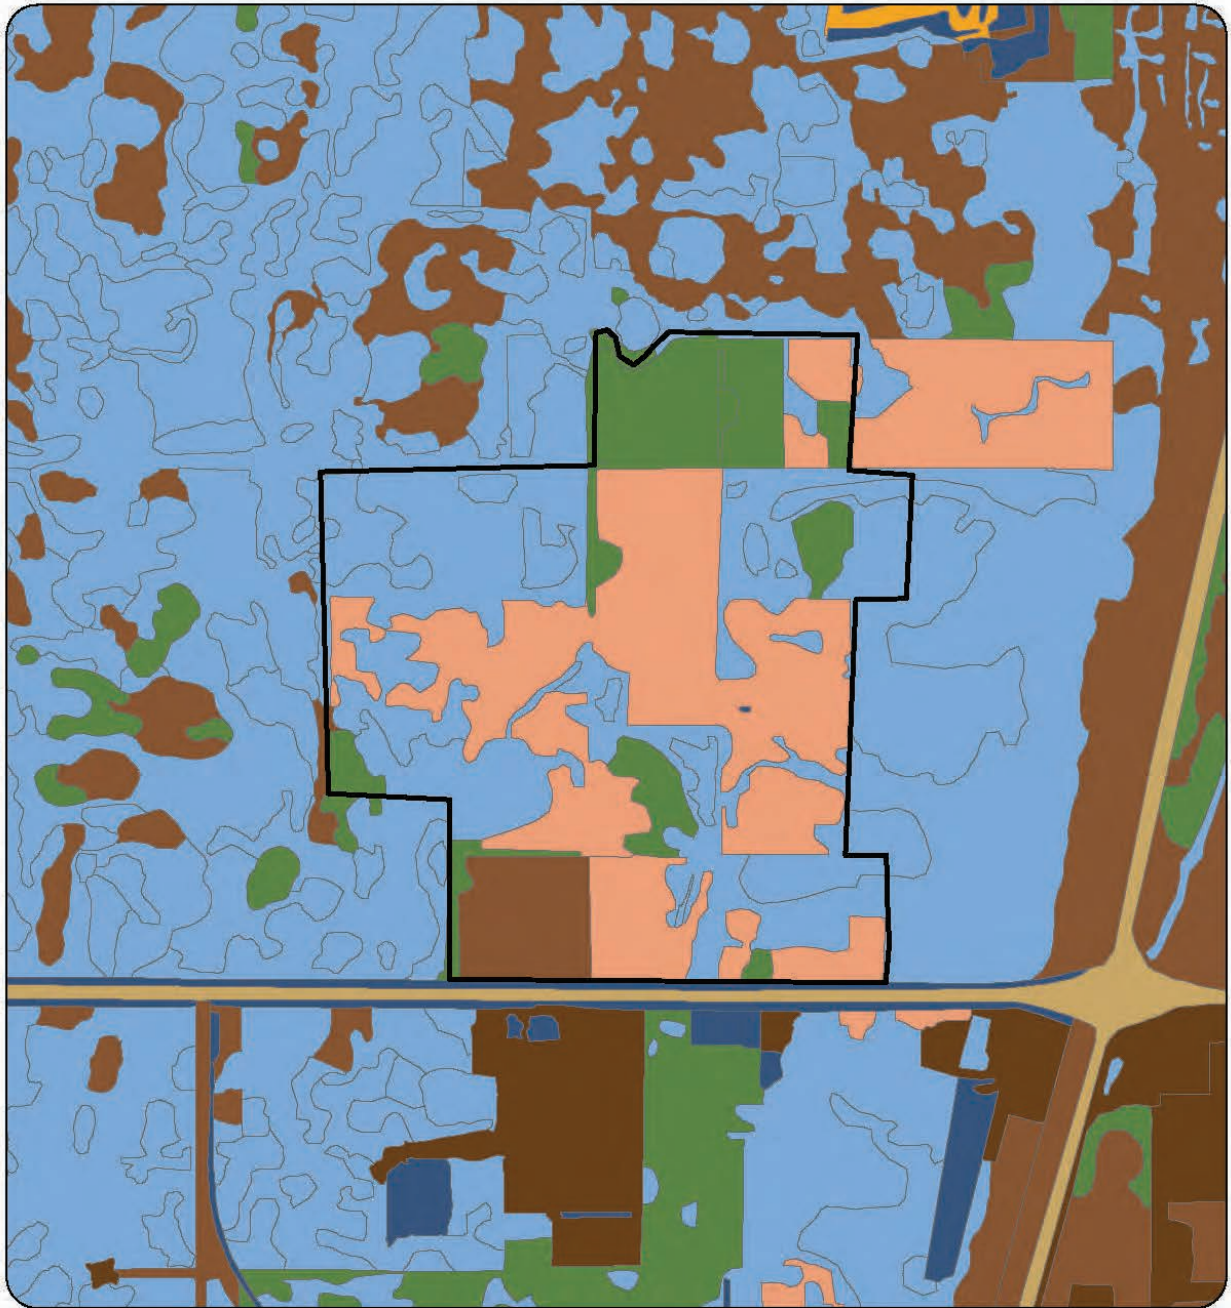

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Discovery Solar Energy Center

Discovery Solar Energy Center
Land Use / Land Cover Map



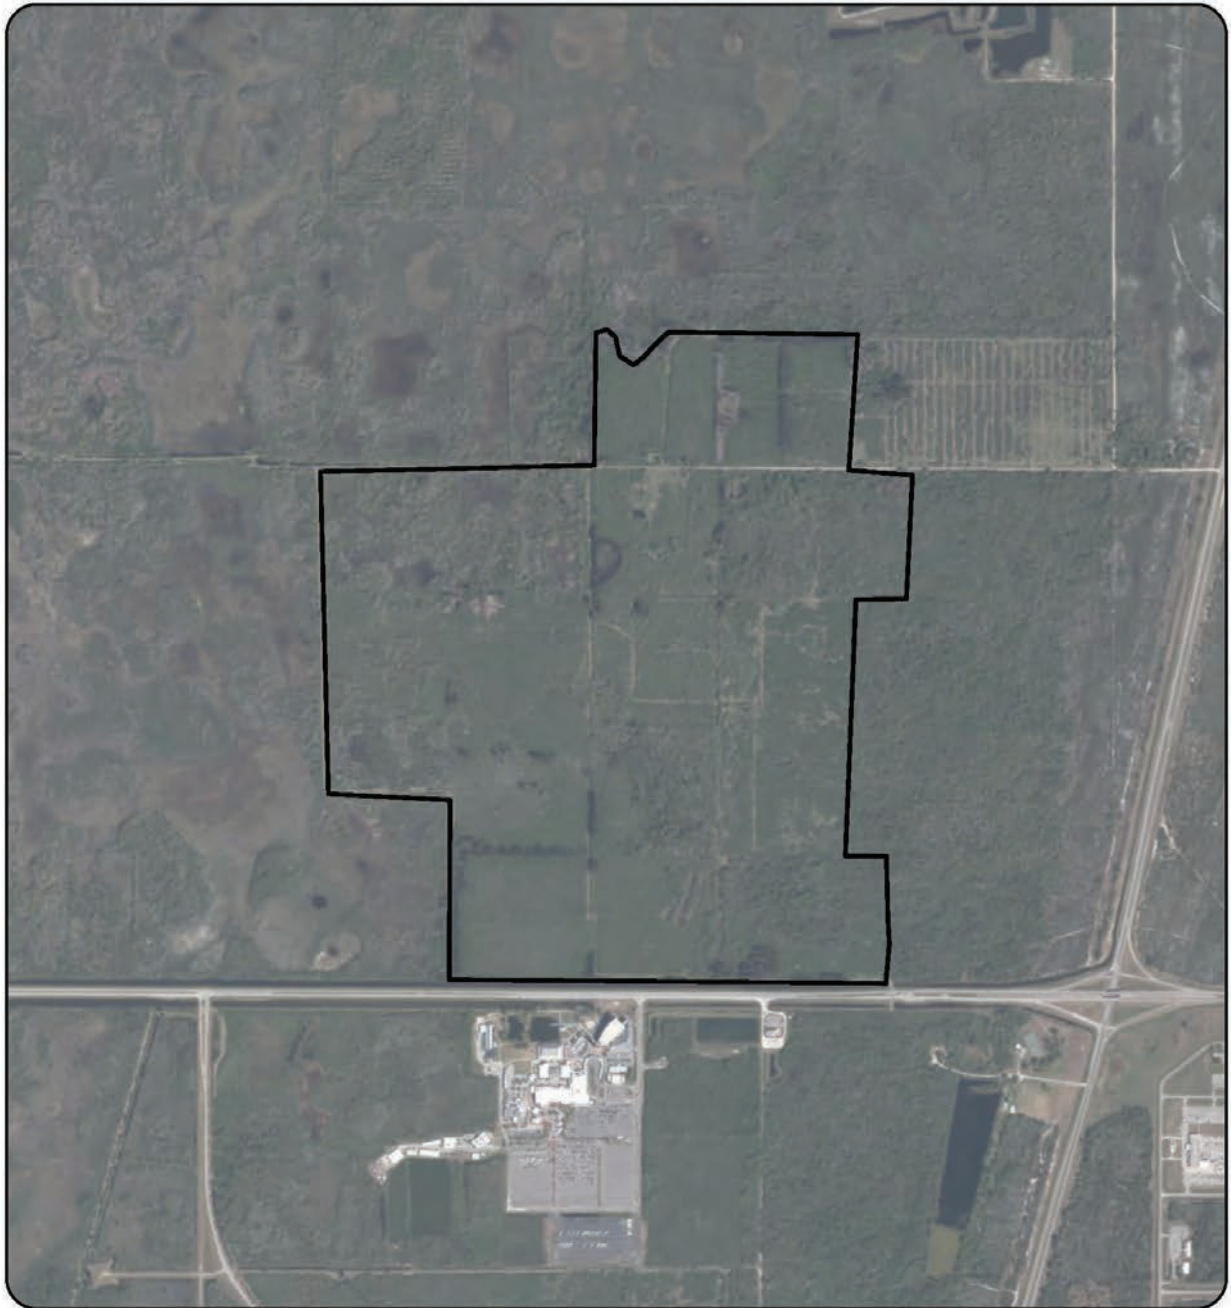

 Discovery Solar Energy Center

Discovery Solar Energy Center


Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 14: Orange Blossom Solar Energy Center,
Indian River County***




 Orange Blossom Solar Energy Center

Orange Blossom Solar Energy Center
USGS Topography Map



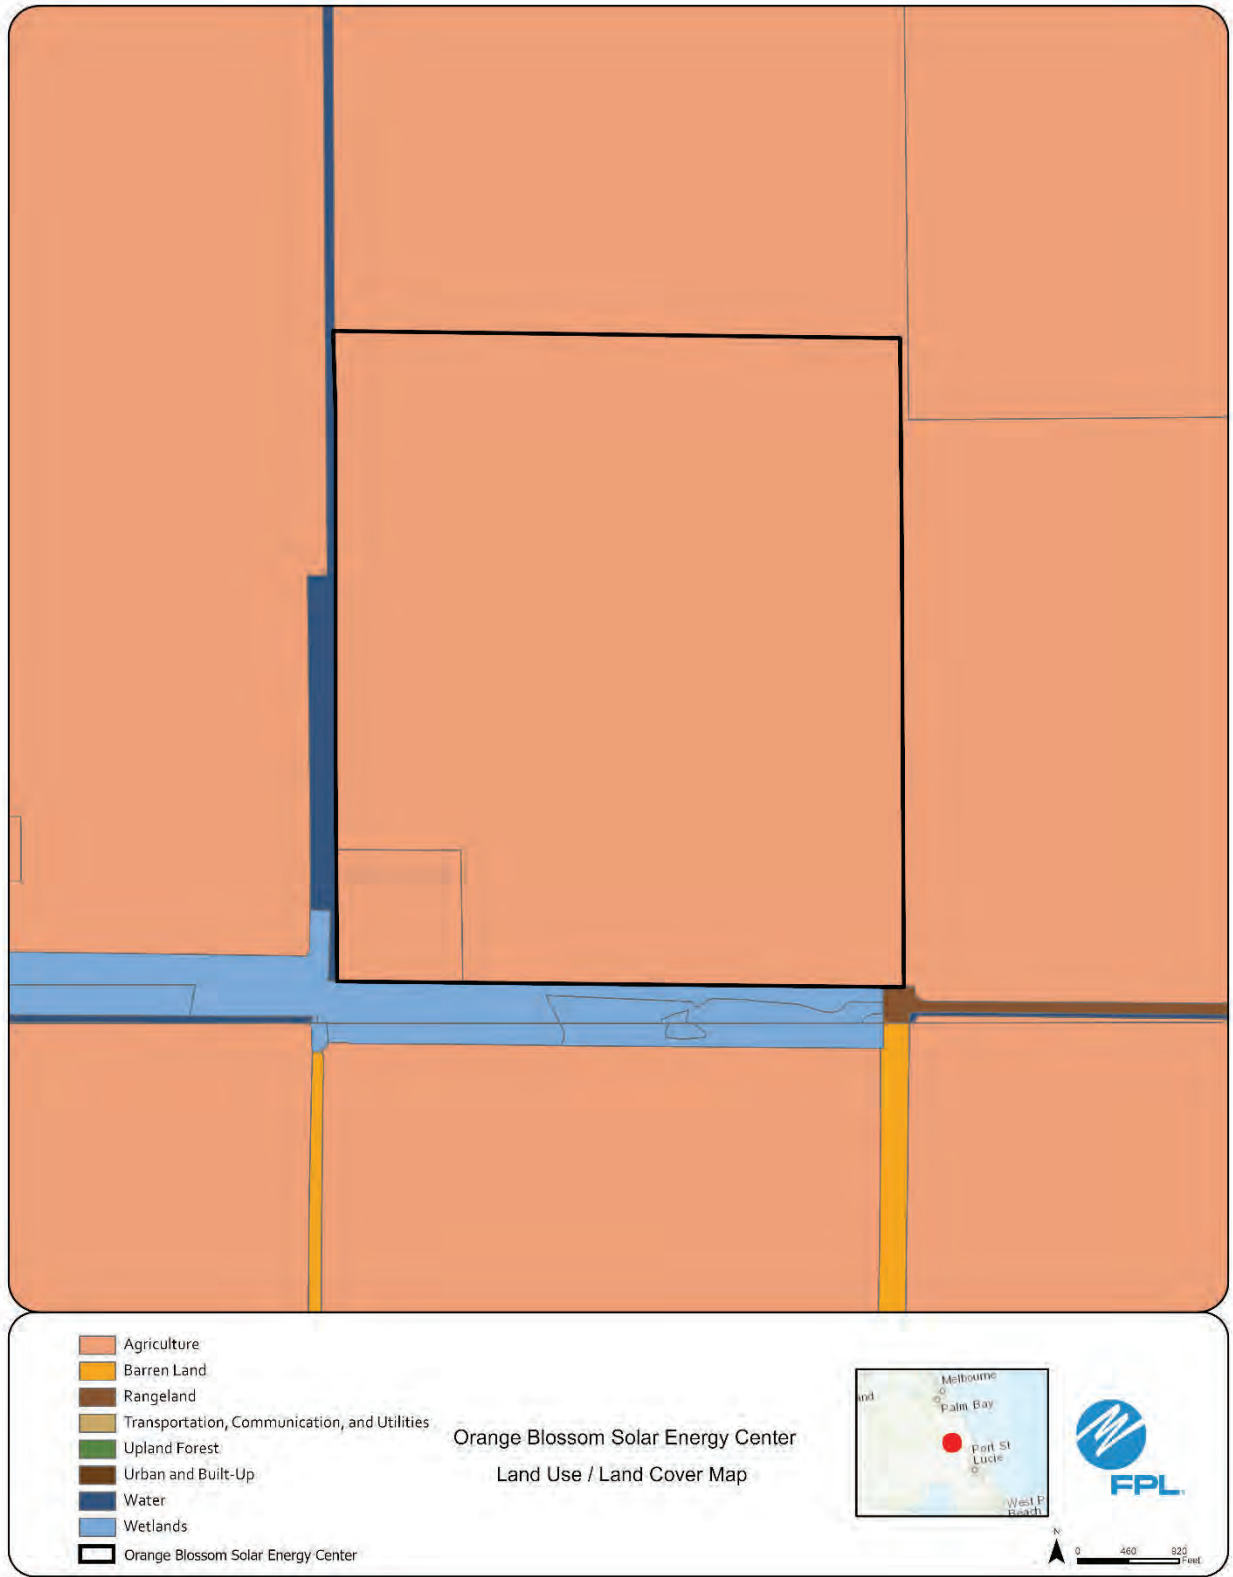

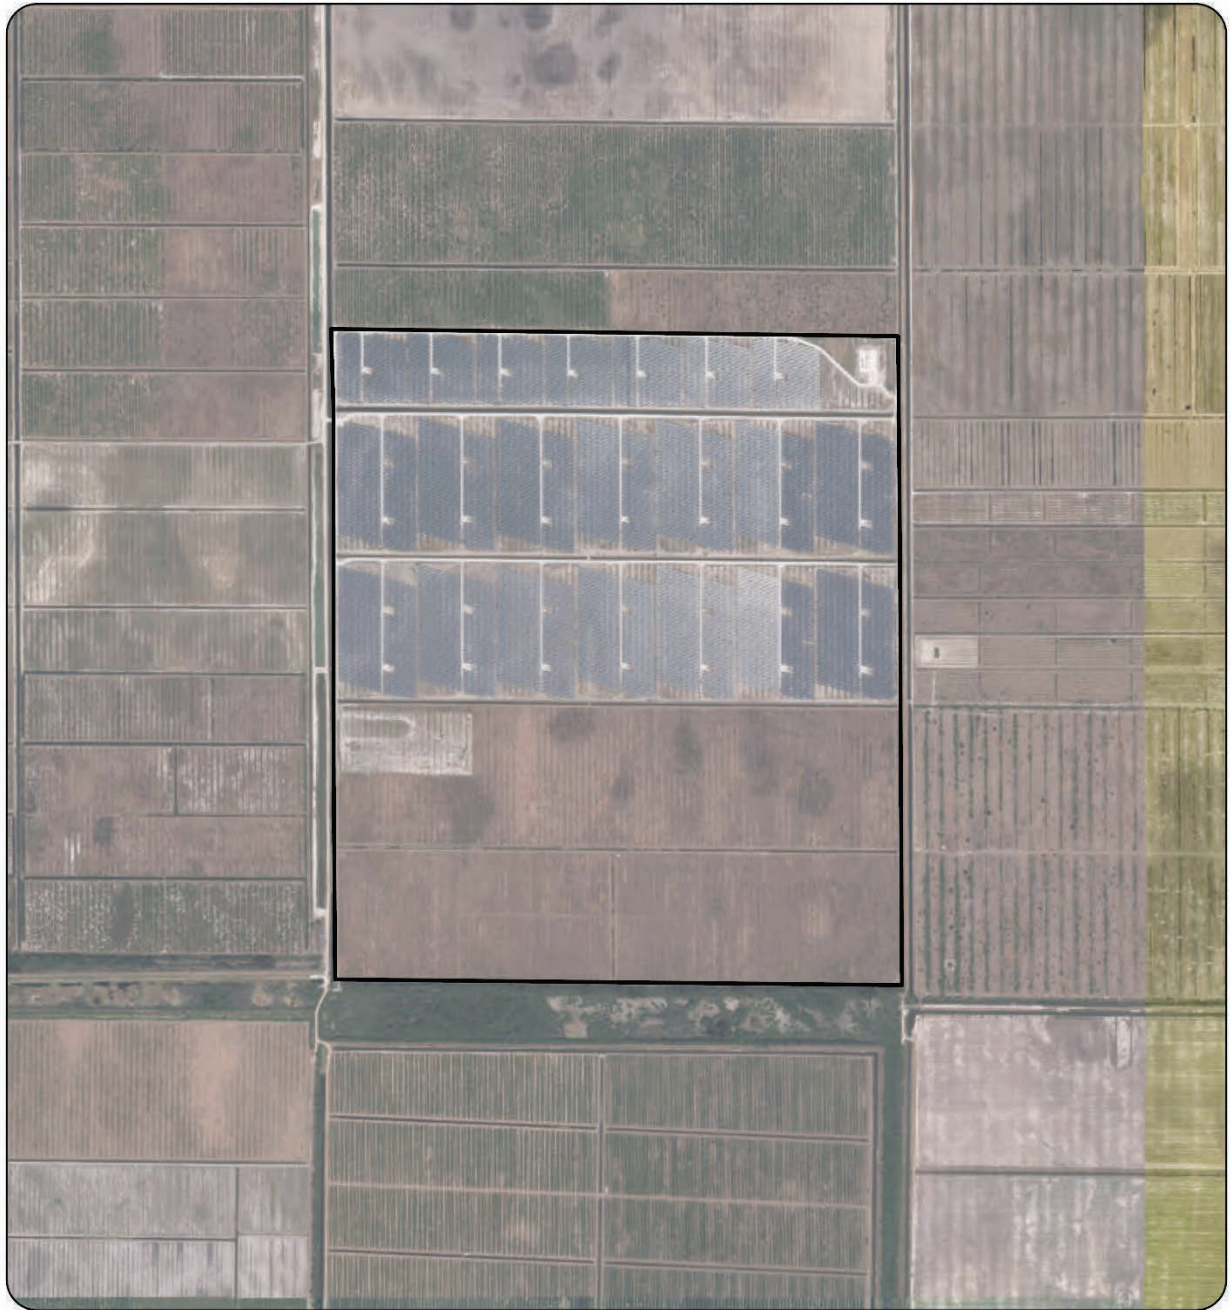

 Orange Blossom Solar Energy Center

Orange Blossom Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 15: Sabal Palm Solar Energy Center,
Palm Beach County***



 Sabal Palm Solar Energy Center



Sabal Palm Solar Energy Center
USGS Topography Map



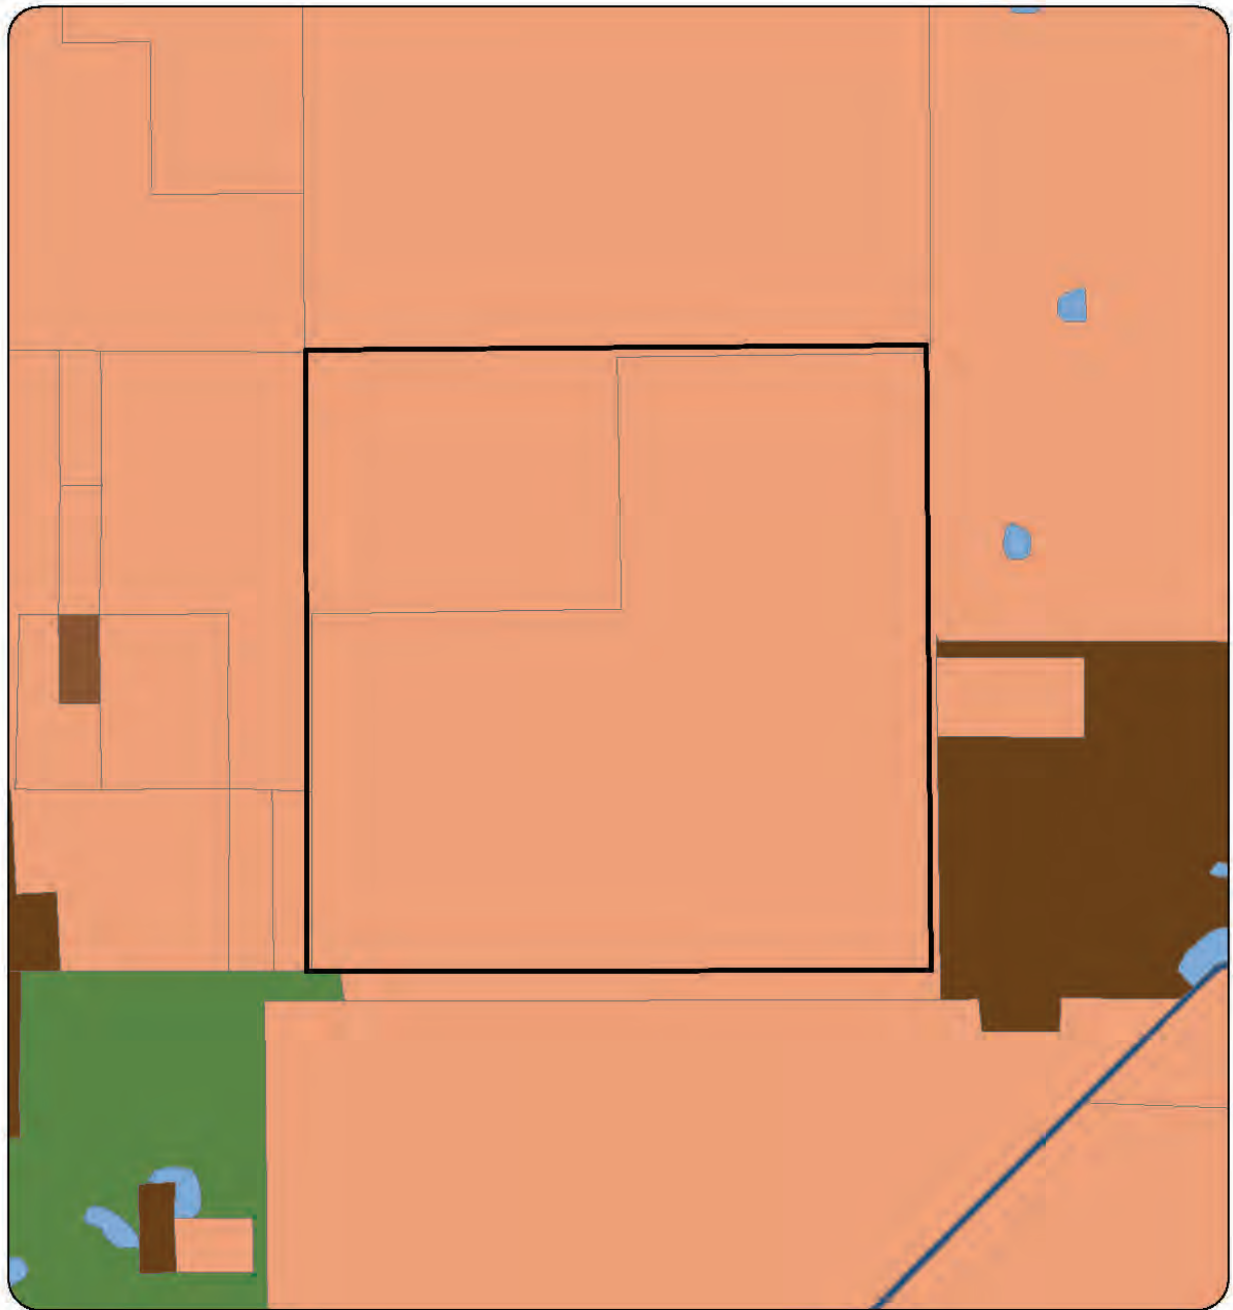


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Sabal Palm Solar Energy Center

**Sabal Palm Solar Energy Center
Land Use / Land Cover Map**





 Sabal Palm Solar Energy Center


Sabal Palm Solar Energy Center


Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 16: Fort Drum Solar Energy Center,
Okeechobee County***

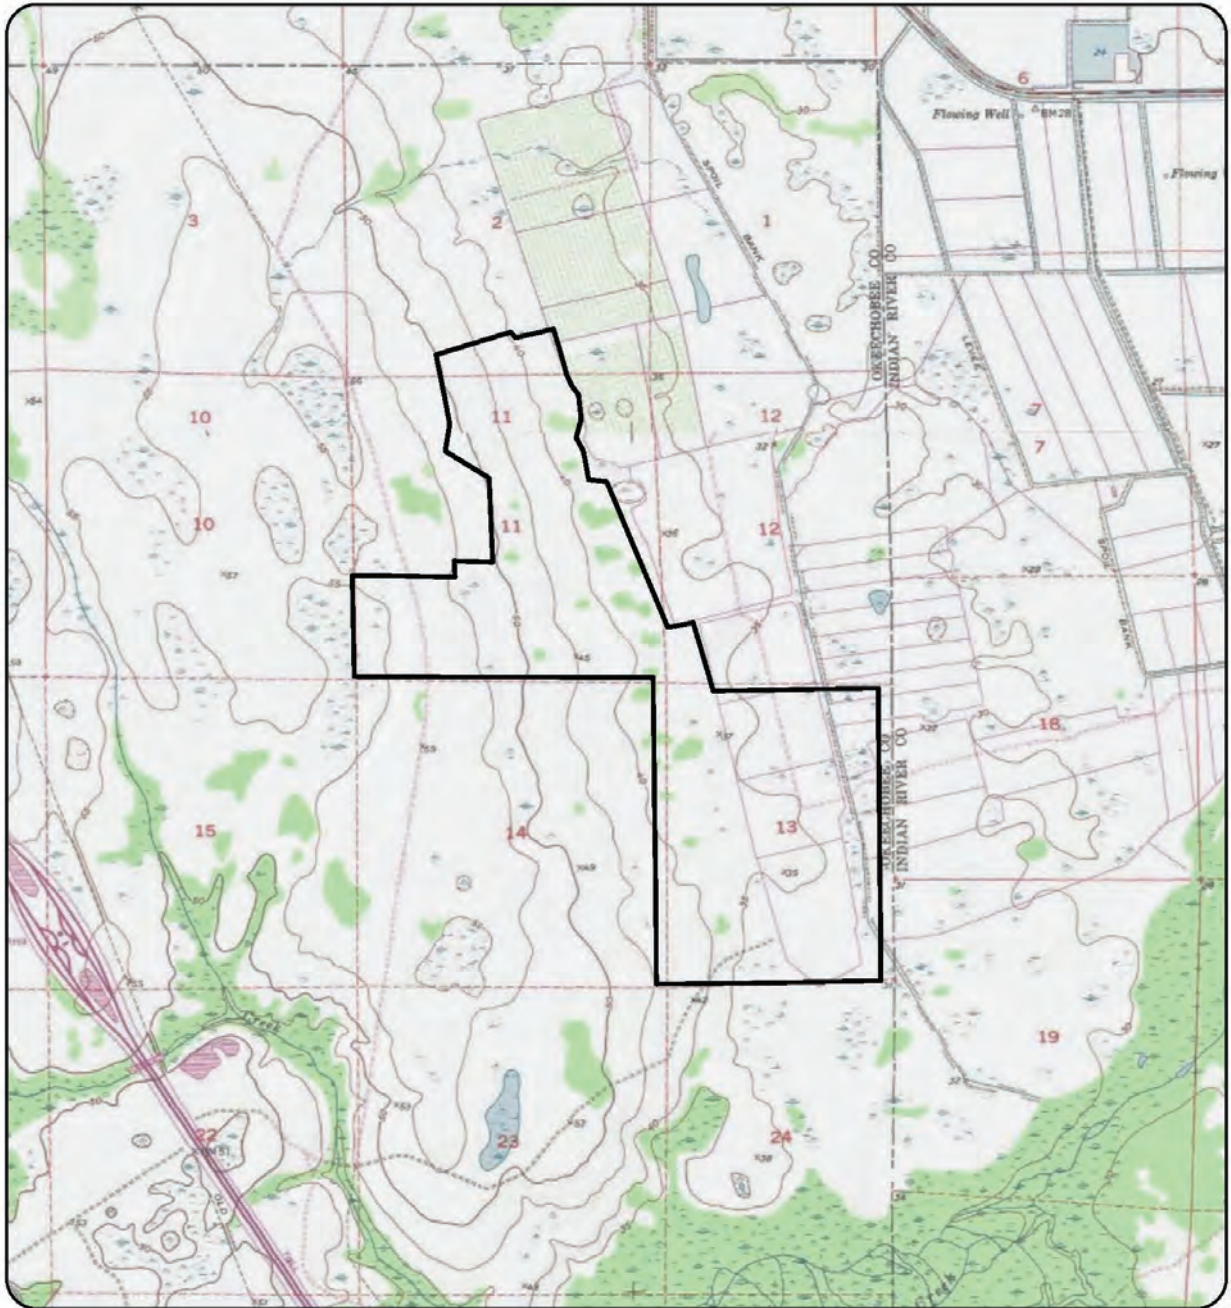

 Fort Drum Solar Energy Center

Fort Drum Solar Energy Center
USGS Topography Map




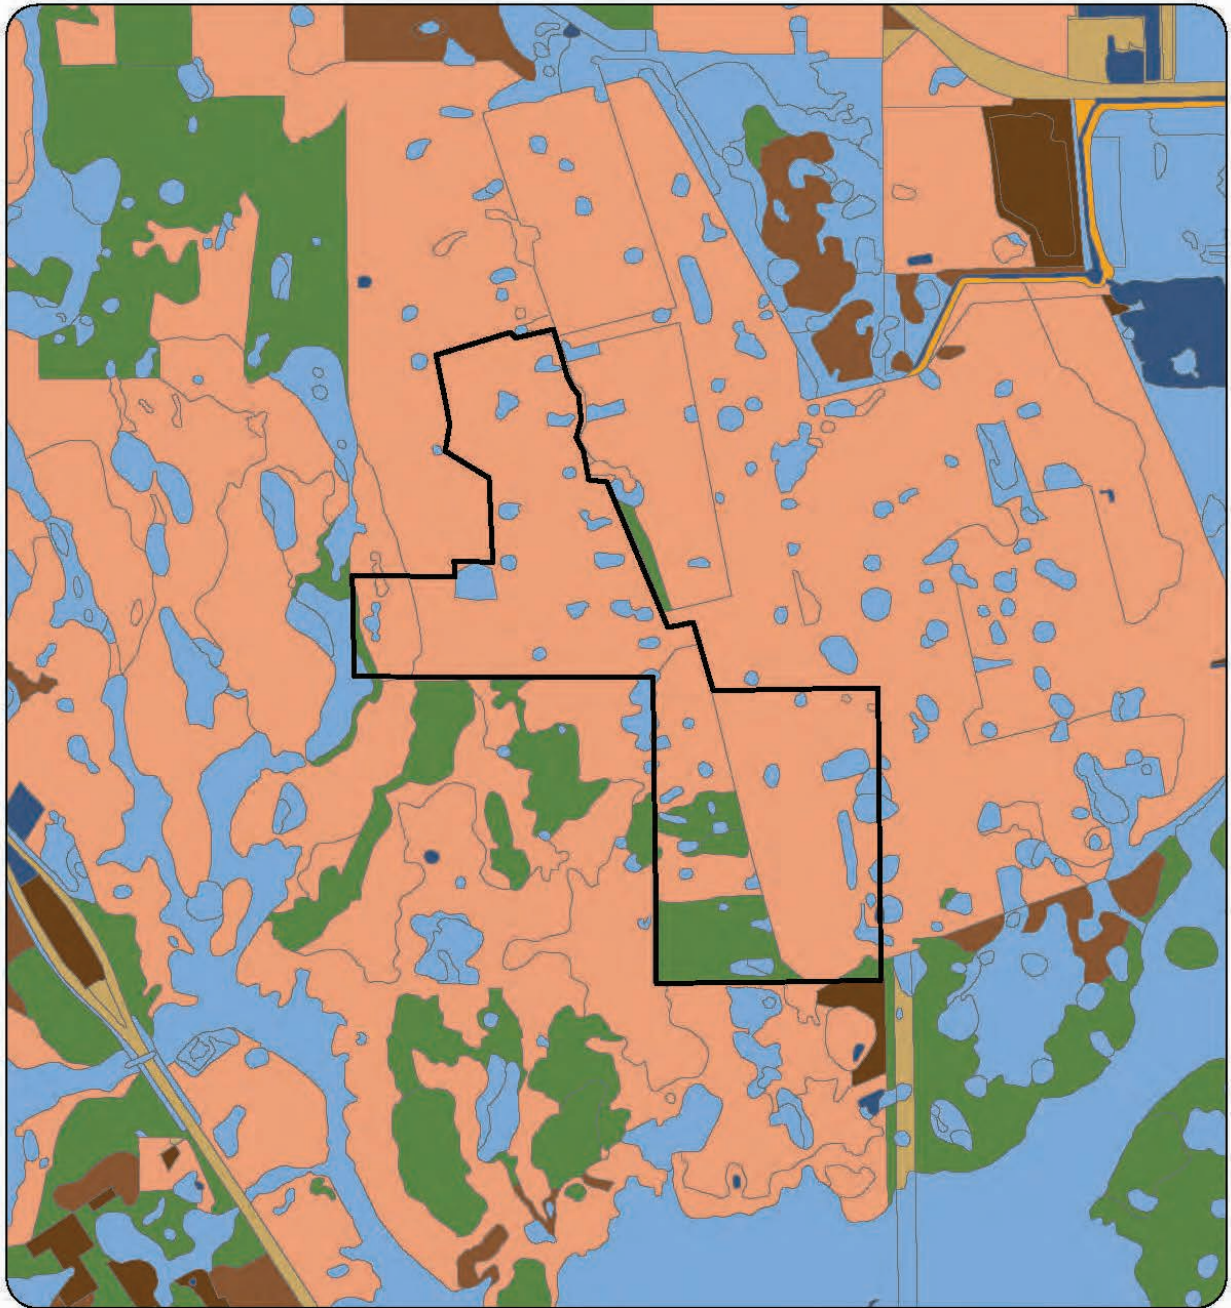

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Fort Drum Solar Energy Center

**Fort Drum Solar Energy Center
Land Use / Land Cover Map**



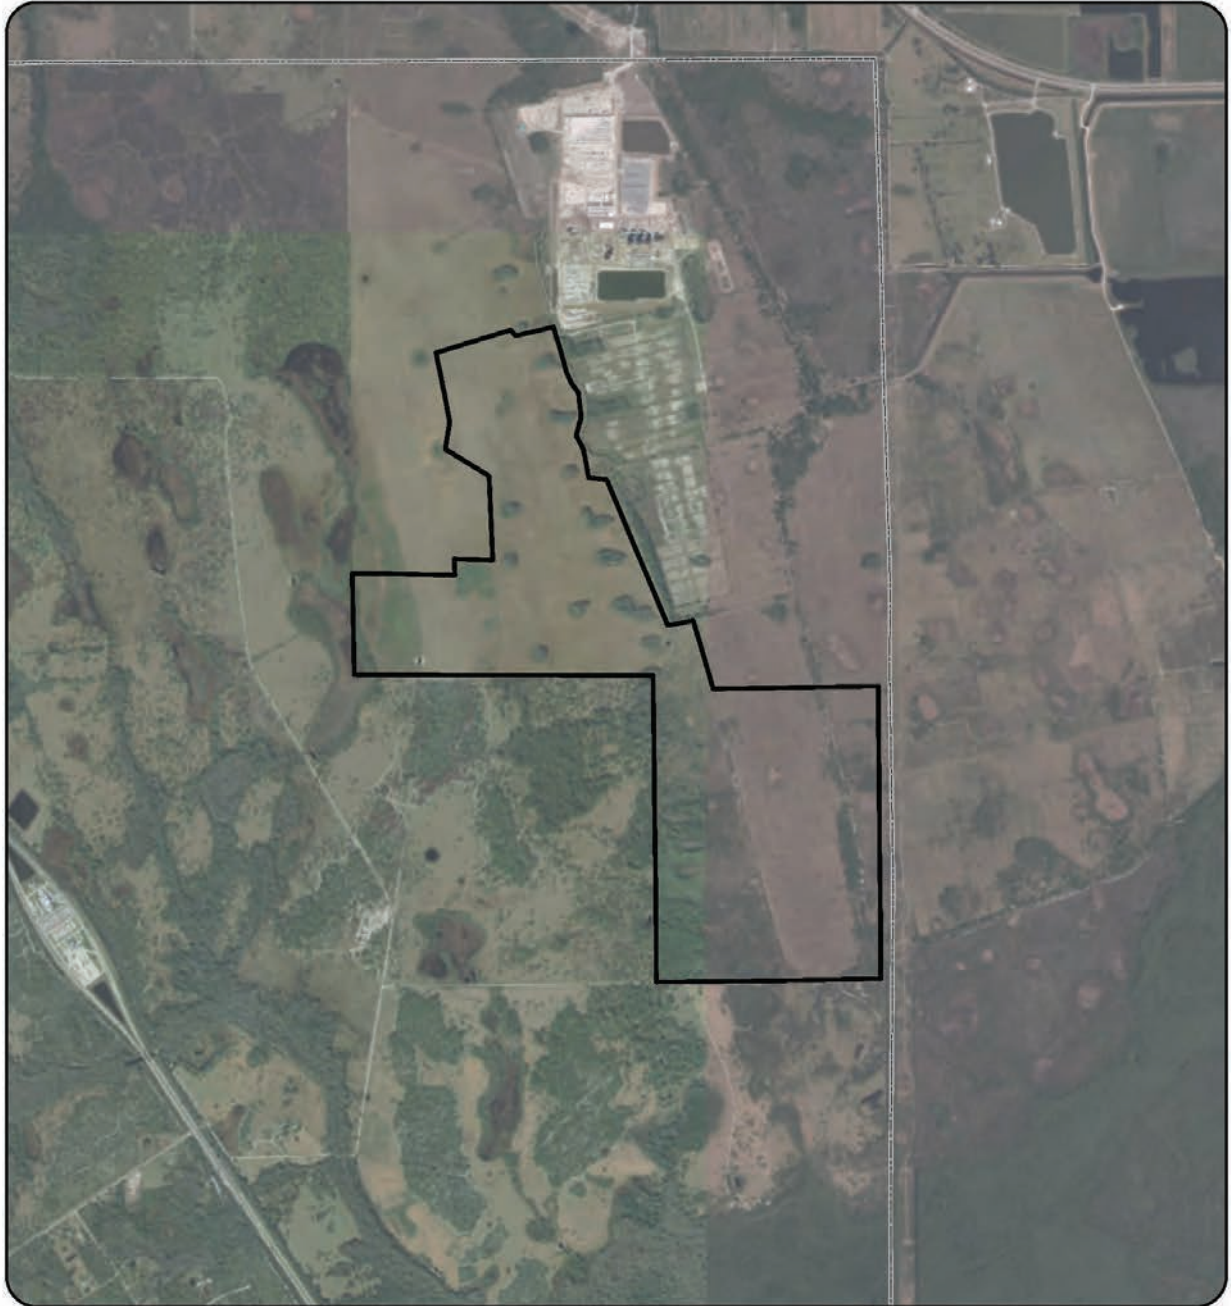

 Fort Drum Solar Energy Center


Fort Drum Solar Energy Center

Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 17: Rodeo Solar Energy Center,
DeSoto County***

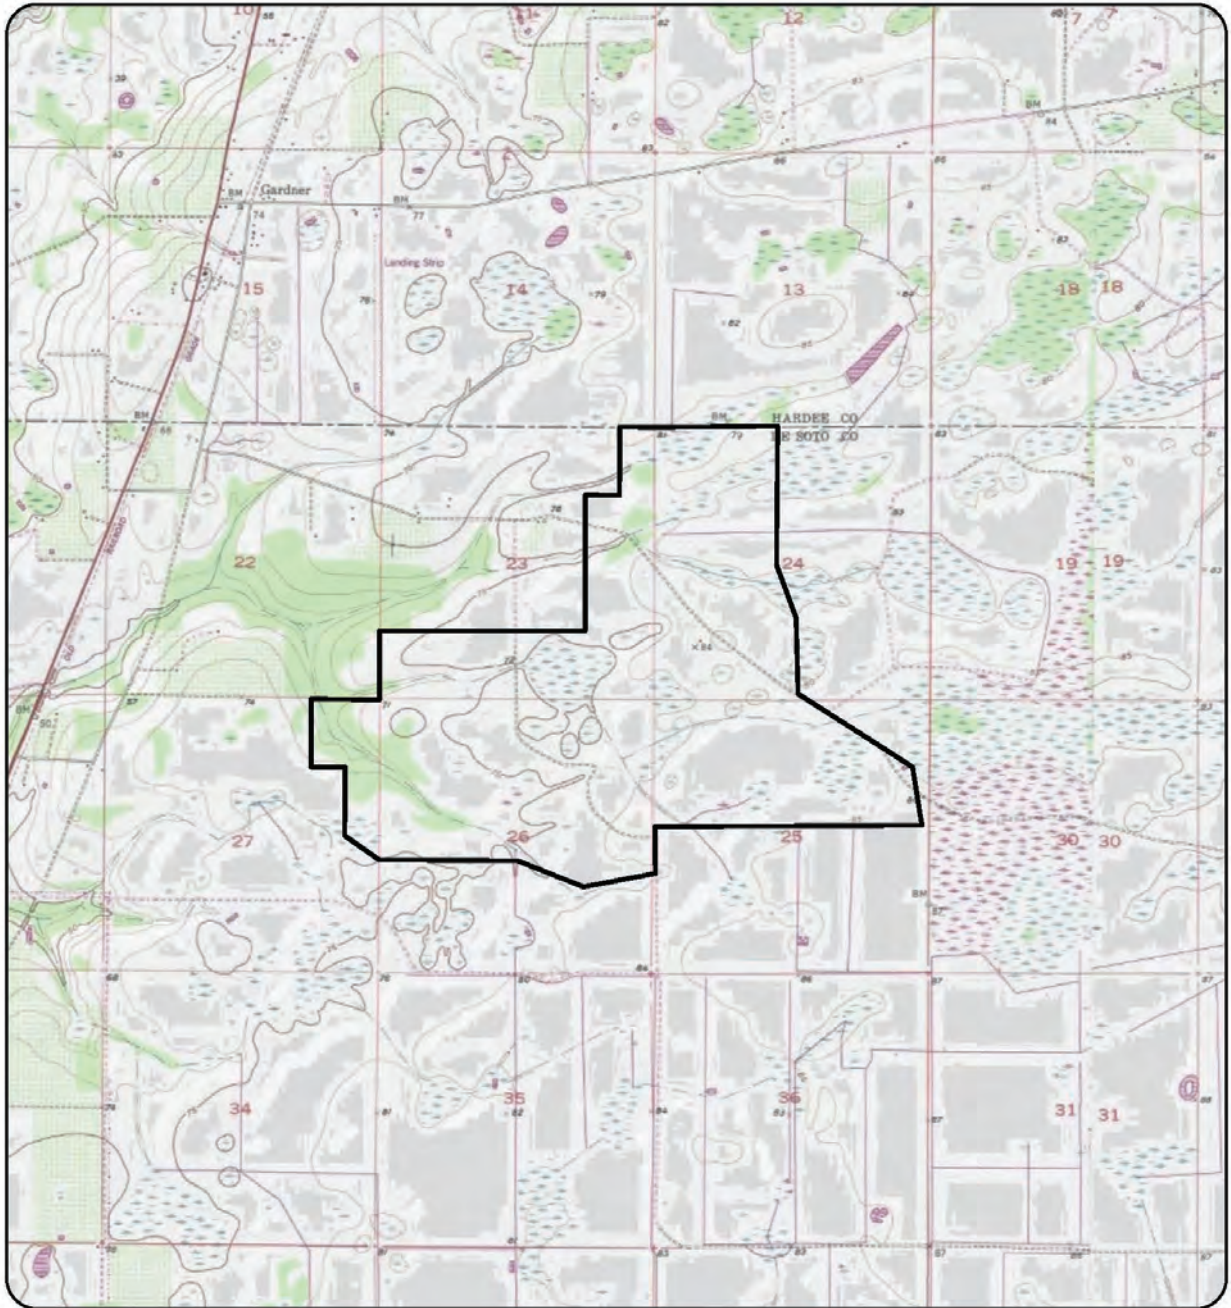


 Rodeo Solar Energy Center

Rodeo Solar Energy Center
USGS Topography Map



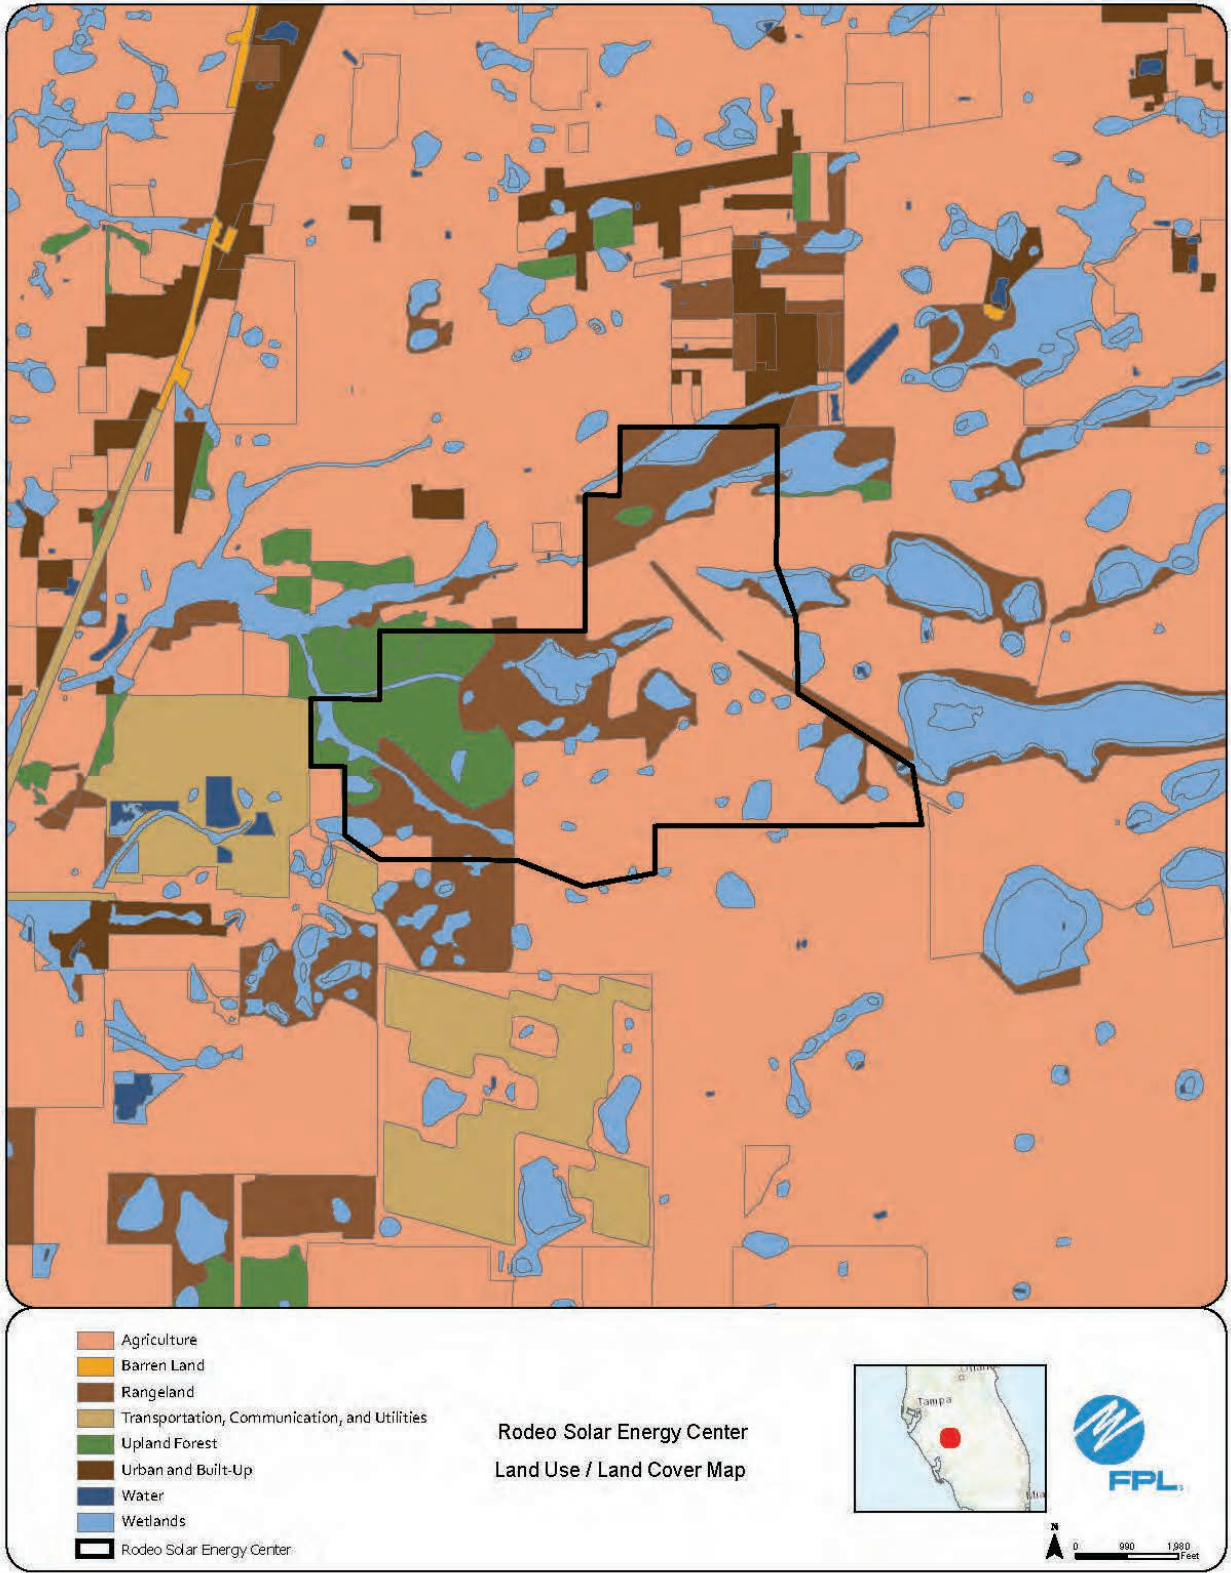

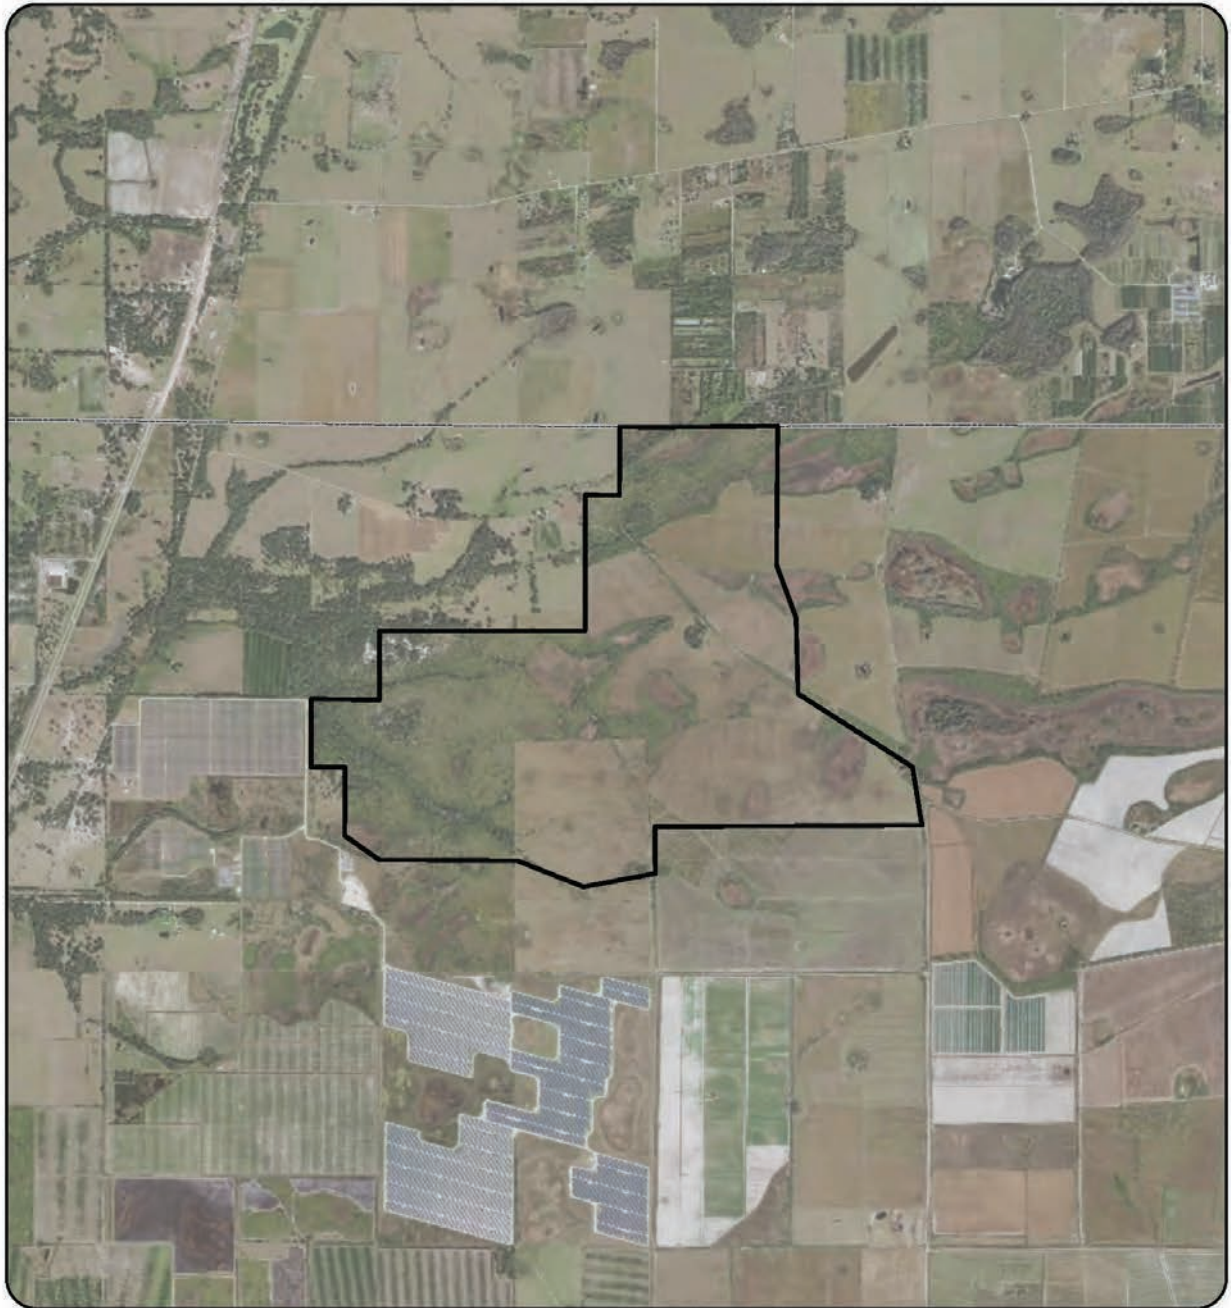

 Rodeo Solar Energy Center


Rodeo Solar Energy Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***



***Preferred Site # 18: Willow Solar Energy Center,
Manatee County***

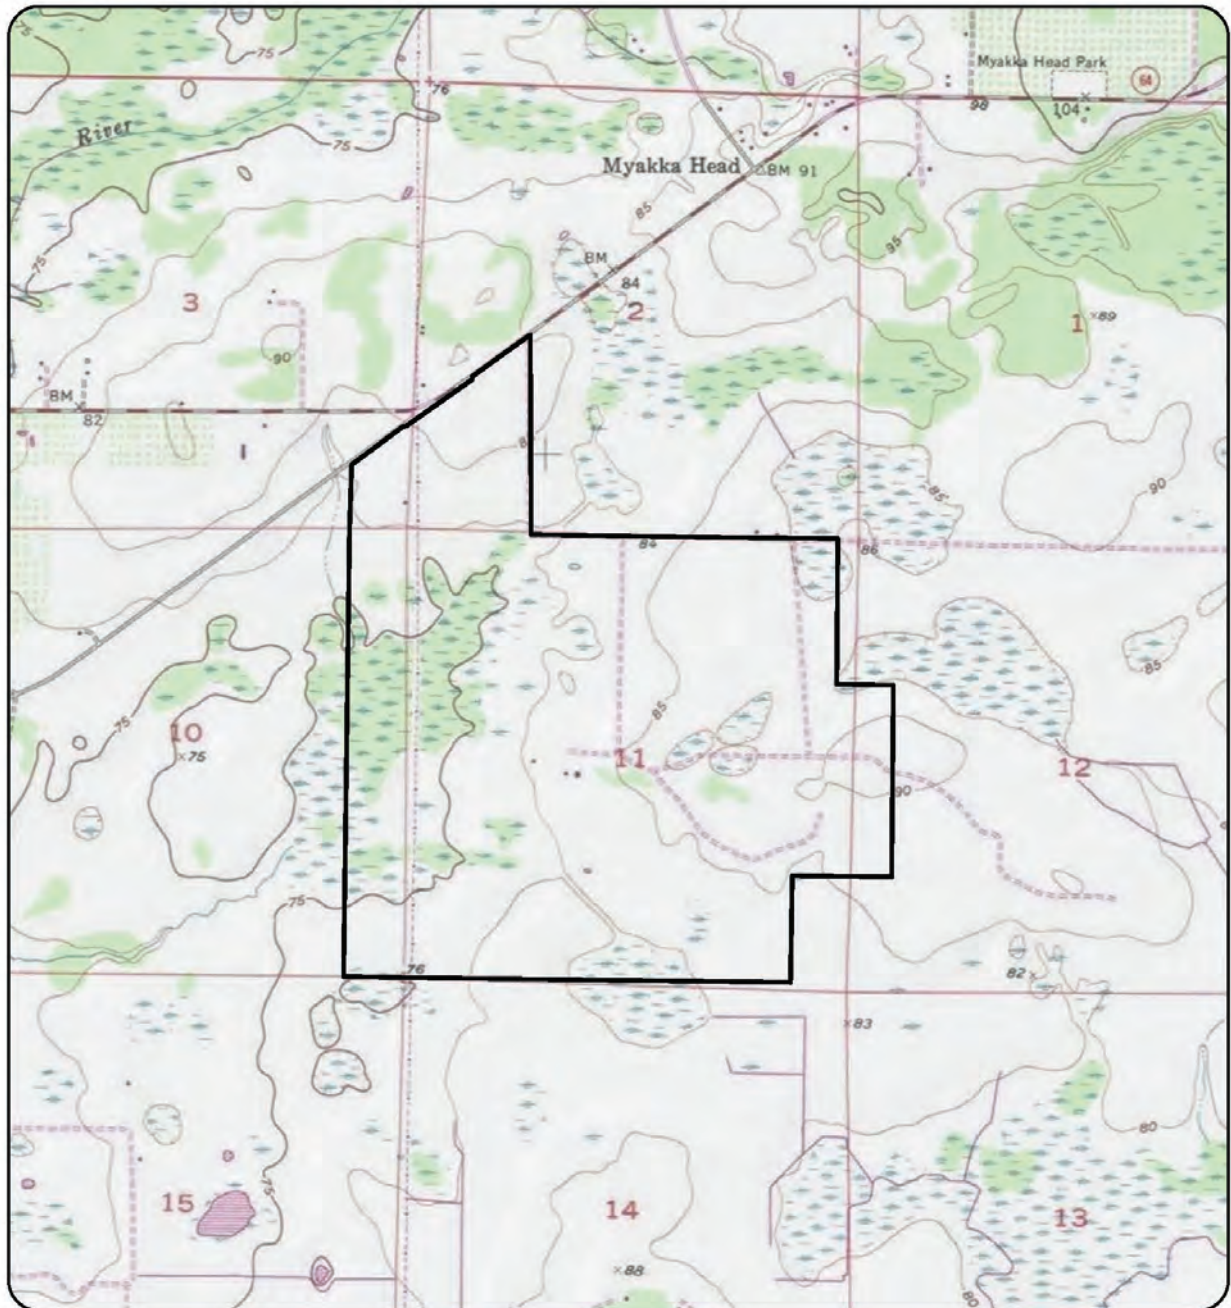



 Willow Solar Energy Center

Willow Solar Energy Center

USGS Topography Map



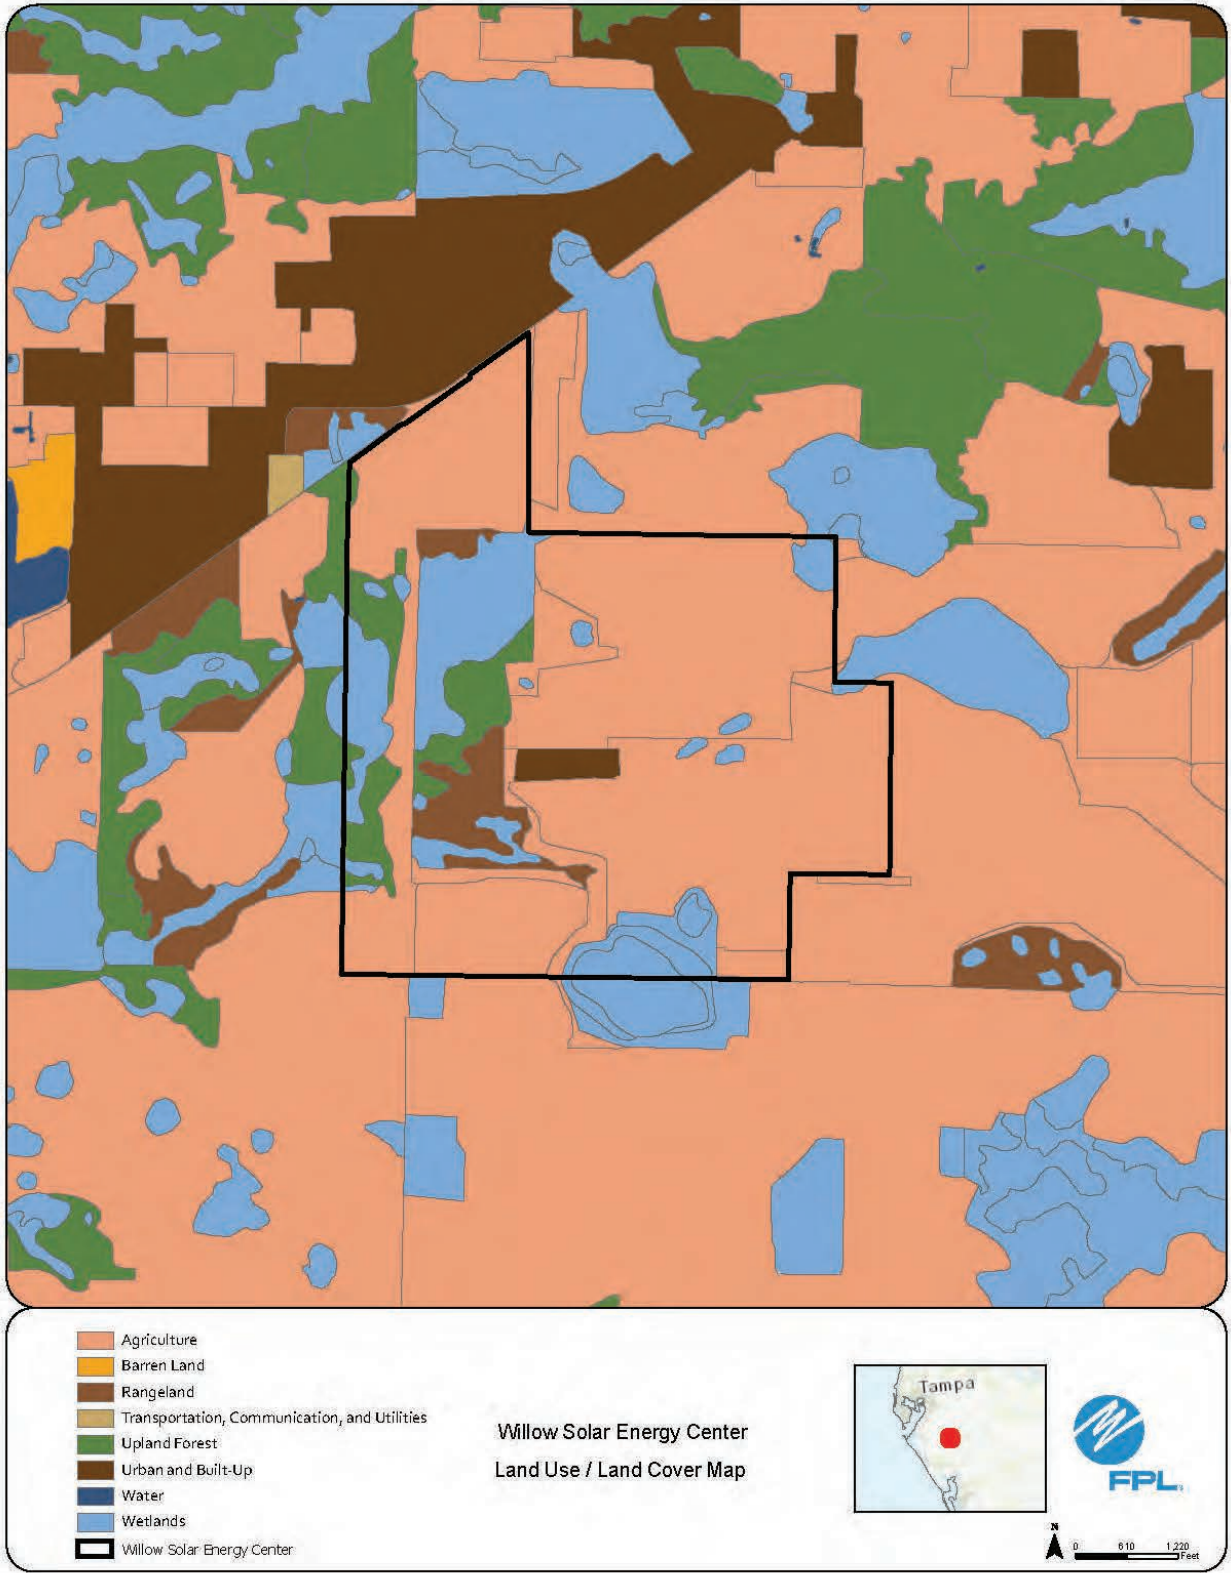

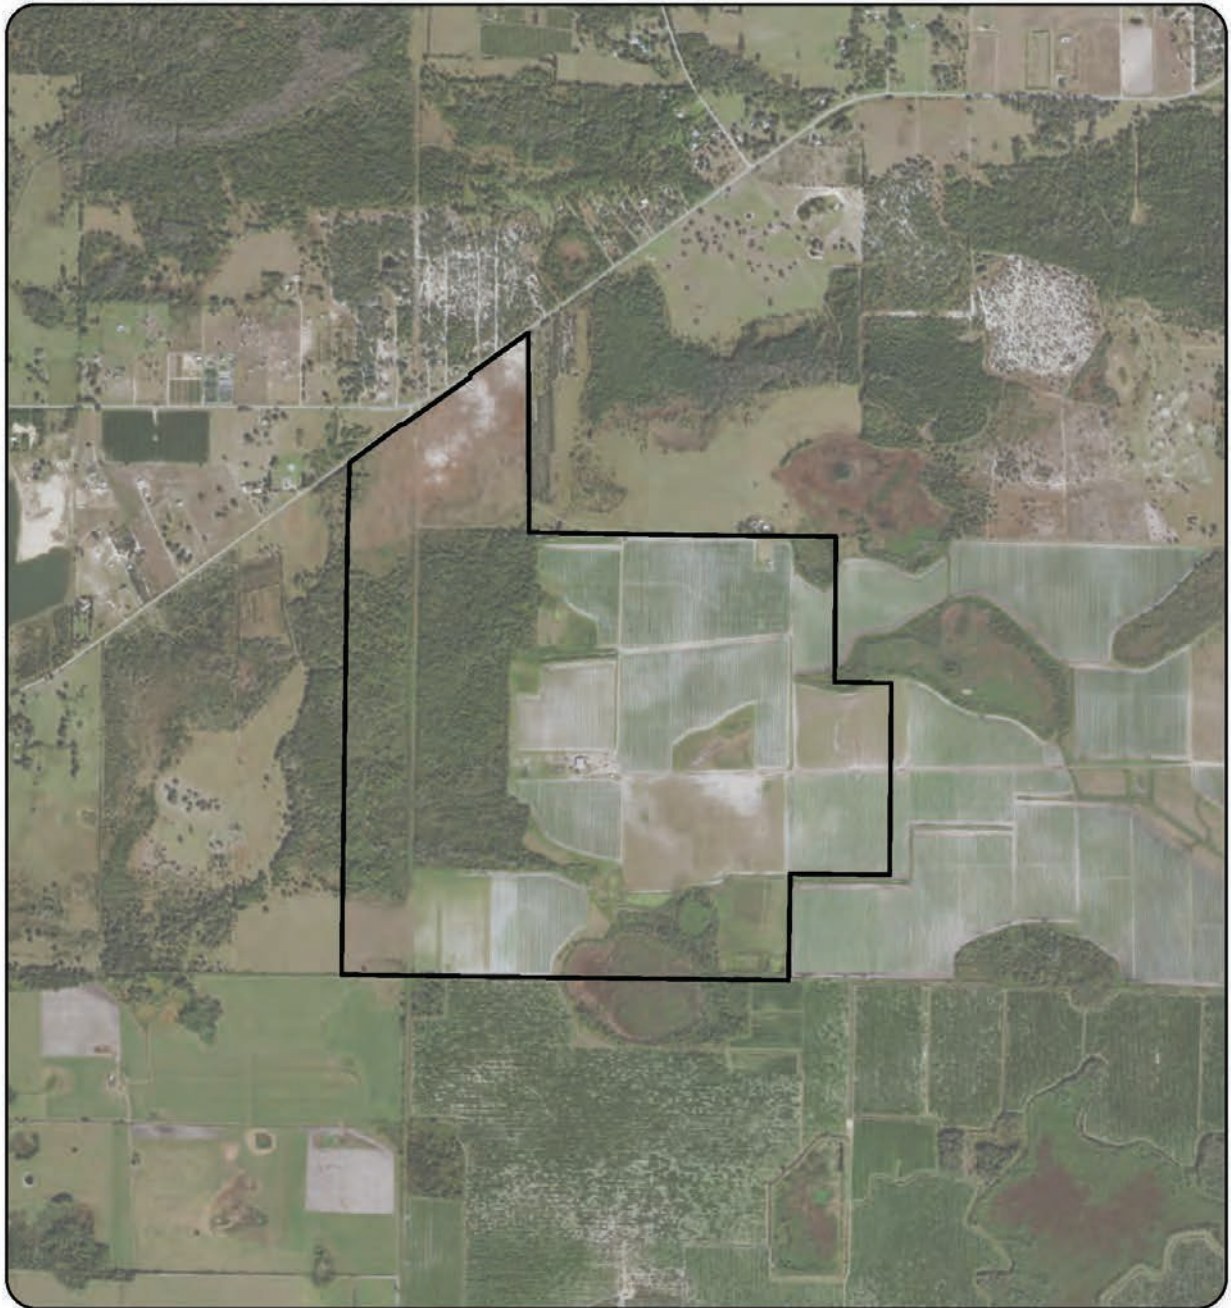

 Willow Solar Energy Center


Willow Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 19: Manatee Energy Storage Center,
Manatee County***

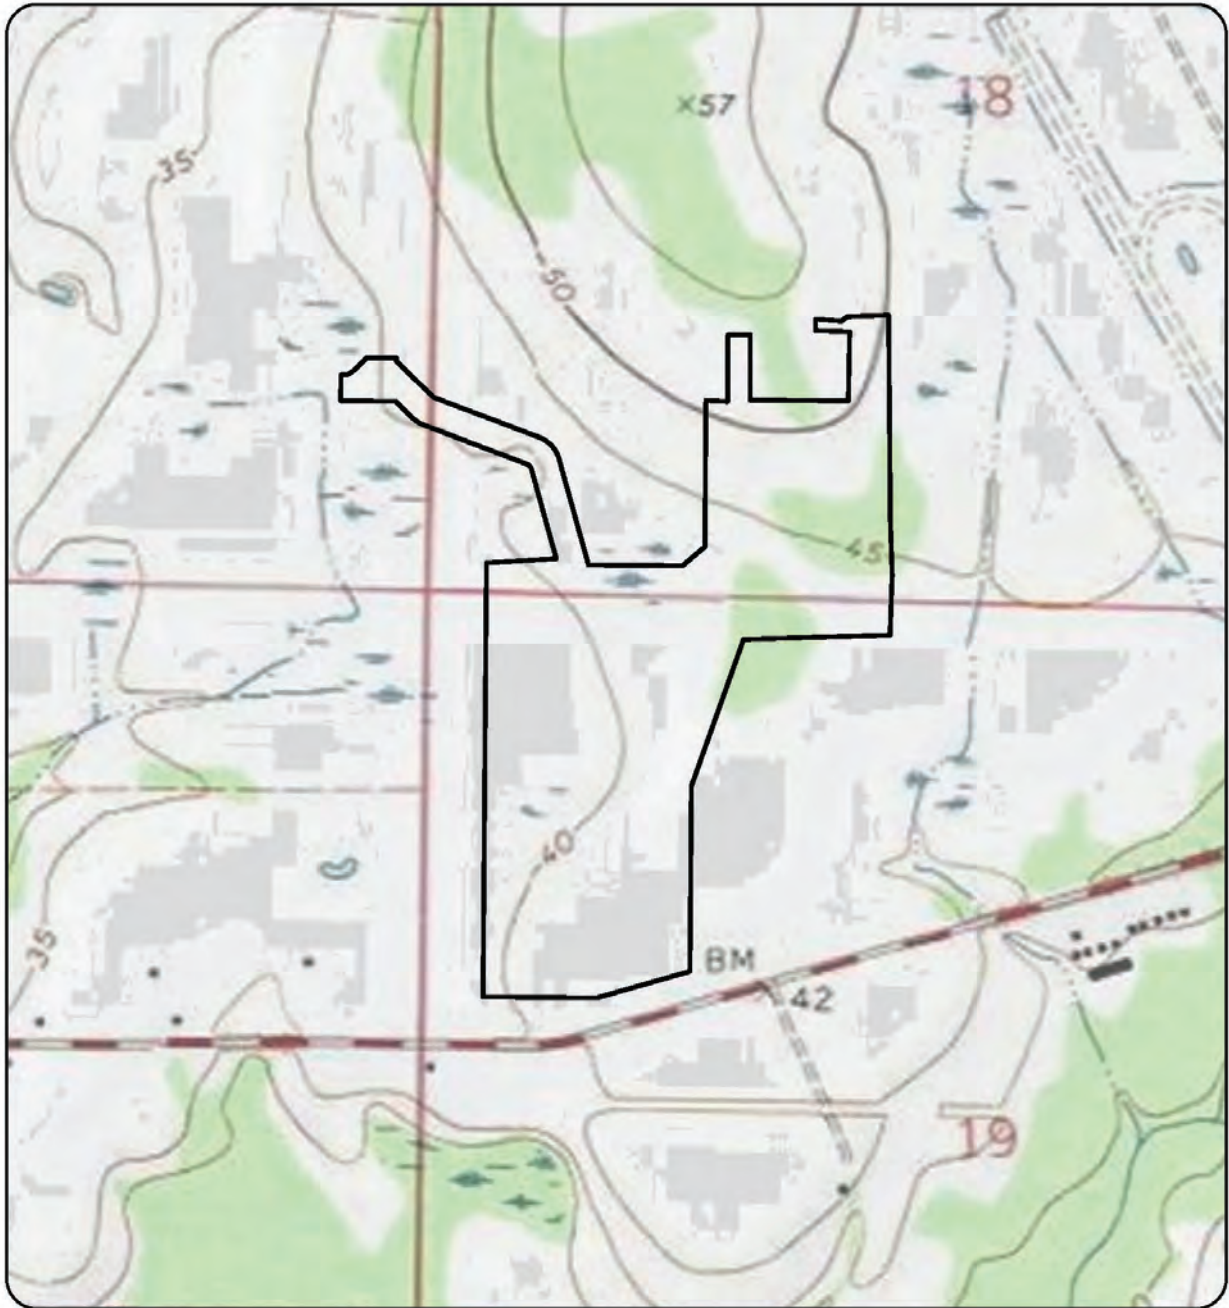

 Manatee Energy Storage Center

Manatee Energy Storage Center
USGS Topography Map




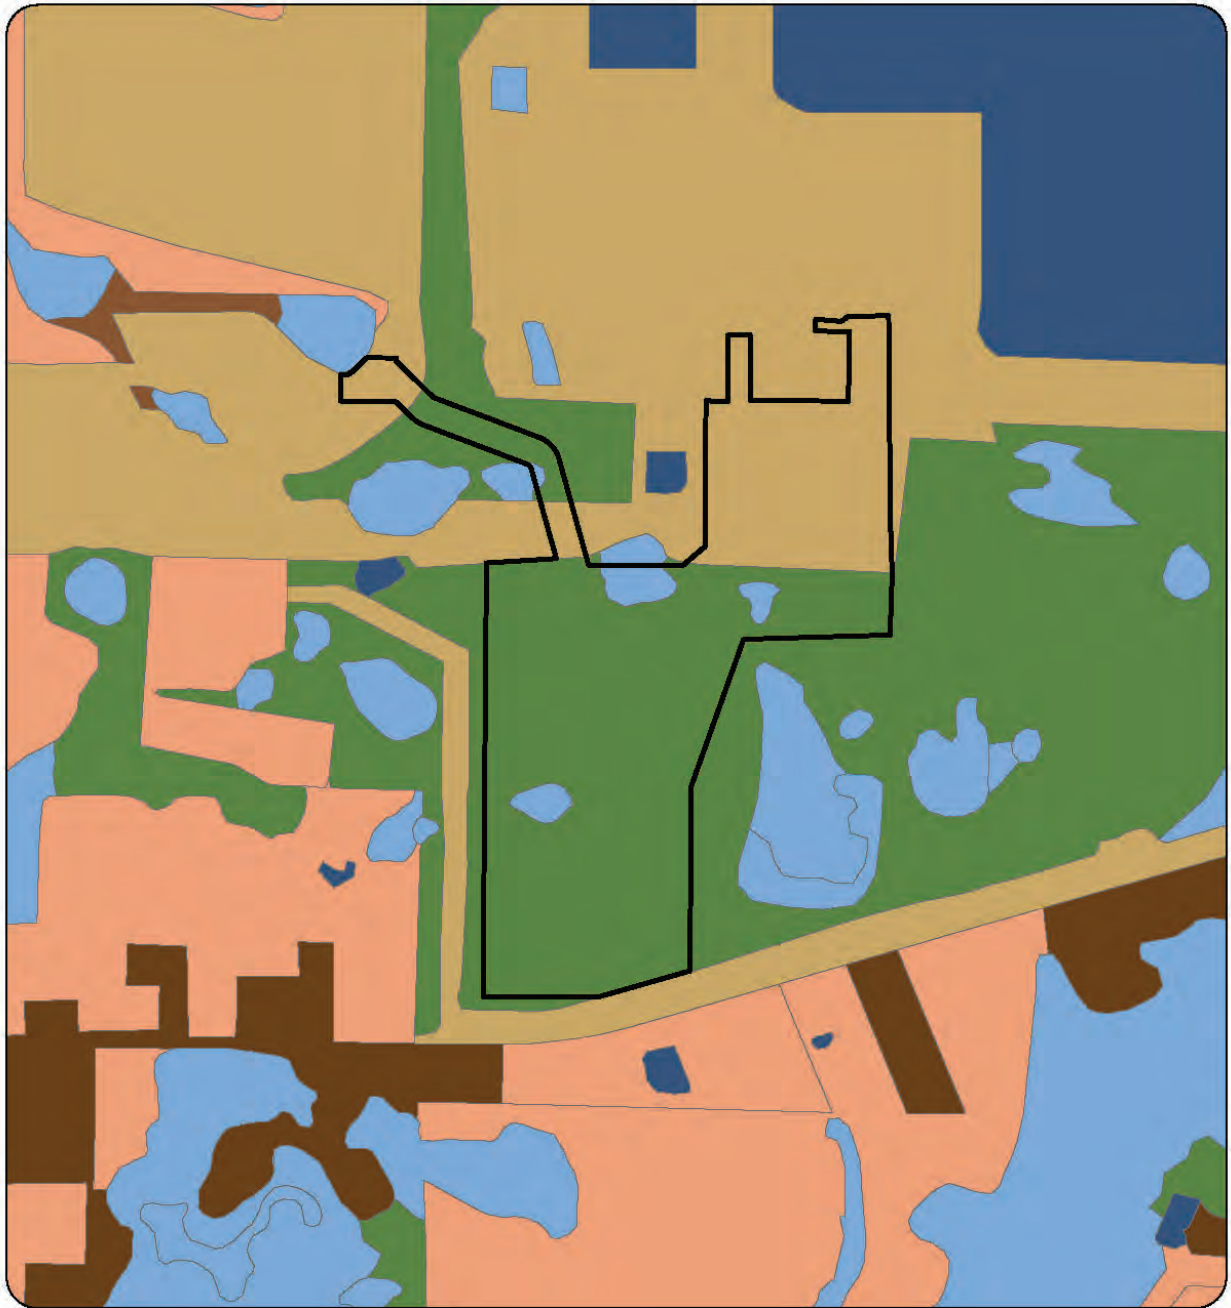

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Manatee Energy Storage Center

**Manatee Energy Storage Center
Land Use / Land Cover Map**




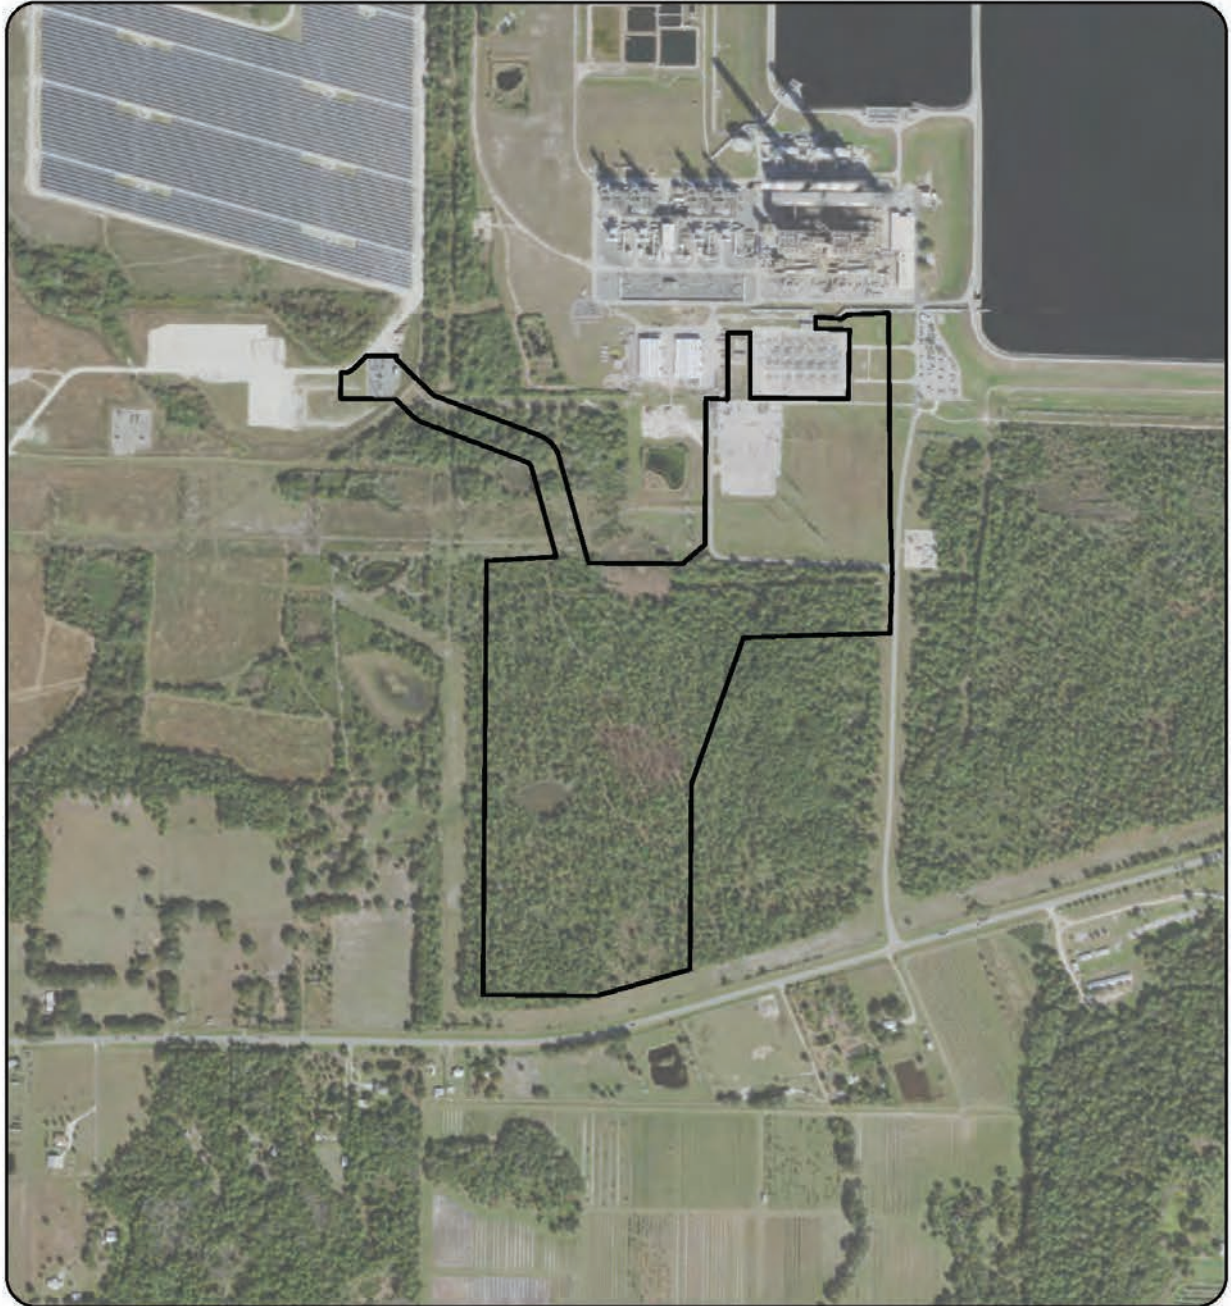

 Manatee Energy Storage Center


Manatee Energy Storage Center

Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 20: Sunshine Gateway Energy Storage Center,
Columbia County***

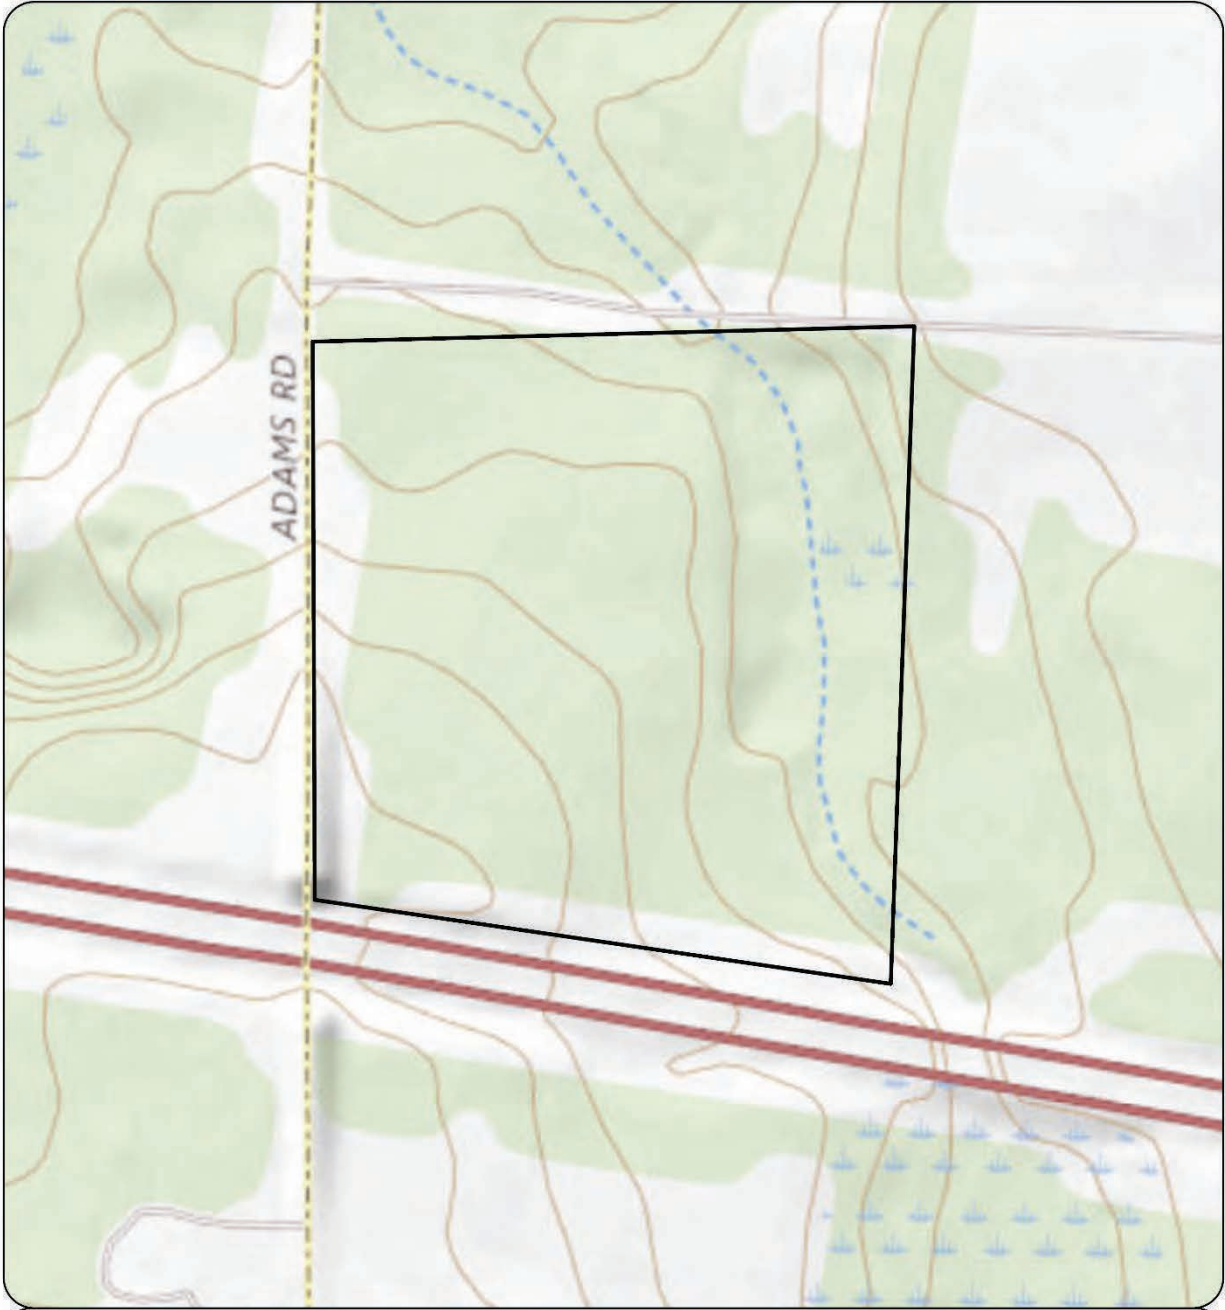

 Sunshine Gateway Energy Storage Center


Sunshine Gateway Energy Storage Center
 USGS Topography Map



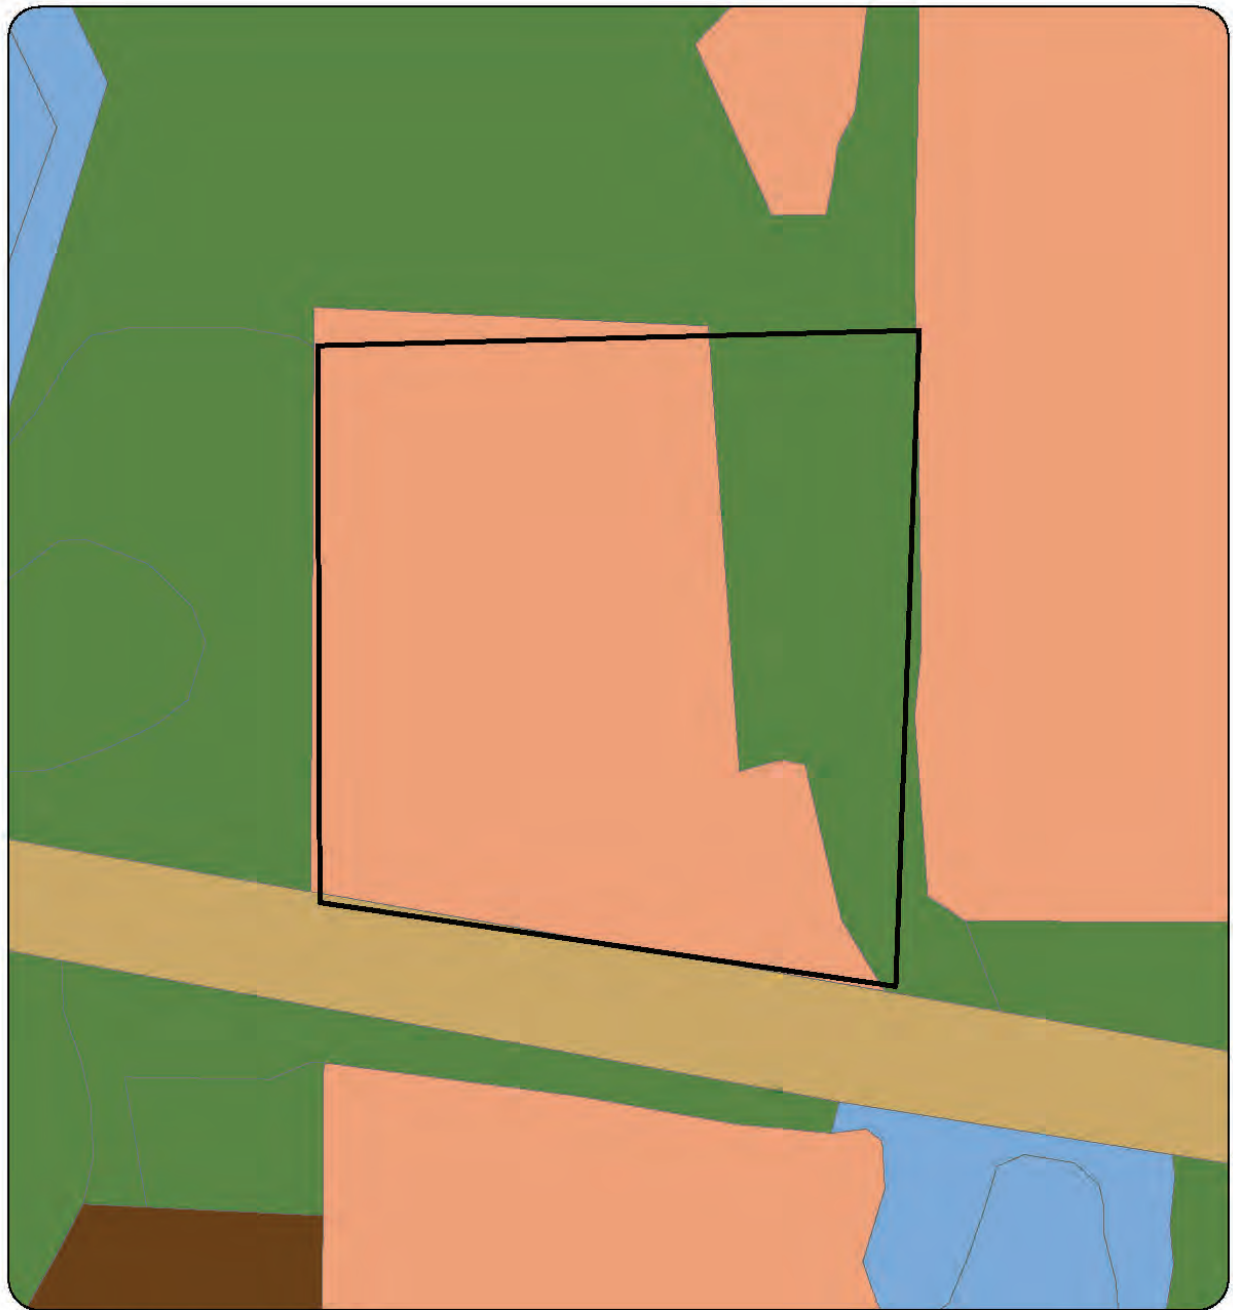

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Sunshine Gateway Energy Storage Center

**Sunshine Gateway Energy Storage Center
Land Use / Land Cover Map**





 Sunshine Gateway Energy Storage Center


Sunshine Gateway Energy Storage Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 21: Echo River Energy Storage Center,
Suwanee County***

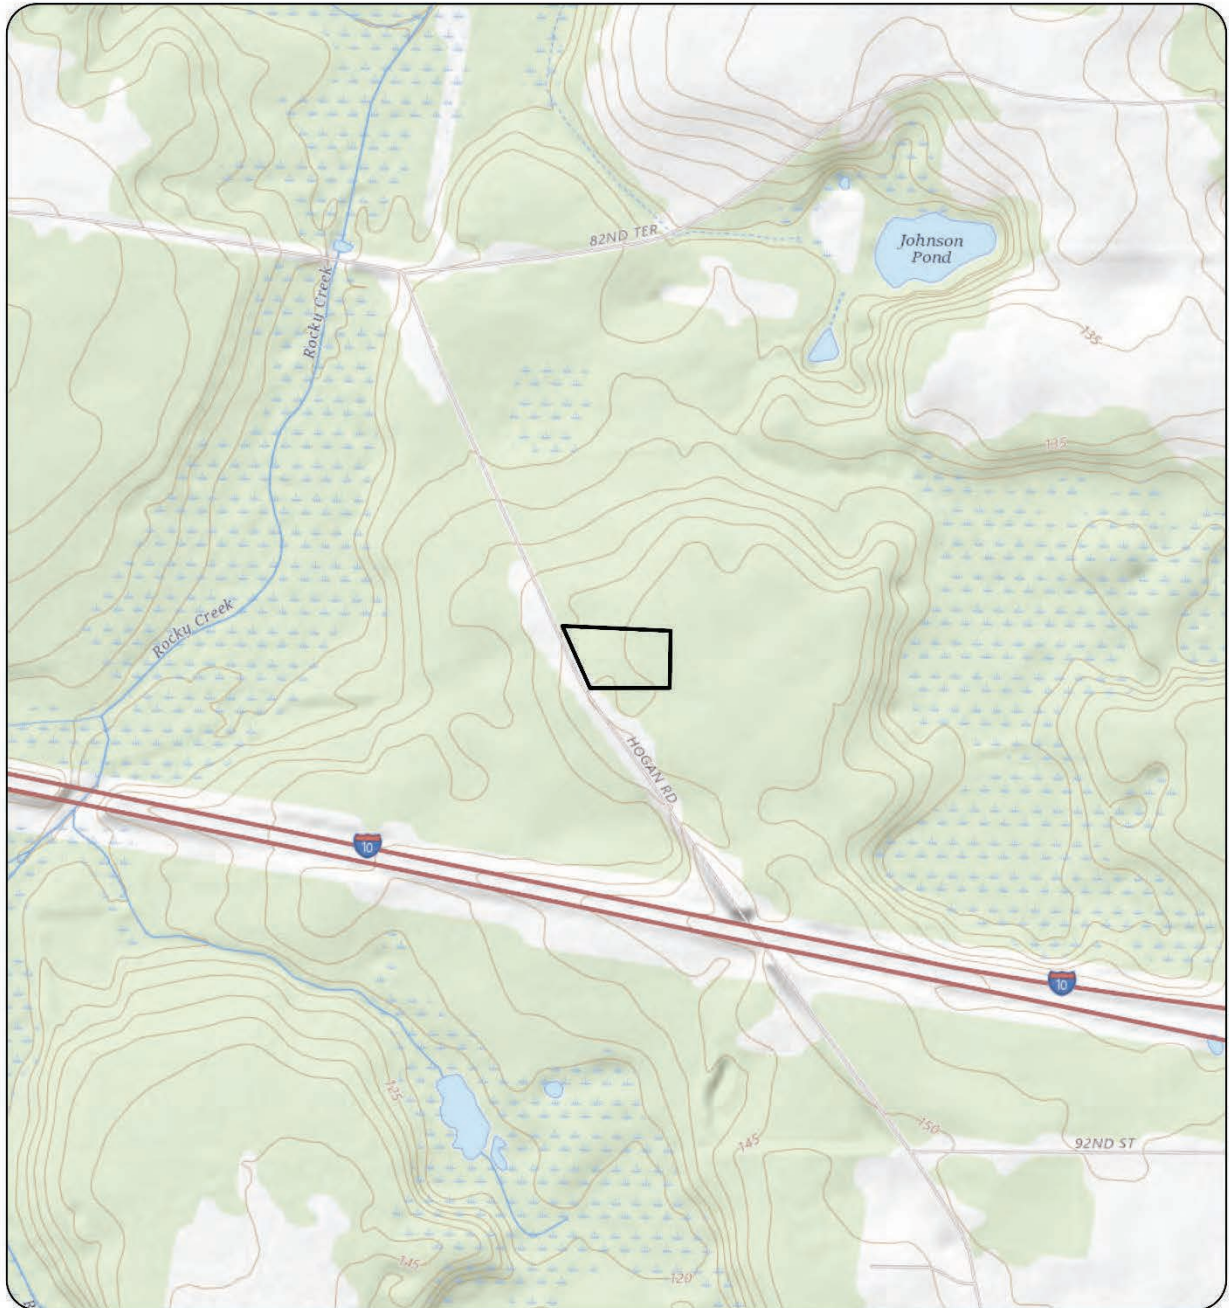

 Echo River Energy Storage Center

Echo River Energy Storage Center
USGS Topography Map



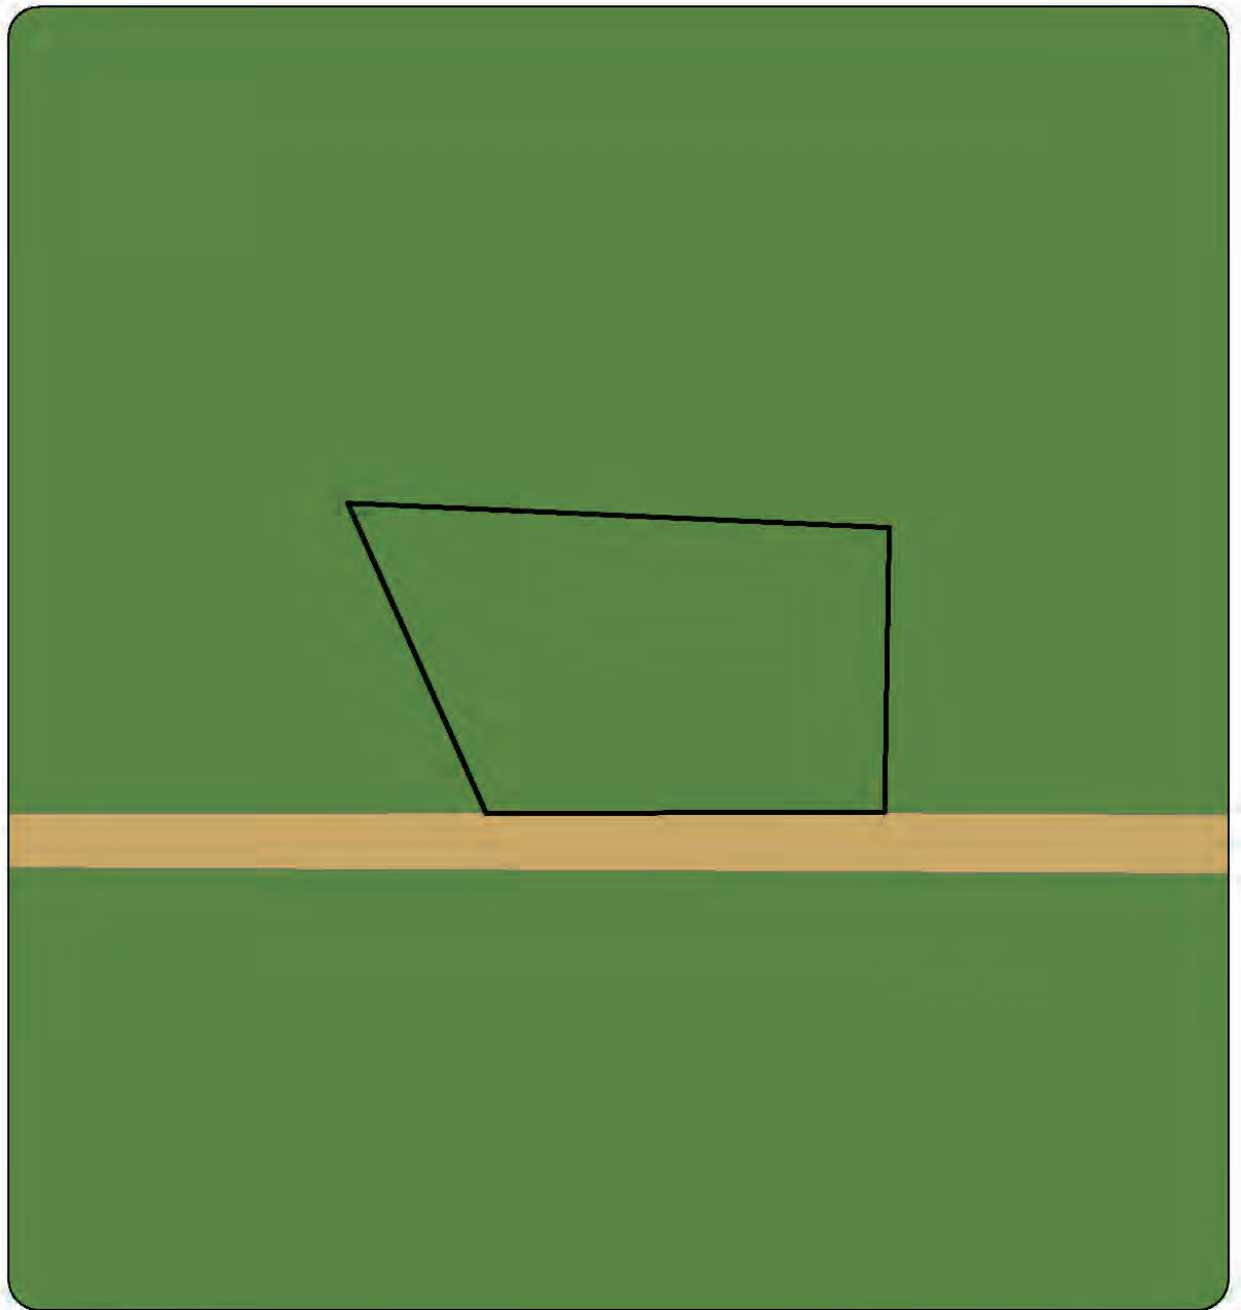


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Echo River Energy Storage Center

**Echo River Energy Storage Center
Land Use / Land Cover Map**





 Echo River Energy Storage Center


Echo River Energy Storage Center

Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 22: Dania Beach Clean Energy Center Unit 7,
Broward County***

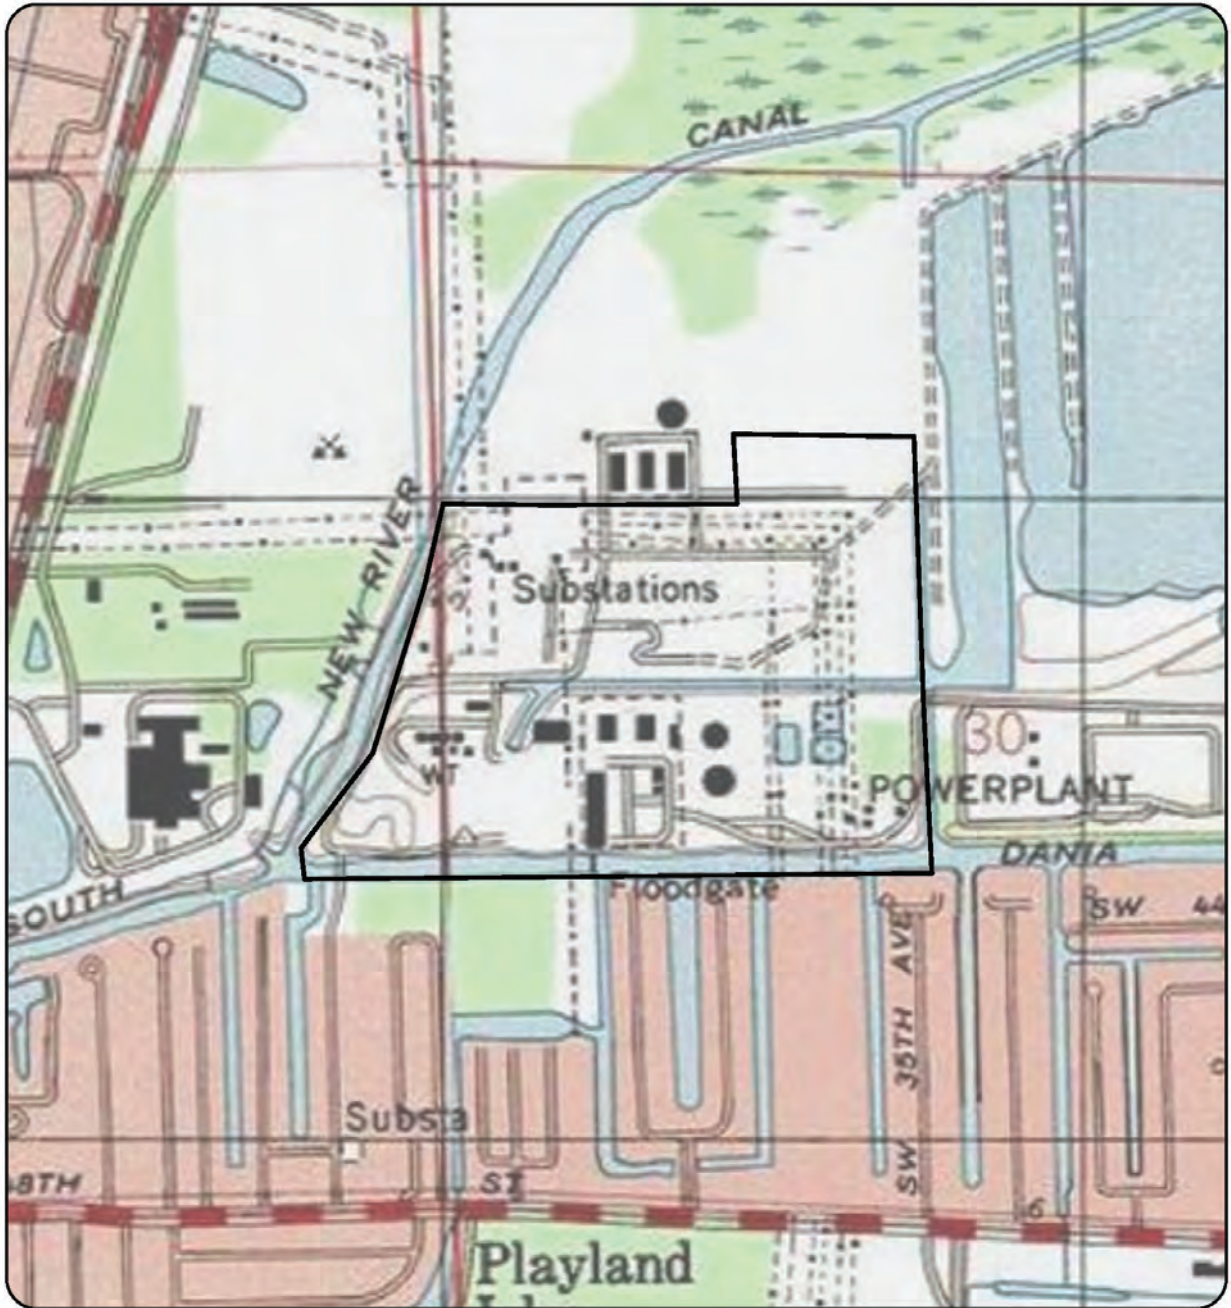

 Dania Beach Clean Energy Center Unit 7

Dania Beach Clean Energy Center Unit 7


USGS Topography Map





- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Dania Beach Clean Energy Center Unit 7

Dania Beach Clean Energy Center Unit 7
Land Use / Land Cover Map






 Dania Beach Clean Energy Center Unit 7


Dania Beach Clean Energy Center Unit 7


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 23: Turkey Point Units 6&7,
Miami-Dade County***

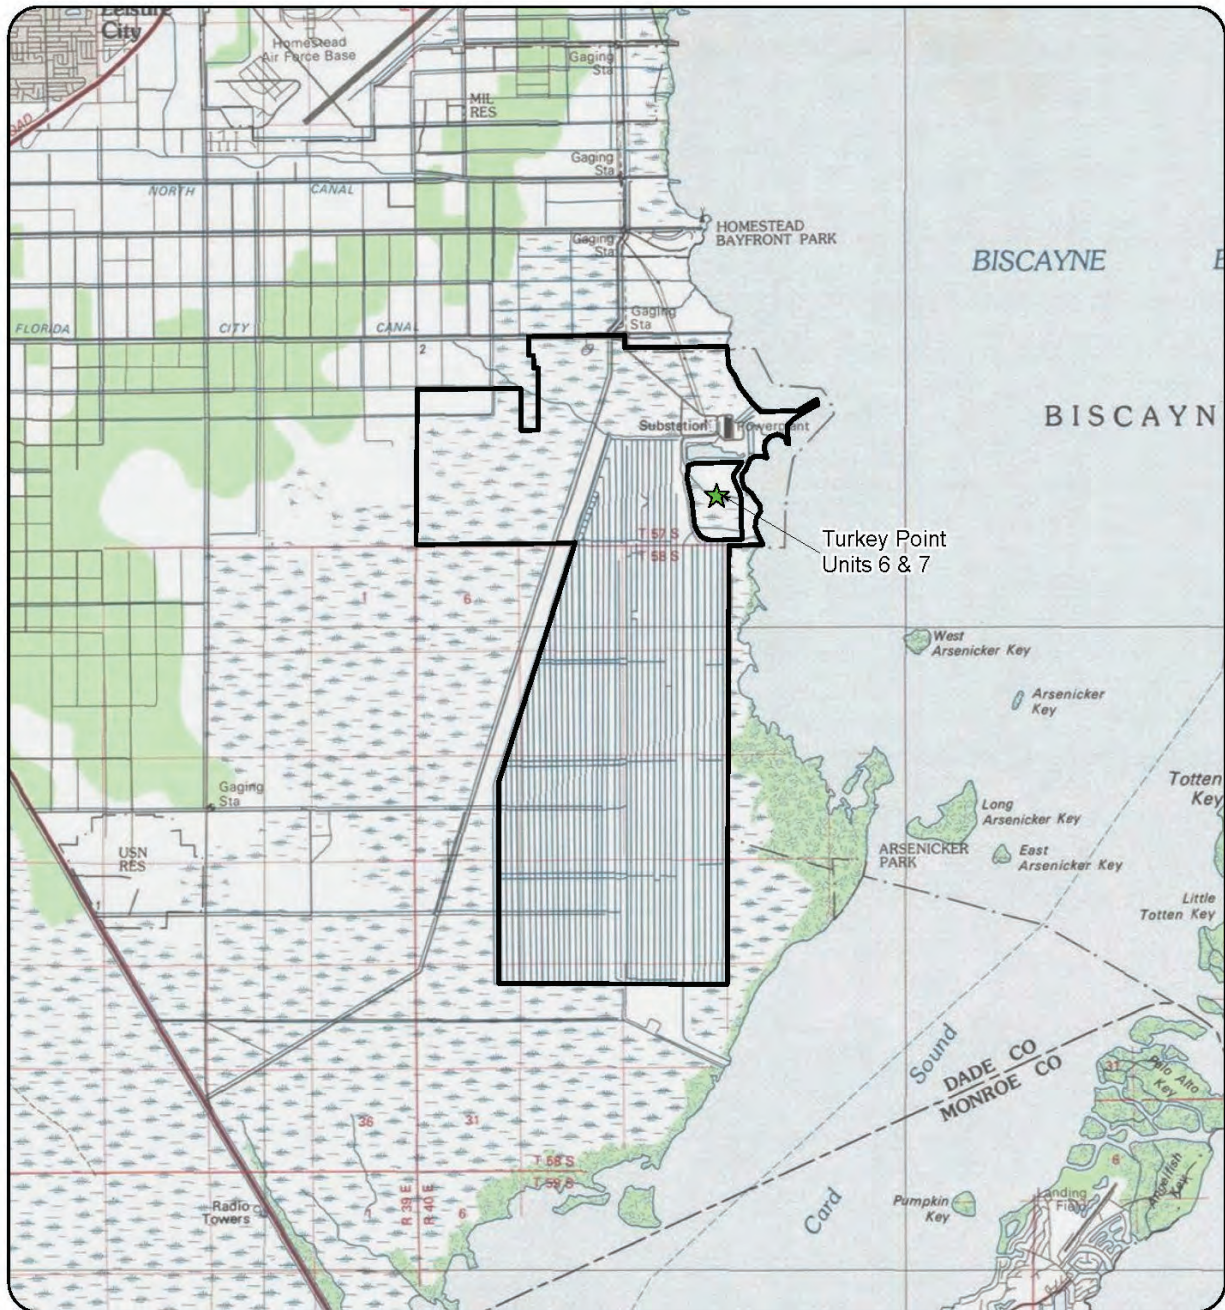

 Turkey Point Units 6 & 7

Turkey Point Units 6 & 7
USGS Topography Map



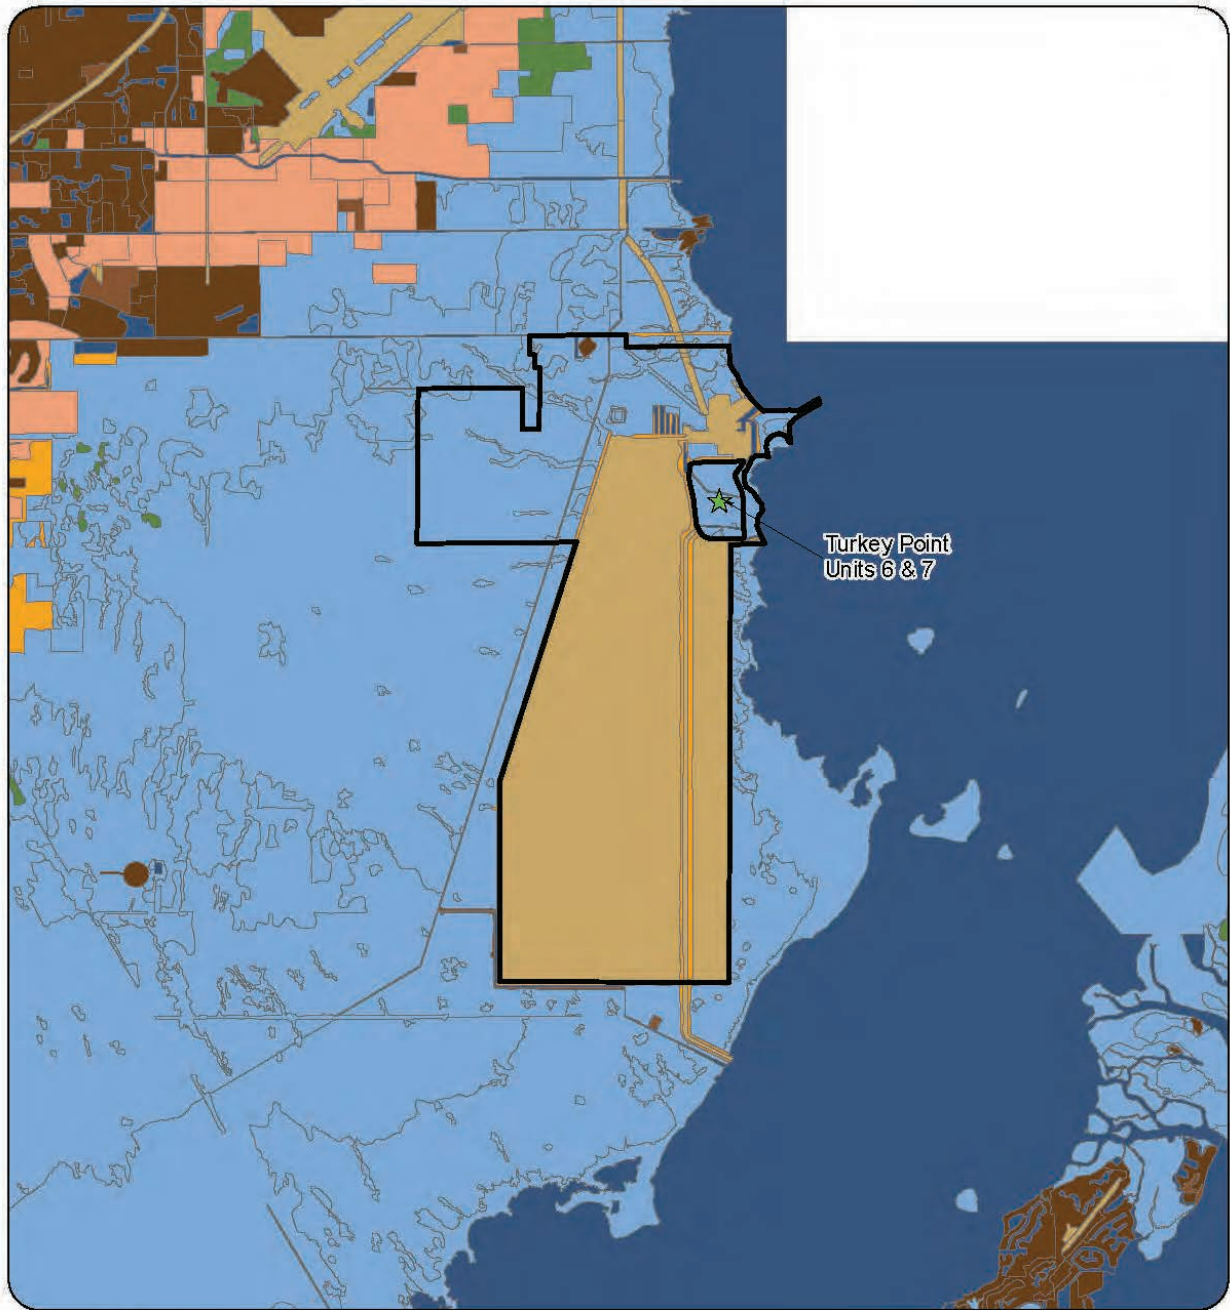

Turkey Point
Units 6 & 7

- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Turkey Point Units 6 & 7

Turkey Point Units 6 & 7
Land Use / Land Cover Map





 Turkey Point Units 6 & 7


Turkey Point Units 6 & 7

Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***Preferred Site # 24: Blue Springs Solar Energy Center,
Jackson County***

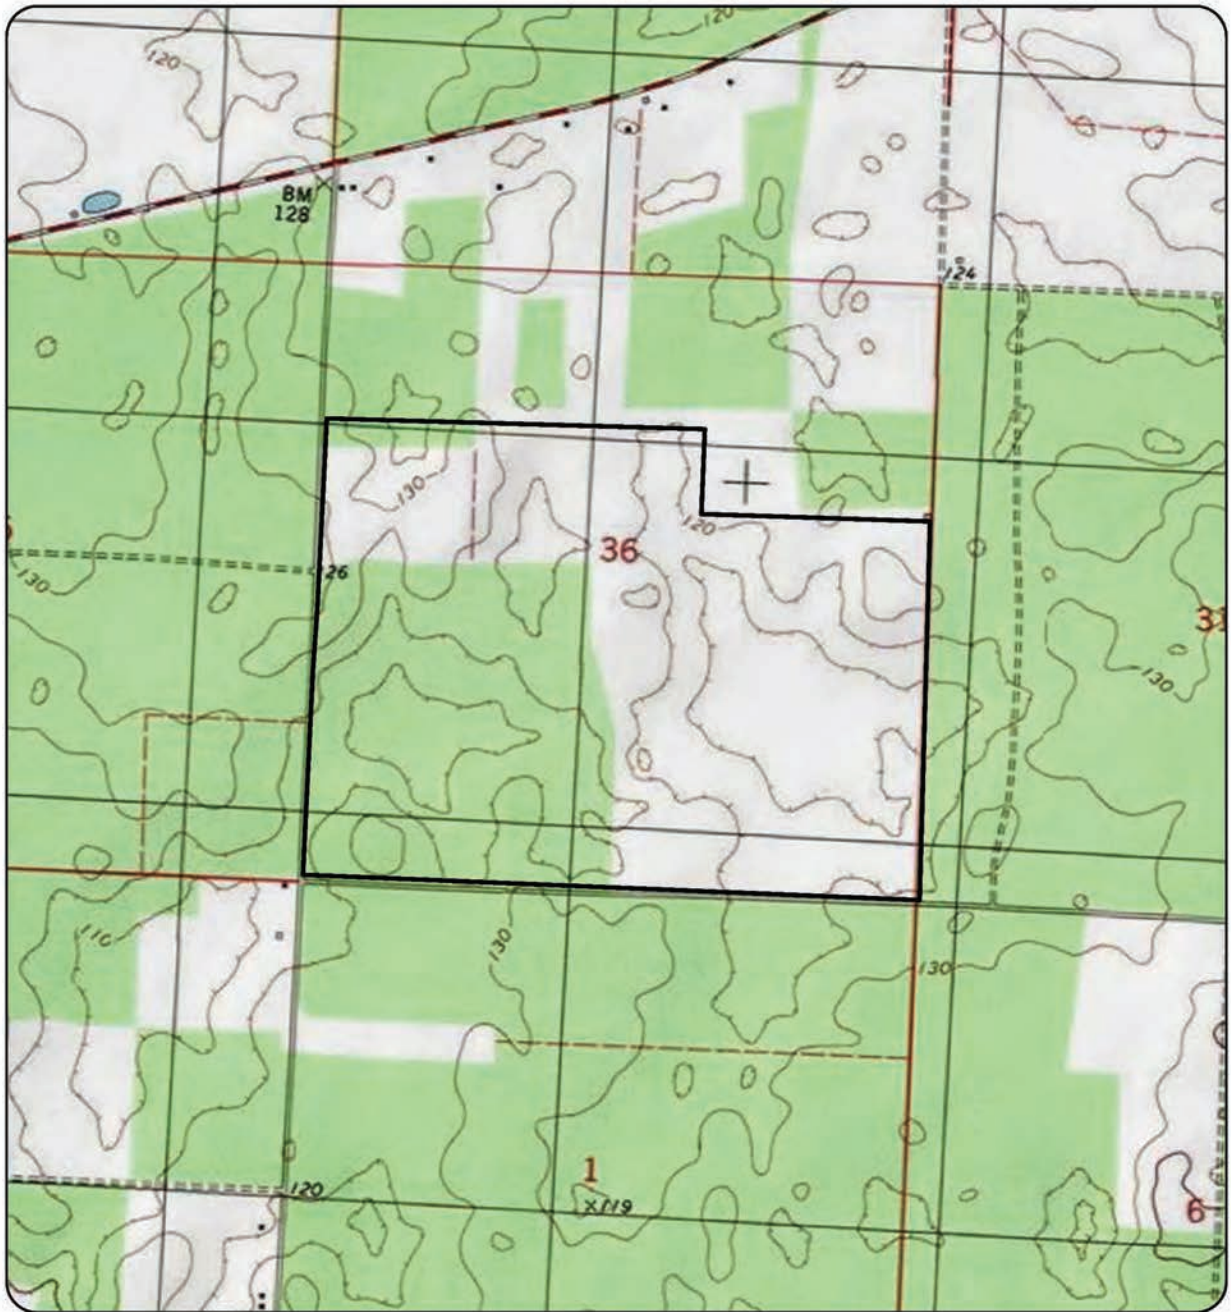


Blue Springs Solar Energy Center

Blue Springs Solar Energy Center
 USGS Topography Map










- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Blue Springs Solar Energy Center

Blue Springs Solar Energy Center
Land Use / Land Cover Map



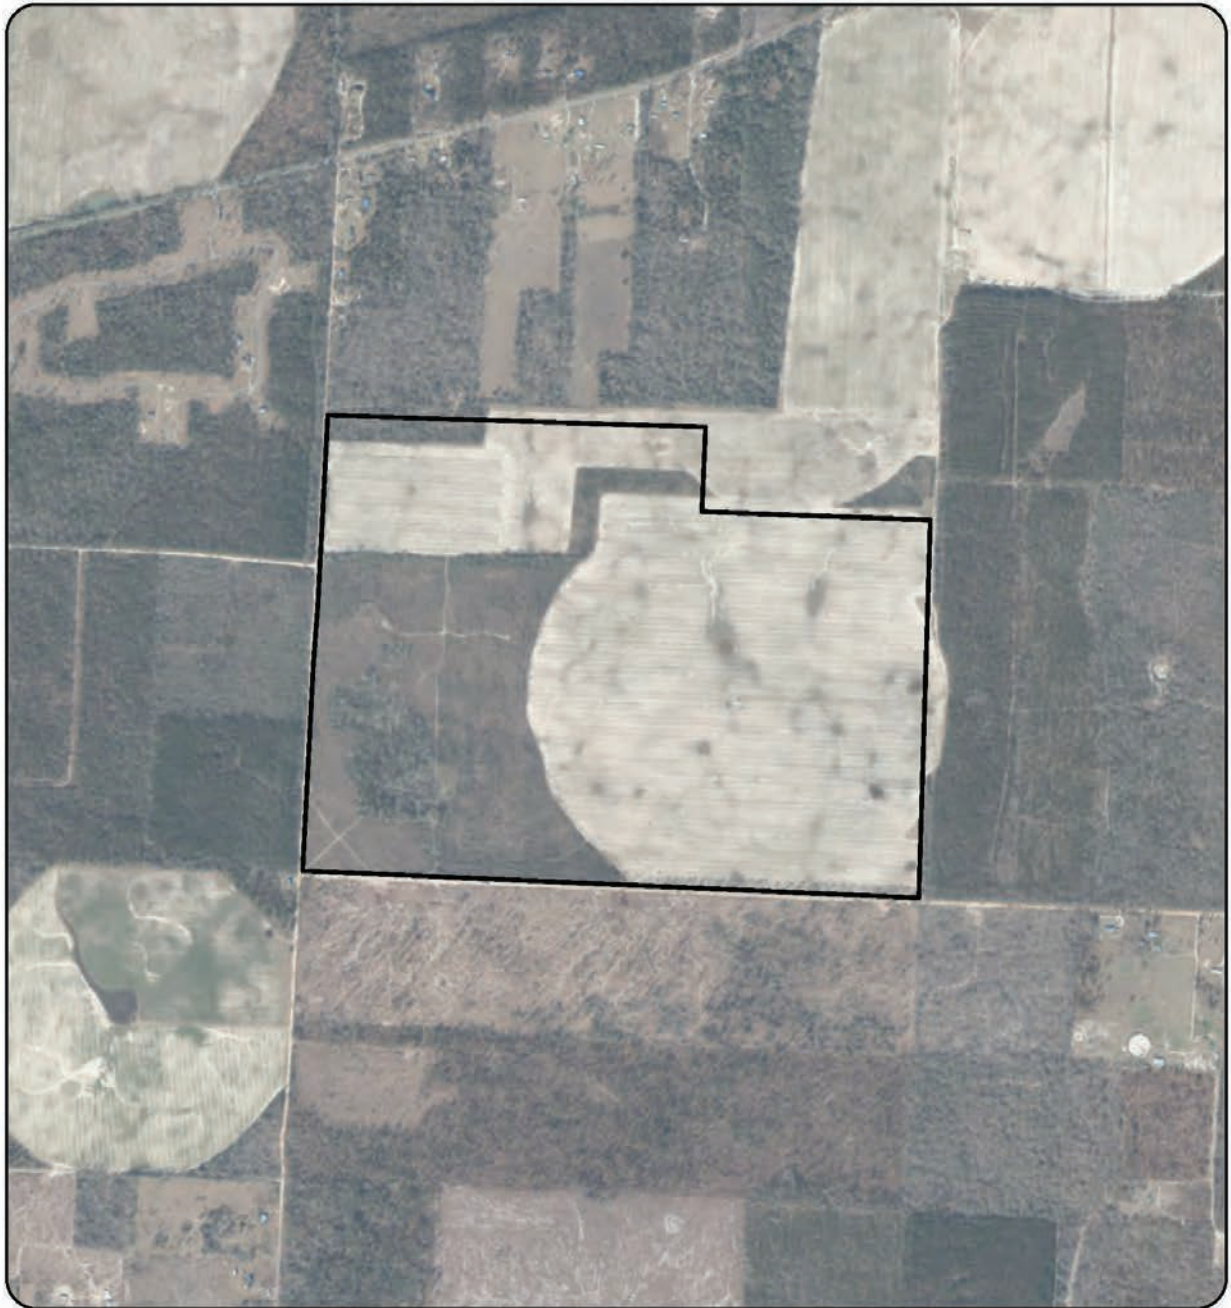

 Blue Springs Solar Energy Center


Blue Springs Solar Energy Center

Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***

***Preferred Site # 25: Chautauqua Solar Energy Center,
Walton County***

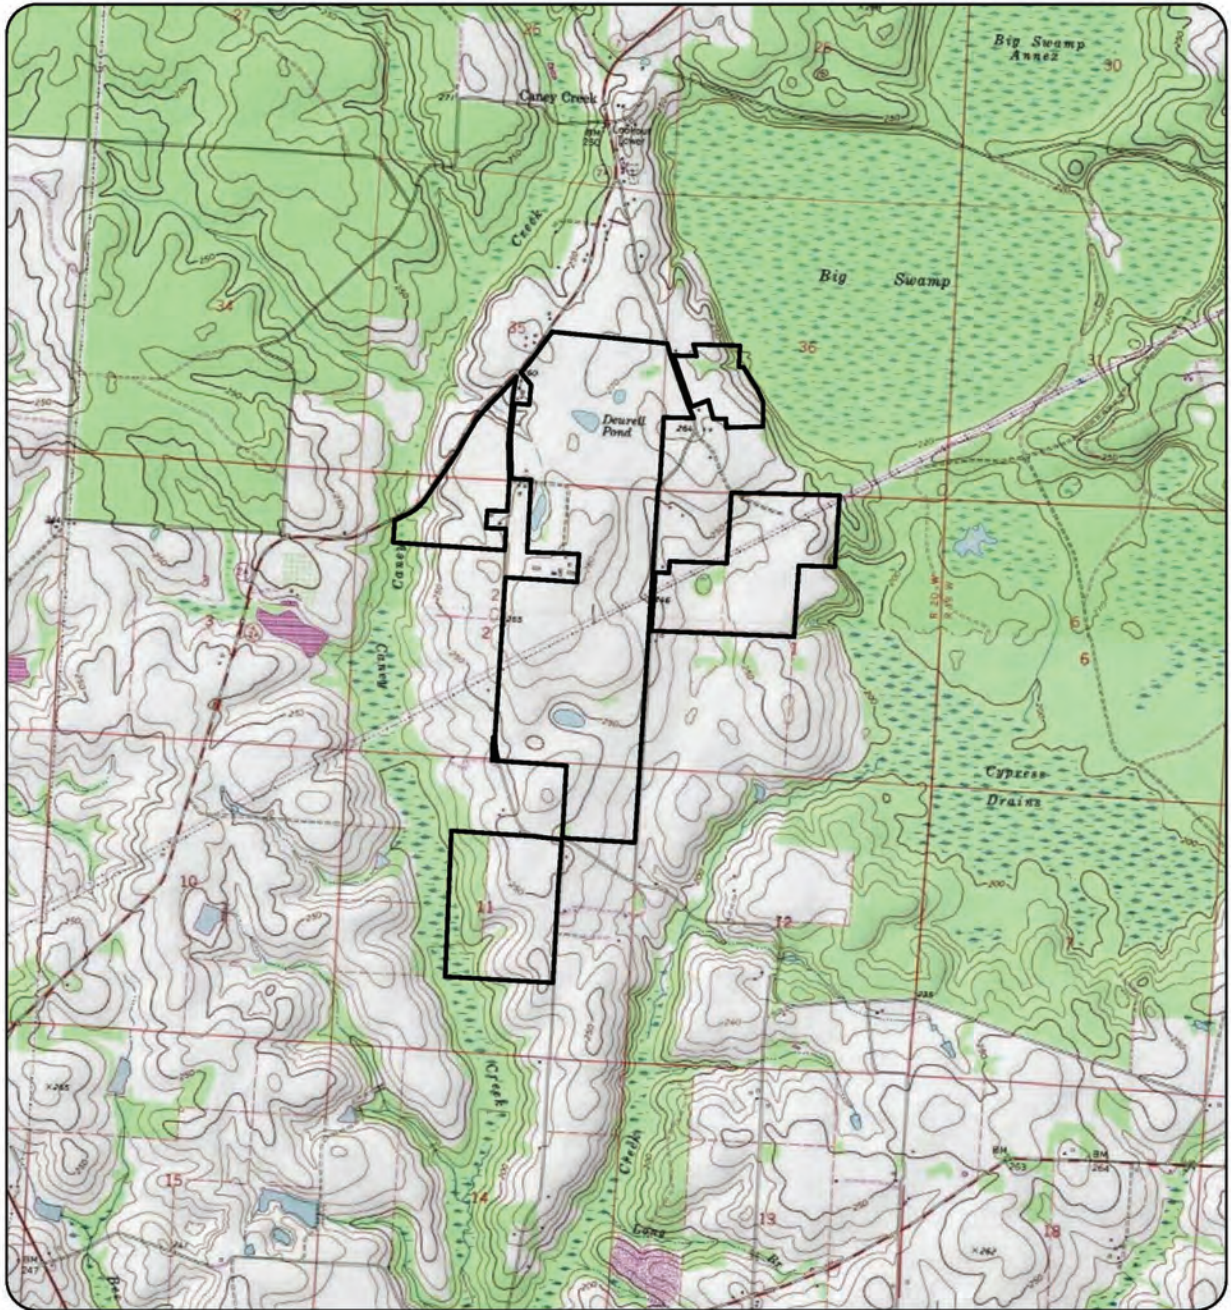


Chautauqua Solar Energy Center


Chautauqua Solar Energy Center
 USGS Topography Map




FLORIDA



Gulf Power®




0 925 1,850
feet

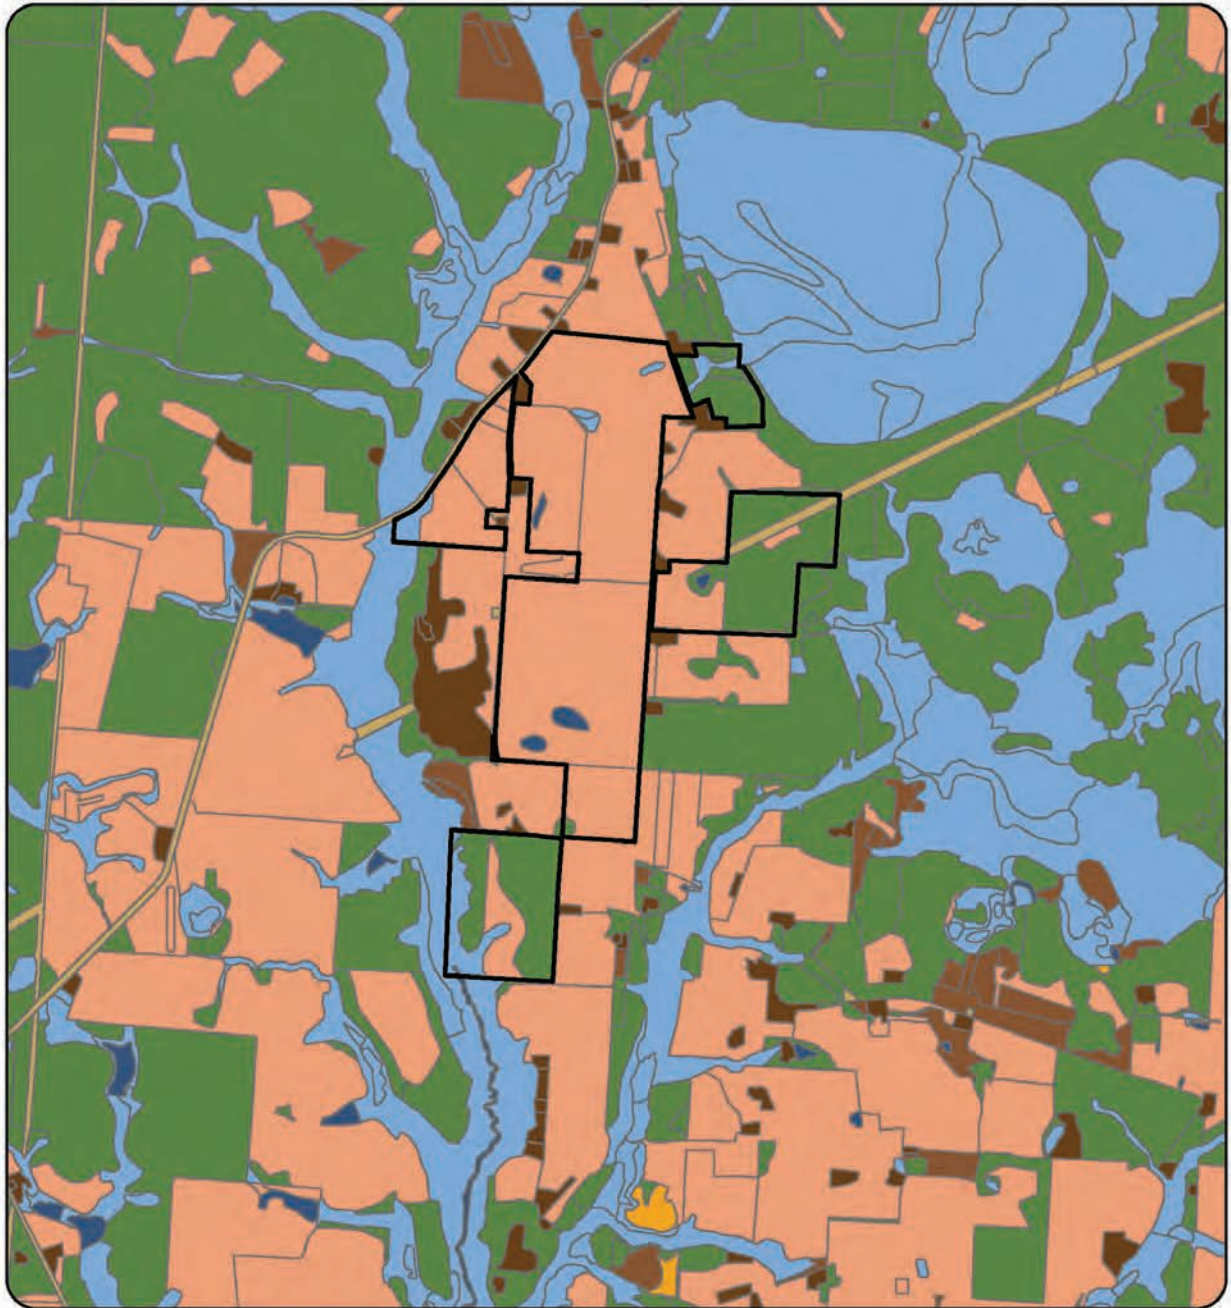


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Chautauqua Solar Energy Center

Chautauqua Solar Energy Center
Land Use / Land Cover Map



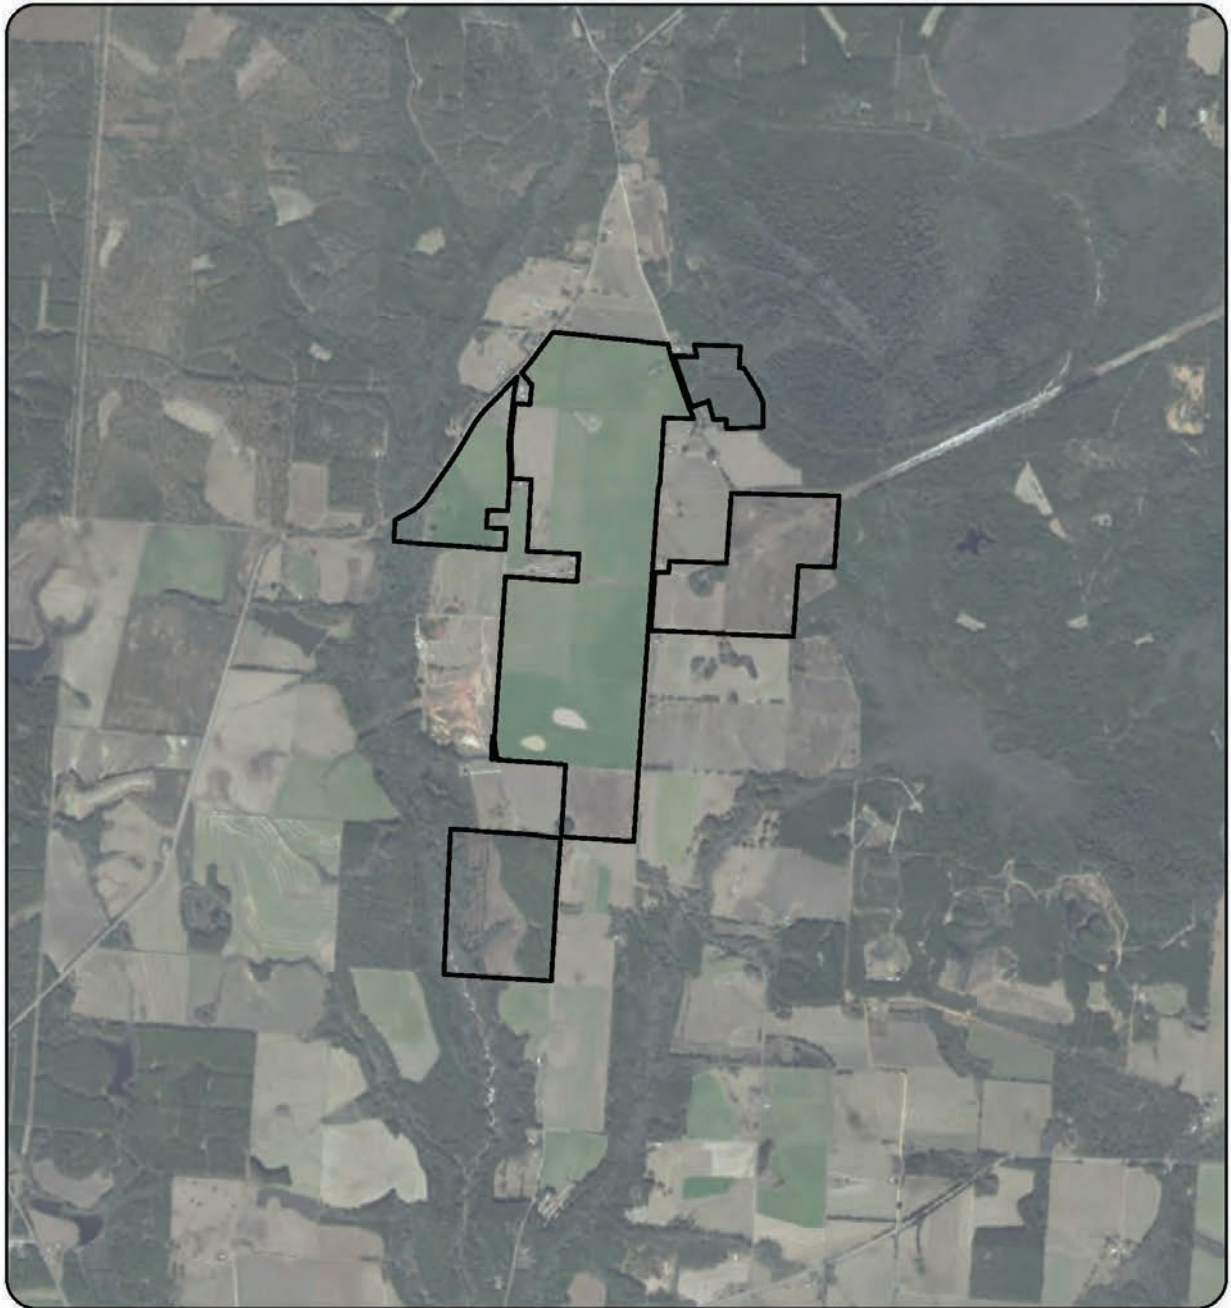

 Chautauqua Solar Energy Center


Chautauqua Solar Energy Center


Facility Layout Map



***Environmental and Land Use Information:
Supplemental Information***

***Preferred Site # 26: Crist Unit 8,
Escambia County***

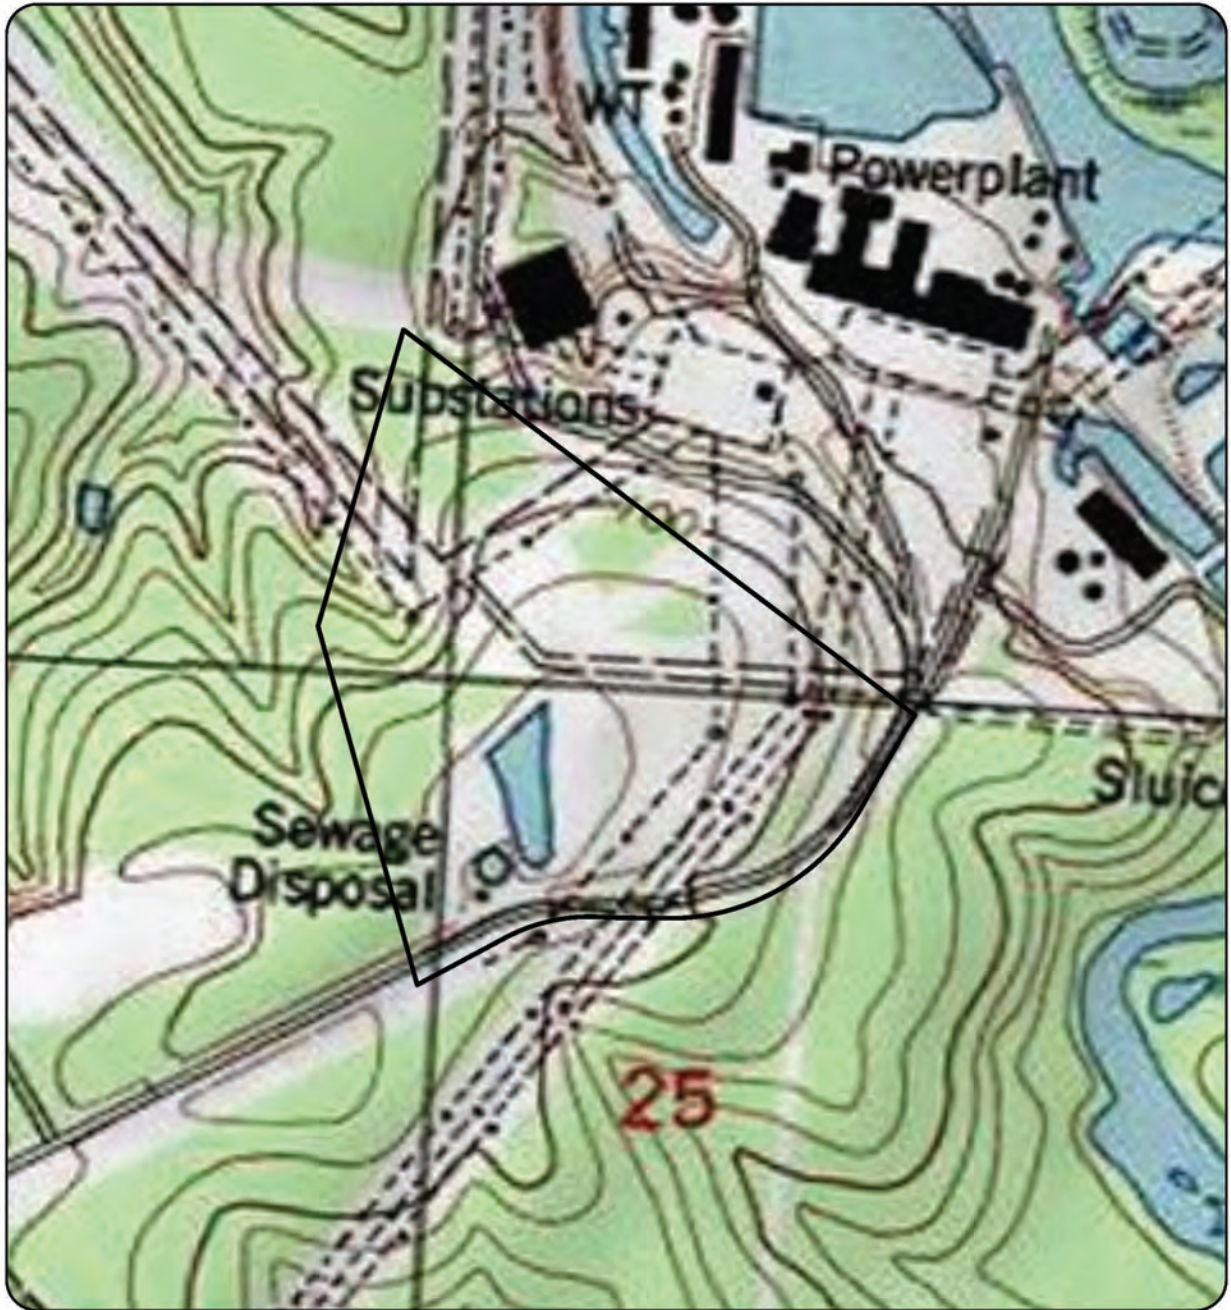

 Crist Unit 8

Crist Unit 8
 USGS Topography Map

Pensacola



- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Crist Unit 8

Crist Unit 8
Land Use / Land Cover Map






 Crist Unit 8


Crist Unit 8
Facility Layout Map




***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 1: Elder Branch Solar Energy Center,
Manatee County***

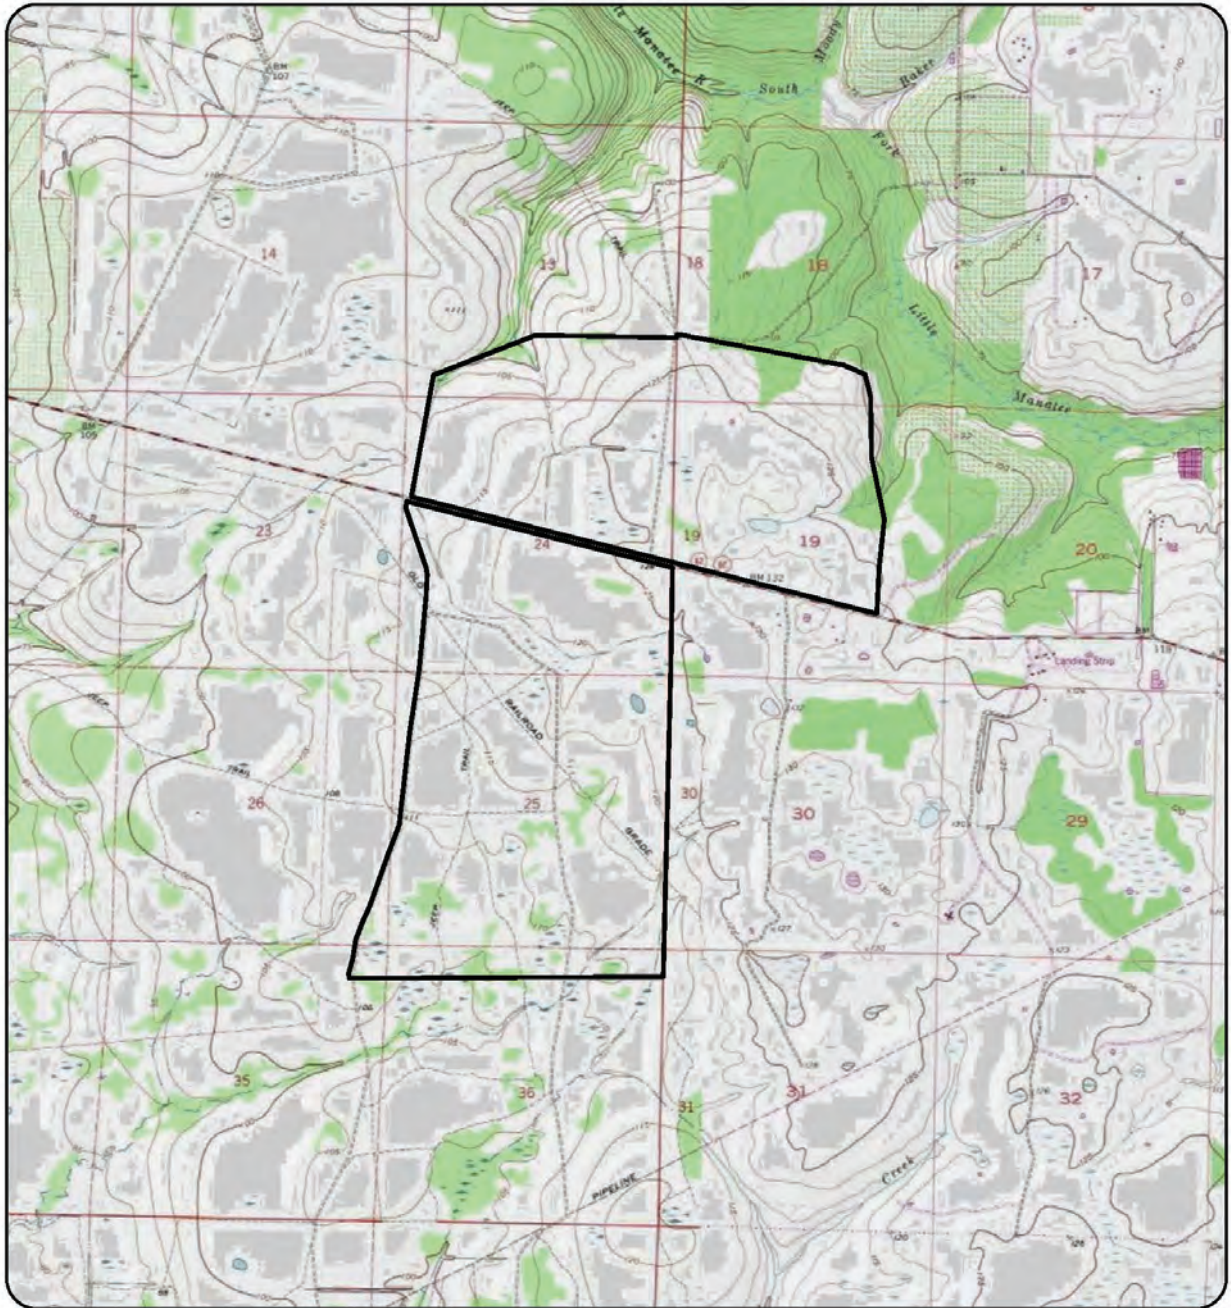

 Elder Branch Solar Energy Center


Elder Branch Solar Energy Center
 USGS Topography Map



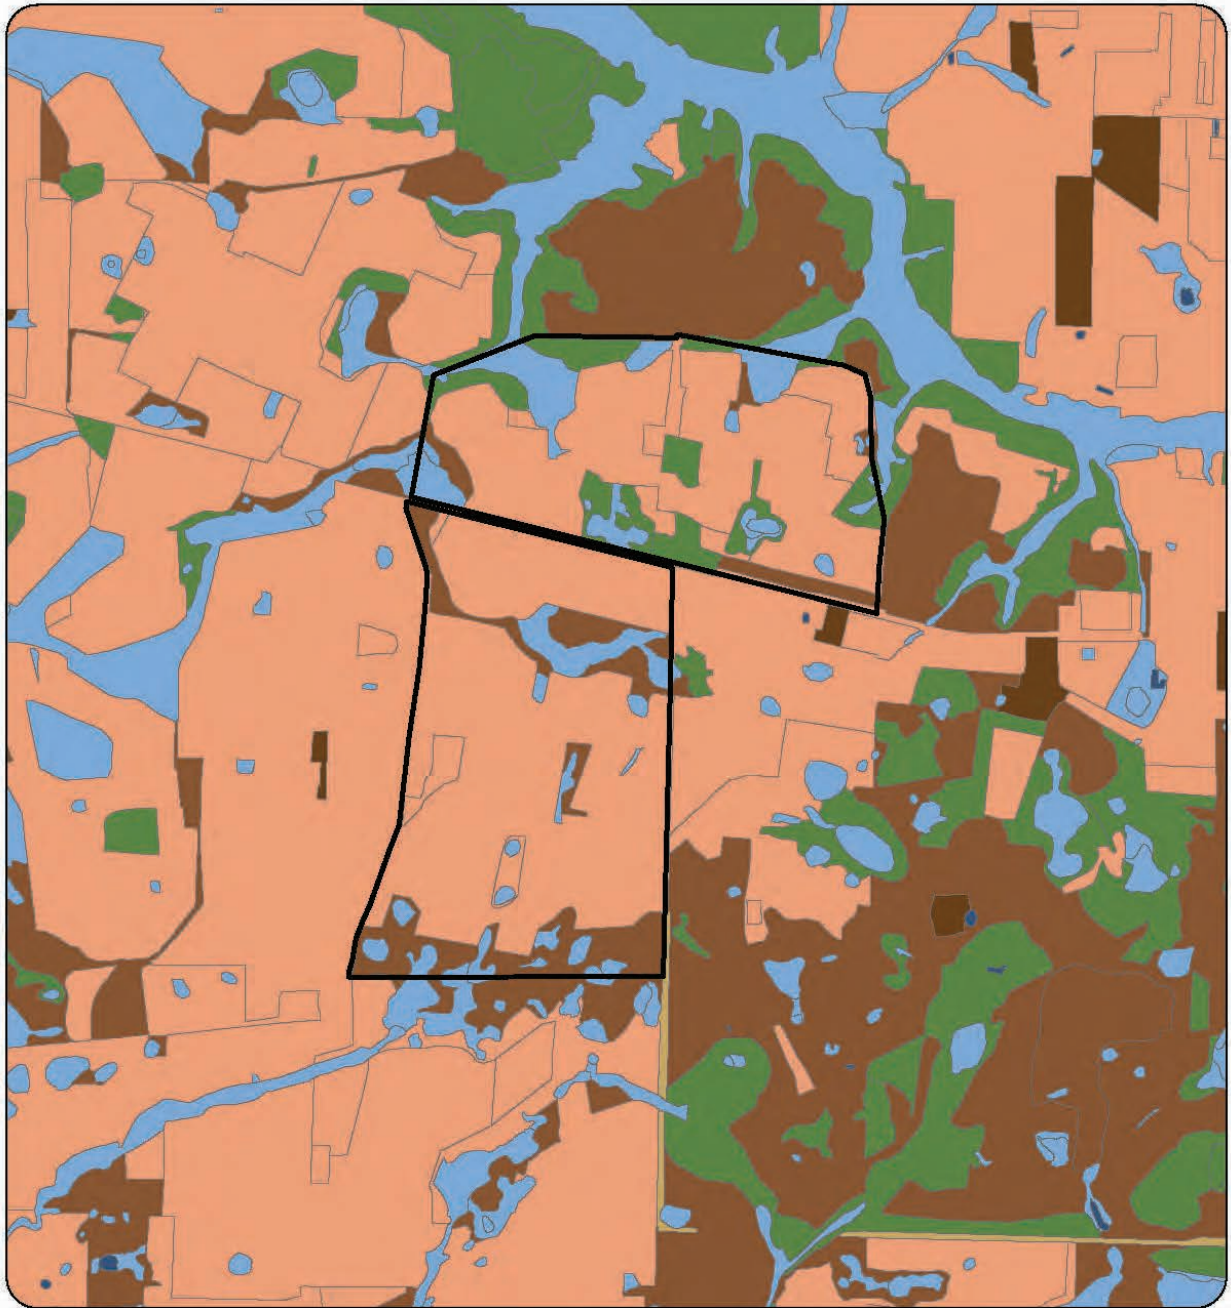


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Elder Branch Solar Energy Center

Elder Branch Solar Energy Center
Land Use / Land Cover Map



***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 2: Everglades Solar Energy Center,
Miami-Dade County***

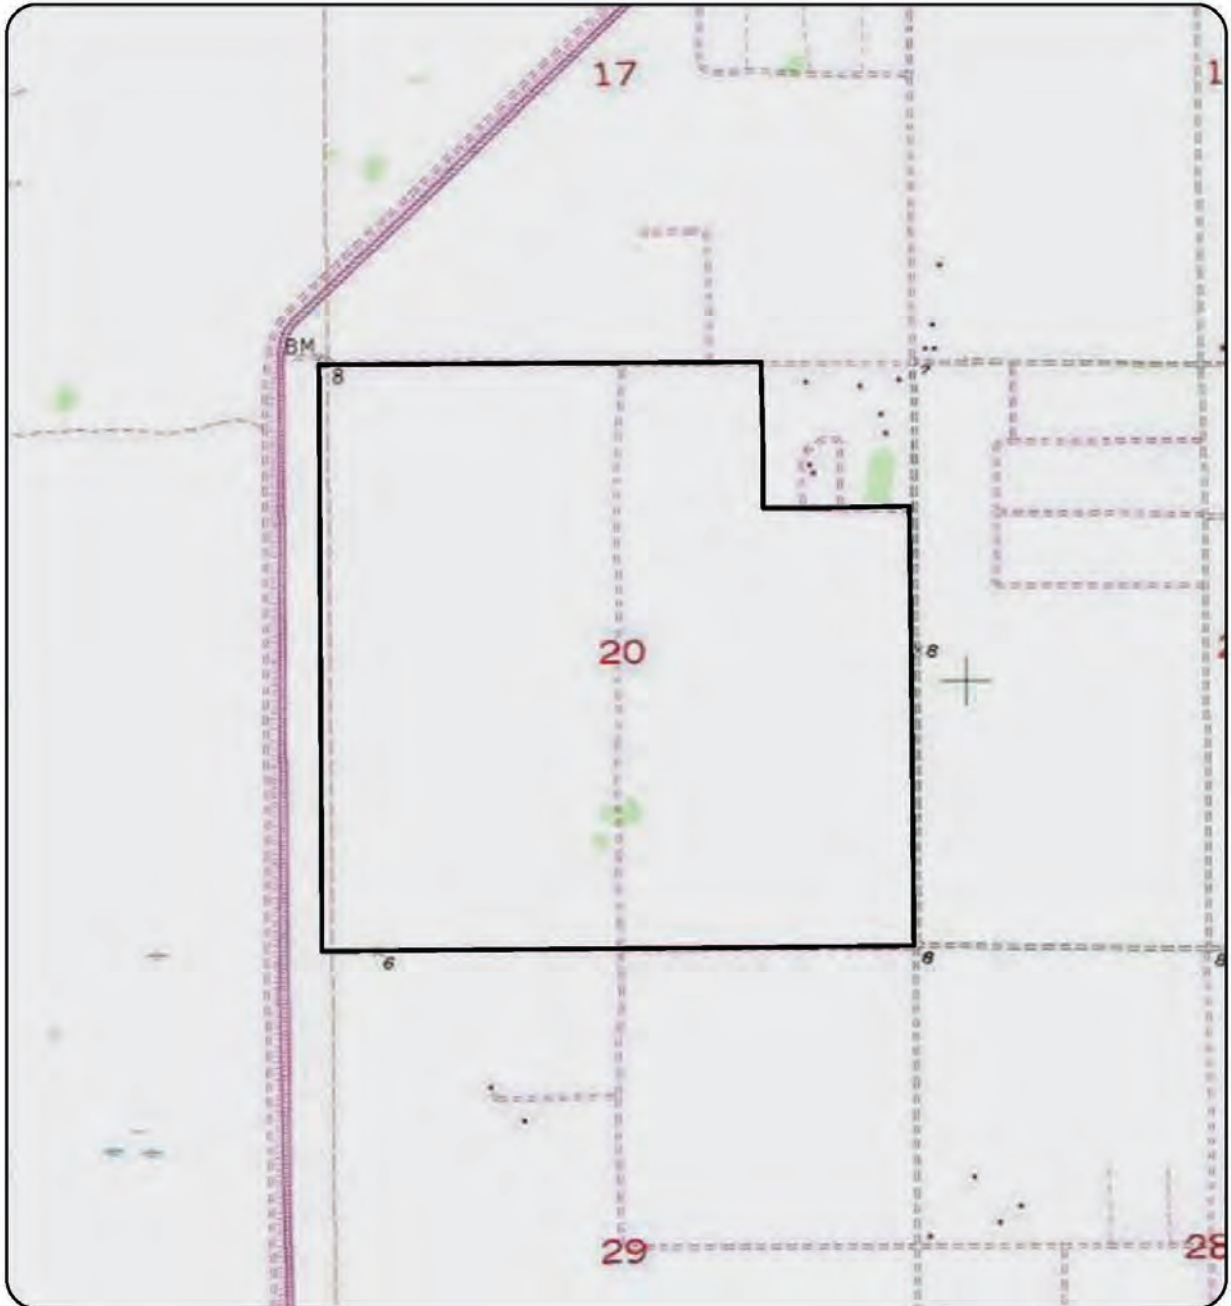

 Everglades Solar Energy Center


Everglades Solar Energy Center
USGS Topography Map



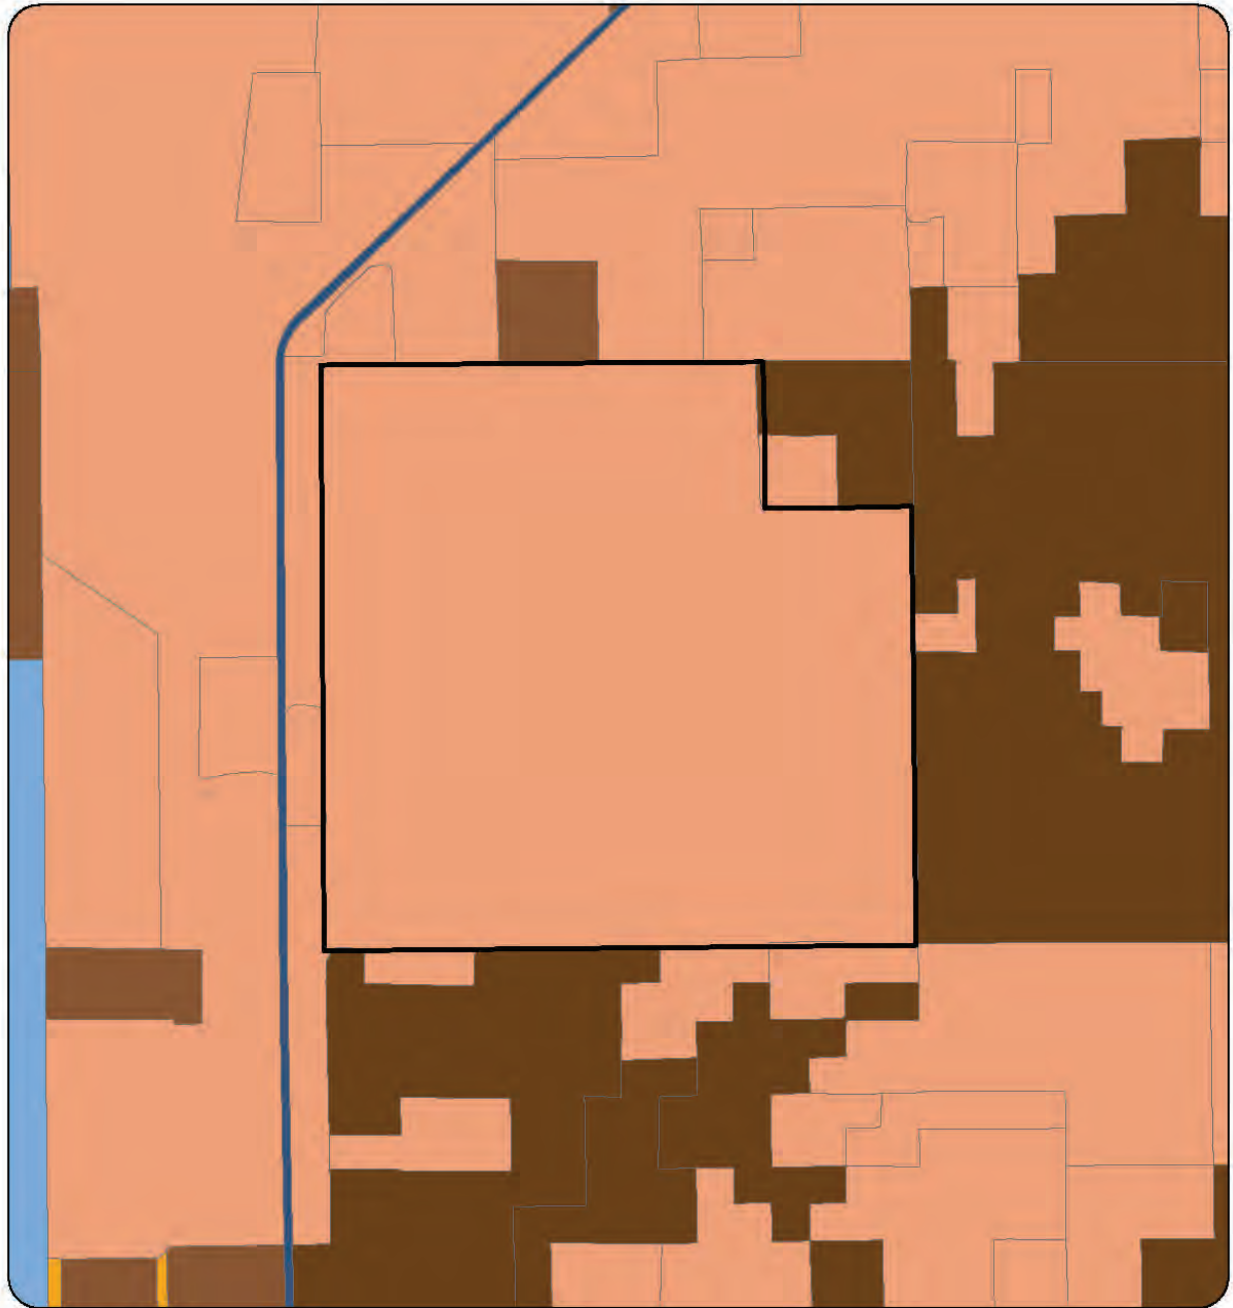


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Everglades Solar Energy Center


Everglades Solar Energy Center
Land Use / Land Cover Map




***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 3: Ghost Orchid Solar Energy Center,
Hendry County***

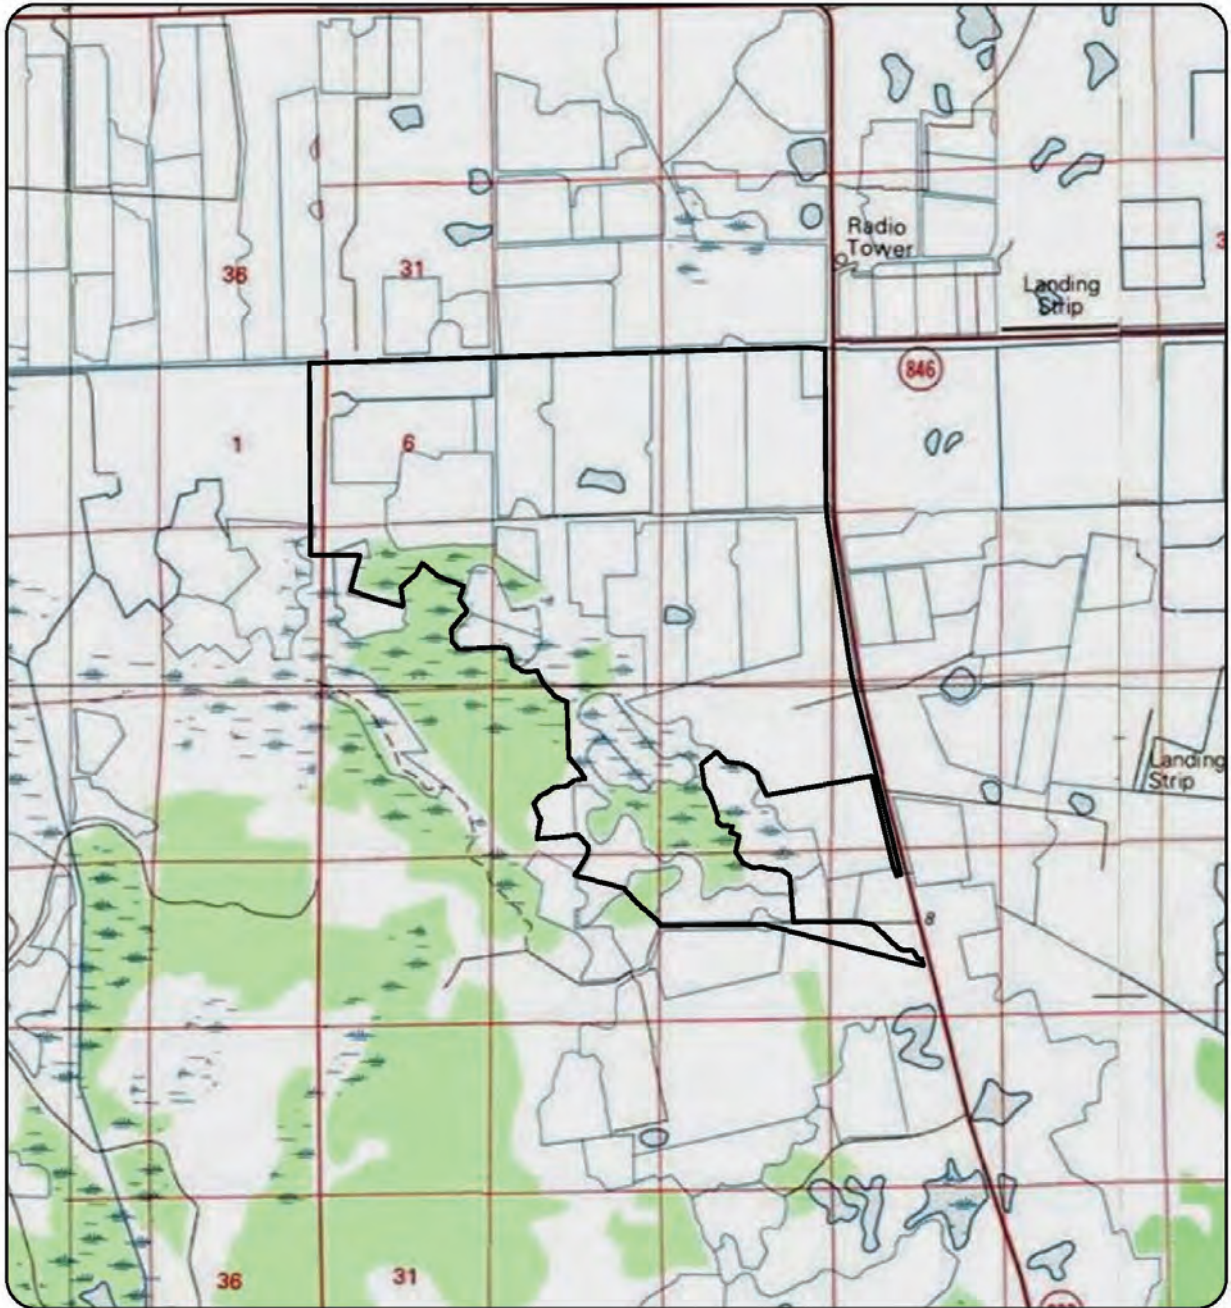

 Ghost Orchid Solar Energy Center


Ghost Orchid Solar Energy Center
USGS Topography Map



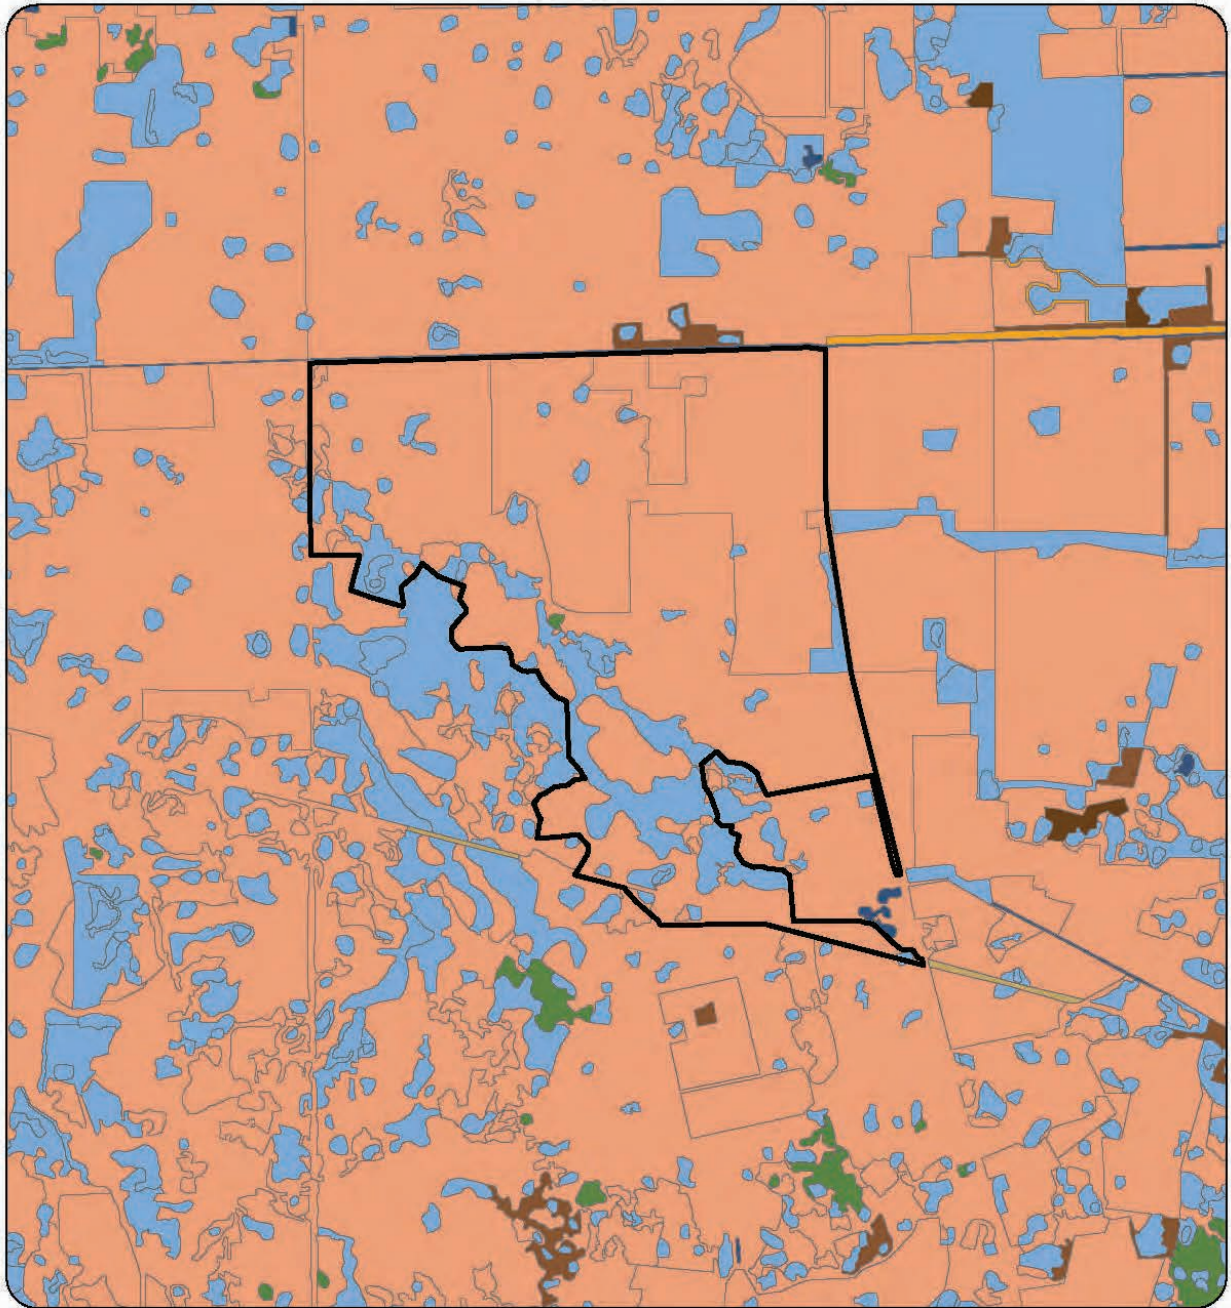


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Ghost Orchid Solar Energy Center

Ghost Orchid Solar Energy Center
Land Use / Land Cover Map



***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 4: Sawgrass Solar Energy Center,
Hendry County***

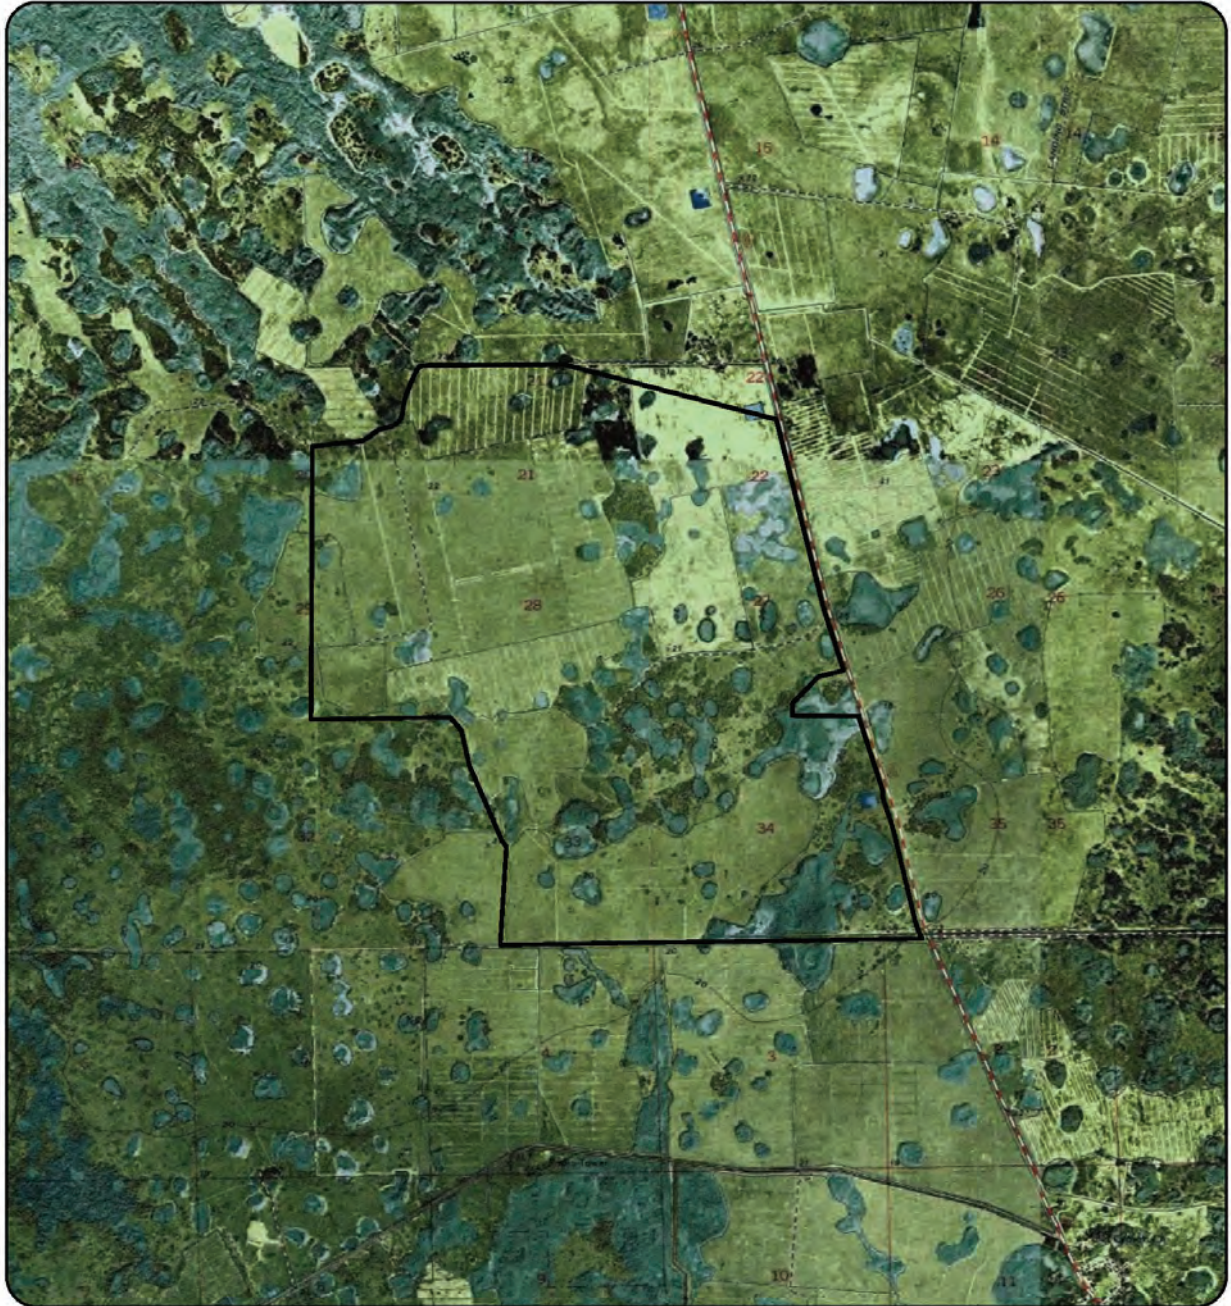

 Sawgrass Solar Energy Center


Sawgrass Solar Energy Center
USGS Topography Map



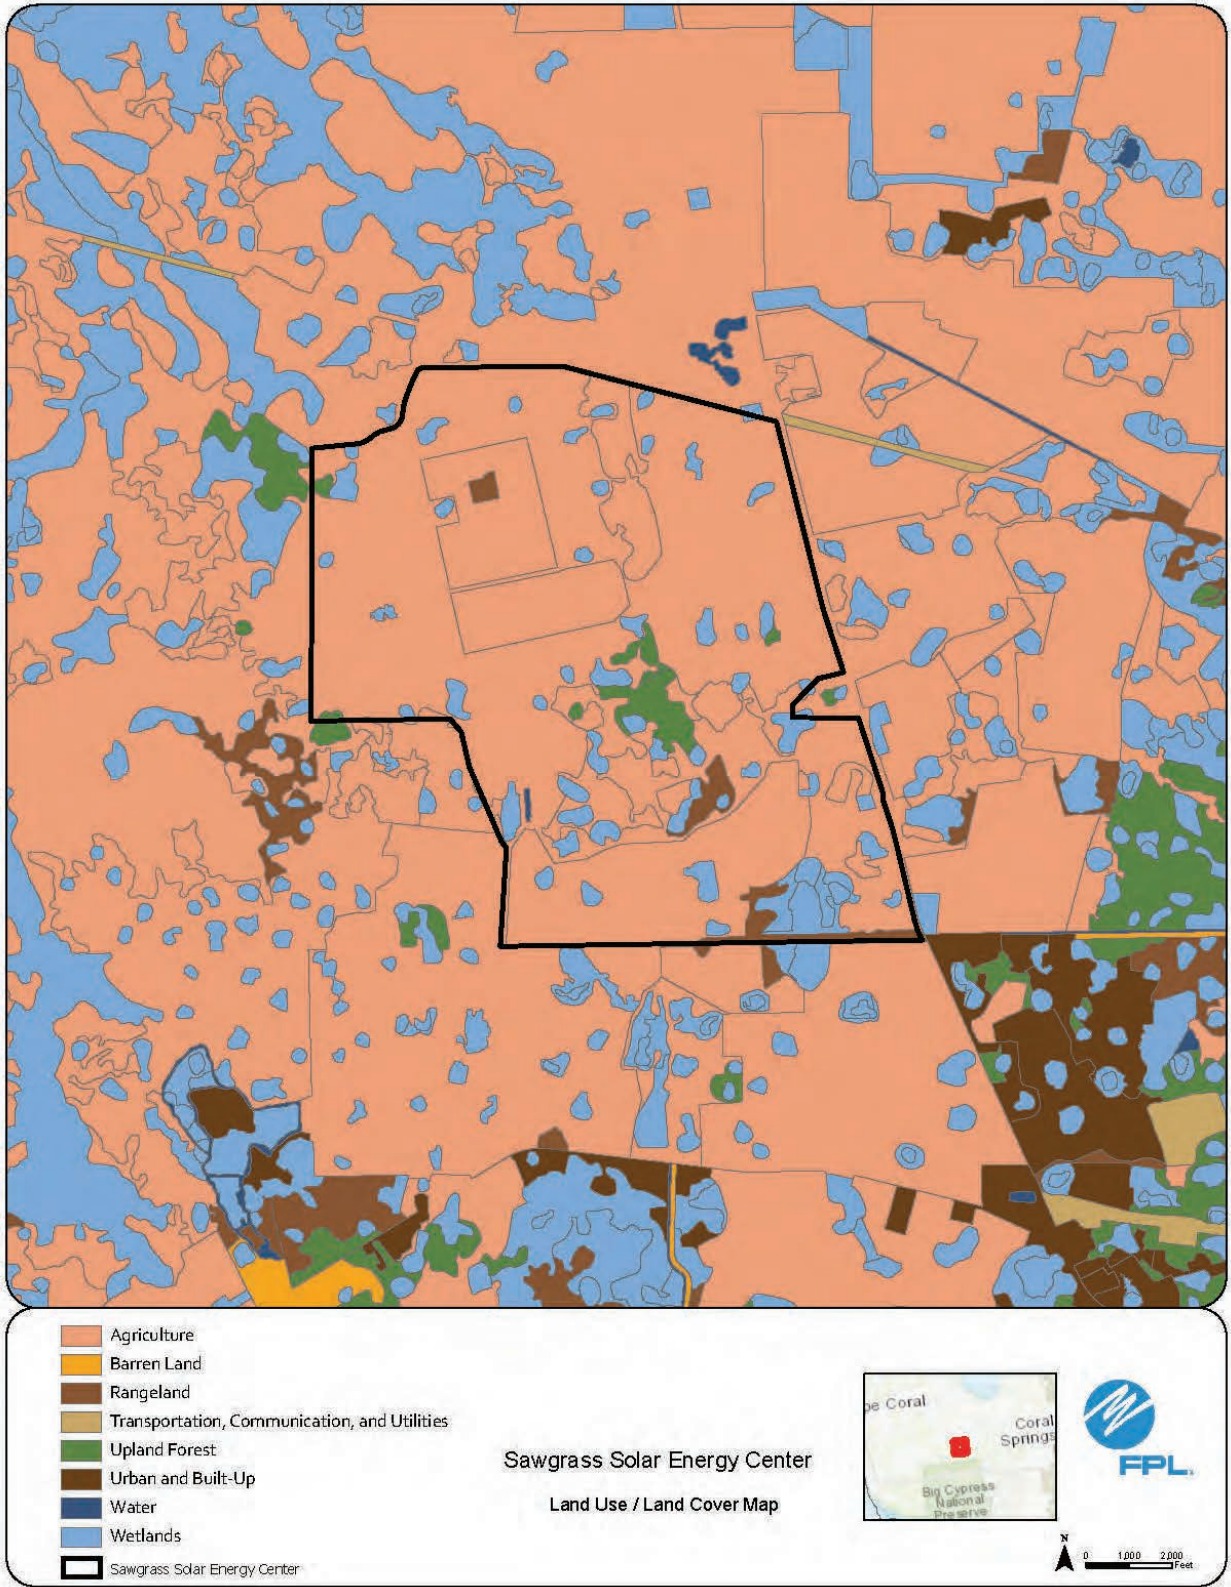

***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 5: Sundew Solar Energy Center,
St. Lucie County***

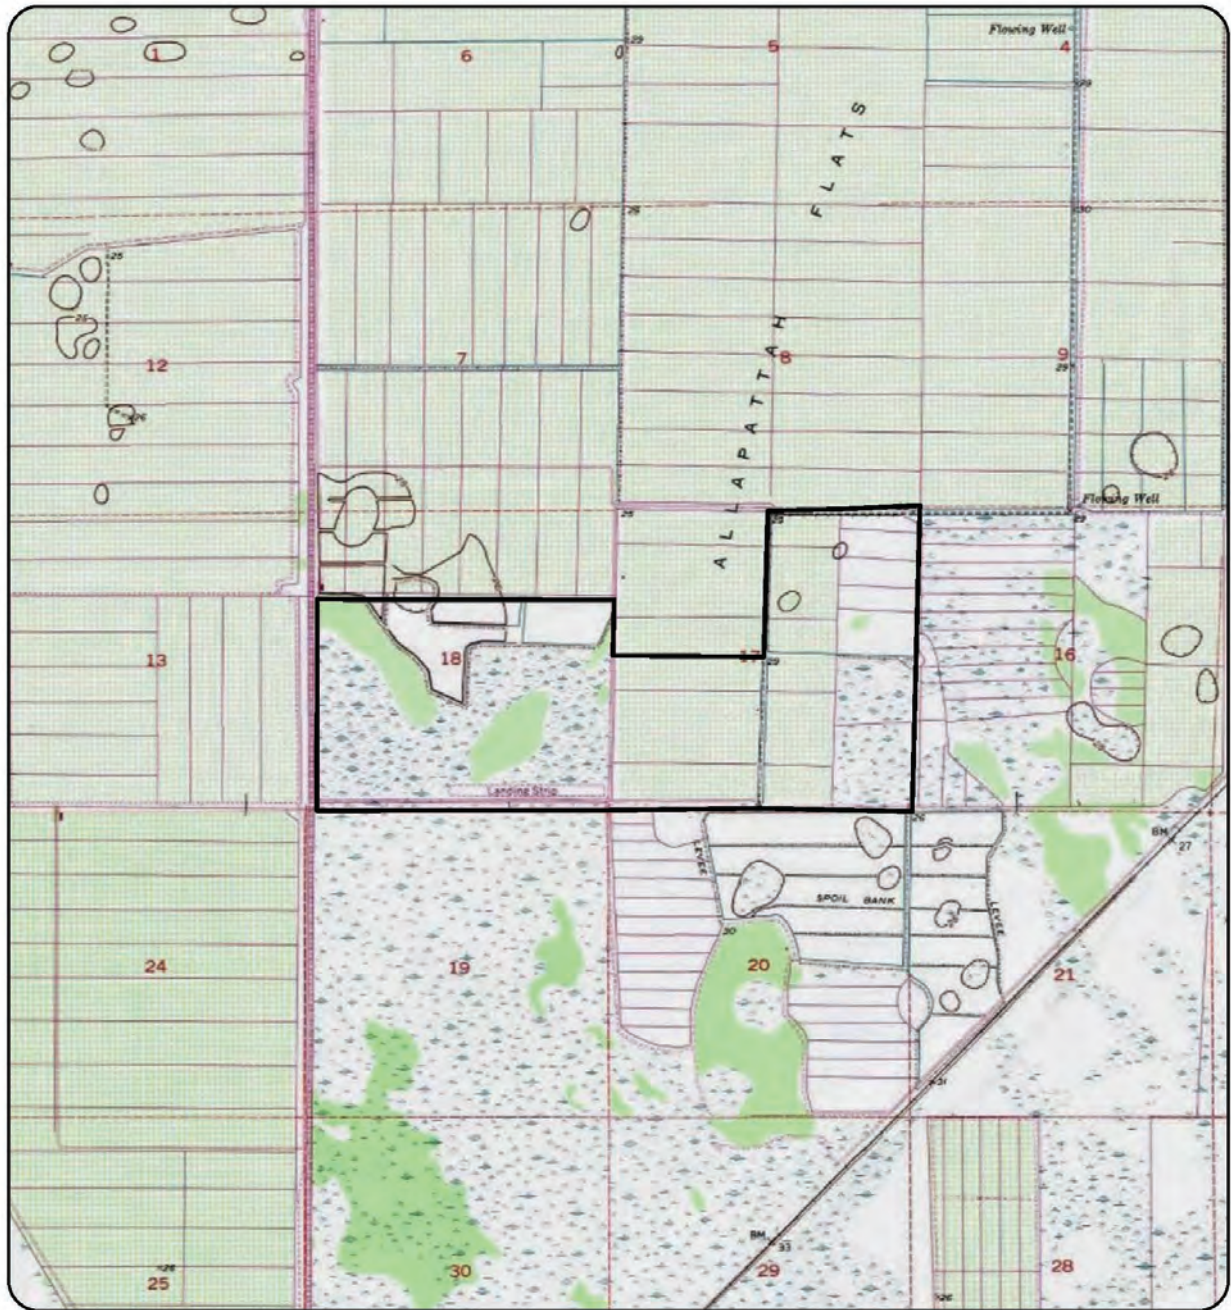

 Sundew Solar Energy Center



Sundew Solar Energy Center
USGS Topography Map



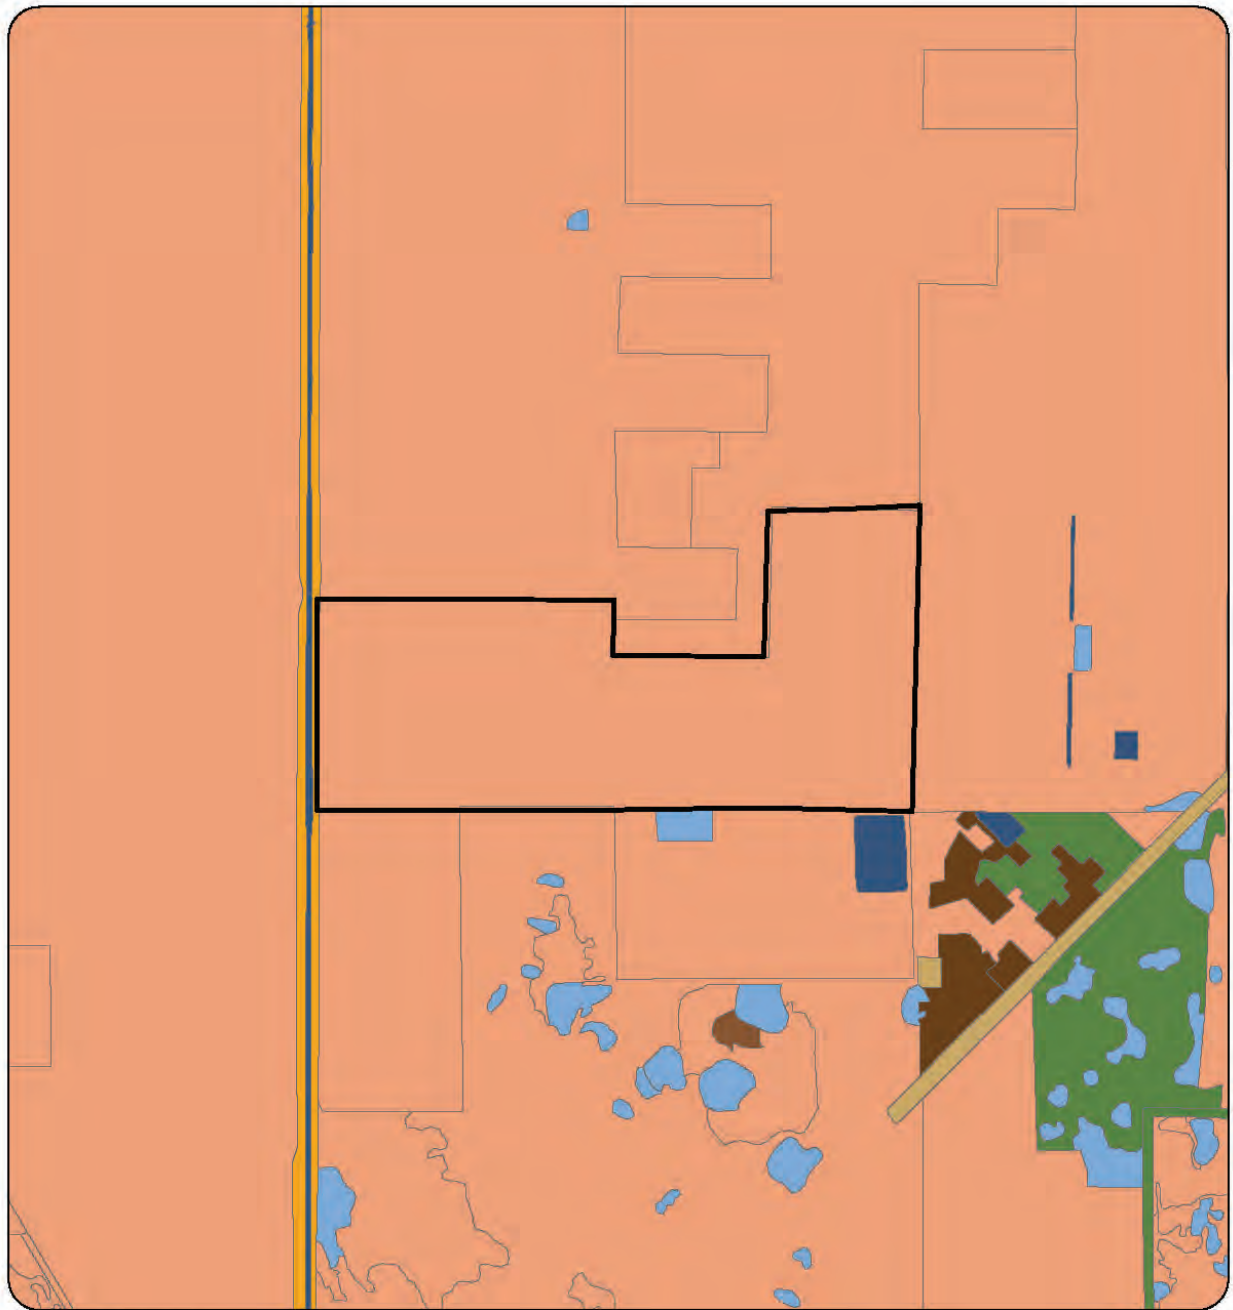


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Sundew Solar Energy Center

Sundew Solar Energy Center
Land Use / Land Cover Map



***Environmental and Land Use Information:
Supplemental Information***


***FPL Area Potential Site # 6: White Tail Solar Energy Center,
Martin County***

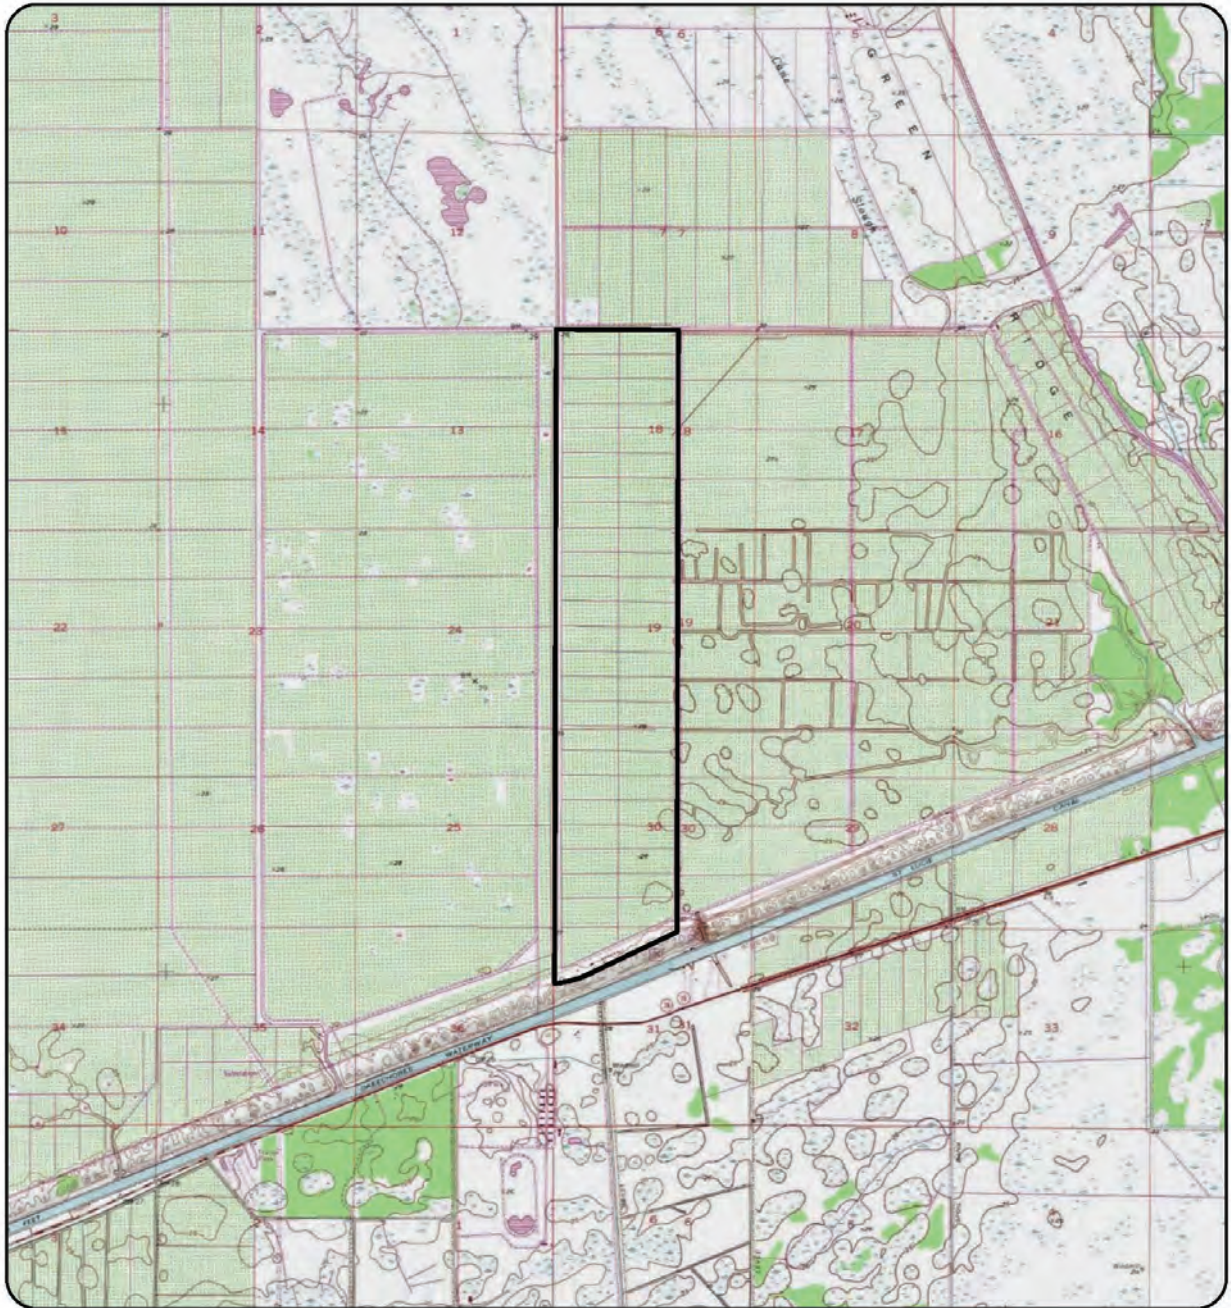

 White Tail Solar Energy Center


White Tail Solar Energy Center
USGS Topography Map



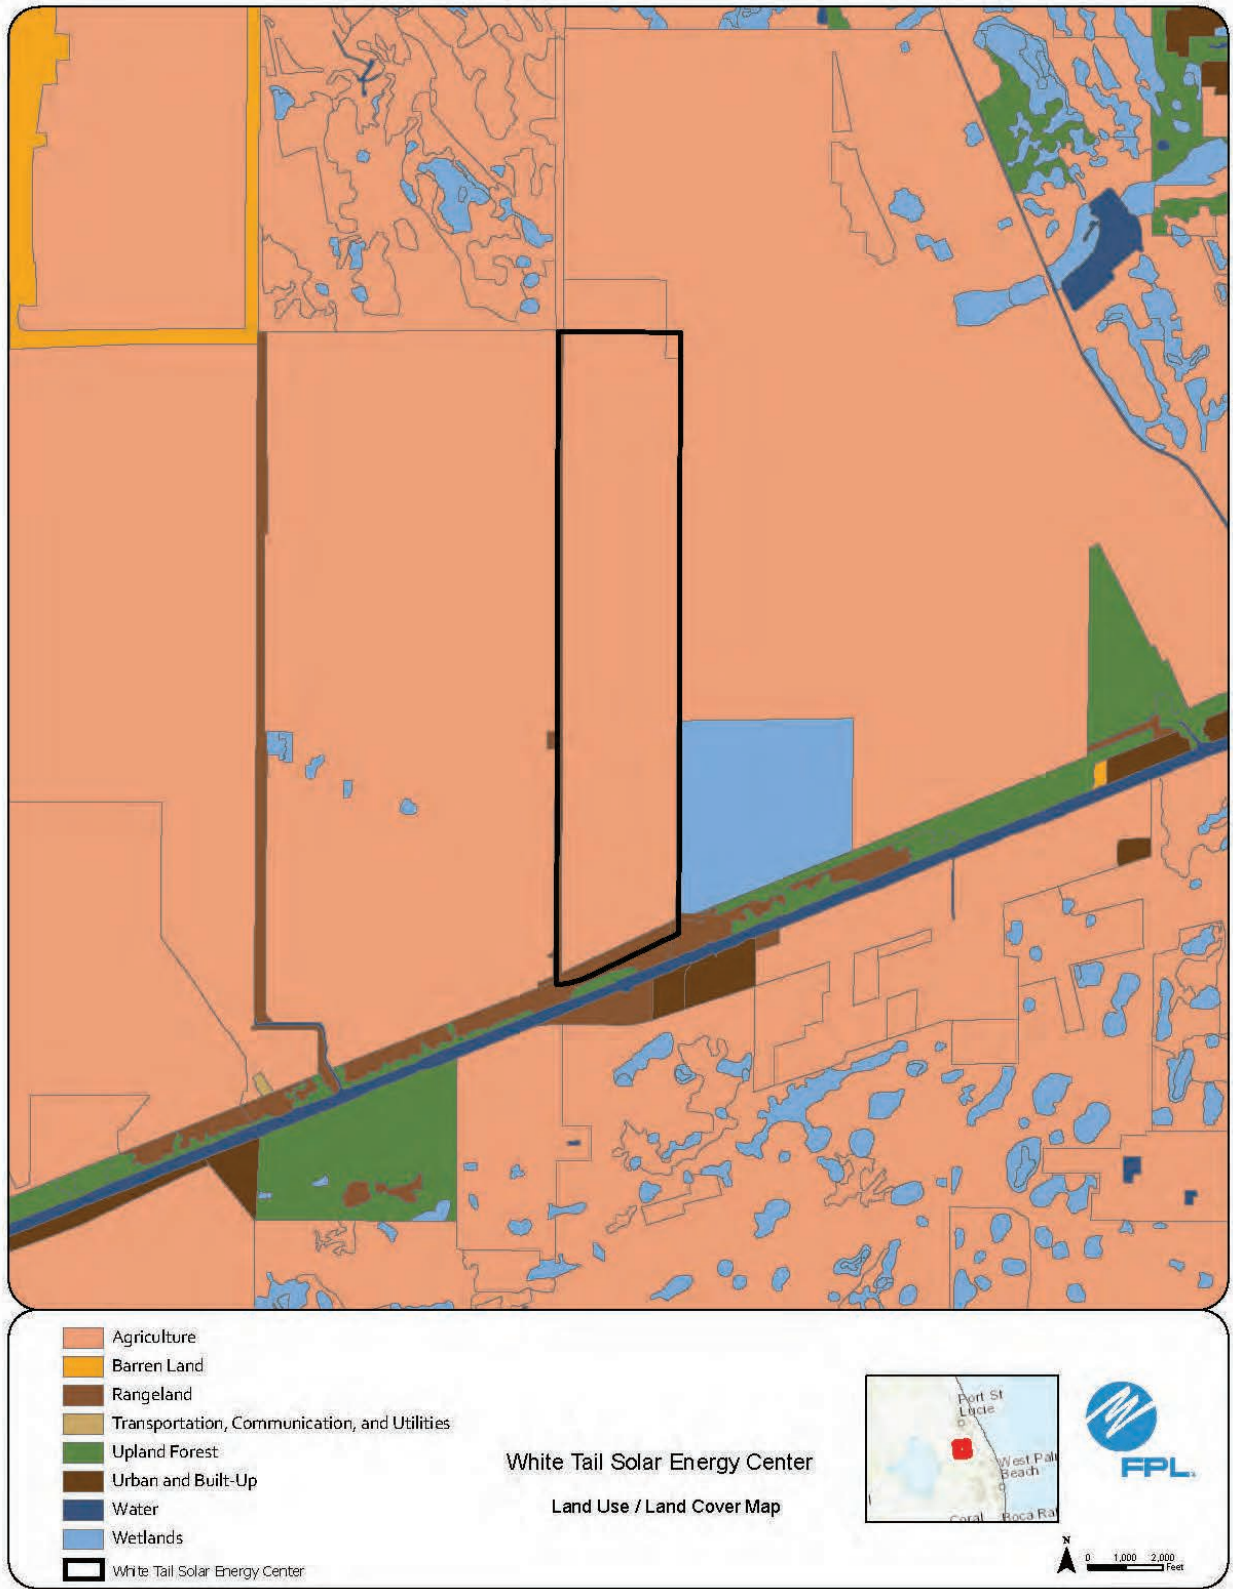



***Environmental and Land Use Information:
Supplemental Information***

Gulf Area Potential Sites # 1 & 2: Calhoun County

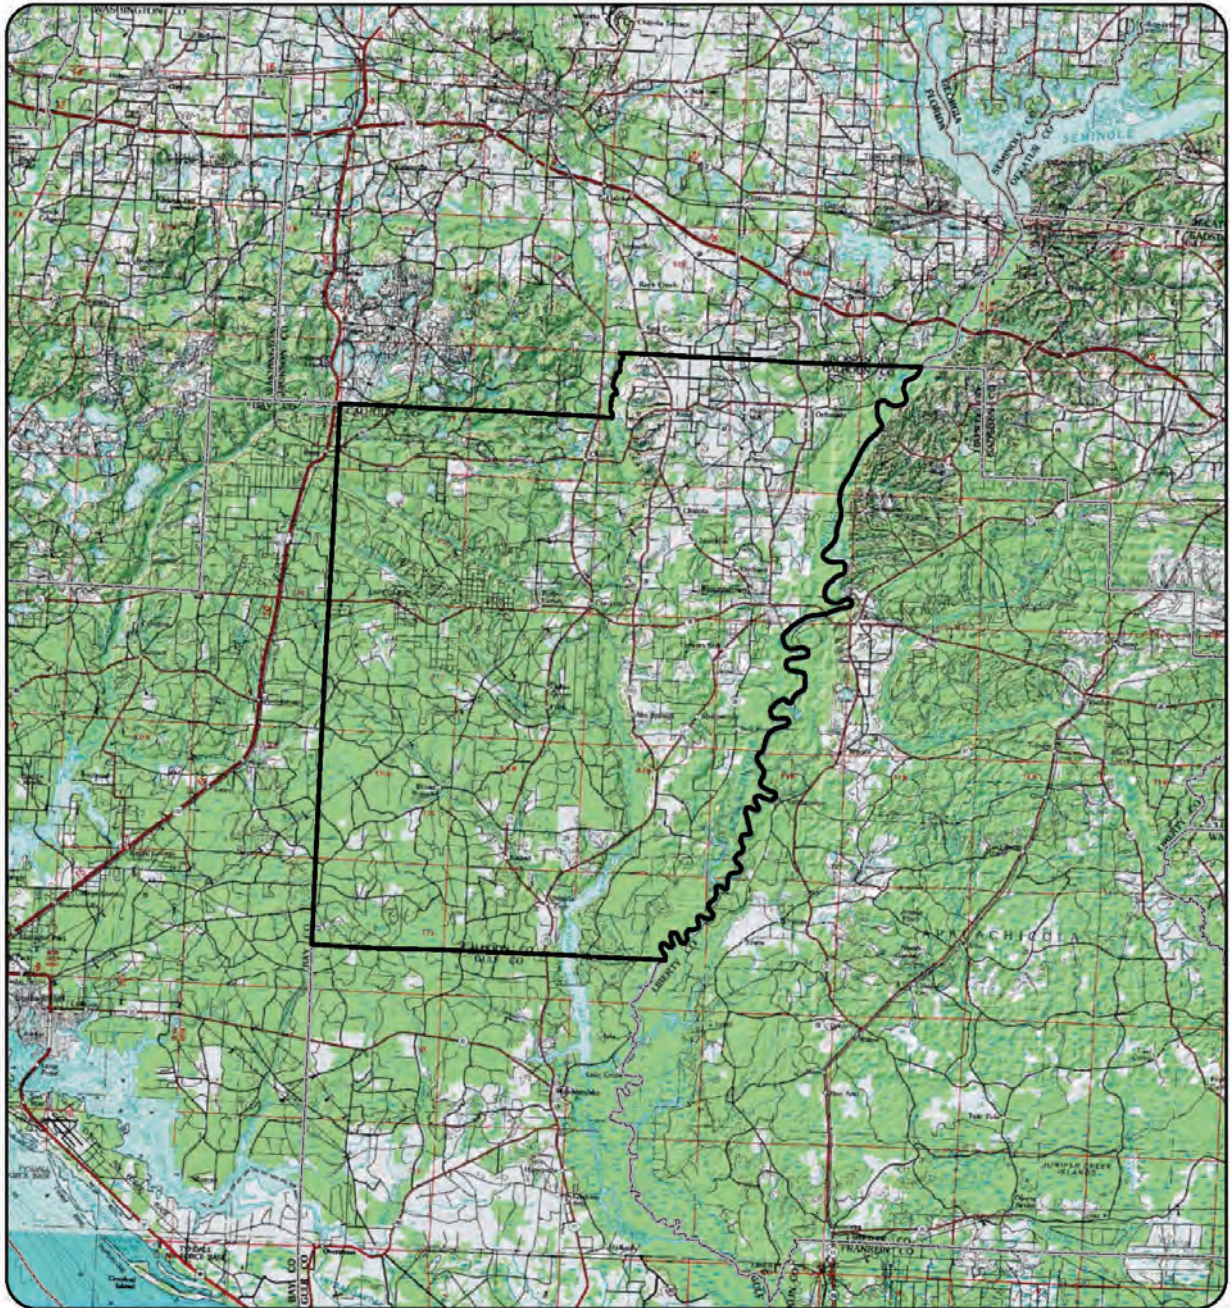

 Calhoun County Project

Calhoun County Project
USGS Topography Map






- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Calhoun County Project

Calhoun County Project
Land Use / Land Cover Map




***Environmental and Land Use Information:
Supplemental Information***


Gulf Area Potential Site # 3: Escambia County

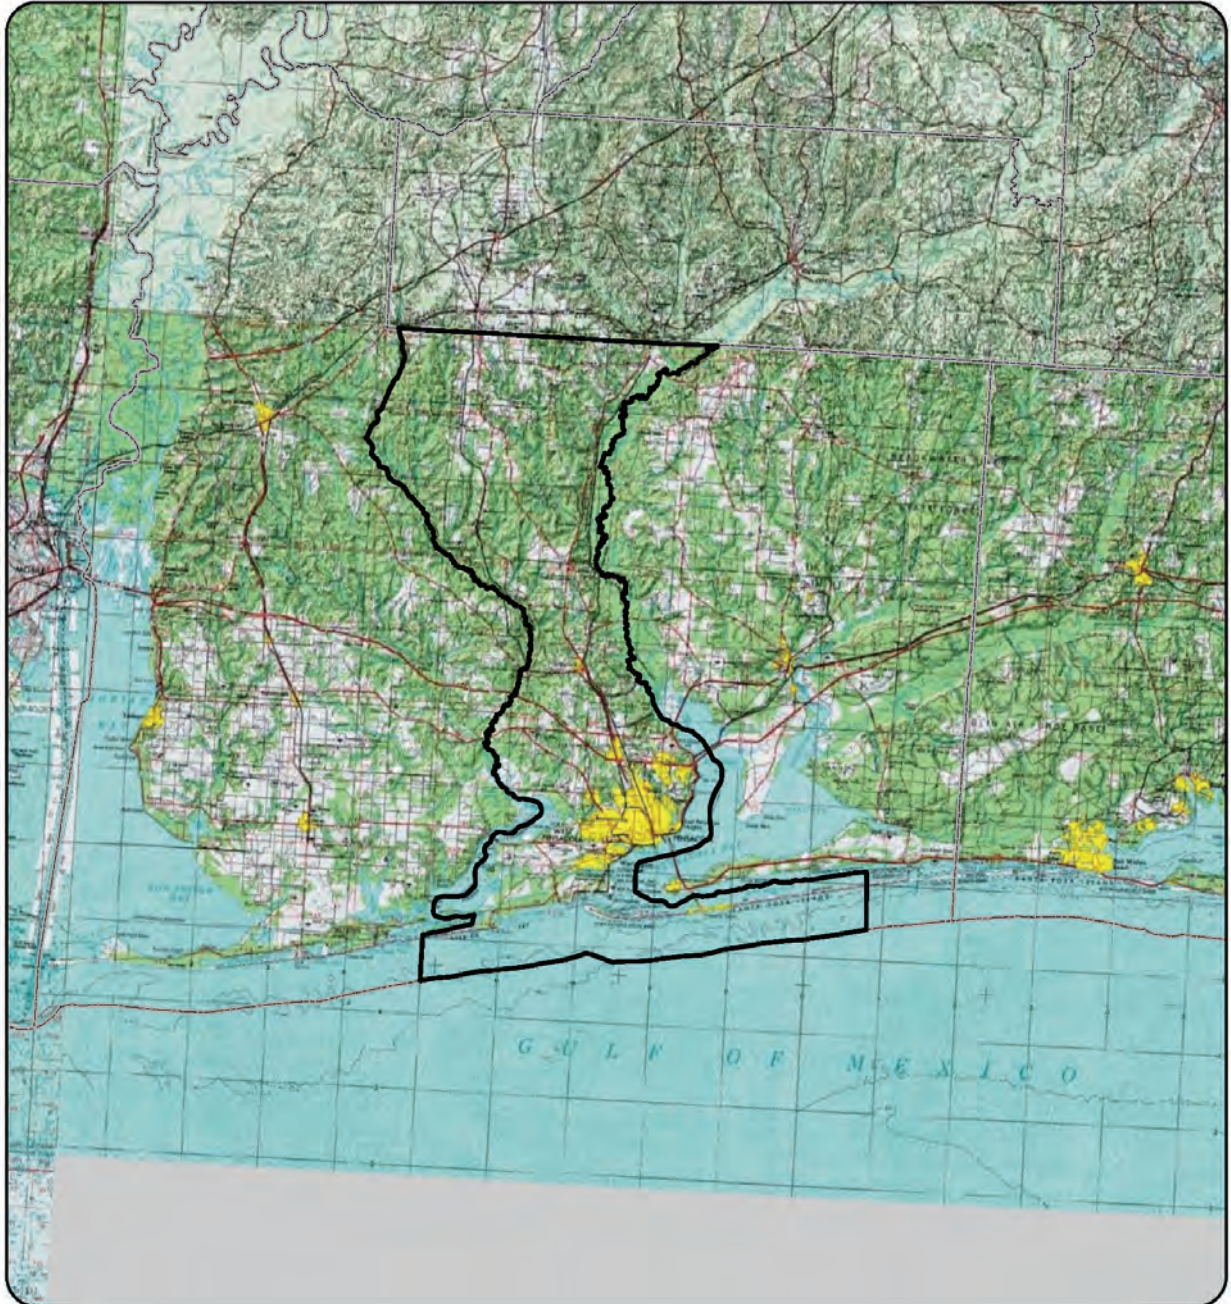

 Escambia County Project

Escambia County Project
USGS Topography Map



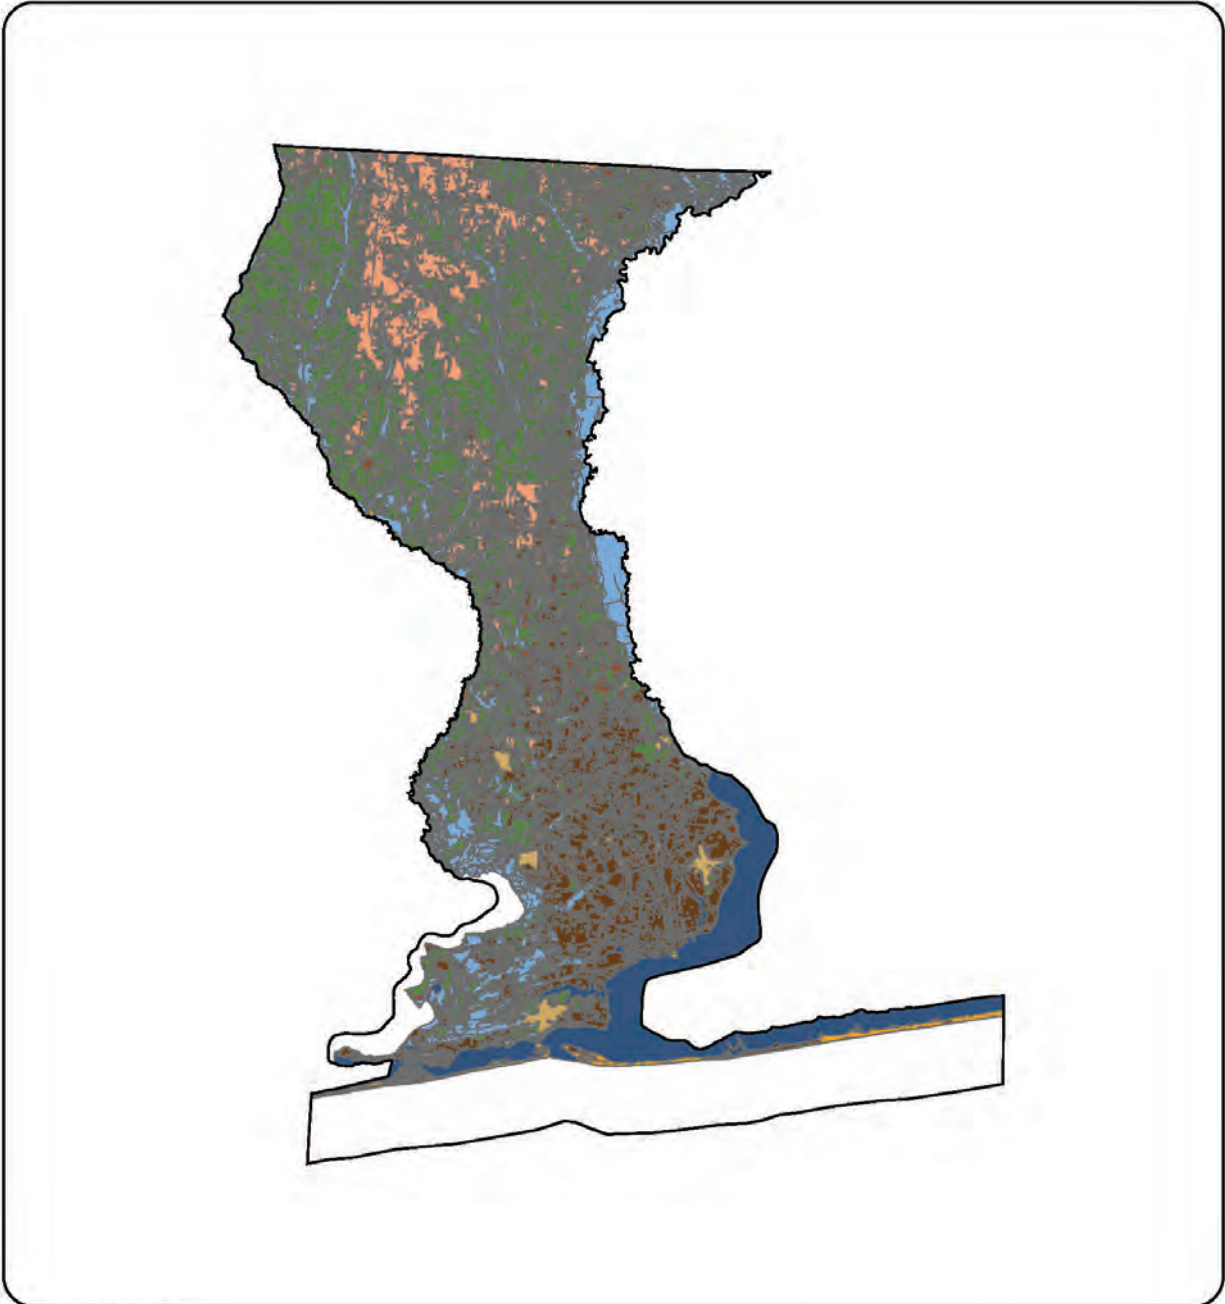


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Escambia County Project

Escambia County Project
Land Use / Land Cover Map




***Environmental and Land Use Information:
Supplemental Information***


Gulf Area Potential Site # 4: Gadsden County

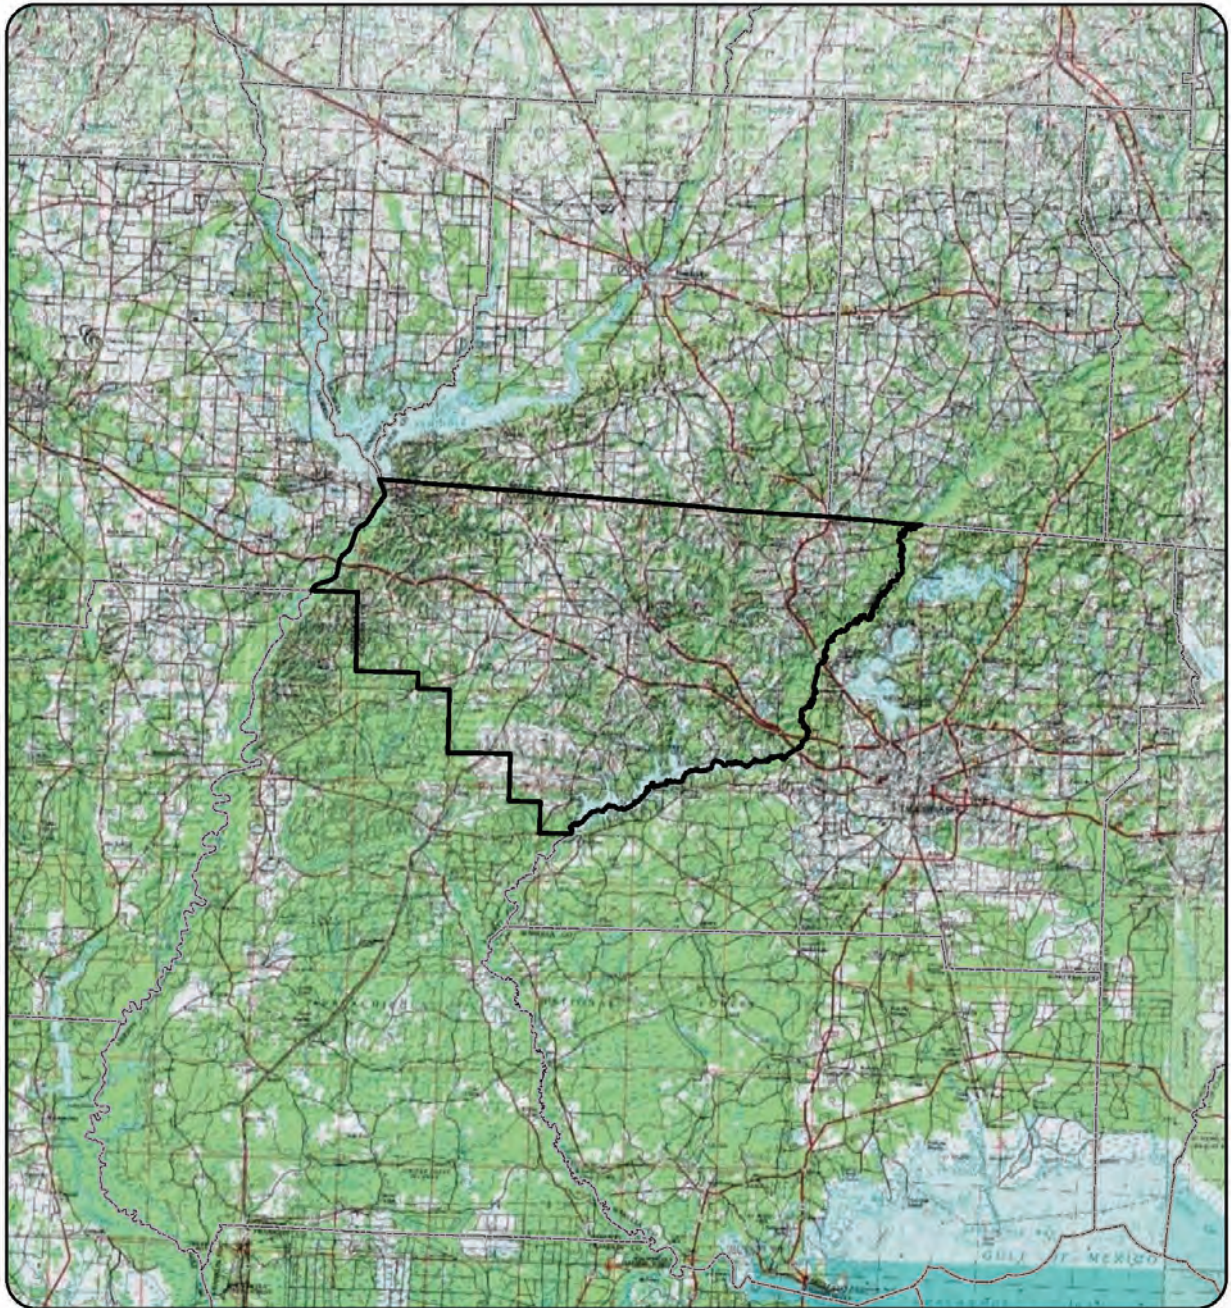

 Gadsden County Project

Gadsden County Project
USGS Topography Map



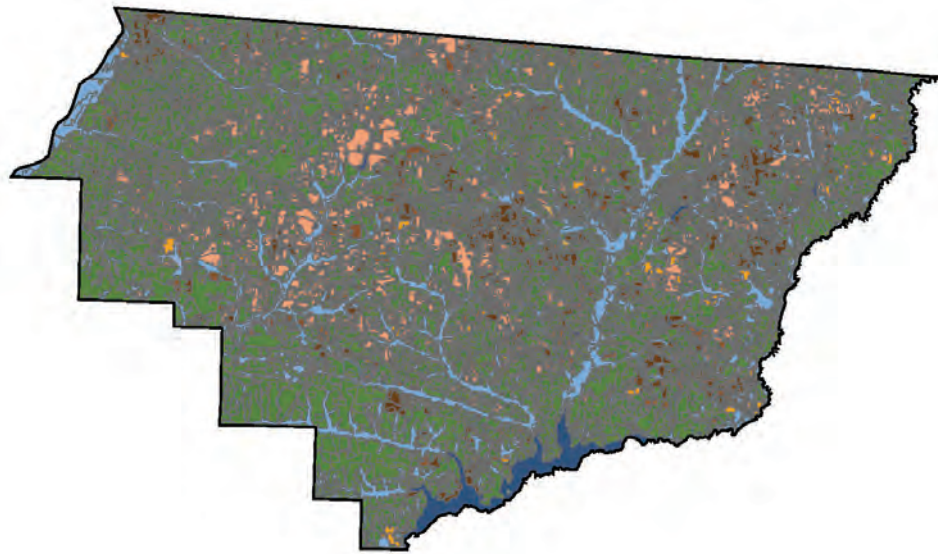


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Gadsden County Project

Gadsden County Project
Land Use / Land Cover Map




***Environmental and Land Use Information:
Supplemental Information***


Gulf Area Potential Site # 5: Jackson County

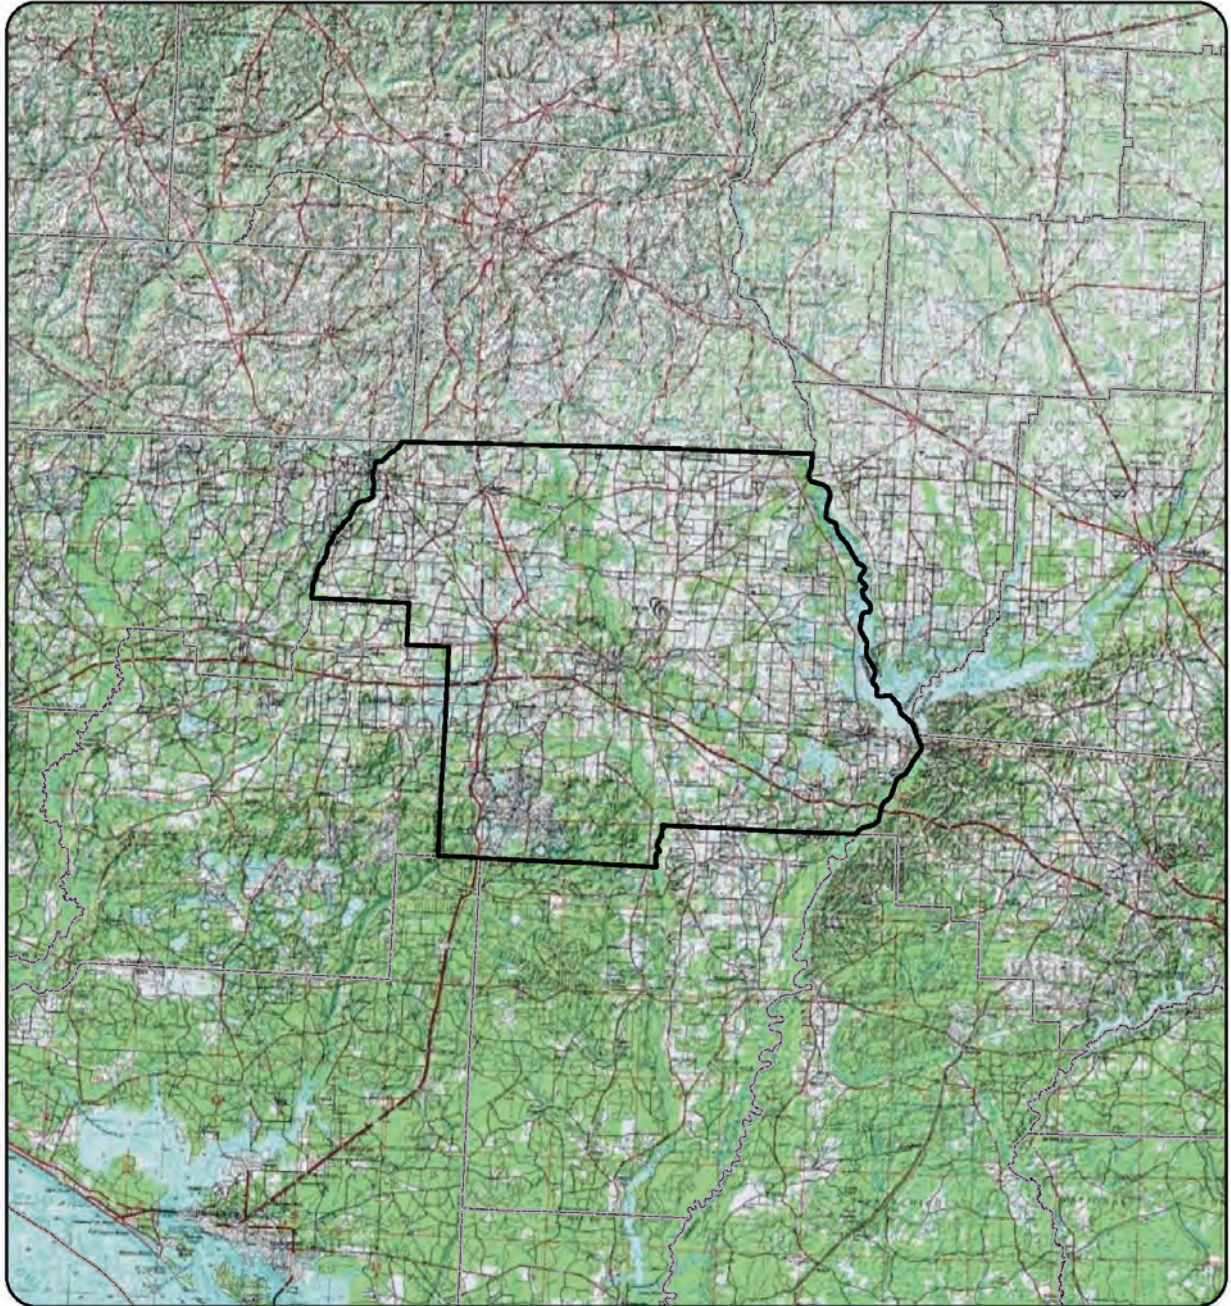

 Jackson County Project

Jackson County Project
USGS Topography Map



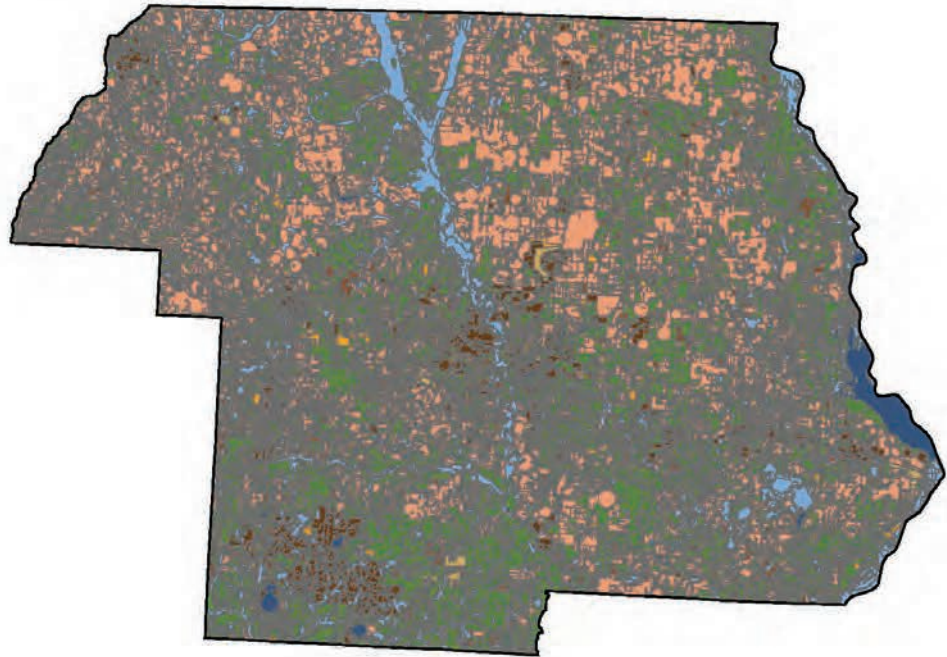


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Jackson County Project

Jackson County Project
Land Use / Land Cover Map



***Environmental and Land Use Information:
Supplemental Information***


Gulf Area Potential Site # 6: Okaloosa County

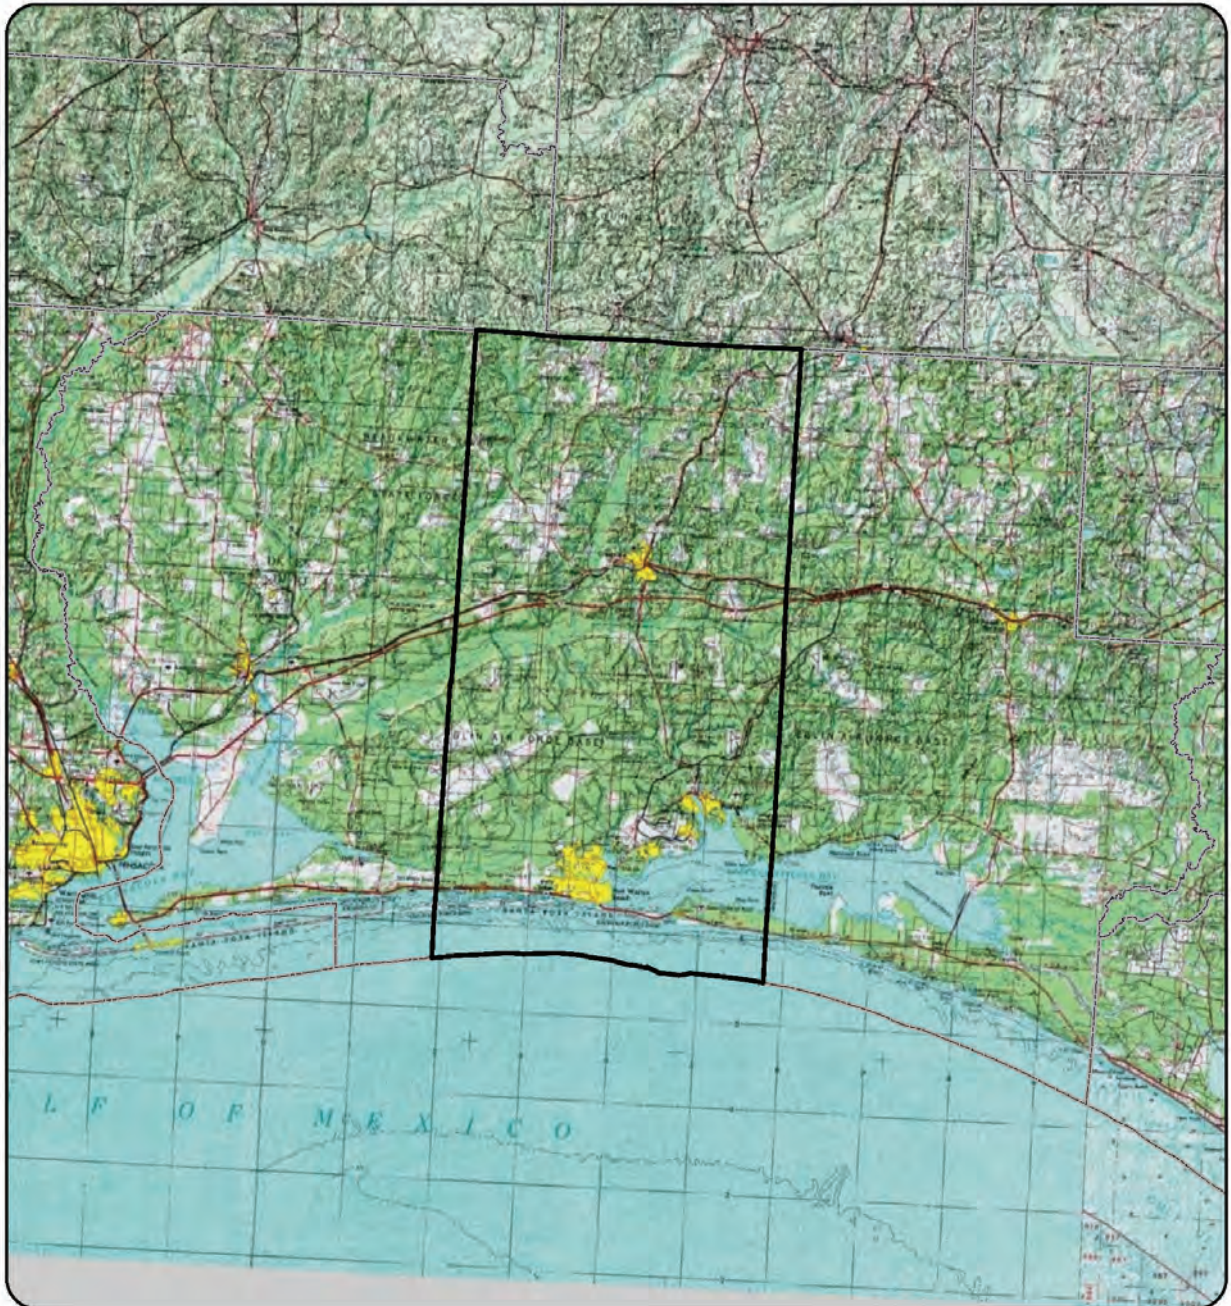

 Okaloosa County Project

Okaloosa County Project
USGS Topography Map



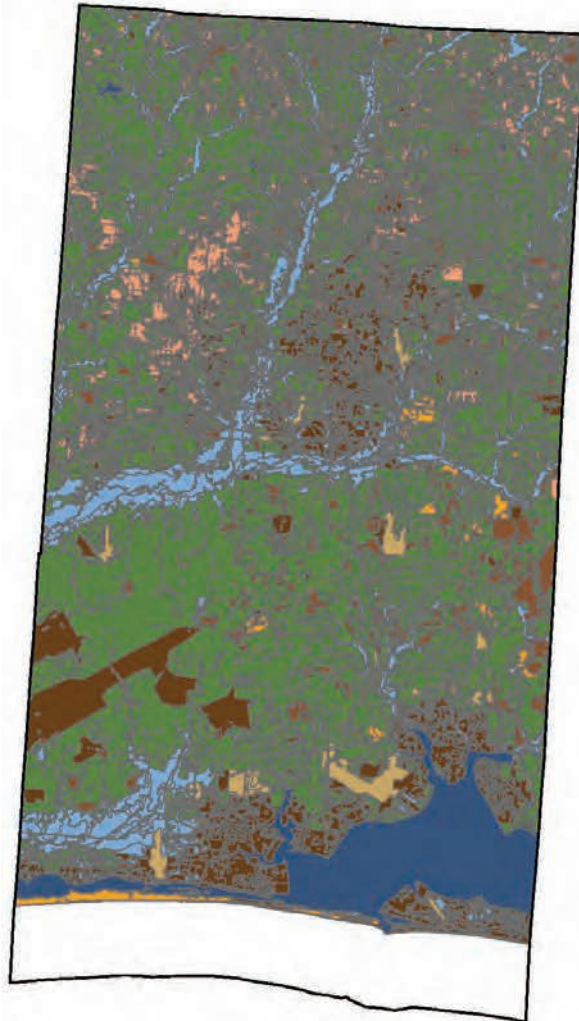


- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Okaloosa County Project


Okaloosa County Project
Land Use / Land Cover Map




***Environmental and Land Use Information:
Supplemental Information***

Gulf Area Potential Site # 7: Santa Rosa County

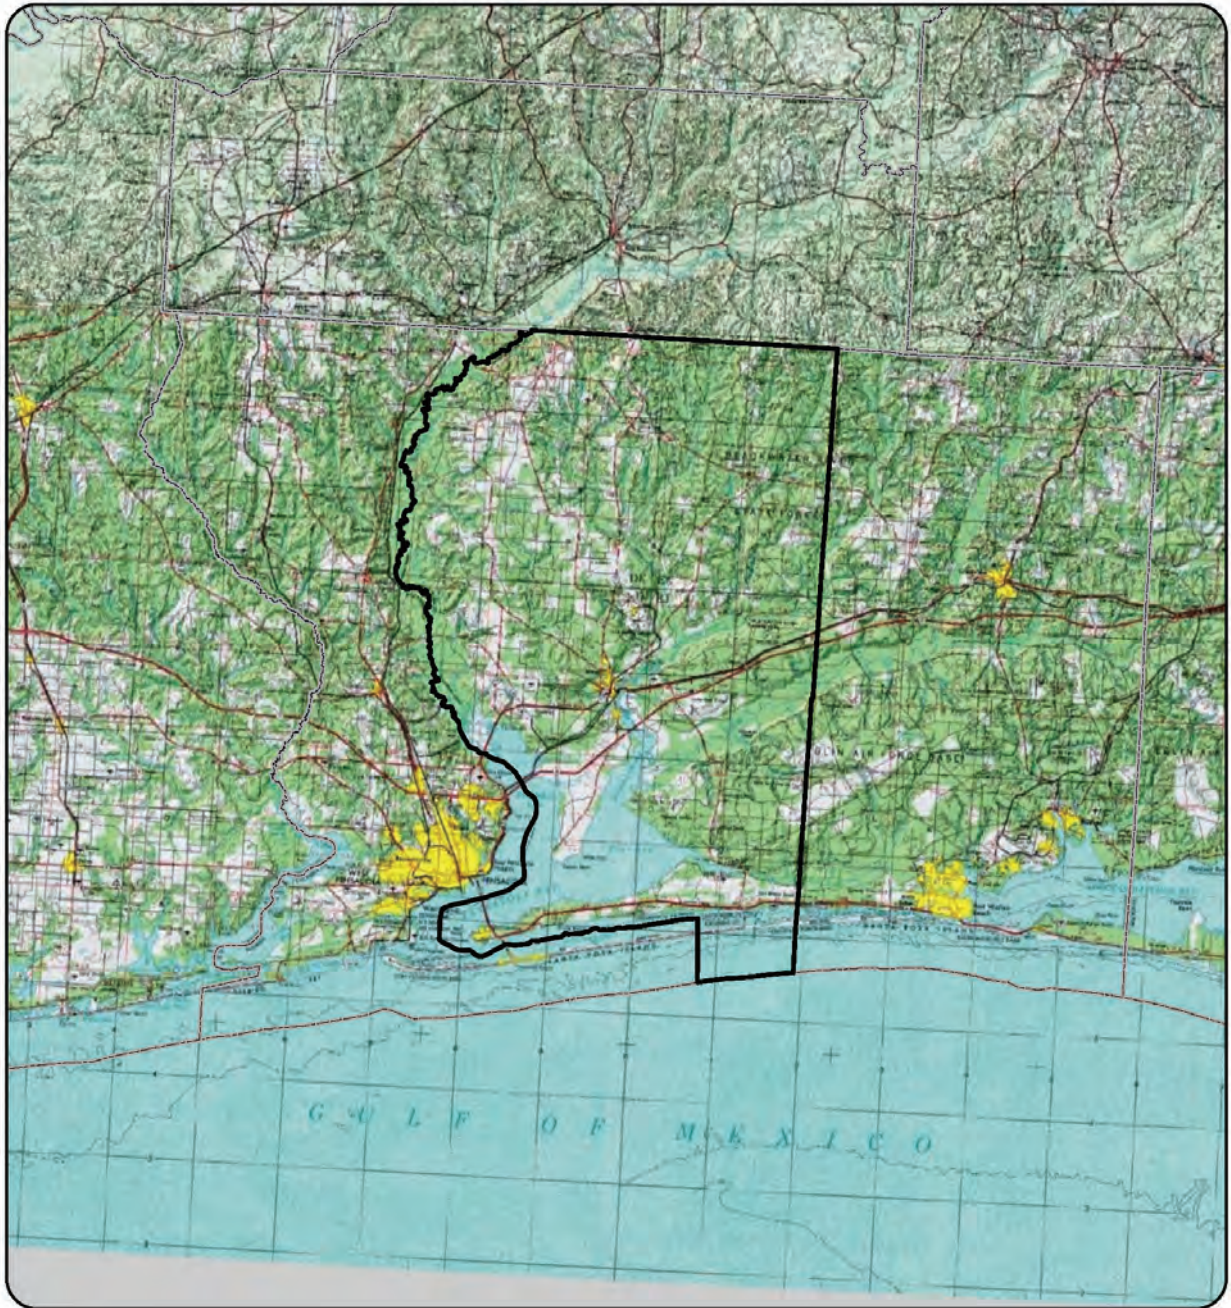

 Santa Rosa County Project

Santa Rosa County Project
USGS Topography Map





- Agriculture
- Barren Land
- Rangeland
- Transportation, Communication, and Utilities
- Upland Forest
- Urban and Built-Up
- Water
- Wetlands
- Santa Rosa County Project

Santa Rosa County Project
Land Use / Land Cover Map



CHAPTER V

Other Planning Assumptions & Information

(This page is left intentionally blank.)

Introduction

The Florida Public Service Commission (FPSC), in Docket No. 960111-EU, specified certain information to be included in an electric utility's Ten Year Power Plant Site Plan filing. This specified information includes 12 items listed under a heading entitled "Other Planning Assumptions and Information." These 12 items concern specific aspects of a utility's resource planning work. The FPSC requested a discussion or a description of each of these items.

These 12 items are addressed individually below as separate "Discussion Items".

Discussion Item # 1: Describe how any transmission constraints were modeled and explain the impacts on the plan. Discuss any plans for alleviating any transmission constraints.

FPL and Gulf Power Company's resource planning work considers two types of transmission limitations/constraints: external limitations and internal limitations. External limitations involve FPL's and Gulf's ties to its neighboring electric systems. Internal limitations involve the flow of electricity within the FPL system.

The external limitations are important because they affect the development of assumptions for the amount of external assistance that is available to the FPL and Gulf areas as well as the amount and price of economy energy purchases. Therefore, these external limitations are incorporated both in the reliability analysis and economic analysis aspects of resource planning. The amount of external assistance that is assumed to be available is based on the projected transfer capability to the FPL and Gulf areas from outside entities as well as historical levels of available assistance. In the loss of load probability (LOLP) portion of its reliability analyses, FPL's resource planning group models the amount of external assistance as an additional generator(s) within the system that provides capacity in all but the peak load months. The assumed amount and price of economy energy are based on historical values and projections from production costing models.

Internal transmission limitations are addressed in economic analyses by identifying potential geographic locations for potential new generating units that minimize adverse impacts to the flow of electricity within the system. The internal transmission limitations are also addressed by: 1) developing the direct costs for siting potential new units at different locations, 2) evaluating the cost impacts created by the new unit/unit location combination on the operation of existing generating units in the system, and/or 3) evaluating the costs of transmission and/or generation additions that may be needed to address regional concerns regarding an imbalance between load and generation in a given region. Costs for these site, region, and system factors are developed for use in economic analyses. These factors are also

considered in both system and regional reliability analyses. When analyzing DSM portfolios, such as for a DSM Goals docket, the potential to avoid or defer regional transmission additions that might otherwise be needed is typically analyzed. In addition, transfer limits for capacity and energy that can be imported into the Southeastern Florida region of FPL's area (Miami-Dade and Broward Counties), or transferred between FPL and Gulf once the two systems are interconnected by the planned North Florida Resiliency Connection transmission line project, are also developed, as applicable, for use in reliability analyses and production costing analyses. (The need to maintain a regional balance between generation and transmission in Southeastern Florida, is also discussed in the Executive Summary and in Chapter III.)

Annual transmission planning work determines transmission additions needed to address limitations and maintain/enhance system and regional reliability. Planned transmission facilities to interconnect and integrate generating units in the resource plan, including those transmission facilities that must be certified under the Transmission Line Siting Act, are presented in Chapter III.

Discussion Item # 2: Discuss the extent to which the overall economics of the plan were analyzed. Discuss how the plan is determined to be cost-effective. Discuss any changes in the generation expansion plan as a result of sensitivity tests to the base case load forecast.

FPL's resource planning group typically performs economic analyses of competing resource plans using levelized system average electric rates (*i.e.*, a Rate Impact Measure or RIM approach) as an economic criterion. In addition, for analyses in which DSM levels are not changed and only supply options are analyzed, the equivalent criterion of the cumulative present value of revenue requirements (CPVRR) may also be used.¹⁶

The only load forecast sensitivities analyzed during 2019 and/or early 2020 were developed in early 2019. These included extreme-weather sensitivity forecasts developed to analyze potential near-term operational scenarios and a higher load forecast scenario that was used to examine the projected future need for natural gas for the FPL system. These load forecast sensitivities and scenarios did not result in a change in the resource plan.

Discussion Item # 3: Explain and discuss the assumptions used to derive the base case fuel forecast. Explain the extent to which the utility tested the sensitivity of the base case plan to

¹⁶ FPL's basic approach in its resource planning work is to base decisions on a lowest electric rate basis. However, when DSM levels are considered a "given" in the analysis (*i.e.*, when only new generating options are considered), the lowest electric rate basis approach and the lowest system cumulative present value of revenue requirements (CPVRR) basis approach yield identical results in terms of which resource options are more economic. In such cases, resource options can be evaluated on the simpler-to-calculate (but equivalent) lowest CPVRR basis.

high and low fuel price scenarios. If high and low fuel price sensitivities were performed, explain the changes made to the base case fuel price forecast to generate the sensitivities. If high and low fuel price scenarios were performed as part of the planning process, discuss the resulting changes, if any, in the generation expansion plan under the high and low fuel price scenarios. If high and low fuel price sensitivities were not evaluated, describe how the base case plan is tested for sensitivity to varying fuel prices.

The basic assumptions used to derive fuel price forecasts are discussed in Chapter III of this document. FPL's resource planning group may use a single fuel cost forecast, or multiple fuel cost forecasts (Low, Medium, and High), in its analyses as appropriate.

In cases where multiple fuel cost forecasts are used, a Medium fuel cost forecast is developed first. Then the approach has been to adjust the Medium fuel cost forecast upward (for the High fuel cost forecast) or downward (for the Low fuel cost forecast) by multiplying the annual cost values from the Medium fuel cost forecast by a factor of $(1 + \text{the historical volatility of the 12-month forward price, one year ahead})$ for the High fuel cost forecast, or by a factor of $(1 - \text{the historical volatility of the 12-month forward price, one year ahead})$ for the Low fuel cost forecast.

The resource plan presented in this Site Plan is based on an updated fuel cost forecast developed in January 2020.

Discussion Item # 4: Describe how the sensitivity of the plan was tested with respect to holding the differential between oil/gas and coal constant over the planning horizon.

In its 2019 and early 2020 resource planning work, a forecast scenario in which the differential between oil/gas and coal was held constant was not utilized. This is, in part, because FPL is currently using, and is projected to use, very little oil or coal. In addition, system improvements on the Gulf system are now being made that will result in significantly less coal usage both in the years before integrating the two systems and after that integration has been completed. These trends are shown on Schedules 5, 6.1, and 6.2 in Chapter III.

Discussion Item # 5: Describe how generating unit performance was modeled in the planning process.

The performance of existing generating units both the FPL and Gulf areas are modeled using current projections for scheduled outages, unplanned outages, capacity output ratings, and heat rate information.

Schedule 1 in Chapter I and Schedule 8 in Chapter III present the current and projected capacity output ratings of the existing generating units. The values used for outages and heat rates are generally consistent with the values that have been used in planning studies in recent years for both the FPL and Gulf areas.

In regard to new unit performance, FPL utilized current projections for the capital costs, fixed and variable operating and maintenance costs, capital replacement costs, construction schedules, heat rates, and capacity ratings for all construction options in its resource planning work. A summary of this information for the new capacity options that FPL currently projects to add over the reporting horizon for this document is presented on the Schedule 9 forms in Chapter III.

Discussion Item # 6: Describe and discuss the financial assumptions used in the planning process. Discuss how the sensitivity of the plan was tested with respect to varying financial assumptions.

The financial assumptions used in the 2019 resource planning analyses for FPL's area were: (i) an incremental capital structure of 40.40% debt and 59.60% equity; (ii) a 4.79% cost of debt; (iii) a 10.55% return on equity; and (iv) an after-tax discount rate of 7.73%. For Gulf's area, the values assumed in the vast majority of the resource planning work conducted during 2019 were: (i) an incremental capital structure of 46.50% debt and 53.50% equity; (ii) a 5.09% cost of debt; (iii) a 10.25% return on equity; and (iv) an after-tax discount rate of 7.25%.

The financial assumptions used in the resource planning analyses that led to the resource plan for a fully integrated FPL and Gulf system that is presented in this 2020 Ten Year Site Plan were: an incremental capital structure of 40.40% debt and 59.60% equity; (ii) a 4.10% cost of debt; (iii) a 10.55% return on equity; and (iv) an after-tax discount rate of 7.52%. No other financial assumptions were used in the 2019/early 2020 resource planning work.

Discussion Item # 7: Describe in detail the electric utility's Integrated Resource Planning process. Discuss whether the optimization was based on revenue requirements, rates, or total resource cost.

FPL's integrated resource planning (IRP) process is described in detail in Chapter III of this document.

The standard basis for comparing the economics of competing resource plans in FPL's basic IRP process is the impact of the plans on electricity rate levels, with the objective generally being to minimize the projected levelized system average electric rate (*i.e.*, a Rate Impact Measure or RIM approach). As discussed in response to Discussion Item # 2, both the electricity rate perspective and the cumulative present value of revenue requirement (CPVRR) perspective for the system yield identical results in terms of which resource options are more economical when DSM levels are unchanged between competing resource plans. Therefore, in planning work in which DSM levels were unchanged, FPL's resource planning group utilizes the equivalent, but simpler-to-calculate CPVRR perspective.

Discussion Item # 8: Define and discuss the electric utility's generation and transmission reliability criteria.

FPL's resource planning group uses three system reliability criteria in its resource planning work for both the FPL and Gulf areas that address various resource options including: utility generation, power purchases, and DSM options. One criterion is a minimum 20% Summer and Winter total reserve margin. Another reliability criterion is a maximum of 0.1 days per-year loss-of-load-probability (LOLP). The third criterion is a minimum 10% generation-only reserve margin (GRM). These three reliability criteria are discussed in Chapter III of this document.

In regard to transmission reliability analysis, transmission planning criteria have been adopted that are consistent with those established by the Florida Reliability Coordinating Council (FRCC) and the SERC Reliability Corporation (SERC). The FRCC and SERC have adopted transmission planning criteria that are consistent with the Reliability Standards established by the North American Electric Reliability Corporation (NERC). The *NERC Reliability Standards* are available on the NERC internet site (<http://www.nerc.com/>).

In addition, *Facility Interconnection Requirements* (FIR) documents for both FPL and Gulf systems/areas have been developed. The document for FPL is available on FPL's Open Access Same-time Information System (OASIS) website, <https://www.oatioasis.com/FPL/index.html>, under the "Interconnection Request Information" directory. The document for Gulf is available on Gulf's Open Access Same-time Information System (OASIS) website, <https://www.oasis.oati.com/gulf/index.html>, also under the "Interconnection Request Information" directory. Furthermore, all new transmission facilities within the FPL and Gulf service

territories that are used to meet FPL and Gulf load are planned to comply with Extreme Wind Loading Criteria as implemented in FPL and Gulf Design Guidelines.

FPL and Gulf Power Company’s transmission planning group generally limits planned flows on its transmission facilities to no more than 100% of the applicable thermal rating. There may be isolated cases for which it is acceptable to deviate from the general criteria stated below. There are several factors that could influence these criteria, such as the overall number of potential customers that may be impacted, the probability of an outage actually occurring, transmission system performance, and other factors.

The normal and contingency voltage criteria for FPL stations are provided below:

Normal/Contingency¹⁷

<u>Voltage Level (kV)</u>	<u>Vmin (p.u.)</u>	<u>Vmax (p.u.)</u>
69, 115, 138	0.95/0.95	1.05/1.07
230	0.95/0.95	1.06/1.07
500	0.95/0.95	1.07/1.10
Turkey Point (*)	1.013/1.013	1.06/1.06
St. Lucie (*)	1.00/1.00	1.06/1.06

(*) Voltage range criteria for FPL’s Nuclear Power Plants

In regards to the normal and contingency voltage criteria for Gulf Power Company stations, Gulf adopts the Southern Company Voltage Schedule Procedures as provided in the link below to the Southern Company OASIS document:

- [Voltage Schedule Procedures](#)

¹⁷ Immediately following a contingency, steady-state voltages may deviate from the normal voltage range if there are known automatic or manual operating actions to adjust the voltage to within the contingency voltage range. However, the steady-state voltage must never exceed voltage System Operating Limits (SOLs), which have a lower limit of 0.88pu and a higher limit of 1.10pu for all transmission facilities, excluding nuclear plant switchyards for which the SOLS are equal to the normal/contingency limits.

Discussion Item # 9: Discuss how the electric utility verifies the durability of energy savings for its DSM programs.

FPL and Gulf periodically revise the projected impacts of its DSM programs on demand and energy consumption. Engineering models, calibrated with current field-metered data, are updated at regular intervals. Participation trends are tracked for all of FPL's and Gulf's DSM programs in order to adjust impacts each year for changes in the mix of efficiency measures being installed by program participants. For its load management programs, FPL conducts periodic tests of its load management equipment to ensure it is functioning correctly. These tests, plus actual load management events, also allow FPL to gauge the MW reduction capabilities of its load management programs on an ongoing basis.

Discussion Item # 10: Discuss how strategic concerns are incorporated in the planning process.

The Executive Summary and Chapter III provide a discussion of a variety of system concerns/issues that influence FPL's resource planning process. Please see those chapters for a discussion of those concerns/issues.

In addition to these system concerns/issues, there are other strategic factors that FPL's resource planning group typically considers when choosing among resource options. These include: (1) technology risk; (2) environmental risk, and (3) site feasibility. The consideration of these factors may include both economic and non-economic aspects. Technology risk is an assessment of the relative maturity of competing technologies. For example, a prototype technology that has not achieved general commercial acceptance has a higher risk than a technology in wide use and, therefore, assuming all else is equal, is less desirable.

Environmental risk is an assessment of the relative environmental acceptability of different generating technologies and their associated environmental impacts on the utility system, including projected environmental compliance costs. Technologies regarded as more acceptable from an environmental perspective for a prospective resource plan are those that minimize environmental impacts for the utility system as a whole through highly efficient fuel use, state-of-the-art environmental controls, and generating technologies that do not utilize fossil fuels (such as nuclear and solar).

Site feasibility assesses a wide range of economic, regulatory, and environmental factors related to successfully developing and operating the specified technology at the site in question. Projects that are more acceptable have sites with fewer barriers to successful development.

All of these factors play a part in resource planning and decision-making, including decisions to construct capacity or purchase power.

Discussion Item # 11: Describe the procurement process the electric utility intends to utilize to acquire the additional supply-side resources identified in the electric utility's ten-year site plan.

As shown in this 2020 Site Plan, the current resource plan reflects the following major supply-side or generation resource additions in FPL's area: combustion turbine (CT) component upgrades at various existing CCs, addition of new PV facilities, addition of new battery storage facilities, and addition of new CC capacity from the Dania Beach Energy Center Unit 7 through the modernization of FPL's existing Lauderdale plant site. The current resource plan also reflects the following major supply-side or generation resource additions and/or changes in Gulf's area: CT component upgrades at the existing CC, addition of new PV facilities, conversion of coal-fueled generation to gas-fueled generation, the addition of CT generation, and the addition of new battery storage facilities.

CT upgrades are planned to take place at various CC units throughout the FPL and Gulf areas. The original equipment manufacturer (OEM) of the CTs approached FPL and Gulf regarding the possibility of upgrading these units. Following negotiations with the OEM and economic analyses that showed upgrading was cost-effective for customers, FPL and Gulf decided to proceed with the CT upgrades and the supporting balance of plant modifications.

For new solar facilities for both FPL's and Gulf's areas, the selection of equipment and installation contractors has been, and will continue to be, done via competitive bidding. FPL's Engineering & Construction (E&C) group seek bids from multiple suppliers for major components such as PV panels, inverters, and step-up transformers. Where possible, this group aggregates and executes component purchases as a portfolio to achieve cost synergies. However, this must be balanced against rapid technology changes and potential future cost reductions. Therefore, any bundling of purchases over the planned construction horizon is strategically managed. The remaining balance-of-system (BOS) purchases, such as racking and cabling, as well as engineering and construction services, are typically bid out to a number of contractors to determine the best value.

The selection of equipment and installation contractors for the projected battery storage facilities is expected to be done in a manner similar to that described above for the projected solar facilities.

The modernization project at FPL's existing Lauderdale site received an FPSC waiver from the Bid Rule due to attributes specific to modernization projects (such as the ability to use existing gas and/or transmission infrastructure, ability to use land at an existing plant site, no incremental water

requirements, etc.). In addition to these attributes, the Lauderdale modernization project, which will result in the addition of a new combined cycle unit (FPL Dania Beach Clean Energy Center Unit 7) is also projected to result in significant economic benefits for FPL's customers. Additionally, the new unit is projected to lower natural gas usage in the FPL system, and lower system emissions of SO₂, NO_x, and CO₂ compared to continuing to operate the existing Lauderdale generating units. The waiver from the Bid Rule was granted in Consummating Order No. PSC-2017-0431-CO-EI. On March 19, 2018, the FPSC issued a final order granting an affirmative need determination for the planned new Dania Beach Unit 7 (Order No. PSC-2018-0150-FOF-EI). FPL utilized a competitive bidding process to select equipment suppliers and installation contractors based on its assessment of price and supplier capability to realize the best generation option for its customers.

The new CTs projected in the current resource plan for Gulf's area by late 2021 will be procured via competitive bidding.

Discussion Item # 12: Provide the transmission construction and upgrade plans for electric utility system lines that must be certified under the Transmission Line Siting Act (403.52 – 403.536, F. S.) during the planning horizon. Also, provide the rationale for any new or upgraded line.

In the current resource plan, there are no new transmission lines planned in the Gulf area that require certification under the Transmission Line Siting Act.

Although not projected to be added in the planning horizon (2020 through 2029) addressed by this document, FPL has a transmission line project planned for 2030 or later that will utilize the remaining portion of the Levee-Midway corridor to bring a second 500 kV line to feed Conservation substation in Broward County, Florida (as is shown on Table III.E.1 in Chapter III).

(This page is intentionally left blank.)