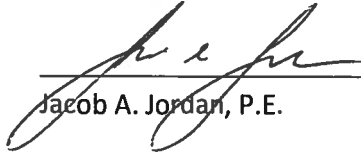


<b>257.83 (b)(2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant Crist - Gypsum Storage Area		
	<b>OWNER/OPERATOR OF FACILITY:</b> Gulf Power		
	<b>INSPECTION DATE:</b> November 8, 2016		
	<b>INSPECTING ENGINEER:</b> Jacob A. Jordan, P.E. (FL PE# 80903 )		
	Based on the results of my inspection and review of the data provided, it is my professional opinion that the report has been completed in accordance with 40 CFR 257.83(b).		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	(IF YES, DESCRIBE):		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>NO INSTRUMENTATION</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>N/A</b>	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION*</b>		
	MIN. DEPTH: 0 ft	MAX. DEPTH: 7 ft	PRESENT DEPTH: 7 ft
	MIN. ELEVATION: 36.31	MAX. ELEVATION: 38.31	PRESENT ELEVATION: 38.31 ft.
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.*</b>		
	MIN. DEPTH: 0 ft	MAX. DEPTH: 11.0 ft	PRESENT DEPTH: 9.0 ft
	MIN. ELEVATION: 28.3 ft	MAX. ELEVATION: 39.3 ft	PRESENT ELEVATION: 28.3 ft.
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION.*</b>	<b>347,305 yd<sup>3</sup></b>	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION*</b>	<b>WATER:</b> 36,445 yd <sup>3</sup>	<b>CCR:</b> 196,019 yd <sup>3</sup>
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	(IF YES, DESCRIBE):		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
	(IF YES, DESCRIBE):		

\* Depths, elevations and cubic yard volumes are estimates derived by qualified personnel from available information. Elevation data provided for the 2015 annual inspection were reported in a datum referenced to an arbitrary benchmark at Plant Crist (plant elevation). The elevations reported in this report reference feet above Mean Sea Level (MSL).

Based on the results of my inspection and review of the data provided, it is my professional opinion that the report has been completed in accordance with 40 CFR 257.83(b).

  
\_\_\_\_\_  
Jacob A. Jordan, P.E.

1/12/17  
Date

